

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926159

Luminaire Tested: DFN2DIP-TR2F0-050D050US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926159
REPORT IS A COMBINATION OF REPORTS P901778 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-050D050US950-RLLONL
Description: 2 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8276.0 lumens
Efficiency: N/A
Efficacy: 96.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 86
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926159

CATALOG NUMBER: DFN2DIP-TR2F0-050D050US950-RLLONL

Luminous Intensity Polar Plot

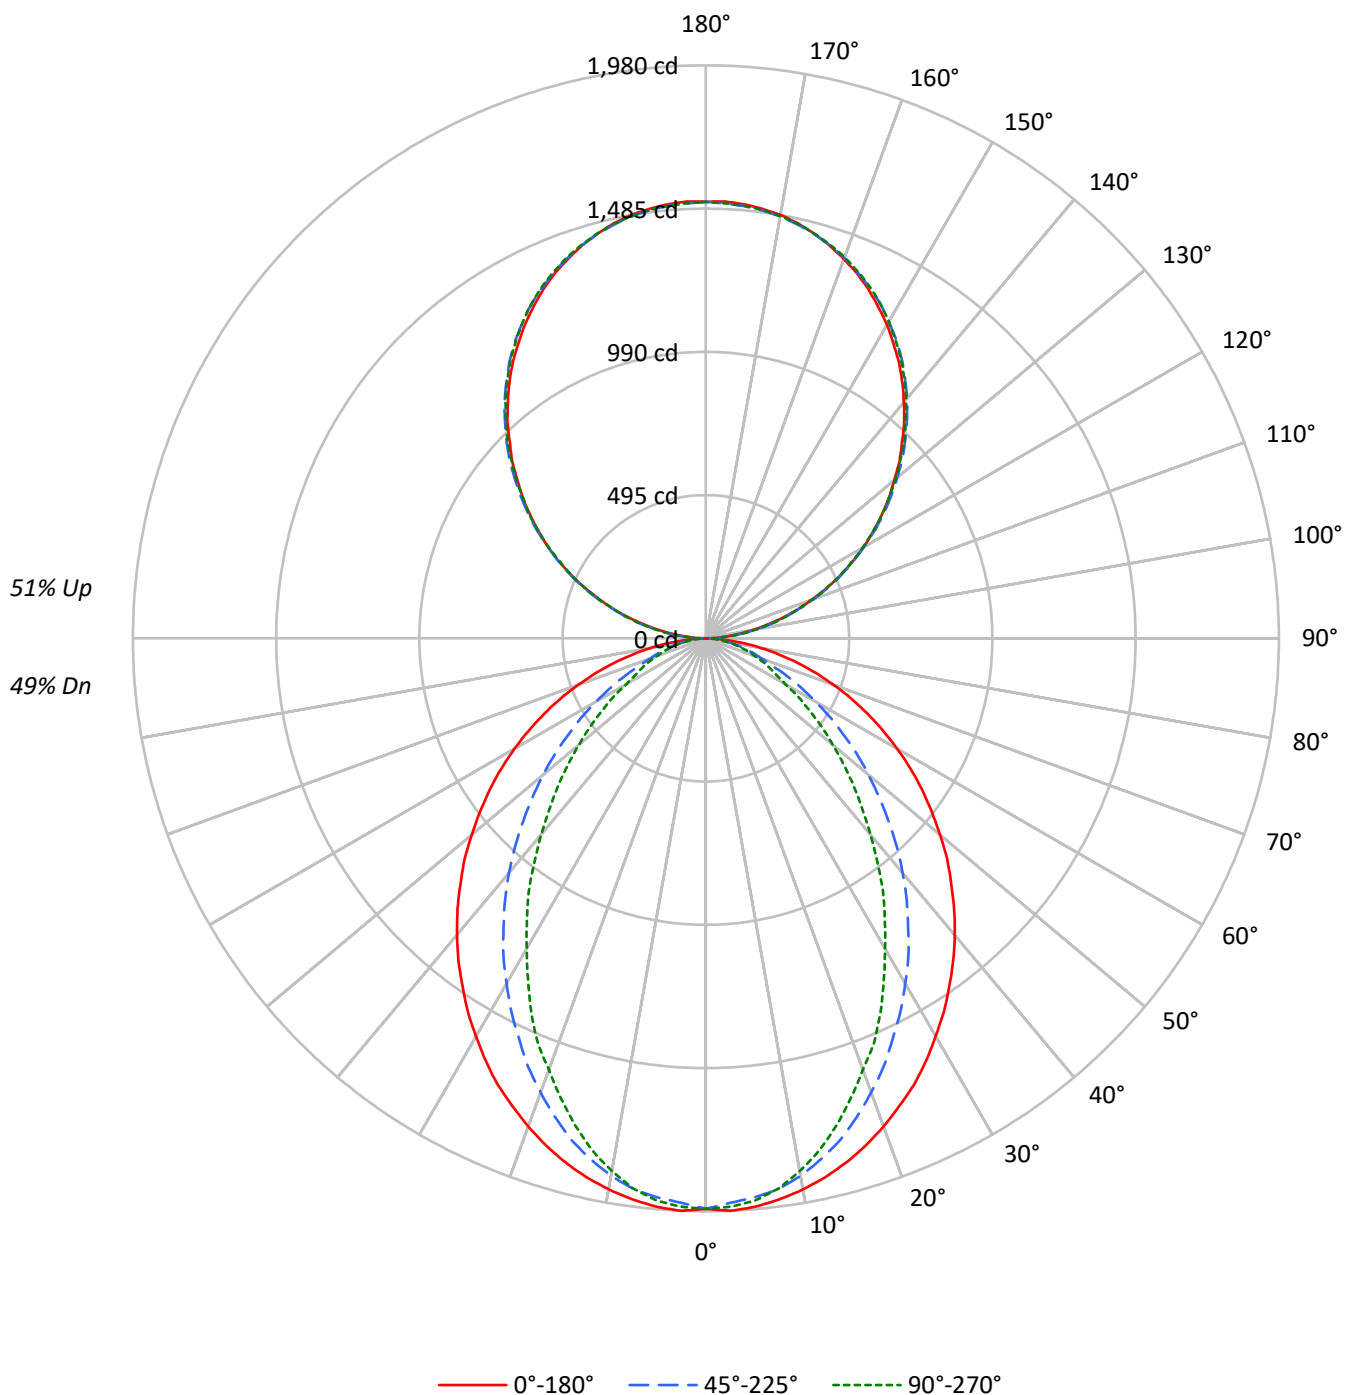

TEST NUMBER: P926159

CATALOG NUMBER: DFN2DIP-TR2F0-050D050US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4397	4397	4397
5°	4398	4318	4348
10°	4347	4223	4198
15°	4281	4074	3973
20°	4196	3873	3699
25°	4108	3649	3434
30°	3992	3420	3101
35°	3878	3175	2809
40°	3762	2922	2475
45°	3628	2643	2173
50°	3489	2363	1878
55°	3343	2064	1595
60°	3173	1753	1306
65°	2978	1439	1167
70°	2741	1146	1046
75°	2443	991	936
80°	2013	805	789
85°	1323	499	556

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3628 cd/sqm

TEST NUMBER: P926159

CATALOG NUMBER: DFN2DIP-TR2F0-050D050US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.8	2.2
10°-20°	507.2	6.1
20°-30°	712.1	8.6
30°-40°	776.3	9.4
40°-50°	713.5	8.6
50°-60°	560.3	6.8
60°-70°	364.7	4.4
70°-80°	187.7	2.3
80°-90°	52.2	0.6
90°-100°	93.4	1.1
100°-110°	296.6	3.6
110°-120°	507.6	6.1
120°-130°	667.5	8.1
130°-140°	749.3	9.1
140°-150°	734.8	8.9
150°-160°	616.4	7.4
160°-170°	408.8	4.9
170°-180°	142.9	1.7
0°-30°	1404.1	17.0
0°-40°	2180.4	26.3
0°-60°	3454.1	41.7
0°-90°	4058.8	49.0
90°-120°	897.5	10.8
90°-150°	3049.2	36.8
90°-180°	4217.0	51.0
0°-180°	8276.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1971	1971	1971	1971	1971	
5°	1971	1963	1939	1955	1950	187
15°	1875	1855	1795	1761	1743	528
25°	1702	1645	1527	1454	1427	783
35°	1467	1376	1219	1106	1067	918
45°	1199	1079	892	765	722	926
55°	912	772	580	473	439	815
65°	616	471	310	250	244	610
75°	328	203	143	130	128	347
85°	77	39	34	34	34	88
90°	1	16	45	42	43	8
95°	66	79	81	81	79	74
105°	274	277	280	282	282	289
115°	509	517	514	513	509	504
125°	741	752	749	744	743	662
135°	958	972	975	974	970	741
145°	1163	1172	1180	1181	1176	727
155°	1330	1334	1338	1344	1340	612
165°	1447	1446	1446	1455	1449	408
175°	1506	1502	1500	1509	1501	143
180°	1509	1509	1509	1509	1509	

TEST NUMBER: P926159

CATALOG NUMBER: DFN2DIP-TR2F0-050D050US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1971.4	1971.4	1971.4	1971.4	1971.4
2.5°	1980.3	1971.4	1951.8	1969.7	1966.1
5°	1971.4	1962.6	1939.3	1955.3	1950.1
7.5°	1955.3	1944.7	1919.7	1926.8	1917.8
10°	1933.9	1921.5	1885.9	1880.4	1869.7
12.5°	1907.2	1891.2	1842.9	1832.3	1812.6
15°	1875.1	1855.4	1794.9	1761.0	1743.1
17.5°	1837.6	1809.1	1734.1	1694.9	1666.3
20°	1794.9	1759.1	1669.9	1625.4	1586.0
22.5°	1748.5	1707.4	1603.9	1543.3	1516.6
25°	1702.0	1644.9	1527.2	1454.1	1427.2
27.5°	1646.8	1586.0	1455.8	1371.9	1330.9
30°	1587.9	1520.0	1377.3	1286.4	1238.1
32.5°	1530.8	1448.6	1302.5	1195.4	1150.7
35°	1466.6	1375.6	1218.6	1106.2	1066.9
37.5°	1404.1	1305.9	1140.1	1016.9	972.4
40°	1338.1	1231.1	1057.9	931.3	884.9
42.5°	1270.3	1156.2	975.9	843.8	799.4
45°	1199.0	1079.4	892.1	765.3	722.5
47.5°	1131.2	1004.6	811.9	685.1	645.9
50°	1056.3	929.6	733.3	610.1	572.8
52.5°	983.0	849.2	658.4	540.6	506.8
55°	911.6	772.5	579.7	472.8	438.9
57.5°	838.6	695.8	510.3	410.4	381.8
60°	763.6	620.9	437.0	346.2	317.6
62.5°	690.5	547.8	374.6	289.1	274.8
65°	615.5	471.0	310.4	249.9	244.4
67.5°	544.2	399.6	249.9	219.4	214.1
70°	469.3	330.1	206.9	189.1	181.9
72.5°	397.9	265.8	173.1	158.8	155.2
75°	328.3	203.3	142.7	130.2	128.5
77.5°	258.7	144.4	112.5	105.2	101.6
80°	194.4	103.5	85.6	78.5	78.5
82.5°	135.6	69.6	58.9	55.2	55.2
85°	76.7	39.2	33.9	33.9	33.9
87.5°	28.6	14.2	14.2	12.5	12.5
90°	1.3	16.4	44.6	41.9	43.2
92.5°	28.2	38.2	39.6	40.9	40.9
95°	66.4	79.2	81.4	81.4	79.2
97.5°	110.5	122.3	127.4	127.4	127.4
100°	161.4	171.9	175.5	175.5	174.2
102.5°	215.1	222.9	227.8	229.2	227.8
105°	273.8	277.4	280.2	282.4	282.4
107.5°	332.0	337.4	337.4	338.4	332.0
110°	388.4	395.7	395.7	395.7	392.0



TEST NUMBER: P926159

CATALOG NUMBER: DFN2DIP-TR2F0-050D050US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	449.3	457.1	455.7	452.1	449.3
115°	509.3	516.7	514.4	513.1	509.3
117.5°	569.0	579.0	572.6	569.0	565.3
120°	629.0	639.0	629.0	629.0	624.9
122.5°	683.5	696.3	689.9	686.3	683.5
125°	740.9	752.2	748.6	744.5	743.2
127.5°	796.8	810.9	805.9	800.4	796.8
130°	849.2	865.5	863.2	860.5	855.5
132.5°	907.8	920.5	921.5	915.1	911.5
135°	958.3	972.3	975.1	973.7	970.1
137.5°	1014.7	1026.0	1028.3	1027.4	1021.9
140°	1064.2	1075.6	1081.9	1081.9	1077.0
142.5°	1115.1	1126.6	1130.2	1131.5	1126.6
145°	1163.4	1172.5	1179.7	1181.1	1176.1
147.5°	1206.6	1218.0	1223.4	1225.7	1220.6
150°	1251.2	1258.9	1263.9	1268.0	1263.9
152.5°	1290.8	1298.5	1304.8	1309.8	1304.8
155°	1330.3	1333.9	1338.0	1344.4	1340.3
157.5°	1364.4	1367.1	1369.4	1378.5	1372.1
160°	1394.8	1397.6	1398.9	1406.7	1401.2
162.5°	1423.1	1423.1	1424.4	1433.1	1426.7
165°	1447.2	1445.8	1445.8	1454.9	1448.6
167.5°	1469.0	1464.9	1464.9	1474.0	1467.6
170°	1485.4	1481.8	1480.4	1489.5	1481.8
172.5°	1496.7	1493.1	1491.8	1500.8	1493.1
175°	1505.9	1502.2	1499.5	1508.6	1500.8
177.5°	1510.8	1507.2	1504.5	1512.2	1504.5
180°	1508.6	1508.6	1508.6	1508.6	1508.6

TEST NUMBER: P926159

CATALOG NUMBER: DFN2DIP-TR2F0-050D050US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.07	12.89	13.04	13.88	15.16	8.05	8.88	9.03	9.86	11.15
	3H	13.73	14.46	14.71	15.45	16.76	9.23	9.96	10.21	10.95	12.26
	4H	14.32	15.01	15.31	16.01	17.33	9.67	10.36	10.66	11.35	12.67
	6H	14.72	15.36	15.73	16.36	17.69	9.97	10.61	10.98	11.61	12.94
	8H	14.84	15.44	15.85	16.46	17.79	10.05	10.66	11.07	11.68	13.01
	12H	14.89	15.47	15.90	16.47	17.83	10.09	10.67	11.11	11.68	13.03
4H	2H	12.09	12.78	13.09	13.77	15.09	8.64	9.33	9.64	10.32	11.64
	3H	13.89	14.47	14.90	15.49	16.82	9.97	10.54	10.98	11.57	12.90
	4H	14.56	15.09	15.58	16.10	17.46	10.50	11.03	11.52	12.04	13.40
	6H	15.05	15.51	16.08	16.55	17.90	10.90	11.36	11.93	12.39	13.75
	8H	15.21	15.64	16.25	16.67	18.04	11.02	11.44	12.05	12.48	13.84
	12H	15.30	15.68	16.34	16.73	18.10	11.08	11.46	12.12	12.51	13.88
8H	4H	14.52	14.95	15.55	15.98	17.35	10.77	11.19	11.80	12.22	13.59
	6H	15.06	15.41	16.12	16.49	17.85	11.26	11.61	12.32	12.68	14.05
	8H	15.27	15.57	16.33	16.63	18.01	11.44	11.75	12.50	12.81	14.19
	12H	15.39	15.66	16.45	16.71	18.14	11.55	11.82	12.61	12.87	14.29
12H	4H	14.47	14.86	15.52	15.90	17.28	10.77	11.15	11.81	12.20	13.57
	6H	15.04	15.35	16.10	16.40	17.79	11.30	11.61	12.37	12.67	14.05
	8H	15.24	15.51	16.31	16.57	17.99	11.50	11.77	12.56	12.82	14.25

END OF REPORT