

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926163

Luminaire Tested: DFN2DIP-TR2F0-050D060US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926163
REPORT IS A COMBINATION OF REPORTS P901788 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-050D060US950-RLLONL
Description: 2 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9120.3 lumens
Efficiency: N/A
Efficacy: 95.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 95.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926163

CATALOG NUMBER: DFN2DIP-TR2F0-050D060US950-RLLONL

Luminous Intensity Polar Plot

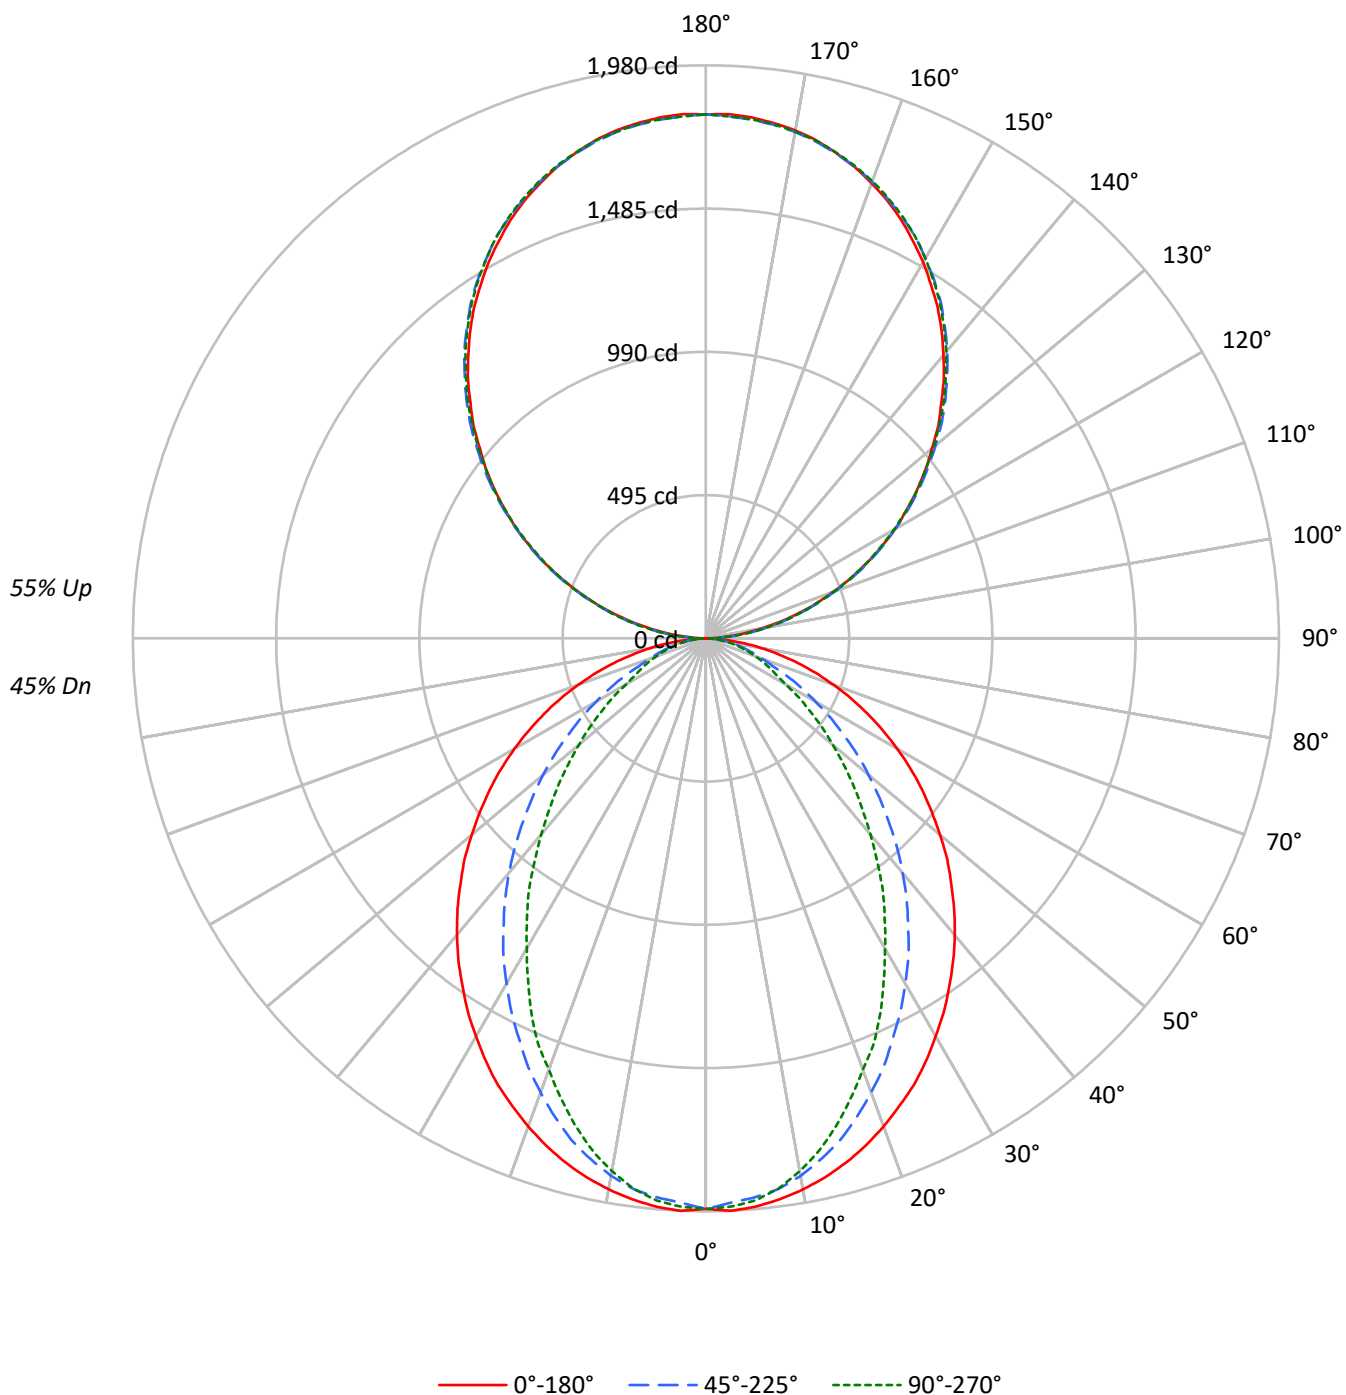

TEST NUMBER: P926163

CATALOG NUMBER: DFN2DIP-TR2F0-050D060US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	97	93	89	86	89	85	82	79	71	69	67	58	56	55	46	45	44
2	89	82	76	71	81	75	70	66	63	59	56	51	49	47	41	39	38
3	81	72	65	59	74	66	60	55	56	51	47	46	43	40	37	34	33
4	74	64	56	51	68	59	52	47	50	45	41	41	37	35	33	30	28
5	68	57	49	44	63	53	46	41	45	39	35	37	33	30	30	27	25
6	63	51	44	38	58	48	41	36	40	35	31	34	30	27	27	24	22
7	58	47	39	33	54	43	36	31	37	31	28	31	27	24	25	22	20
8	54	42	35	30	50	39	33	28	34	28	25	28	24	21	23	20	18
9	51	39	31	27	46	36	29	25	31	26	22	26	22	19	21	18	16
10	47	36	29	24	43	33	27	23	28	23	20	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4397	4397	4397
5°	4398	4318	4348
10°	4347	4223	4198
15°	4281	4074	3973
20°	4196	3873	3699
25°	4108	3649	3434
30°	3992	3420	3101
35°	3878	3175	2809
40°	3762	2922	2475
45°	3628	2643	2173
50°	3489	2363	1878
55°	3343	2064	1595
60°	3173	1753	1306
65°	2978	1439	1167
70°	2741	1146	1046
75°	2443	991	936
80°	2013	805	789
85°	1323	499	556

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3628 cd/sqm

TEST NUMBER: P926163

CATALOG NUMBER: DFN2DIP-TR2F0-050D060US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.8	2.0
10°-20°	507.2	5.6
20°-30°	712.1	7.8
30°-40°	776.3	8.5
40°-50°	713.5	7.8
50°-60°	560.3	6.1
60°-70°	364.7	4.0
70°-80°	187.7	2.1
80°-90°	53.1	0.6
90°-100°	112.0	1.2
100°-110°	355.9	3.9
110°-120°	609.1	6.7
120°-130°	801.1	8.8
130°-140°	899.2	9.9
140°-150°	881.7	9.7
150°-160°	739.6	8.1
160°-170°	490.5	5.4
170°-180°	171.4	1.9
0°-30°	1404.1	15.4
0°-40°	2180.4	23.9
0°-60°	3454.1	37.9
0°-90°	4059.7	44.5
90°-120°	1077.0	11.8
90°-150°	3659.0	40.1
90°-180°	5061.0	55.5
0°-180°	9120.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1971	1971	1971	1971	1971	
5°	1971	1963	1939	1955	1950	187
15°	1875	1855	1795	1761	1743	528
25°	1702	1645	1527	1454	1427	783
35°	1467	1376	1219	1106	1067	918
45°	1199	1079	892	765	722	926
55°	912	772	580	473	439	815
65°	616	471	310	250	244	610
75°	328	203	143	130	128	347
85°	77	39	34	34	34	88
90°	2	20	54	50	52	9
95°	80	95	98	98	95	89
105°	329	333	336	339	339	347
115°	611	620	617	616	611	605
125°	889	903	898	893	892	794
135°	1150	1167	1170	1168	1164	889
145°	1396	1407	1416	1417	1411	872
155°	1596	1601	1606	1613	1608	735
165°	1737	1735	1735	1746	1738	490
175°	1807	1803	1799	1810	1801	172
180°	1810	1810	1810	1810	1810	

TEST NUMBER: P926163

CATALOG NUMBER: DFN2DIP-TR2F0-050D060US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1971.4	1971.4	1971.4	1971.4	1971.4
2.5°	1980.3	1971.4	1951.8	1969.7	1966.1
5°	1971.4	1962.6	1939.3	1955.3	1950.1
7.5°	1955.3	1944.7	1919.7	1926.8	1917.8
10°	1933.9	1921.5	1885.9	1880.4	1869.7
12.5°	1907.2	1891.2	1842.9	1832.3	1812.6
15°	1875.1	1855.4	1794.9	1761.0	1743.1
17.5°	1837.6	1809.1	1734.1	1694.9	1666.3
20°	1794.9	1759.1	1669.9	1625.4	1586.0
22.5°	1748.5	1707.4	1603.9	1543.3	1516.6
25°	1702.0	1644.9	1527.2	1454.1	1427.2
27.5°	1646.8	1586.0	1455.8	1371.9	1330.9
30°	1587.9	1520.0	1377.3	1286.4	1238.1
32.5°	1530.8	1448.6	1302.5	1195.4	1150.7
35°	1466.6	1375.6	1218.6	1106.2	1066.9
37.5°	1404.1	1305.9	1140.1	1016.9	972.4
40°	1338.1	1231.1	1057.9	931.3	884.9
42.5°	1270.3	1156.2	975.9	843.8	799.4
45°	1199.0	1079.4	892.1	765.3	722.5
47.5°	1131.2	1004.6	811.9	685.1	645.9
50°	1056.3	929.6	733.3	610.1	572.8
52.5°	983.0	849.2	658.4	540.6	506.8
55°	911.6	772.5	579.7	472.8	438.9
57.5°	838.6	695.8	510.3	410.4	381.8
60°	763.6	620.9	437.0	346.2	317.6
62.5°	690.5	547.8	374.6	289.1	274.8
65°	615.5	471.0	310.4	249.9	244.4
67.5°	544.2	399.6	249.9	219.4	214.1
70°	469.3	330.1	206.9	189.1	181.9
72.5°	397.9	265.8	173.1	158.8	155.2
75°	328.3	203.3	142.7	130.2	128.5
77.5°	258.7	144.4	112.5	105.2	101.6
80°	194.4	103.5	85.6	78.5	78.5
82.5°	135.6	69.6	58.9	55.2	55.2
85°	76.7	39.2	33.9	33.9	33.9
87.5°	28.6	14.2	14.2	12.5	12.5
90°	1.6	19.7	53.5	50.2	51.8
92.5°	33.9	45.9	47.5	49.1	49.1
95°	79.7	94.9	97.7	97.7	94.9
97.5°	132.6	146.8	152.8	152.8	152.8
100°	193.8	206.3	210.6	210.6	209.0
102.5°	258.2	267.4	273.4	275.0	273.4
105°	328.6	332.9	336.2	339.0	339.0
107.5°	398.4	405.0	405.0	406.0	398.4
110°	466.1	474.8	474.8	474.8	470.4



TEST NUMBER: P926163

CATALOG NUMBER: DFN2DIP-TR2F0-050D060US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	539.2	548.5	546.8	542.4	539.2
115°	611.2	620.0	617.2	615.6	611.2
117.5°	682.8	694.8	687.1	682.8	678.4
120°	754.8	766.8	754.8	754.8	749.8
122.5°	820.2	835.5	827.9	823.6	820.2
125°	889.0	902.7	898.3	893.4	891.8
127.5°	956.2	973.1	967.1	960.6	956.2
130°	1019.0	1038.6	1035.9	1032.6	1026.6
132.5°	1089.4	1104.6	1105.7	1098.1	1093.7
135°	1150.0	1166.8	1170.1	1168.5	1164.1
137.5°	1217.6	1231.2	1234.0	1232.9	1226.4
140°	1277.1	1290.8	1298.4	1298.4	1292.4
142.5°	1338.2	1351.8	1356.2	1357.8	1351.8
145°	1396.1	1407.0	1415.7	1417.4	1411.3
147.5°	1447.9	1461.5	1468.1	1470.8	1464.8
150°	1501.4	1510.7	1516.7	1521.5	1516.7
152.5°	1548.8	1558.2	1565.8	1571.8	1565.8
155°	1596.3	1600.7	1605.6	1613.3	1608.3
157.5°	1637.3	1640.6	1643.3	1654.2	1646.6
160°	1673.9	1677.1	1678.8	1688.0	1681.5
162.5°	1707.7	1707.7	1709.3	1719.7	1712.0
165°	1736.6	1734.9	1734.9	1745.9	1738.3
167.5°	1762.8	1757.9	1757.9	1768.8	1761.2
170°	1782.5	1778.1	1776.4	1787.3	1778.1
172.5°	1796.1	1791.7	1790.1	1801.0	1791.7
175°	1807.0	1802.7	1799.3	1810.3	1801.0
177.5°	1813.0	1808.7	1805.3	1814.6	1805.3
180°	1810.3	1810.3	1810.3	1810.3	1810.3

TEST NUMBER: P926163

CATALOG NUMBER: DFN2DIP-TR2F0-050D060US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.63	12.41	12.64	13.43	14.78	7.61	8.40	8.62	9.41	10.76
	3H	13.28	13.98	14.30	15.01	16.38	8.78	9.48	9.80	10.51	11.88
	4H	13.87	14.53	14.90	15.56	16.94	9.22	9.88	10.25	10.91	12.29
	6H	14.27	14.88	15.31	15.91	17.30	9.52	10.13	10.56	11.16	12.55
	8H	14.38	14.97	15.43	16.01	17.40	9.60	10.19	10.65	11.23	12.62
	12H	14.43	14.99	15.49	16.03	17.44	9.64	10.19	10.69	11.23	12.64
4H	2H	11.64	12.30	12.67	13.33	14.71	8.19	8.85	9.22	9.88	11.26
	3H	13.43	13.99	14.48	15.04	16.43	9.51	10.07	10.56	11.12	12.51
	4H	14.11	14.61	15.16	15.66	17.07	10.05	10.55	11.10	11.60	13.01
	6H	14.60	15.03	15.66	16.10	17.51	10.45	10.88	11.51	11.95	13.36
	8H	14.76	15.16	15.82	16.23	17.65	10.56	10.97	11.63	12.03	13.46
	12H	14.84	15.21	15.92	16.28	17.71	10.62	10.98	11.70	12.06	13.49
8H	4H	14.07	14.47	15.13	15.54	16.96	10.31	10.72	11.37	11.78	13.20
	6H	14.61	14.94	15.69	16.05	17.47	10.80	11.14	11.89	12.24	13.66
	8H	14.81	15.10	15.90	16.19	17.63	10.98	11.28	12.07	12.36	13.80
	12H	14.93	15.19	16.02	16.27	17.75	11.09	11.34	12.18	12.43	13.91
12H	4H	14.02	14.38	15.10	15.46	16.89	10.31	10.68	11.39	11.75	13.18
	6H	14.58	14.87	15.67	15.96	17.40	10.85	11.14	11.94	12.23	13.67
	8H	14.78	15.04	15.88	16.12	17.60	11.04	11.30	12.14	12.38	13.86