

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926164

Luminaire Tested: DFN2DIP-TR2F0-060D020US950-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926164
REPORT IS A COMBINATION OF REPORTS P900229 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-060D020US950-FLLFLL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7355.4 lumens
Efficiency: N/A
Efficacy: 98.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 74.7
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926164

CATALOG NUMBER: DFN2DIP-TR2F0-060D020US950-FLLFLL

Luminous Intensity Polar Plot

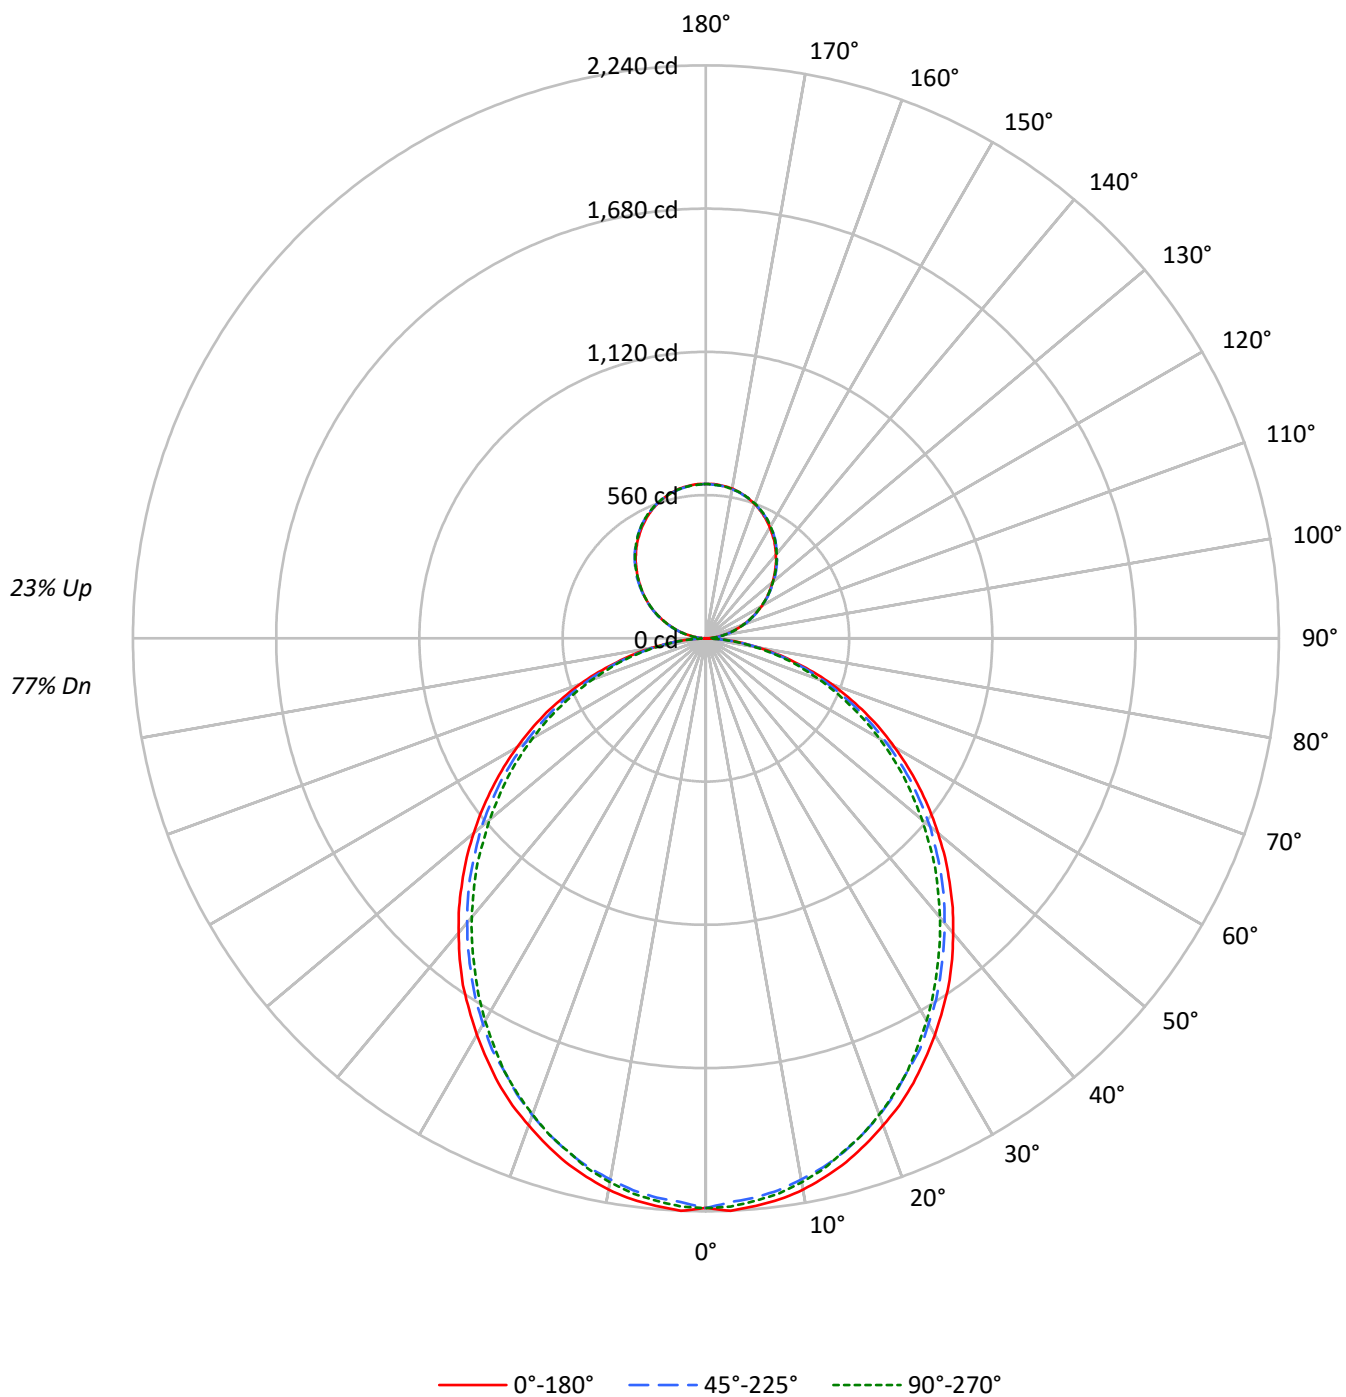

TEST NUMBER: P926164

CATALOG NUMBER: DFN2DIP-TR2F0-060D020US950-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	114	114	114	114	108	108	108	108	98	98	98	89	89	89	81	81	81
1	104	99	95	92	99	95	91	88	86	84	81	79	77	75	72	70	68
2	95	87	80	75	90	83	77	72	76	71	67	69	66	62	63	60	58
3	86	76	69	63	82	73	66	61	67	61	57	61	57	53	56	52	49
4	79	68	59	53	75	65	57	52	60	53	48	55	50	45	50	46	42
5	73	61	52	46	69	58	50	44	53	47	42	49	44	39	45	41	37
6	67	55	46	40	64	52	45	39	48	42	37	45	39	35	41	36	33
7	62	49	41	35	59	48	40	34	44	37	33	41	35	31	37	33	29
8	58	45	37	31	55	43	36	31	40	34	29	37	32	28	34	30	26
9	54	41	33	28	52	40	32	27	37	31	26	34	29	25	32	27	24
10	51	38	30	25	48	37	30	25	34	28	24	32	26	23	30	25	22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4968	4968	4968
5°	4968	4887	4923
10°	4921	4810	4848
15°	4841	4720	4735
20°	4736	4599	4620
25°	4631	4457	4489
30°	4502	4323	4324
35°	4378	4168	4150
40°	4227	4010	3983
45°	4077	3852	3813
50°	3912	3685	3616
55°	3738	3492	3433
60°	3542	3266	3224
65°	3326	3029	2977
70°	3053	2740	2709
75°	2677	2394	2451
80°	2219	1953	1981
85°	1512	1231	1231

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4077 cd/sqm

TEST NUMBER: P926164

CATALOG NUMBER: DFN2DIP-TR2F0-060D020US950-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	209.6	2.8
10°-20°	589.8	8.0
20°-30°	866.8	11.8
30°-40°	1006.7	13.7
40°-50°	1005.5	13.7
50°-60°	876.7	11.9
60°-70°	648.1	8.8
70°-80°	366.7	5.0
80°-90°	98.5	1.3
90°-100°	37.3	0.5
100°-110°	118.7	1.6
110°-120°	203.0	2.8
120°-130°	267.0	3.6
130°-140°	299.7	4.1
140°-150°	293.9	4.0
150°-160°	246.5	3.4
160°-170°	163.5	2.2
170°-180°	57.1	0.8
0°-30°	1666.2	22.7
0°-40°	2673.0	36.3
0°-60°	4555.2	61.9
0°-90°	5668.5	77.1
90°-120°	359.0	4.9
90°-150°	1219.7	16.6
90°-180°	1687.0	22.9
0°-180°	7355.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2227	2227	2227	2227	2227	
5°	2227	2219	2195	2212	2208	211
15°	2120	2108	2080	2088	2078	597
25°	1919	1902	1866	1870	1866	883
35°	1656	1634	1600	1587	1576	1034
45°	1347	1332	1300	1276	1268	1040
55°	1020	1007	981	955	945	912
65°	688	675	653	634	623	680
75°	360	356	345	332	336	384
85°	88	86	84	77	75	98
90°	1	7	18	17	17	7
95°	26	32	32	32	32	30
105°	110	111	112	113	113	116
115°	204	207	206	205	204	202
125°	296	301	300	298	297	265
135°	383	389	390	390	388	296
145°	465	469	472	472	470	291
155°	532	534	535	538	536	245
165°	579	578	578	582	580	163
175°	602	601	600	603	600	57
180°	603	603	603	603	603	

TEST NUMBER: P926164

CATALOG NUMBER: DFN2DIP-TR2F0-060D020US950-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2227.2	2227.2	2227.2	2227.2	2227.2
2.5°	2240.2	2229.5	2205.8	2227.2	2223.1
5°	2227.2	2218.8	2195.2	2212.2	2208.1
7.5°	2212.2	2199.5	2175.9	2193.2	2188.9
10°	2188.9	2173.9	2148.1	2165.2	2158.8
12.5°	2156.6	2143.8	2118.2	2128.9	2124.6
15°	2120.2	2107.5	2079.5	2088.2	2077.5
17.5°	2075.2	2062.5	2034.6	2045.2	2034.6
20°	2025.9	2013.2	1983.2	1989.6	1981.2
22.5°	1976.9	1957.5	1929.6	1929.6	1925.3
25°	1918.9	1901.9	1865.5	1869.6	1865.5
27.5°	1854.6	1839.6	1811.8	1805.5	1794.9
30°	1790.6	1773.2	1741.2	1734.8	1726.2
32.5°	1721.9	1709.2	1674.8	1661.9	1653.3
35°	1655.6	1634.2	1599.9	1586.9	1576.2
37.5°	1580.6	1561.2	1527.0	1511.9	1501.2
40°	1503.5	1486.2	1452.0	1432.9	1424.2
42.5°	1428.5	1411.3	1377.2	1355.6	1342.9
45°	1347.2	1332.2	1299.9	1276.5	1267.9
47.5°	1267.9	1252.9	1218.6	1195.0	1182.2
50°	1184.3	1173.6	1143.7	1113.6	1102.9
52.5°	1102.9	1087.9	1060.2	1036.6	1021.6
55°	1019.5	1006.6	980.9	955.2	944.6
57.5°	936.0	925.3	897.3	871.7	863.0
60°	852.3	843.9	814.0	790.3	783.9
62.5°	770.9	755.9	734.6	713.2	704.6
65°	687.5	674.7	653.3	633.9	623.2
67.5°	601.9	591.0	571.9	556.9	548.3
70°	522.6	514.0	494.6	479.7	471.3
72.5°	441.2	432.6	422.0	407.0	400.6
75°	359.7	355.7	344.7	332.0	336.3
77.5°	287.0	278.4	274.0	267.7	261.3
80°	214.3	212.0	207.7	201.3	197.0
82.5°	145.7	145.7	143.6	135.0	135.0
85°	87.7	85.7	83.6	77.0	75.0
87.5°	38.6	34.3	30.0	23.7	21.4
90°	0.6	6.6	17.8	16.7	17.3
92.5°	11.3	15.3	15.8	16.4	16.4
95°	26.5	31.7	32.5	32.5	31.7
97.5°	44.2	48.9	50.9	50.9	50.9
100°	64.6	68.8	70.2	70.2	69.6
102.5°	86.1	89.1	91.1	91.7	91.1
105°	109.5	111.0	112.1	113.0	113.0
107.5°	132.8	135.0	135.0	135.4	132.8
110°	155.4	158.3	158.3	158.3	156.8

TEST NUMBER: P926164

CATALOG NUMBER: DFN2DIP-TR2F0-060D020US950-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	179.7	182.8	182.3	180.8	179.7
115°	203.8	206.6	205.8	205.2	203.8
117.5°	227.6	231.6	229.1	227.6	226.1
120°	251.6	255.6	251.6	251.6	249.9
122.5°	273.4	278.5	276.0	274.6	273.4
125°	296.3	300.9	299.5	297.8	297.3
127.5°	318.7	324.4	322.4	320.2	318.7
130°	339.6	346.2	345.3	344.2	342.2
132.5°	363.1	368.2	368.5	366.0	364.5
135°	383.3	388.9	390.0	389.5	388.0
137.5°	405.8	410.4	411.4	411.0	408.8
140°	425.7	430.3	432.8	432.8	430.8
142.5°	446.1	450.6	452.1	452.6	450.6
145°	465.4	469.0	471.9	472.4	470.4
147.5°	482.6	487.2	489.4	490.3	488.3
150°	500.5	503.5	505.5	507.1	505.5
152.5°	516.3	519.4	521.9	523.9	521.9
155°	532.1	533.6	535.2	537.8	536.1
157.5°	545.8	546.8	547.8	551.4	548.8
160°	558.0	559.0	559.6	562.7	560.5
162.5°	569.3	569.3	569.7	573.3	570.7
165°	578.9	578.3	578.3	581.9	579.5
167.5°	587.6	585.9	585.9	589.6	587.1
170°	594.2	592.7	592.1	595.8	592.7
172.5°	598.7	597.2	596.7	600.4	597.2
175°	602.4	600.9	599.8	603.4	600.4
177.5°	604.4	602.9	601.8	604.8	601.8
180°	603.4	603.4	603.4	603.4	603.4

TEST NUMBER: P926164

CATALOG NUMBER: DFN2DIP-TR2F0-060D020US950-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.91	16.08	15.60	16.78	17.61	14.49	15.66	15.17	16.36	17.19
	3H	16.57	17.62	17.27	18.34	19.19	16.11	17.16	16.81	17.87	18.73
	4H	17.16	18.15	17.87	18.87	19.74	16.70	17.69	17.41	18.41	19.28
	6H	17.55	18.47	18.28	19.20	20.09	17.09	18.01	17.82	18.74	19.63
	8H	17.66	18.53	18.40	19.29	20.17	17.20	18.07	17.94	18.83	19.71
	12H	17.71	18.54	18.45	19.29	20.20	17.24	18.08	17.99	18.83	19.74
4H	2H	15.40	16.39	16.12	17.12	17.99	15.06	16.05	15.78	16.78	17.65
	3H	17.27	18.10	18.00	18.86	19.74	16.88	17.71	17.61	18.47	19.36
	4H	17.97	18.73	18.72	19.49	20.41	17.58	18.33	18.33	19.09	20.01
	6H	18.48	19.14	19.25	19.92	20.85	18.09	18.74	18.85	19.53	20.45
	8H	18.63	19.24	19.40	20.02	20.96	18.23	18.84	19.00	19.63	20.56
	12H	18.71	19.26	19.50	20.06	21.00	18.30	18.85	19.09	19.66	20.60
8H	4H	18.18	18.80	18.96	19.58	20.52	17.83	18.44	18.60	19.23	20.16
	6H	18.80	19.31	19.60	20.13	21.07	18.45	18.96	19.25	19.78	20.72
	8H	19.01	19.46	19.82	20.28	21.24	18.65	19.10	19.47	19.93	20.88
	12H	19.14	19.54	19.95	20.35	21.36	18.77	19.17	19.58	19.98	20.99
12H	4H	18.18	18.73	18.97	19.54	20.48	17.84	18.39	18.63	19.19	20.14
	6H	18.83	19.28	19.64	20.10	21.06	18.49	18.94	19.30	19.76	20.72
	8H	19.07	19.47	19.88	20.28	21.29	18.72	19.12	19.54	19.93	20.95