

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926172

Luminaire Tested: DFN2DIP-TR2F0-060D040US950-FLLFLL

Issue Date: 11/21/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P926172  
REPORT IS A COMBINATION OF REPORTS P900249 AND P897145  
Test Lab: INNOVATION CENTER  
Issue Date: 11/21/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: NEO-RAY  
Catalog Number: DFN2DIP-TR2F0-060D040US950-FLLFLL  
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens  
Light Source: -  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 9043.9 lumens  
Efficiency: N/A  
Efficacy: 101.8 lumens/watt  
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29  
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')  
CIE Type: Semi-Direct  
  
Input Watts (W): 88.8  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: 0.9971  
Total Harmonic Distortion (THDi): 0.049  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P926172

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US950-FLLFLL

### Luminous Intensity Polar Plot

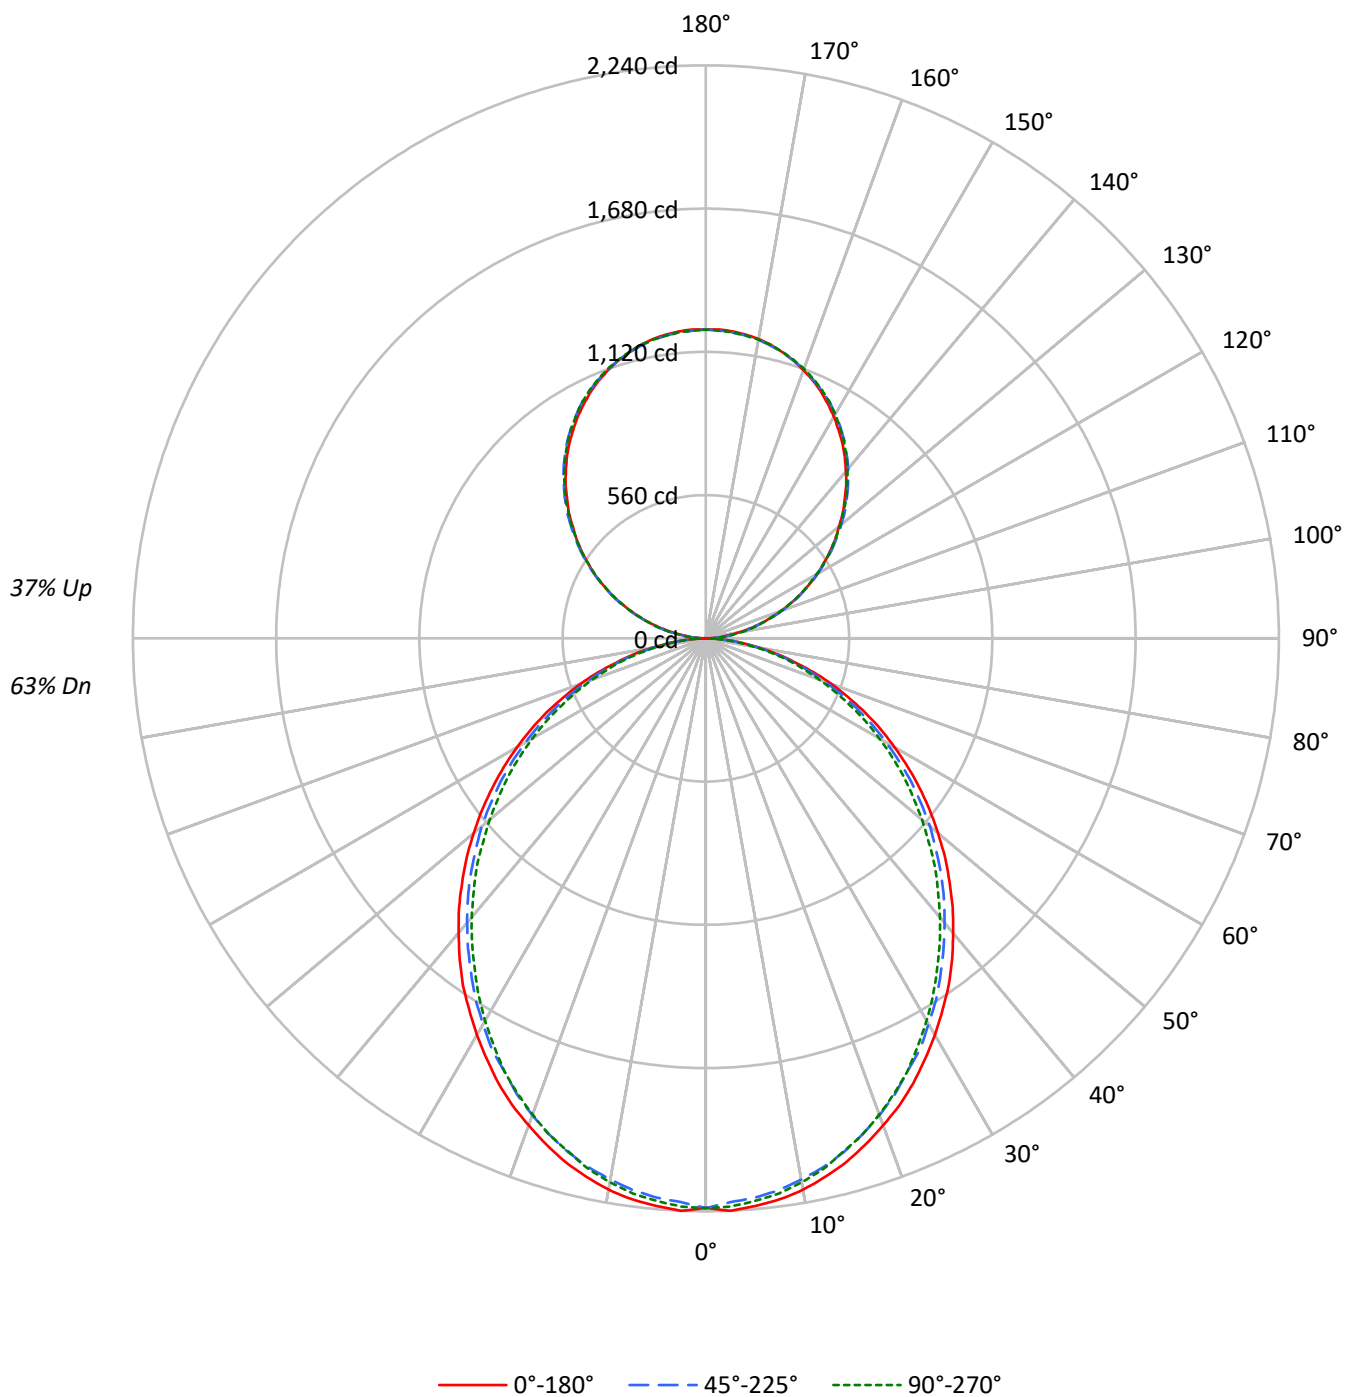

TEST NUMBER: P926172

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US950-FLLFLL

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |    |    |    |    |    |    |    |    |    |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|----|----|----|----|----|----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20 |    |    |    | 20 |    |    |    | 20 |
| RC  | 80  |     |     |     | 70  |     |     |     | 50 |    |    |    | 30 |    |    |    | 10 |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 |
| RCR |     |     |     |     |     |     |     |     |    |    |    |    |    |    |    |    |    |
| 0   | 110 | 110 | 110 | 110 | 103 | 103 | 103 | 103 | 90 | 90 | 90 | 79 | 79 | 79 | 68 | 68 | 68 |
| 1   | 101 | 96  | 92  | 89  | 94  | 90  | 87  | 84  | 79 | 77 | 74 | 69 | 67 | 66 | 60 | 59 | 57 |
| 2   | 92  | 84  | 78  | 72  | 86  | 79  | 73  | 69  | 70 | 65 | 62 | 61 | 58 | 55 | 53 | 50 | 48 |
| 3   | 84  | 74  | 66  | 60  | 78  | 70  | 63  | 58  | 61 | 56 | 52 | 54 | 50 | 46 | 47 | 44 | 41 |
| 4   | 77  | 66  | 57  | 51  | 71  | 62  | 54  | 49  | 55 | 49 | 44 | 48 | 43 | 40 | 42 | 38 | 35 |
| 5   | 70  | 58  | 50  | 44  | 66  | 55  | 48  | 42  | 49 | 43 | 38 | 43 | 38 | 35 | 38 | 34 | 31 |
| 6   | 65  | 53  | 44  | 38  | 61  | 50  | 42  | 37  | 44 | 38 | 33 | 39 | 34 | 30 | 34 | 30 | 27 |
| 7   | 60  | 48  | 39  | 34  | 56  | 45  | 38  | 32  | 40 | 34 | 30 | 36 | 31 | 27 | 31 | 27 | 24 |
| 8   | 56  | 43  | 35  | 30  | 52  | 41  | 34  | 29  | 37 | 31 | 26 | 33 | 28 | 24 | 29 | 25 | 22 |
| 9   | 52  | 40  | 32  | 27  | 49  | 38  | 30  | 26  | 34 | 28 | 24 | 30 | 25 | 22 | 27 | 23 | 20 |
| 10  | 49  | 36  | 29  | 24  | 46  | 35  | 28  | 23  | 31 | 25 | 21 | 28 | 23 | 20 | 25 | 21 | 18 |

**AVERAGE LUMINANCE (cd/sqm):**

|     | 0°   | 45°  | 90°  |
|-----|------|------|------|
| 0°  | 4968 | 4968 | 4968 |
| 5°  | 4968 | 4887 | 4923 |
| 10° | 4921 | 4810 | 4848 |
| 15° | 4841 | 4720 | 4735 |
| 20° | 4736 | 4599 | 4620 |
| 25° | 4631 | 4457 | 4489 |
| 30° | 4502 | 4323 | 4324 |
| 35° | 4378 | 4168 | 4150 |
| 40° | 4227 | 4010 | 3983 |
| 45° | 4077 | 3852 | 3813 |
| 50° | 3912 | 3685 | 3616 |
| 55° | 3738 | 3492 | 3433 |
| 60° | 3542 | 3266 | 3224 |
| 65° | 3326 | 3029 | 2977 |
| 70° | 3053 | 2740 | 2709 |
| 75° | 2677 | 2394 | 2451 |
| 80° | 2219 | 1953 | 1981 |
| 85° | 1512 | 1231 | 1231 |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4077 cd/sqm

TEST NUMBER: P926172

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US950-FLLFLL

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 209.6  | 2.3       |
| 10°-20°   | 589.8  | 6.5       |
| 20°-30°   | 866.8  | 9.6       |
| 30°-40°   | 1006.7 | 11.1      |
| 40°-50°   | 1005.5 | 11.1      |
| 50°-60°   | 876.7  | 9.7       |
| 60°-70°   | 648.1  | 7.2       |
| 70°-80°   | 366.7  | 4.1       |
| 80°-90°   | 100.2  | 1.1       |
| 90°-100°  | 74.7   | 0.8       |
| 100°-110° | 237.3  | 2.6       |
| 110°-120° | 406.1  | 4.5       |
| 120°-130° | 534.0  | 5.9       |
| 130°-140° | 599.4  | 6.6       |
| 140°-150° | 587.8  | 6.5       |
| 150°-160° | 493.1  | 5.5       |
| 160°-170° | 327.0  | 3.6       |
| 170°-180° | 114.3  | 1.3       |
| 0°-30°    | 1666.2 | 18.4      |
| 0°-40°    | 2673.0 | 29.6      |
| 0°-60°    | 4555.2 | 50.4      |
| 0°-90°    | 5670.2 | 62.7      |
| 90°-120°  | 718.0  | 7.9       |
| 90°-150°  | 2439.3 | 27.0      |
| 90°-180°  | 3374.0 | 37.3      |
| 0°-180°   | 9043.9 | 100.0     |

**CANDELA DISTRIBUTION:**

|      | 0°   | 22.5° | 45°  | 67.5° | 90°  | Flux |
|------|------|-------|------|-------|------|------|
| 0°   | 2227 | 2227  | 2227 | 2227  | 2227 |      |
| 5°   | 2227 | 2219  | 2195 | 2212  | 2208 | 211  |
| 15°  | 2120 | 2108  | 2080 | 2088  | 2078 | 597  |
| 25°  | 1919 | 1902  | 1866 | 1870  | 1866 | 883  |
| 35°  | 1656 | 1634  | 1600 | 1587  | 1576 | 1034 |
| 45°  | 1347 | 1332  | 1300 | 1276  | 1268 | 1040 |
| 55°  | 1020 | 1007  | 981  | 955   | 945  | 912  |
| 65°  | 688  | 675   | 653  | 634   | 623  | 680  |
| 75°  | 360  | 356   | 345  | 332   | 336  | 384  |
| 85°  | 88   | 86    | 84   | 77    | 75   | 98   |
| 90°  | 1    | 13    | 36   | 34    | 34   | 9    |
| 95°  | 53   | 63    | 65   | 65    | 63   | 59   |
| 105° | 219  | 222   | 224  | 226   | 226  | 231  |
| 115° | 408  | 413   | 412  | 410   | 408  | 403  |
| 125° | 593  | 602   | 599  | 596   | 594  | 530  |
| 135° | 767  | 778   | 780  | 779   | 776  | 593  |
| 145° | 931  | 938   | 944  | 945   | 941  | 582  |
| 155° | 1064 | 1067  | 1070 | 1076  | 1072 | 490  |
| 165° | 1158 | 1157  | 1157 | 1164  | 1159 | 327  |
| 175° | 1205 | 1202  | 1200 | 1207  | 1201 | 114  |
| 180° | 1207 | 1207  | 1207 | 1207  | 1207 |      |

TEST NUMBER: P926172

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US950-FLLFLL

**CANDELA DISTRIBUTION (FULL):**

|        | 0°     | 22.5°  | 45°    | 67.5°  | 90°    |
|--------|--------|--------|--------|--------|--------|
| 0°     | 2227.2 | 2227.2 | 2227.2 | 2227.2 | 2227.2 |
| 2.5°   | 2240.2 | 2229.5 | 2205.8 | 2227.2 | 2223.1 |
| 5°     | 2227.2 | 2218.8 | 2195.2 | 2212.2 | 2208.1 |
| 7.5°   | 2212.2 | 2199.5 | 2175.9 | 2193.2 | 2188.9 |
| 10°    | 2188.9 | 2173.9 | 2148.1 | 2165.2 | 2158.8 |
| 12.5°  | 2156.6 | 2143.8 | 2118.2 | 2128.9 | 2124.6 |
| 15°    | 2120.2 | 2107.5 | 2079.5 | 2088.2 | 2077.5 |
| 17.5°  | 2075.2 | 2062.5 | 2034.6 | 2045.2 | 2034.6 |
| 20°    | 2025.9 | 2013.2 | 1983.2 | 1989.6 | 1981.2 |
| 22.5°  | 1976.9 | 1957.5 | 1929.6 | 1929.6 | 1925.3 |
| 25°    | 1918.9 | 1901.9 | 1865.5 | 1869.6 | 1865.5 |
| 27.5°  | 1854.6 | 1839.6 | 1811.8 | 1805.5 | 1794.9 |
| 30°    | 1790.6 | 1773.2 | 1741.2 | 1734.8 | 1726.2 |
| 32.5°  | 1721.9 | 1709.2 | 1674.8 | 1661.9 | 1653.3 |
| 35°    | 1655.6 | 1634.2 | 1599.9 | 1586.9 | 1576.2 |
| 37.5°  | 1580.6 | 1561.2 | 1527.0 | 1511.9 | 1501.2 |
| 40°    | 1503.5 | 1486.2 | 1452.0 | 1432.9 | 1424.2 |
| 42.5°  | 1428.5 | 1411.3 | 1377.2 | 1355.6 | 1342.9 |
| 45°    | 1347.2 | 1332.2 | 1299.9 | 1276.5 | 1267.9 |
| 47.5°  | 1267.9 | 1252.9 | 1218.6 | 1195.0 | 1182.2 |
| 50°    | 1184.3 | 1173.6 | 1143.7 | 1113.6 | 1102.9 |
| 52.5°  | 1102.9 | 1087.9 | 1060.2 | 1036.6 | 1021.6 |
| 55°    | 1019.5 | 1006.6 | 980.9  | 955.2  | 944.6  |
| 57.5°  | 936.0  | 925.3  | 897.3  | 871.7  | 863.0  |
| 60°    | 852.3  | 843.9  | 814.0  | 790.3  | 783.9  |
| 62.5°  | 770.9  | 755.9  | 734.6  | 713.2  | 704.6  |
| 65°    | 687.5  | 674.7  | 653.3  | 633.9  | 623.2  |
| 67.5°  | 601.9  | 591.0  | 571.9  | 556.9  | 548.3  |
| 70°    | 522.6  | 514.0  | 494.6  | 479.7  | 471.3  |
| 72.5°  | 441.2  | 432.6  | 422.0  | 407.0  | 400.6  |
| 75°    | 359.7  | 355.7  | 344.7  | 332.0  | 336.3  |
| 77.5°  | 287.0  | 278.4  | 274.0  | 267.7  | 261.3  |
| 80°    | 214.3  | 212.0  | 207.7  | 201.3  | 197.0  |
| 82.5°  | 145.7  | 145.7  | 143.6  | 135.0  | 135.0  |
| 85°    | 87.7   | 85.7   | 83.6   | 77.0   | 75.0   |
| 87.5°  | 38.6   | 34.3   | 30.0   | 23.7   | 21.4   |
| 90°    | 1.0    | 13.1   | 35.7   | 33.5   | 34.5   |
| 92.5°  | 22.5   | 30.5   | 31.7   | 32.7   | 32.7   |
| 95°    | 53.1   | 63.3   | 65.2   | 65.2   | 63.3   |
| 97.5°  | 88.4   | 97.9   | 101.9  | 101.9  | 101.9  |
| 100°   | 129.2  | 137.6  | 140.4  | 140.4  | 139.4  |
| 102.5° | 172.1  | 178.3  | 182.3  | 183.4  | 182.3  |
| 105°   | 219.0  | 221.9  | 224.1  | 225.9  | 225.9  |
| 107.5° | 265.6  | 270.0  | 270.0  | 270.6  | 265.6  |
| 110°   | 310.7  | 316.5  | 316.5  | 316.5  | 313.7  |

TEST NUMBER: P926172

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US950-FLLFLL

**CANDELA DISTRIBUTION (continued):**

|        | 0°     | 22.5°  | 45°    | 67.5°  | 90°    |
|--------|--------|--------|--------|--------|--------|
| 112.5° | 359.5  | 365.7  | 364.5  | 361.7  | 359.5  |
| 115°   | 407.5  | 413.4  | 411.5  | 410.4  | 407.5  |
| 117.5° | 455.2  | 463.2  | 458.1  | 455.2  | 452.3  |
| 120°   | 503.2  | 511.2  | 503.2  | 503.2  | 499.9  |
| 122.5° | 546.8  | 557.0  | 552.0  | 549.0  | 546.8  |
| 125°   | 592.7  | 601.8  | 598.9  | 595.6  | 594.5  |
| 127.5° | 637.5  | 648.7  | 644.7  | 640.3  | 637.5  |
| 130°   | 679.2  | 692.4  | 690.6  | 688.4  | 684.4  |
| 132.5° | 726.2  | 736.4  | 737.2  | 732.0  | 729.1  |
| 135°   | 766.6  | 777.9  | 780.1  | 778.9  | 776.1  |
| 137.5° | 811.8  | 820.8  | 822.6  | 821.9  | 817.6  |
| 140°   | 851.3  | 860.5  | 865.6  | 865.6  | 861.6  |
| 142.5° | 892.2  | 901.2  | 904.1  | 905.3  | 901.2  |
| 145°   | 930.7  | 938.0  | 943.8  | 944.9  | 940.9  |
| 147.5° | 965.3  | 974.3  | 978.7  | 980.5  | 976.5  |
| 150°   | 1000.9 | 1007.1 | 1011.1 | 1014.4 | 1011.1 |
| 152.5° | 1032.6 | 1038.7 | 1043.9 | 1047.9 | 1043.9 |
| 155°   | 1064.2 | 1067.1 | 1070.4 | 1075.5 | 1072.2 |
| 157.5° | 1091.6 | 1093.7 | 1095.5 | 1102.8 | 1097.7 |
| 160°   | 1115.9 | 1118.1 | 1119.1 | 1125.3 | 1121.0 |
| 162.5° | 1138.4 | 1138.4 | 1139.6 | 1146.4 | 1141.4 |
| 165°   | 1157.8 | 1156.6 | 1156.6 | 1163.9 | 1158.8 |
| 167.5° | 1175.2 | 1171.9 | 1171.9 | 1179.2 | 1174.1 |
| 170°   | 1188.3 | 1185.3 | 1184.3 | 1191.5 | 1185.3 |
| 172.5° | 1197.4 | 1194.5 | 1193.4 | 1200.7 | 1194.5 |
| 175°   | 1204.7 | 1201.8 | 1199.6 | 1206.8 | 1200.7 |
| 177.5° | 1208.7 | 1205.8 | 1203.6 | 1209.8 | 1203.6 |
| 180°   | 1206.8 | 1206.8 | 1206.8 | 1206.8 | 1206.8 |

TEST NUMBER: P926172

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US950-FLLFL

**CIE UGR TABLE:**

| Reflectances:   |      |                  |       |       |       |       |                |       |       |       |       |
|-----------------|------|------------------|-------|-------|-------|-------|----------------|-------|-------|-------|-------|
| Ceiling         |      | 0.7              | 0.7   | 0.5   | 0.5   | 0.3   | 0.7            | 0.7   | 0.5   | 0.5   | 0.3   |
| Wall            |      | 0.5              | 0.3   | 0.5   | 0.3   | 0.3   | 0.5            | 0.3   | 0.5   | 0.3   | 0.3   |
| Reference plane |      | 0.2              | 0.2   | 0.2   | 0.2   | 0.2   | 0.2            | 0.2   | 0.2   | 0.2   | 0.2   |
| Room dimensions |      | Viewed crosswise |       |       |       |       | Viewed endwise |       |       |       |       |
| X=2H            | Y=2H | 13.81            | 14.80 | 14.65 | 15.66 | 16.74 | 13.38          | 14.37 | 14.22 | 15.23 | 16.31 |
|                 | 3H   | 15.45            | 16.34 | 16.31 | 17.21 | 18.32 | 14.99          | 15.88 | 15.84 | 16.75 | 17.86 |
|                 | 4H   | 16.03            | 16.87 | 16.90 | 17.75 | 18.86 | 15.57          | 16.41 | 16.44 | 17.29 | 18.40 |
|                 | 6H   | 16.42            | 17.19 | 17.30 | 18.08 | 19.21 | 15.96          | 16.73 | 16.84 | 17.62 | 18.75 |
|                 | 8H   | 16.52            | 17.26 | 17.41 | 18.16 | 19.29 | 16.06          | 16.80 | 16.95 | 17.70 | 18.83 |
|                 | 12H  | 16.56            | 17.26 | 17.46 | 18.16 | 19.32 | 16.10          | 16.80 | 16.99 | 17.70 | 18.85 |
| 4H              | 2H   | 14.28            | 15.11 | 15.15 | 15.99 | 17.11 | 13.94          | 14.77 | 14.81 | 15.65 | 16.77 |
|                 | 3H   | 16.12            | 16.82 | 17.01 | 17.74 | 18.87 | 15.74          | 16.44 | 16.63 | 17.35 | 18.48 |
|                 | 4H   | 16.83            | 17.46 | 17.72 | 18.37 | 19.53 | 16.43          | 17.07 | 17.33 | 17.98 | 19.13 |
|                 | 6H   | 17.33            | 17.88 | 18.24 | 18.81 | 19.97 | 16.93          | 17.48 | 17.84 | 18.41 | 19.57 |
|                 | 8H   | 17.47            | 17.98 | 18.38 | 18.91 | 20.08 | 17.07          | 17.58 | 17.98 | 18.51 | 19.68 |
|                 | 12H  | 17.54            | 18.00 | 18.47 | 18.94 | 20.12 | 17.13          | 17.59 | 18.06 | 18.54 | 19.72 |
| 8H              | 4H   | 17.02            | 17.54 | 17.94 | 18.46 | 19.63 | 16.67          | 17.19 | 17.58 | 18.11 | 19.28 |
|                 | 6H   | 17.63            | 18.06 | 18.57 | 19.02 | 20.20 | 17.28          | 17.71 | 18.22 | 18.67 | 19.84 |
|                 | 8H   | 17.84            | 18.22 | 18.79 | 19.17 | 20.36 | 17.48          | 17.86 | 18.43 | 18.82 | 20.00 |
|                 | 12H  | 17.96            | 18.29 | 18.91 | 19.24 | 20.48 | 17.59          | 17.92 | 18.54 | 18.87 | 20.11 |
| 12H             | 4H   | 17.01            | 17.48 | 17.95 | 18.42 | 19.60 | 16.67          | 17.13 | 17.60 | 18.08 | 19.25 |
|                 | 6H   | 17.66            | 18.04 | 18.61 | 18.99 | 20.18 | 17.32          | 17.69 | 18.27 | 18.65 | 19.84 |
|                 | 8H   | 17.89            | 18.22 | 18.84 | 19.17 | 20.41 | 17.54          | 17.87 | 18.50 | 18.83 | 20.06 |