

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926173

Luminaire Tested: DFN2DIP-TR2F0-060D040US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926173
REPORT IS A COMBINATION OF REPORTS P901769 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-060D040US950-FLLONL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9043.9 lumens
Efficiency: N/A
Efficacy: 101.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 88.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926173

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US950-FLLONL

Luminous Intensity Polar Plot

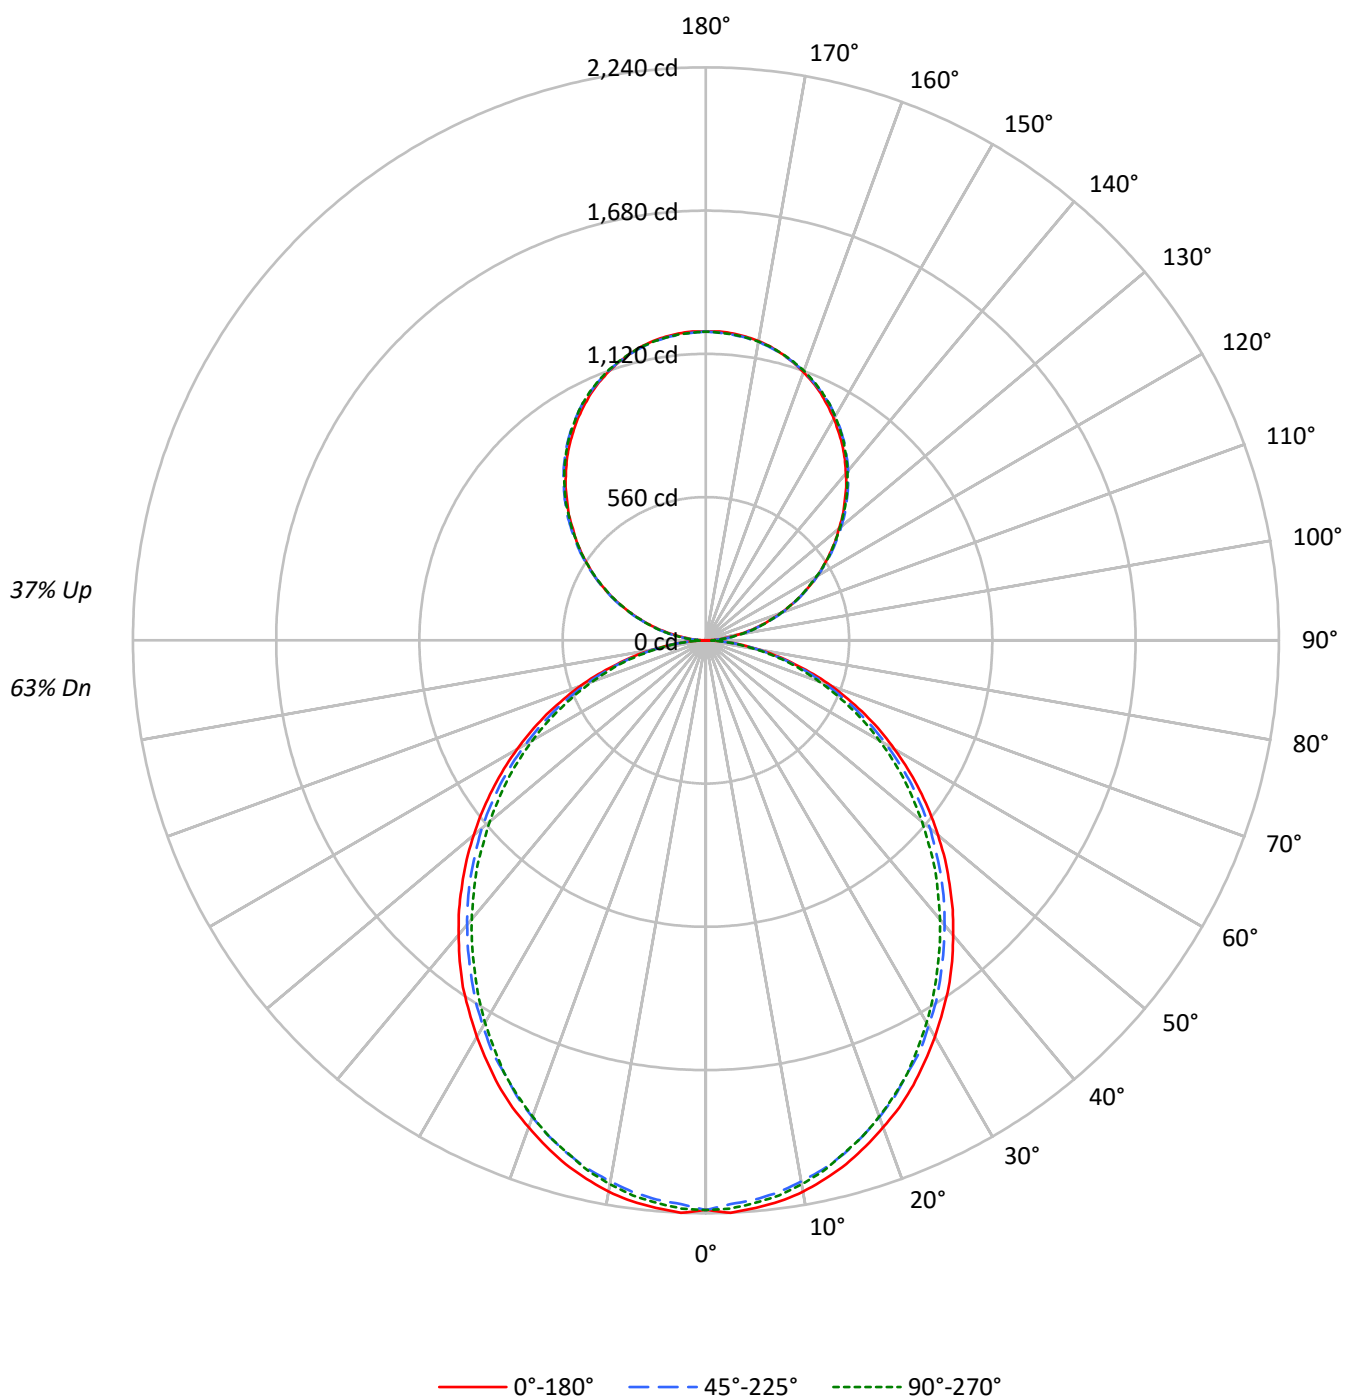

TEST NUMBER: P926173

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	79	79	79	68	68	68
1	101	96	92	89	94	90	87	84	79	77	74	69	67	66	60	59	57
2	92	84	78	72	86	79	73	69	70	65	62	61	58	55	53	50	48
3	84	74	66	60	78	70	63	58	61	56	52	54	50	46	47	44	41
4	77	66	57	51	71	62	54	49	55	49	44	48	43	40	42	38	35
5	70	58	50	44	66	55	48	42	49	43	38	43	38	35	38	34	31
6	65	53	44	38	61	50	42	37	44	38	33	39	34	30	34	30	27
7	60	48	39	34	56	45	38	32	40	34	30	36	31	27	31	27	24
8	56	43	35	30	52	41	34	29	37	31	26	33	28	24	29	25	22
9	52	40	32	27	49	38	30	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	35	28	23	31	25	21	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4968	4968	4968
5°	4968	4887	4923
10°	4921	4810	4848
15°	4841	4720	4735
20°	4736	4599	4620
25°	4631	4457	4489
30°	4502	4323	4324
35°	4378	4168	4150
40°	4227	4010	3983
45°	4077	3852	3813
50°	3912	3685	3616
55°	3738	3492	3433
60°	3542	3266	3224
65°	3326	3029	2977
70°	3053	2740	2709
75°	2677	2394	2451
80°	2219	1953	1981
85°	1512	1231	1231

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4077 cd/sqm

TEST NUMBER: P926173

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	209.6	2.3
10°-20°	589.8	6.5
20°-30°	866.8	9.6
30°-40°	1006.7	11.1
40°-50°	1005.5	11.1
50°-60°	876.7	9.7
60°-70°	648.1	7.2
70°-80°	366.7	4.1
80°-90°	100.2	1.1
90°-100°	74.7	0.8
100°-110°	237.3	2.6
110°-120°	406.1	4.5
120°-130°	534.0	5.9
130°-140°	599.4	6.6
140°-150°	587.8	6.5
150°-160°	493.1	5.5
160°-170°	327.0	3.6
170°-180°	114.3	1.3
0°-30°	1666.2	18.4
0°-40°	2673.0	29.6
0°-60°	4555.2	50.4
0°-90°	5670.2	62.7
90°-120°	718.0	7.9
90°-150°	2439.3	27.0
90°-180°	3374.0	37.3
0°-180°	9043.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2227	2227	2227	2227	2227	
5°	2227	2219	2195	2212	2208	211
15°	2120	2108	2080	2088	2078	597
25°	1919	1902	1866	1870	1866	883
35°	1656	1634	1600	1587	1576	1034
45°	1347	1332	1300	1276	1268	1040
55°	1020	1007	981	955	945	912
65°	688	675	653	634	623	680
75°	360	356	345	332	336	384
85°	88	86	84	77	75	98
90°	1	13	36	34	34	9
95°	53	63	65	65	63	59
105°	219	222	224	226	226	231
115°	408	413	412	410	408	403
125°	593	602	599	596	594	530
135°	767	778	780	779	776	593
145°	931	938	944	945	941	582
155°	1064	1067	1070	1076	1072	490
165°	1158	1157	1157	1164	1159	327
175°	1205	1202	1200	1207	1201	114
180°	1207	1207	1207	1207	1207	

TEST NUMBER: P926173

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2227.2	2227.2	2227.2	2227.2	2227.2
2.5°	2240.2	2229.5	2205.8	2227.2	2223.1
5°	2227.2	2218.8	2195.2	2212.2	2208.1
7.5°	2212.2	2199.5	2175.9	2193.2	2188.9
10°	2188.9	2173.9	2148.1	2165.2	2158.8
12.5°	2156.6	2143.8	2118.2	2128.9	2124.6
15°	2120.2	2107.5	2079.5	2088.2	2077.5
17.5°	2075.2	2062.5	2034.6	2045.2	2034.6
20°	2025.9	2013.2	1983.2	1989.6	1981.2
22.5°	1976.9	1957.5	1929.6	1929.6	1925.3
25°	1918.9	1901.9	1865.5	1869.6	1865.5
27.5°	1854.6	1839.6	1811.8	1805.5	1794.9
30°	1790.6	1773.2	1741.2	1734.8	1726.2
32.5°	1721.9	1709.2	1674.8	1661.9	1653.3
35°	1655.6	1634.2	1599.9	1586.9	1576.2
37.5°	1580.6	1561.2	1527.0	1511.9	1501.2
40°	1503.5	1486.2	1452.0	1432.9	1424.2
42.5°	1428.5	1411.3	1377.2	1355.6	1342.9
45°	1347.2	1332.2	1299.9	1276.5	1267.9
47.5°	1267.9	1252.9	1218.6	1195.0	1182.2
50°	1184.3	1173.6	1143.7	1113.6	1102.9
52.5°	1102.9	1087.9	1060.2	1036.6	1021.6
55°	1019.5	1006.6	980.9	955.2	944.6
57.5°	936.0	925.3	897.3	871.7	863.0
60°	852.3	843.9	814.0	790.3	783.9
62.5°	770.9	755.9	734.6	713.2	704.6
65°	687.5	674.7	653.3	633.9	623.2
67.5°	601.9	591.0	571.9	556.9	548.3
70°	522.6	514.0	494.6	479.7	471.3
72.5°	441.2	432.6	422.0	407.0	400.6
75°	359.7	355.7	344.7	332.0	336.3
77.5°	287.0	278.4	274.0	267.7	261.3
80°	214.3	212.0	207.7	201.3	197.0
82.5°	145.7	145.7	143.6	135.0	135.0
85°	87.7	85.7	83.6	77.0	75.0
87.5°	38.6	34.3	30.0	23.7	21.4
90°	1.0	13.1	35.7	33.5	34.5
92.5°	22.5	30.5	31.7	32.7	32.7
95°	53.1	63.3	65.2	65.2	63.3
97.5°	88.4	97.9	101.9	101.9	101.9
100°	129.2	137.6	140.4	140.4	139.4
102.5°	172.1	178.3	182.3	183.4	182.3
105°	219.0	221.9	224.1	225.9	225.9
107.5°	265.6	270.0	270.0	270.6	265.6
110°	310.7	316.5	316.5	316.5	313.7



TEST NUMBER: P926173

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	359.5	365.7	364.5	361.7	359.5
115°	407.5	413.4	411.5	410.4	407.5
117.5°	455.2	463.2	458.1	455.2	452.3
120°	503.2	511.2	503.2	503.2	499.9
122.5°	546.8	557.0	552.0	549.0	546.8
125°	592.7	601.8	598.9	595.6	594.5
127.5°	637.5	648.7	644.7	640.3	637.5
130°	679.2	692.4	690.6	688.4	684.4
132.5°	726.2	736.4	737.2	732.0	729.1
135°	766.6	777.9	780.1	778.9	776.1
137.5°	811.8	820.8	822.6	821.9	817.6
140°	851.3	860.5	865.6	865.6	861.6
142.5°	892.2	901.2	904.1	905.3	901.2
145°	930.7	938.0	943.8	944.9	940.9
147.5°	965.3	974.3	978.7	980.5	976.5
150°	1000.9	1007.1	1011.1	1014.4	1011.1
152.5°	1032.6	1038.7	1043.9	1047.9	1043.9
155°	1064.2	1067.1	1070.4	1075.5	1072.2
157.5°	1091.6	1093.7	1095.5	1102.8	1097.7
160°	1115.9	1118.1	1119.1	1125.3	1121.0
162.5°	1138.4	1138.4	1139.6	1146.4	1141.4
165°	1157.8	1156.6	1156.6	1163.9	1158.8
167.5°	1175.2	1171.9	1171.9	1179.2	1174.1
170°	1188.3	1185.3	1184.3	1191.5	1185.3
172.5°	1197.4	1194.5	1193.4	1200.7	1194.5
175°	1204.7	1201.8	1199.6	1206.8	1200.7
177.5°	1208.7	1205.8	1203.6	1209.8	1203.6
180°	1206.8	1206.8	1206.8	1206.8	1206.8

TEST NUMBER: P926173

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US950-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.81	14.80	14.65	15.66	16.74	13.38	14.37	14.22	15.23	16.31
	3H	15.45	16.34	16.31	17.21	18.32	14.99	15.88	15.84	16.75	17.86
	4H	16.03	16.87	16.90	17.75	18.86	15.57	16.41	16.44	17.29	18.40
	6H	16.42	17.19	17.30	18.08	19.21	15.96	16.73	16.84	17.62	18.75
	8H	16.52	17.26	17.41	18.16	19.29	16.06	16.80	16.95	17.70	18.83
	12H	16.56	17.26	17.46	18.16	19.32	16.10	16.80	16.99	17.70	18.85
4H	2H	14.28	15.11	15.15	15.99	17.11	13.94	14.77	14.81	15.65	16.77
	3H	16.12	16.82	17.01	17.74	18.87	15.74	16.44	16.63	17.35	18.48
	4H	16.83	17.46	17.72	18.37	19.53	16.43	17.07	17.33	17.98	19.13
	6H	17.33	17.88	18.24	18.81	19.97	16.93	17.48	17.84	18.41	19.57
	8H	17.47	17.98	18.38	18.91	20.08	17.07	17.58	17.98	18.51	19.68
	12H	17.54	18.00	18.47	18.94	20.12	17.13	17.59	18.06	18.54	19.72
8H	4H	17.02	17.54	17.94	18.46	19.63	16.67	17.19	17.58	18.11	19.28
	6H	17.63	18.06	18.57	19.02	20.20	17.28	17.71	18.22	18.67	19.84
	8H	17.84	18.22	18.79	19.17	20.36	17.48	17.86	18.43	18.82	20.00
	12H	17.96	18.29	18.91	19.24	20.48	17.59	17.92	18.54	18.87	20.11
12H	4H	17.01	17.48	17.95	18.42	19.60	16.67	17.13	17.60	18.08	19.25
	6H	17.66	18.04	18.61	18.99	20.18	17.32	17.69	18.27	18.65	19.84
	8H	17.89	18.22	18.84	19.17	20.41	17.54	17.87	18.50	18.83	20.06

END OF REPORT