

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904412

Luminaire Tested: DFN2DIP-TR3F0-050D030US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904412
REPORT IS A COMBINATION OF REPORTS P900275 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-050D030US830-FLLFLL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7168.0 lumens
Efficiency: N/A
Efficacy: 105.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 68.1
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904412

CATALOG NUMBER: DFN2DIP-TR3F0-050D030US830-FLLFLL

Luminous Intensity Polar Plot

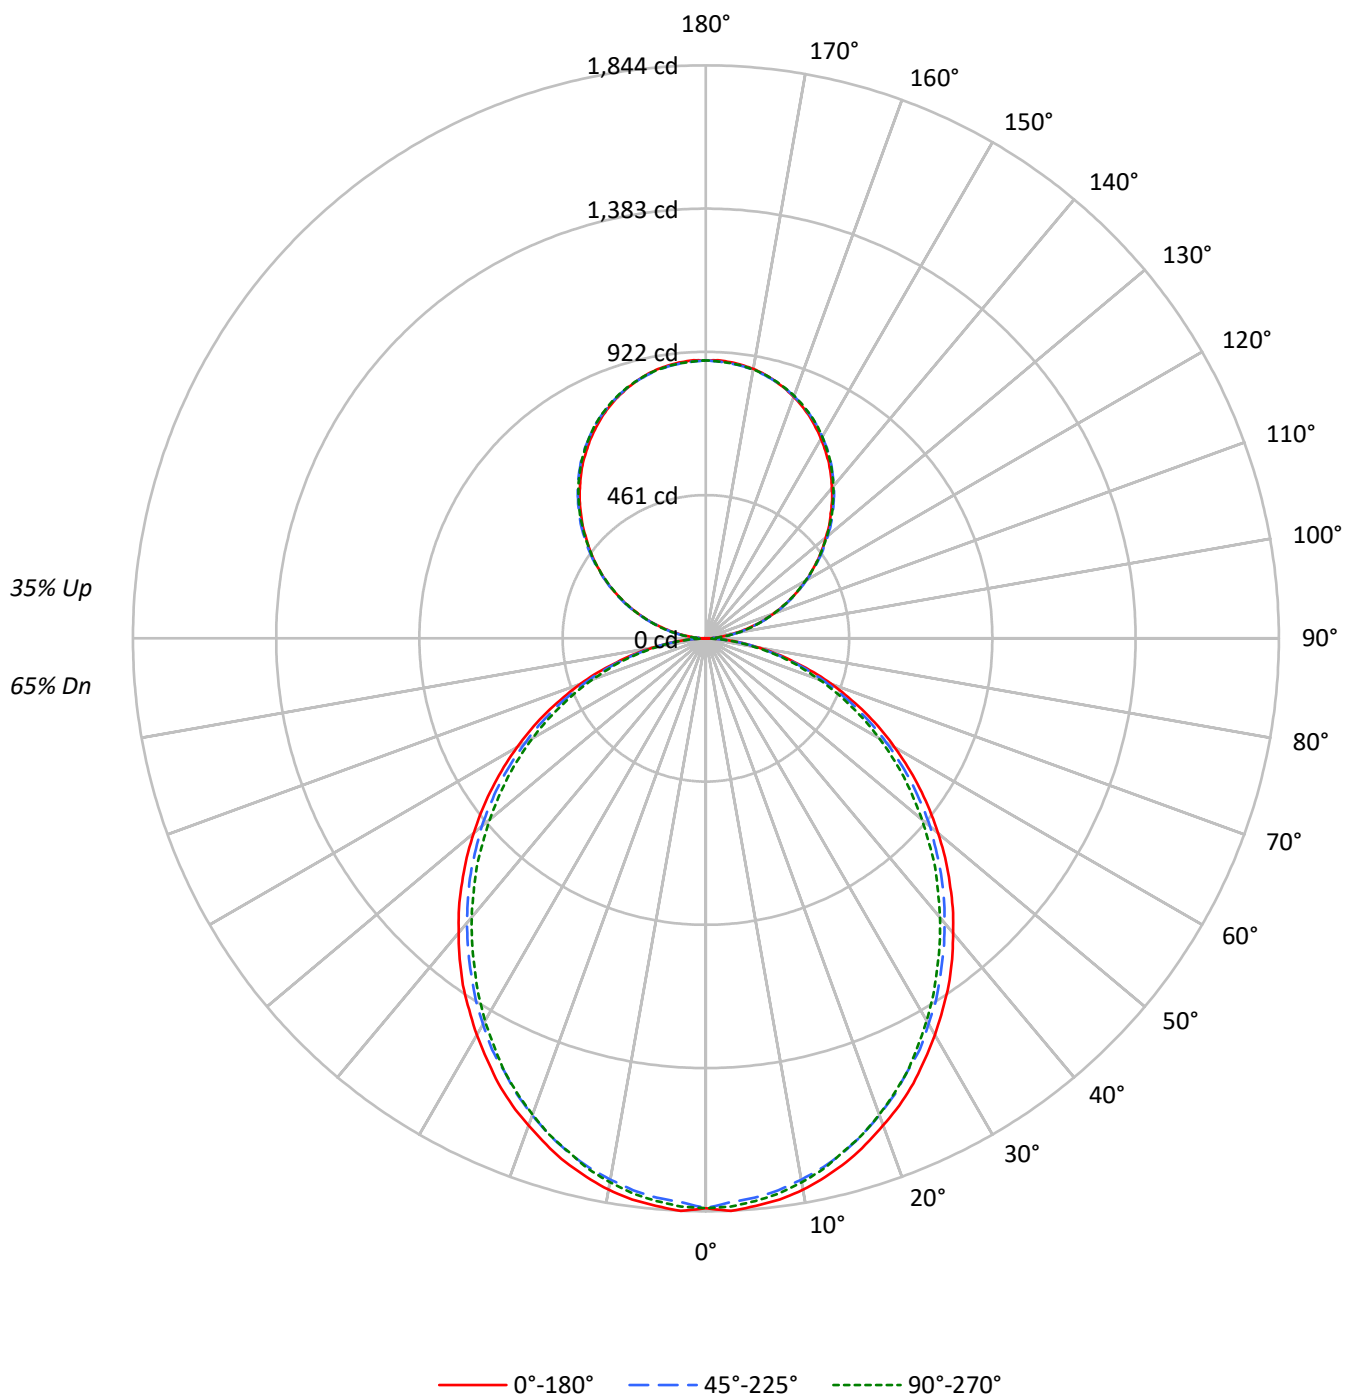

TEST NUMBER: P904412

CATALOG NUMBER: DFN2DIP-TR3F0-050D030US830-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	80	80	80	70	70	70
1	101	97	93	89	95	91	88	84	81	78	75	71	69	67	62	60	59
2	92	85	78	73	86	80	74	69	71	66	63	62	59	56	55	52	50
3	84	74	67	61	79	70	63	58	62	57	53	55	51	47	48	45	42
4	77	66	58	52	72	62	55	49	55	50	45	49	44	41	43	40	37
5	71	59	50	44	66	56	48	42	50	44	39	44	39	35	39	35	32
6	65	53	45	39	61	50	43	37	45	39	34	40	35	31	35	31	28
7	60	48	40	34	57	45	38	33	41	35	30	36	31	28	32	28	25
8	56	44	36	30	53	41	34	29	37	31	27	33	28	25	30	26	22
9	52	40	32	27	49	38	31	26	34	28	24	31	26	22	27	23	20
10	49	37	29	24	46	35	28	23	32	26	22	28	24	20	25	21	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2285	2285	2285
5°	2287	2251	2267
10°	2268	2219	2235
15°	2233	2181	2185
20°	2187	2128	2135
25°	2141	2065	2076
30°	2083	2007	2003
35°	2028	1938	1925
40°	1962	1869	1851
45°	1895	1799	1775
50°	1822	1726	1687
55°	1745	1641	1606
60°	1658	1541	1513
65°	1563	1437	1403
70°	1442	1310	1285
75°	1275	1158	1173
80°	1073	963	964
85°	758	634	622

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1895 cd/sqm

TEST NUMBER: P904412

CATALOG NUMBER: DFN2DIP-TR3F0-050D030US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	172.6	2.4
10°-20°	485.6	6.8
20°-30°	713.7	10.0
30°-40°	828.9	11.6
40°-50°	827.8	11.5
50°-60°	721.8	10.1
60°-70°	533.6	7.4
70°-80°	301.9	4.2
80°-90°	82.2	1.1
90°-100°	55.3	0.8
100°-110°	175.8	2.5
110°-120°	300.9	4.2
120°-130°	395.7	5.5
130°-140°	444.2	6.2
140°-150°	435.6	6.1
150°-160°	365.4	5.1
160°-170°	242.3	3.4
170°-180°	84.7	1.2
0°-30°	1371.9	19.1
0°-40°	2200.7	30.7
0°-60°	3750.4	52.3
0°-90°	4668.1	65.1
90°-120°	532.1	7.4
90°-150°	1807.5	25.2
90°-180°	2500.0	34.9
0°-180°	7168.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1834	1834	1834	1834	1834	
5°	1834	1827	1807	1821	1818	174
15°	1746	1735	1712	1719	1710	492
25°	1580	1566	1536	1539	1536	727
35°	1363	1346	1317	1307	1298	851
45°	1109	1097	1070	1051	1044	856
55°	839	829	808	786	778	750
65°	566	555	538	522	513	560
75°	296	293	284	273	277	316
85°	72	70	69	63	62	81
90°	1	10	26	25	26	7
95°	39	47	48	48	47	44
105°	162	164	166	167	167	171
115°	302	306	305	304	302	299
125°	439	446	444	441	440	392
135°	568	576	578	577	575	439
145°	690	695	699	700	697	431
155°	789	791	793	797	795	363
165°	858	857	857	862	859	242
175°	893	890	889	894	890	85
180°	894	894	894	894	894	



TEST NUMBER: P904412

CATALOG NUMBER: DFN2DIP-TR3F0-050D030US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1833.7	1833.7	1833.7	1833.7	1833.7
2.5°	1844.4	1835.6	1816.2	1833.7	1830.4
5°	1833.7	1826.8	1807.3	1821.4	1818.1
7.5°	1821.4	1810.9	1791.5	1805.7	1802.1
10°	1802.1	1789.8	1768.7	1782.6	1777.4
12.5°	1775.6	1765.1	1744.0	1752.8	1749.2
15°	1745.6	1735.1	1712.1	1719.3	1710.4
17.5°	1708.5	1698.1	1675.1	1683.9	1675.1
20°	1668.0	1657.6	1632.9	1638.0	1631.2
22.5°	1627.6	1611.7	1588.7	1588.7	1585.1
25°	1579.9	1565.8	1535.9	1539.3	1535.9
27.5°	1526.9	1514.6	1491.8	1486.5	1477.7
30°	1474.1	1460.0	1433.6	1428.3	1421.3
32.5°	1417.7	1407.2	1378.9	1368.3	1361.2
35°	1363.0	1345.5	1317.2	1306.6	1297.8
37.5°	1301.3	1285.4	1257.2	1244.8	1236.0
40°	1237.9	1223.7	1195.4	1179.7	1172.6
42.5°	1176.2	1162.0	1133.9	1116.1	1105.6
45°	1109.2	1096.8	1070.3	1051.0	1043.9
47.5°	1043.9	1031.5	1003.3	983.8	973.4
50°	975.1	966.3	941.6	916.9	908.0
52.5°	908.0	895.7	872.9	853.5	841.1
55°	839.4	828.8	807.6	786.5	777.7
57.5°	770.5	761.8	738.8	717.7	710.5
60°	701.7	694.8	670.1	650.6	645.5
62.5°	634.8	622.5	604.8	587.2	580.1
65°	566.1	555.4	537.8	522.0	513.1
67.5°	495.6	486.6	470.9	458.5	451.4
70°	430.3	423.2	407.3	394.9	388.0
72.5°	363.4	356.2	347.4	335.1	329.8
75°	296.1	292.8	283.8	273.3	276.9
77.5°	236.3	229.1	225.6	220.4	215.2
80°	176.4	174.6	171.0	165.8	162.2
82.5°	119.9	119.9	118.2	111.1	111.1
85°	72.2	70.5	68.8	63.4	61.7
87.5°	31.8	28.3	24.7	19.4	17.6
90°	0.8	9.7	26.4	24.8	25.6
92.5°	16.7	22.6	23.5	24.2	24.2
95°	39.4	46.9	48.3	48.3	46.9
97.5°	65.5	72.5	75.5	75.5	75.5
100°	95.7	101.9	104.1	104.1	103.3
102.5°	127.5	132.1	135.1	135.9	135.1
105°	162.3	164.5	166.1	167.4	167.4
107.5°	196.8	200.0	200.0	200.6	196.8
110°	230.3	234.6	234.6	234.6	232.4



TEST NUMBER: P904412

CATALOG NUMBER: DFN2DIP-TR3F0-050D030US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	266.4	271.0	270.1	268.0	266.4
115°	302.0	306.2	304.9	304.2	302.0
117.5°	337.2	343.2	339.4	337.2	335.1
120°	372.9	378.8	372.9	372.9	370.4
122.5°	405.2	412.7	409.0	406.8	405.2
125°	439.2	445.9	443.7	441.3	440.5
127.5°	472.3	480.7	477.8	474.5	472.3
130°	503.3	513.0	511.7	510.1	507.1
132.5°	538.1	545.6	546.2	542.4	540.3
135°	568.1	576.4	578.1	577.2	575.0
137.5°	601.4	608.2	609.5	609.1	605.8
140°	630.8	637.6	641.4	641.4	638.4
142.5°	661.1	667.8	670.0	670.8	667.8
145°	689.7	695.0	699.4	700.1	697.2
147.5°	715.3	722.0	725.2	726.6	723.6
150°	741.7	746.3	749.2	751.7	749.2
152.5°	765.2	769.7	773.5	776.5	773.5
155°	788.6	790.7	793.1	796.9	794.6
157.5°	808.8	810.4	811.8	817.2	813.4
160°	826.9	828.5	829.3	833.9	830.7
162.5°	843.6	843.6	844.4	849.5	845.7
165°	857.9	857.1	857.1	862.4	858.7
167.5°	870.8	868.4	868.4	873.7	870.0
170°	880.5	878.4	877.6	883.0	878.4
172.5°	887.2	885.1	884.3	889.7	885.1
175°	892.7	890.5	888.9	894.3	889.7
177.5°	895.6	893.4	891.8	896.5	891.8
180°	894.3	894.3	894.3	894.3	894.3

TEST NUMBER: P904412

CATALOG NUMBER: DFN2DIP-TR3F0-050D030US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.38	12.40	12.20	13.23	14.27	10.95	11.97	11.77	12.81	13.84
	3H	13.04	13.96	13.87	14.80	15.87	12.57	13.49	13.40	14.33	15.40
	4H	13.63	14.49	14.48	15.35	16.42	13.16	14.03	14.01	14.88	15.96
	6H	14.03	14.83	14.89	15.69	16.78	13.56	14.36	14.42	15.22	16.31
	8H	14.14	14.89	15.00	15.78	16.87	13.67	14.43	14.54	15.31	16.40
	12H	14.19	14.91	15.06	15.78	16.90	13.71	14.44	14.59	15.31	16.43
4H	2H	11.86	12.72	12.71	13.57	14.65	11.51	12.38	12.36	13.23	14.31
	3H	13.73	14.45	14.59	15.33	16.43	13.34	14.06	14.20	14.94	16.04
	4H	14.44	15.10	15.31	15.98	17.10	14.04	14.69	14.91	15.58	16.70
	6H	14.95	15.52	15.84	16.43	17.55	14.55	15.12	15.44	16.03	17.15
	8H	15.10	15.63	15.99	16.54	17.67	14.70	15.23	15.59	16.13	17.26
	12H	15.18	15.66	16.09	16.58	17.72	14.76	15.24	15.68	16.16	17.30
8H	4H	14.64	15.17	15.54	16.08	17.21	14.29	14.82	15.18	15.72	16.86
	6H	15.27	15.71	16.19	16.65	17.79	14.91	15.35	15.83	16.30	17.43
	8H	15.49	15.88	16.42	16.81	17.96	15.12	15.51	16.05	16.45	17.60
	12H	15.62	15.96	16.55	16.89	18.09	15.24	15.58	16.17	16.51	17.72
12H	4H	14.64	15.11	15.55	16.04	17.18	14.29	14.77	15.20	15.69	16.83
	6H	15.30	15.69	16.23	16.63	17.78	14.95	15.34	15.88	16.28	17.43
	8H	15.54	15.89	16.48	16.81	18.02	15.19	15.53	16.12	16.46	17.66

END OF REPORT