

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904442

Luminaire Tested: DFN2DIP-TR3F0-060D040US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904442
REPORT IS A COMBINATION OF REPORTS P900291 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-060D040US830-FLLFLL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8935.3 lumens
Efficiency: N/A
Efficacy: 102.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 86.9
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904442

CATALOG NUMBER: DFN2DIP-TR3F0-060D040US830-FLLFLL

Luminous Intensity Polar Plot

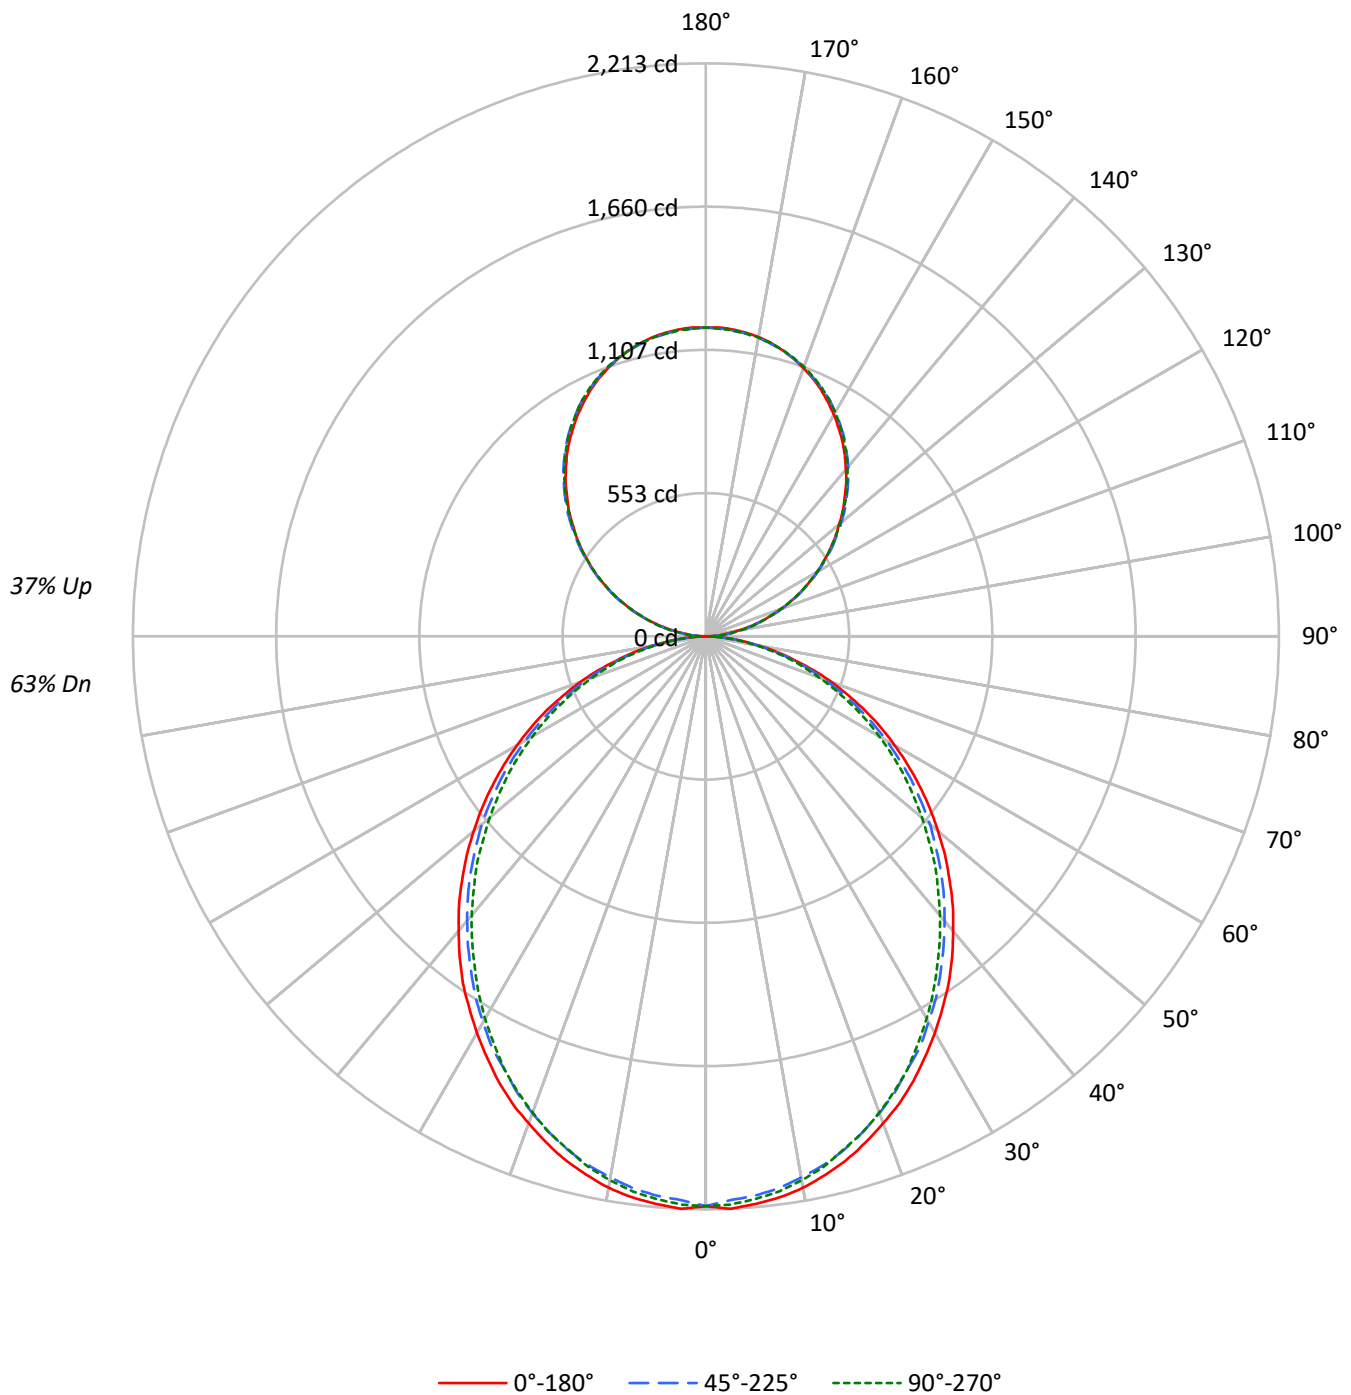

TEST NUMBER: P904442

CATALOG NUMBER: DFN2DIP-TR3F0-060D040US830-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	79	79	79	68	68	68
1	101	96	92	89	94	90	87	84	79	77	74	69	67	66	60	59	57
2	92	84	78	72	86	79	73	69	70	65	62	61	58	55	53	50	48
3	84	74	66	60	78	70	63	58	61	56	52	54	50	46	47	44	41
4	77	66	57	51	71	62	54	49	55	49	44	48	43	40	42	38	35
5	70	58	50	44	66	55	48	42	49	43	38	43	38	35	38	34	31
6	65	53	44	38	61	50	42	37	44	38	33	39	34	30	34	30	27
7	60	48	39	34	56	45	38	32	40	34	30	36	31	27	31	27	24
8	56	43	35	30	52	41	34	29	37	31	26	33	28	24	29	25	22
9	52	40	32	27	49	38	30	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	35	28	23	31	25	21	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2742	2742	2742
5°	2745	2701	2720
10°	2721	2663	2682
15°	2680	2617	2622
20°	2624	2553	2562
25°	2569	2478	2492
30°	2500	2408	2403
35°	2434	2326	2310
40°	2354	2243	2221
45°	2274	2159	2130
50°	2186	2071	2024
55°	2094	1970	1927
60°	1990	1850	1815
65°	1876	1725	1684
70°	1731	1572	1541
75°	1530	1389	1407
80°	1288	1156	1157
85°	909	761	747

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2274 cd/sqm

TEST NUMBER: P904442

CATALOG NUMBER: DFN2DIP-TR3F0-060D040US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.1	2.3
10°-20°	582.7	6.5
20°-30°	856.4	9.6
30°-40°	994.6	11.1
40°-50°	993.4	11.1
50°-60°	866.2	9.7
60°-70°	640.3	7.2
70°-80°	362.3	4.1
80°-90°	99.0	1.1
90°-100°	73.8	0.8
100°-110°	234.4	2.6
110°-120°	401.2	4.5
120°-130°	527.6	5.9
130°-140°	592.2	6.6
140°-150°	580.8	6.5
150°-160°	487.2	5.5
160°-170°	323.1	3.6
170°-180°	112.9	1.3
0°-30°	1646.2	18.4
0°-40°	2640.9	29.6
0°-60°	4500.5	50.4
0°-90°	5602.1	62.7
90°-120°	709.4	7.9
90°-150°	2410.0	27.0
90°-180°	3333.0	37.3
0°-180°	8935.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2200	2200	2200	2200	2200	
5°	2200	2192	2169	2186	2182	209
15°	2095	2082	2055	2063	2053	590
25°	1896	1879	1843	1847	1843	872
35°	1636	1615	1581	1568	1557	1021
45°	1331	1316	1284	1261	1253	1027
55°	1007	994	969	944	933	901
65°	679	667	646	626	616	672
75°	355	351	340	328	332	379
85°	87	85	83	76	74	97
90°	1	13	35	33	34	9
95°	52	63	64	64	63	58
105°	216	219	221	223	223	228
115°	403	408	406	406	403	398
125°	586	595	592	588	587	523
135°	757	768	771	770	767	585
145°	920	927	932	934	930	575
155°	1051	1054	1058	1063	1059	484
165°	1144	1143	1143	1150	1145	323
175°	1190	1187	1185	1192	1186	113
180°	1192	1192	1192	1192	1192	

TEST NUMBER: P904442

CATALOG NUMBER: DFN2DIP-TR3F0-060D040US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2200.5	2200.5	2200.5	2200.5	2200.5
2.5°	2213.3	2202.7	2179.3	2200.5	2196.4
5°	2200.5	2192.2	2168.8	2185.7	2181.6
7.5°	2185.7	2173.1	2149.8	2166.8	2162.6
10°	2162.6	2147.8	2122.3	2139.2	2132.9
12.5°	2130.7	2118.1	2092.7	2103.3	2099.0
15°	2094.7	2082.2	2054.6	2063.1	2052.6
17.5°	2050.3	2037.8	2010.2	2020.6	2010.2
20°	2001.6	1989.0	1959.4	1965.7	1957.4
22.5°	1953.1	1934.0	1906.4	1906.4	1902.1
25°	1895.8	1879.1	1843.0	1847.1	1843.0
27.5°	1832.3	1817.5	1790.1	1783.9	1773.3
30°	1769.1	1751.9	1720.3	1714.0	1705.4
32.5°	1701.2	1688.7	1654.7	1641.9	1633.4
35°	1635.7	1614.6	1580.6	1567.8	1557.3
37.5°	1561.6	1542.5	1508.6	1493.7	1483.2
40°	1485.4	1468.4	1434.5	1415.7	1407.1
42.5°	1411.4	1394.3	1360.7	1339.4	1326.7
45°	1331.1	1316.2	1284.3	1261.2	1252.6
47.5°	1252.6	1237.8	1204.0	1180.6	1168.0
50°	1170.1	1159.5	1129.9	1100.2	1089.7
52.5°	1089.7	1074.9	1047.4	1024.2	1009.4
55°	1007.3	994.5	969.1	943.8	933.2
57.5°	924.7	914.2	886.6	861.2	852.6
60°	842.1	833.8	804.2	780.8	774.5
62.5°	761.7	746.9	725.8	704.6	696.2
65°	679.3	666.6	645.5	626.3	615.8
67.5°	594.6	583.9	565.1	550.3	541.7
70°	516.3	507.8	488.7	473.9	465.6
72.5°	435.9	427.4	416.9	402.1	395.8
75°	355.3	351.4	340.5	328.0	332.2
77.5°	283.5	275.0	270.7	264.5	258.2
80°	211.7	209.4	205.2	198.9	194.6
82.5°	143.9	143.9	141.9	133.4	133.4
85°	86.6	84.6	82.6	76.1	74.1
87.5°	38.2	33.9	29.6	23.4	21.1
90°	1.0	12.9	35.3	33.1	34.1
92.5°	22.2	30.2	31.3	32.3	32.3
95°	52.5	62.6	64.4	64.4	62.6
97.5°	87.4	96.7	100.7	100.7	100.7
100°	127.6	135.9	138.7	138.7	137.7
102.5°	170.0	176.2	180.1	181.2	180.1
105°	216.4	219.2	221.4	223.2	223.2
107.5°	262.4	266.7	266.7	267.4	262.4
110°	307.0	312.7	312.7	312.7	309.9

TEST NUMBER: P904442

CATALOG NUMBER: DFN2DIP-TR3F0-060D040US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	355.1	361.3	360.1	357.3	355.1
115°	402.6	408.4	406.5	405.5	402.6
117.5°	449.7	457.6	452.6	449.7	446.9
120°	497.2	505.0	497.2	497.2	493.9
122.5°	540.3	550.4	545.4	542.4	540.3
125°	585.6	594.6	591.7	588.4	587.4
127.5°	629.8	640.9	637.0	632.6	629.8
130°	671.1	684.1	682.3	680.1	676.2
132.5°	717.5	727.5	728.3	723.2	720.4
135°	757.4	768.5	770.7	769.6	766.8
137.5°	802.0	811.0	812.8	812.0	807.8
140°	841.1	850.2	855.2	855.2	851.2
142.5°	881.5	890.4	893.2	894.4	890.4
145°	919.5	926.7	932.5	933.6	929.6
147.5°	953.7	962.6	967.0	968.7	964.8
150°	988.9	995.0	999.0	1002.2	999.0
152.5°	1020.2	1026.2	1031.3	1035.3	1031.3
155°	1051.4	1054.3	1057.5	1062.6	1059.3
157.5°	1078.5	1080.5	1082.3	1089.6	1084.5
160°	1102.5	1104.7	1105.7	1111.8	1107.5
162.5°	1124.7	1124.7	1125.9	1132.7	1127.7
165°	1143.9	1142.7	1142.7	1149.9	1144.9
167.5°	1161.1	1157.8	1157.8	1165.1	1160.0
170°	1174.0	1171.1	1170.1	1177.2	1171.1
172.5°	1183.0	1180.2	1179.0	1186.3	1180.2
175°	1190.2	1187.3	1185.2	1192.3	1186.3
177.5°	1194.2	1191.3	1189.1	1195.2	1189.1
180°	1192.3	1192.3	1192.3	1192.3	1192.3

TEST NUMBER: P904442

CATALOG NUMBER: DFN2DIP-TR3F0-060D040US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.82	12.81	12.66	13.67	14.75	11.39	12.38	12.23	13.24	14.32
	3H	13.48	14.37	14.33	15.24	16.34	13.01	13.90	13.86	14.77	15.88
	4H	14.07	14.91	14.94	15.78	16.90	13.60	14.44	14.47	15.32	16.43
	6H	14.47	15.24	15.35	16.12	17.25	14.00	14.77	14.88	15.66	16.78
	8H	14.57	15.31	15.46	16.21	17.34	14.10	14.84	14.99	15.74	16.87
	12H	14.62	15.32	15.51	16.22	17.37	14.15	14.85	15.04	15.75	16.90
4H	2H	12.29	13.13	13.17	14.01	15.12	11.95	12.79	12.82	13.67	14.78
	3H	14.16	14.86	15.04	15.77	16.90	13.77	14.47	14.66	15.38	16.51
	4H	14.87	15.51	15.77	16.42	17.57	14.47	15.11	15.37	16.02	17.17
	6H	15.38	15.94	16.30	16.87	18.03	14.98	15.53	15.89	16.46	17.62
	8H	15.53	16.05	16.45	16.97	18.14	15.13	15.64	16.04	16.57	17.74
	12H	15.61	16.07	16.54	17.02	18.19	15.19	15.66	16.13	16.60	17.78
8H	4H	15.07	15.59	15.99	16.51	17.69	14.72	15.23	15.63	16.16	17.33
	6H	15.70	16.13	16.64	17.09	18.26	15.34	15.77	16.28	16.73	17.91
	8H	15.92	16.29	16.87	17.25	18.44	15.55	15.93	16.50	16.89	18.08
	12H	16.05	16.38	17.00	17.33	18.57	15.67	16.00	16.62	16.95	18.19
12H	4H	15.07	15.53	16.00	16.47	17.65	14.72	15.18	15.65	16.12	17.30
	6H	15.73	16.11	16.68	17.06	18.25	15.38	15.76	16.33	16.72	17.91
	8H	15.97	16.30	16.92	17.25	18.49	15.62	15.95	16.57	16.90	18.14