

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904464

Luminaire Tested: DFN2DIP-TR3F0-070D030US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904464
REPORT IS A COMBINATION OF REPORTS P900279 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-070D030US830-FLLFLL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9034.3 lumens
Efficiency: N/A
Efficacy: 97.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 92.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904464

CATALOG NUMBER: DFN2DIP-TR3F0-070D030US830-FLLFLL

Luminous Intensity Polar Plot

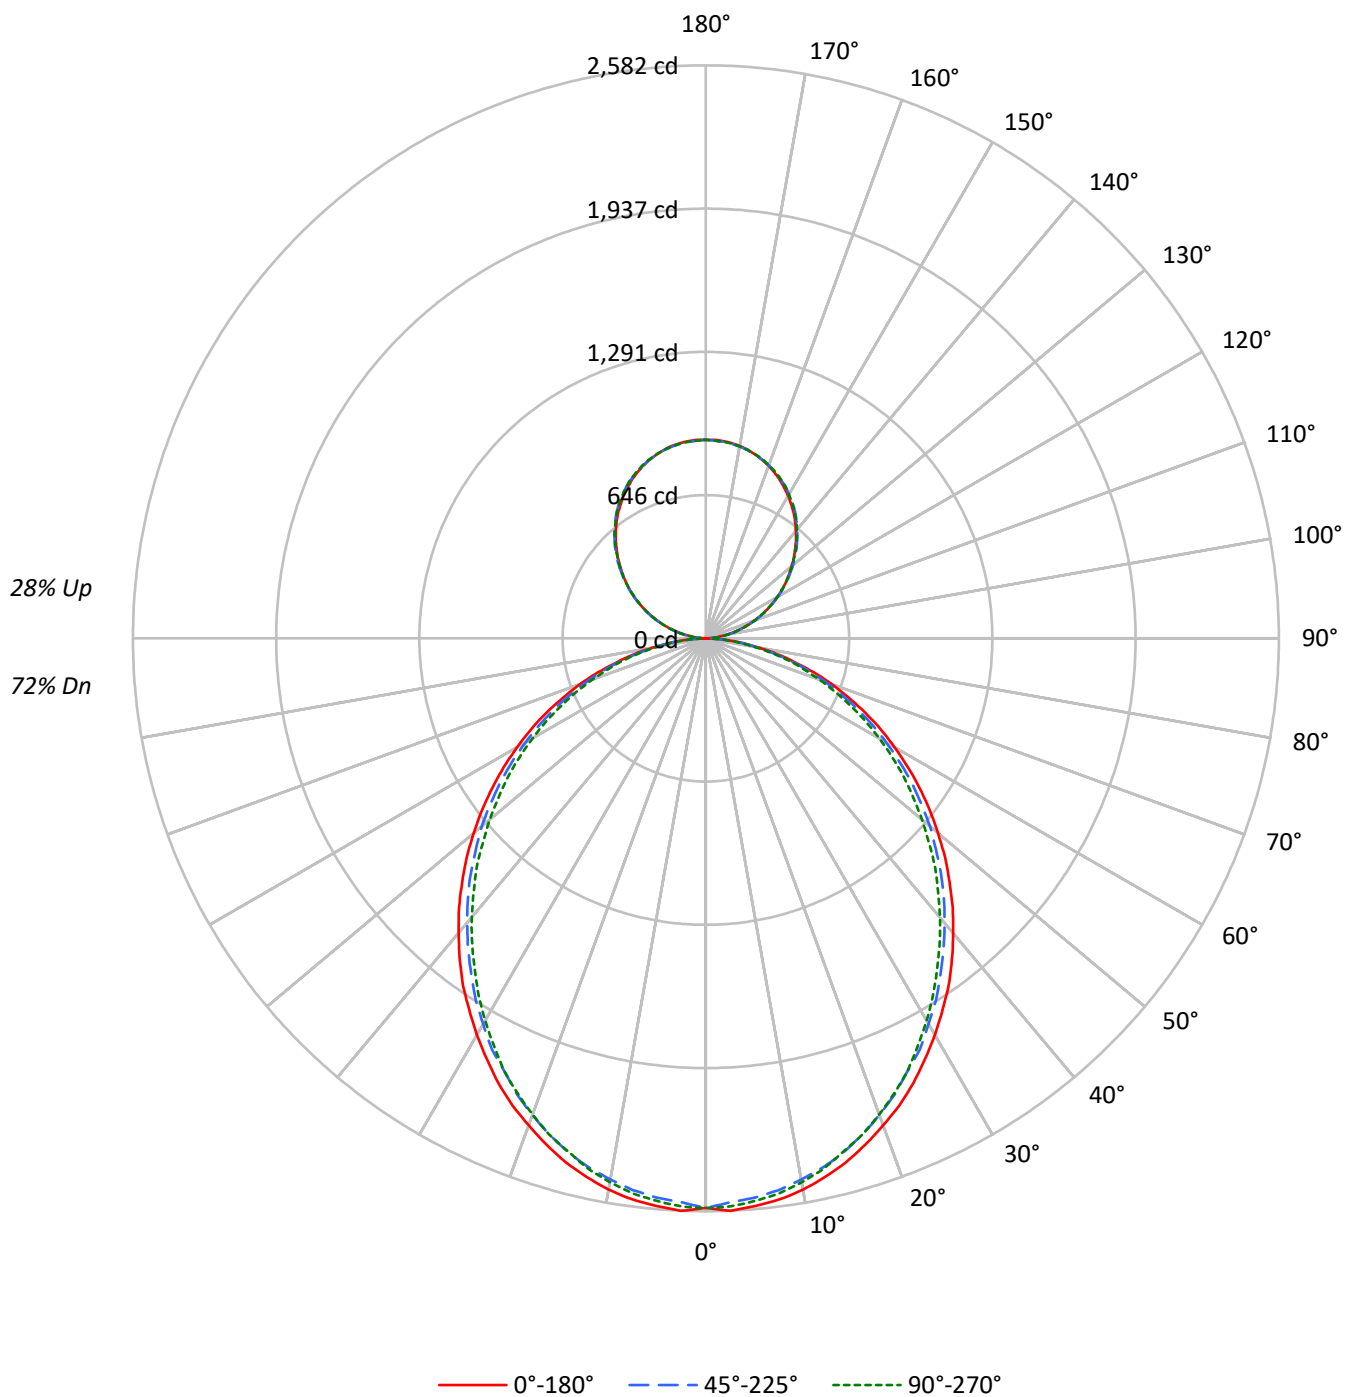

TEST NUMBER: P904464

CATALOG NUMBER: DFN2DIP-TR3F0-070D030US830-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	107	107	107	107	96	96	96	86	86	86	77	77	77
1	103	98	94	91	97	93	90	87	84	81	79	76	74	72	68	66	65
2	94	86	80	74	89	82	76	71	74	69	65	66	63	60	60	57	55
3	85	76	68	62	81	72	65	60	65	60	55	59	54	51	53	49	46
4	78	67	59	52	74	64	56	51	58	52	47	52	48	44	47	43	40
5	72	60	51	45	68	57	49	44	52	46	41	47	42	38	43	38	35
6	66	54	45	39	63	51	44	38	47	40	36	43	37	33	39	34	31
7	62	49	41	35	58	47	39	34	43	36	32	39	34	30	35	31	27
8	57	44	36	31	54	43	35	30	39	33	28	36	30	26	33	28	25
9	53	41	33	28	51	39	32	27	36	30	25	33	28	24	30	26	22
10	50	37	30	25	47	36	29	24	33	27	23	30	25	22	28	24	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3199	3199	3199
5°	3202	3152	3174
10°	3175	3107	3128
15°	3126	3053	3059
20°	3061	2979	2988
25°	2997	2891	2907
30°	2916	2810	2804
35°	2840	2714	2695
40°	2746	2616	2591
45°	2652	2519	2485
50°	2550	2416	2362
55°	2443	2298	2248
60°	2321	2158	2118
65°	2188	2012	1964
70°	2019	1834	1798
75°	1785	1621	1642
80°	1502	1349	1350
85°	1061	888	871

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2652 cd/sqm

TEST NUMBER: P904464

CATALOG NUMBER: DFN2DIP-TR3F0-070D030US830-FLLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	241.6	2.7
10°-20°	679.9	7.5
20°-30°	999.1	11.1
30°-40°	1160.4	12.8
40°-50°	1159.0	12.8
50°-60°	1010.6	11.2
60°-70°	747.1	8.3
70°-80°	422.7	4.7
80°-90°	114.1	1.3
90°-100°	55.3	0.6
100°-110°	175.8	1.9
110°-120°	300.9	3.3
120°-130°	395.7	4.4
130°-140°	444.2	4.9
140°-150°	435.6	4.8
150°-160°	365.4	4.0
160°-170°	242.3	2.7
170°-180°	84.7	0.9
0°-30°	1920.6	21.3
0°-40°	3081.0	34.1
0°-60°	5250.6	58.1
0°-90°	6534.4	72.3
90°-120°	532.1	5.9
90°-150°	1807.5	20.0
90°-180°	2500.0	27.7
0°-180°	9034.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2567	2567	2567	2567	2567	
5°	2567	2558	2530	2550	2545	244
15°	2444	2429	2397	2407	2395	688
25°	2212	2192	2150	2155	2150	1018
35°	1908	1884	1844	1829	1817	1192
45°	1553	1536	1498	1471	1461	1198
55°	1175	1160	1131	1101	1089	1051
65°	793	778	753	731	718	784
75°	415	410	397	383	388	443
85°	101	99	96	89	86	113
90°	1	10	26	25	26	9
95°	39	47	48	48	47	44
105°	162	164	166	167	167	171
115°	302	306	305	304	302	299
125°	439	446	444	441	440	392
135°	568	576	578	577	575	439
145°	690	695	699	700	697	431
155°	789	791	793	797	795	363
165°	858	857	857	862	859	242
175°	893	890	889	894	890	85
180°	894	894	894	894	894	

TEST NUMBER: P904464

CATALOG NUMBER: DFN2DIP-TR3F0-070D030US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2567.2	2567.2	2567.2	2567.2	2567.2
2.5°	2582.2	2569.8	2542.6	2567.2	2562.5
5°	2567.2	2557.6	2530.3	2550.0	2545.2
7.5°	2550.0	2535.3	2508.0	2528.0	2523.0
10°	2523.0	2505.7	2476.1	2495.8	2488.4
12.5°	2485.8	2471.2	2441.6	2453.8	2448.8
15°	2443.9	2429.2	2397.0	2407.0	2394.6
17.5°	2392.0	2377.4	2345.1	2357.5	2345.1
20°	2335.1	2320.5	2285.9	2293.3	2283.6
22.5°	2278.6	2256.4	2224.1	2224.1	2219.1
25°	2211.9	2192.2	2150.3	2155.0	2150.3
27.5°	2137.7	2120.4	2088.5	2081.1	2068.8
30°	2063.9	2043.9	2007.0	1999.7	1989.7
32.5°	1984.7	1970.1	1930.5	1915.6	1905.6
35°	1908.3	1883.7	1844.1	1829.2	1816.8
37.5°	1821.8	1799.6	1760.0	1742.8	1730.4
40°	1733.1	1713.2	1673.6	1651.6	1641.6
42.5°	1646.6	1626.7	1587.4	1562.5	1547.8
45°	1552.8	1535.6	1498.4	1471.4	1461.4
47.5°	1461.4	1444.2	1404.6	1377.3	1362.7
50°	1365.1	1352.7	1318.1	1283.6	1271.3
52.5°	1271.3	1254.1	1222.1	1194.9	1177.5
55°	1175.2	1160.3	1130.7	1101.1	1088.7
57.5°	1078.8	1066.5	1034.3	1004.7	994.8
60°	982.4	972.7	938.2	911.0	903.6
62.5°	888.6	871.4	846.8	822.2	812.2
65°	792.6	777.6	753.0	730.8	718.4
67.5°	693.8	681.3	659.2	642.0	632.0
70°	602.4	592.5	570.1	552.9	543.2
72.5°	508.6	498.7	486.4	469.1	461.8
75°	414.6	409.9	397.3	382.7	387.7
77.5°	330.8	320.8	315.8	308.5	301.2
80°	246.9	244.4	239.4	232.1	227.1
82.5°	167.9	167.9	165.5	155.6	155.6
85°	101.1	98.8	96.4	88.8	86.4
87.5°	44.5	39.6	34.6	27.2	24.6
90°	0.8	9.7	26.4	24.8	25.6
92.5°	16.7	22.6	23.5	24.2	24.2
95°	39.4	46.9	48.3	48.3	46.9
97.5°	65.5	72.5	75.5	75.5	75.5
100°	95.7	101.9	104.1	104.1	103.3
102.5°	127.5	132.1	135.1	135.9	135.1
105°	162.3	164.5	166.1	167.4	167.4
107.5°	196.8	200.0	200.0	200.6	196.8
110°	230.3	234.6	234.6	234.6	232.4

TEST NUMBER: P904464

CATALOG NUMBER: DFN2DIP-TR3F0-070D030US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	266.4	271.0	270.1	268.0	266.4
115°	302.0	306.2	304.9	304.2	302.0
117.5°	337.2	343.2	339.4	337.2	335.1
120°	372.9	378.8	372.9	372.9	370.4
122.5°	405.2	412.7	409.0	406.8	405.2
125°	439.2	445.9	443.7	441.3	440.5
127.5°	472.3	480.7	477.8	474.5	472.3
130°	503.3	513.0	511.7	510.1	507.1
132.5°	538.1	545.6	546.2	542.4	540.3
135°	568.1	576.4	578.1	577.2	575.0
137.5°	601.4	608.2	609.5	609.1	605.8
140°	630.8	637.6	641.4	641.4	638.4
142.5°	661.1	667.8	670.0	670.8	667.8
145°	689.7	695.0	699.4	700.1	697.2
147.5°	715.3	722.0	725.2	726.6	723.6
150°	741.7	746.3	749.2	751.7	749.2
152.5°	765.2	769.7	773.5	776.5	773.5
155°	788.6	790.7	793.1	796.9	794.6
157.5°	808.8	810.4	811.8	817.2	813.4
160°	826.9	828.5	829.3	833.9	830.7
162.5°	843.6	843.6	844.4	849.5	845.7
165°	857.9	857.1	857.1	862.4	858.7
167.5°	870.8	868.4	868.4	873.7	870.0
170°	880.5	878.4	877.6	883.0	878.4
172.5°	887.2	885.1	884.3	889.7	885.1
175°	892.7	890.5	888.9	894.3	889.7
177.5°	895.6	893.4	891.8	896.5	891.8
180°	894.3	894.3	894.3	894.3	894.3

TEST NUMBER: P904464

CATALOG NUMBER: DFN2DIP-TR3F0-070D030US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.11	14.21	13.84	14.97	15.88	12.68	13.78	13.42	14.54	15.46
	3H	14.77	15.77	15.53	16.54	17.48	14.31	15.30	15.06	16.07	17.01
	4H	15.37	16.30	16.14	17.08	18.04	14.90	15.84	15.67	16.62	17.57
	6H	15.77	16.64	16.55	17.43	18.39	15.30	16.17	16.09	16.96	17.93
	8H	15.88	16.71	16.67	17.51	18.48	15.41	16.24	16.20	17.04	18.01
	12H	15.93	16.72	16.73	17.52	18.52	15.46	16.25	16.26	17.05	18.04
4H	2H	13.59	14.53	14.37	15.31	16.26	13.25	14.19	14.02	14.97	15.92
	3H	15.47	16.25	16.26	17.07	18.04	15.08	15.86	15.87	16.68	17.65
	4H	16.19	16.90	16.99	17.71	18.71	15.79	16.50	16.59	17.31	18.31
	6H	16.71	17.32	17.52	18.16	19.17	16.30	16.92	17.12	17.76	18.76
	8H	16.86	17.43	17.68	18.27	19.29	16.45	17.03	17.27	17.86	18.88
	12H	16.94	17.46	17.78	18.31	19.34	16.52	17.04	17.36	17.90	18.92
8H	4H	16.40	16.98	17.22	17.81	18.83	16.04	16.62	16.86	17.45	18.47
	6H	17.03	17.51	17.88	18.38	19.40	16.67	17.15	17.52	18.02	19.04
	8H	17.25	17.67	18.11	18.54	19.58	16.88	17.31	17.74	18.18	19.21
	12H	17.38	17.76	18.25	18.62	19.71	17.00	17.38	17.87	18.24	19.33
12H	4H	16.40	16.91	17.24	17.77	18.79	16.05	16.57	16.89	17.42	18.44
	6H	17.06	17.48	17.92	18.36	19.39	16.71	17.14	17.57	18.01	19.04
	8H	17.31	17.68	18.17	18.54	19.63	16.95	17.33	17.82	18.19	19.28