

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904476

Luminaire Tested: DFN2DIP-TR3F0-070D060US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904476
REPORT IS A COMBINATION OF REPORTS P900321 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-070D060US830-FLLFLL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11536.7 lumens
Efficiency: N/A
Efficacy: 100.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 115.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904476

CATALOG NUMBER: DFN2DIP-TR3F0-070D060US830-FLLFLL

Luminous Intensity Polar Plot

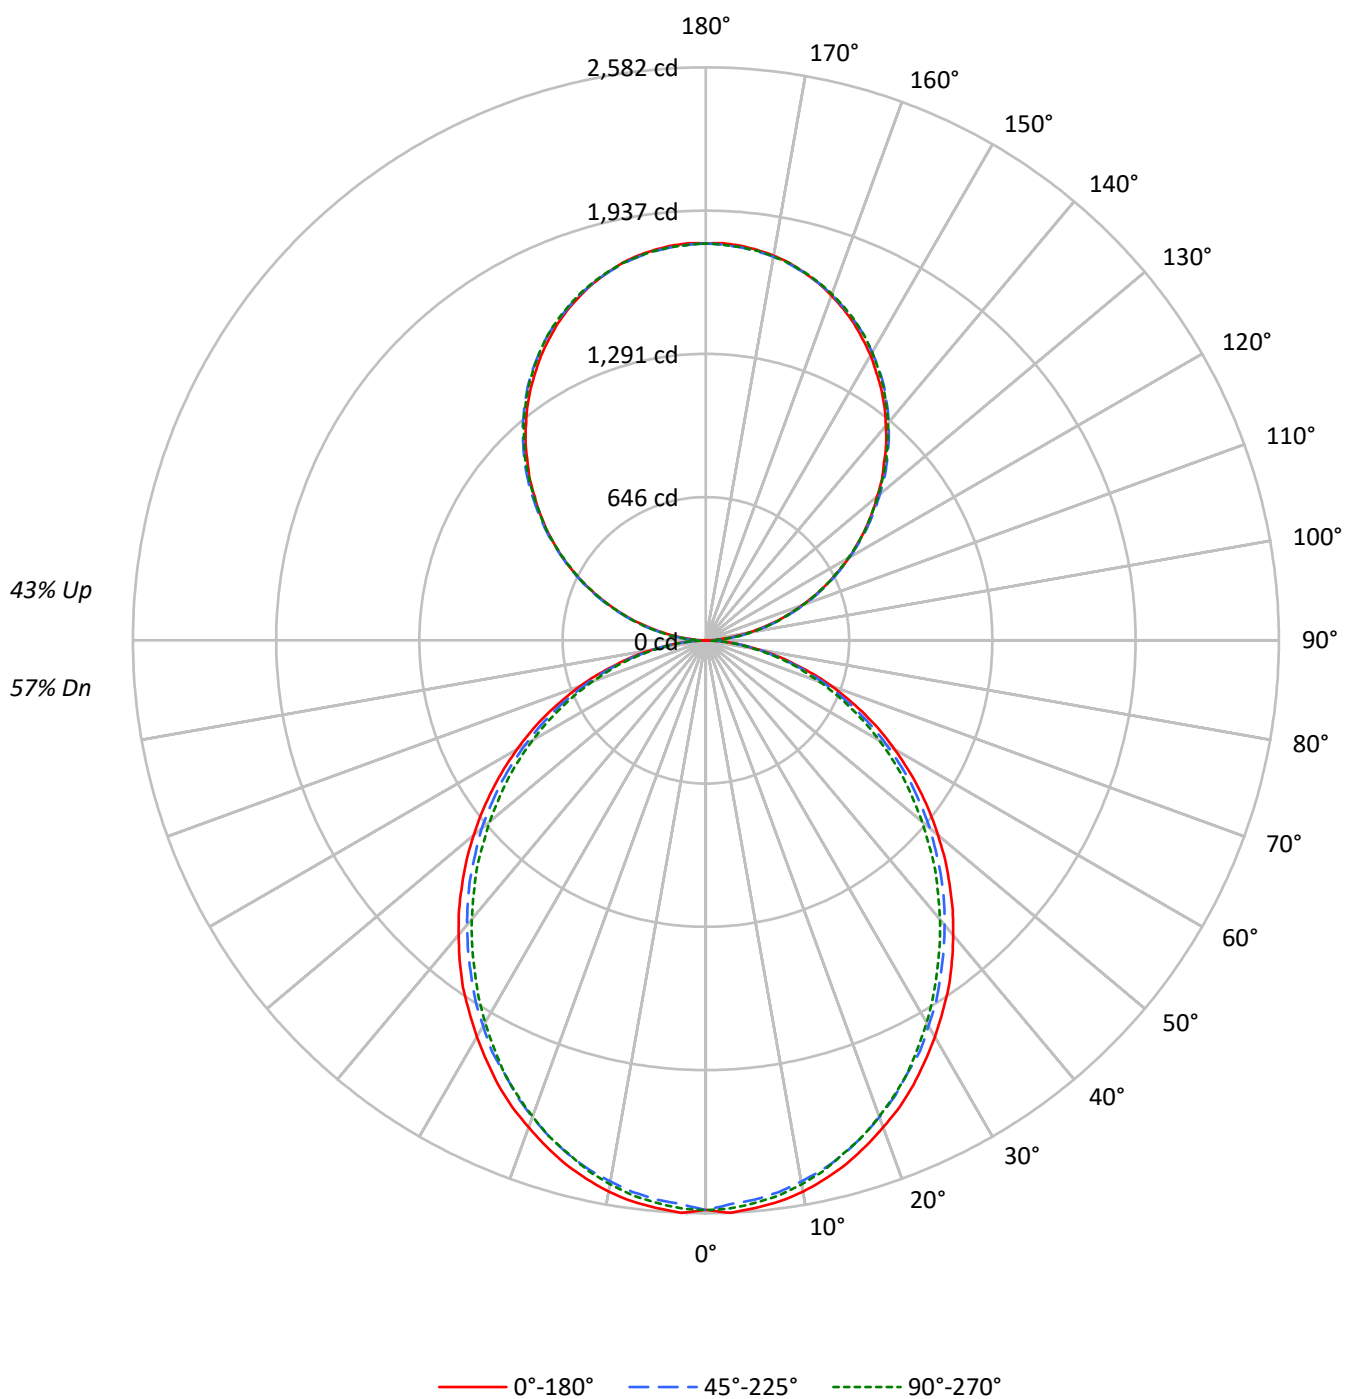

TEST NUMBER: P904476

CATALOG NUMBER: DFN2DIP-TR3F0-070D060US830-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62
1	99	95	91	87	92	88	85	82	76	74	72	65	63	62	55	54	53
2	90	83	77	71	84	77	72	67	67	63	59	57	54	52	48	46	44
3	82	73	65	60	76	68	62	56	59	54	50	51	47	44	43	40	38
4	75	65	57	50	70	60	53	48	53	47	43	45	41	37	38	35	33
5	69	58	49	43	64	54	47	41	47	41	37	41	36	32	35	31	28
6	64	52	43	38	59	48	41	36	42	36	32	37	32	28	31	28	25
7	59	47	39	33	55	44	37	31	38	33	28	33	29	25	29	25	22
8	55	42	35	29	51	40	33	28	35	29	25	31	26	23	26	23	20
9	51	39	31	26	48	37	30	25	32	27	23	28	24	20	24	21	18
10	48	36	28	23	45	34	27	22	30	24	20	26	22	18	23	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3199	3199	3199
5°	3202	3152	3174
10°	3175	3107	3128
15°	3126	3053	3059
20°	3061	2979	2988
25°	2997	2891	2907
30°	2916	2810	2804
35°	2840	2714	2695
40°	2746	2616	2591
45°	2652	2519	2485
50°	2550	2416	2362
55°	2443	2298	2248
60°	2321	2158	2118
65°	2188	2012	1964
70°	2019	1834	1798
75°	1785	1621	1642
80°	1502	1349	1350
85°	1061	888	871

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2652 cd/sqm

TEST NUMBER: P904476

CATALOG NUMBER: DFN2DIP-TR3F0-070D060US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	241.6	2.1
10°-20°	679.9	5.9
20°-30°	999.1	8.7
30°-40°	1160.4	10.1
40°-50°	1159.0	10.0
50°-60°	1010.6	8.8
60°-70°	747.1	6.5
70°-80°	422.7	3.7
80°-90°	116.6	1.0
90°-100°	110.7	1.0
100°-110°	351.6	3.0
110°-120°	601.8	5.2
120°-130°	791.4	6.9
130°-140°	888.4	7.7
140°-150°	871.1	7.6
150°-160°	730.8	6.3
160°-170°	484.6	4.2
170°-180°	169.4	1.5
0°-30°	1920.6	16.6
0°-40°	3081.0	26.7
0°-60°	5250.6	45.5
0°-90°	6536.9	56.7
90°-120°	1064.1	9.2
90°-150°	3615.0	31.3
90°-180°	5000.0	43.3
0°-180°	11536.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2567	2567	2567	2567	2567	
5°	2567	2558	2530	2550	2545	244
15°	2444	2429	2397	2407	2395	688
25°	2212	2192	2150	2155	2150	1018
35°	1908	1884	1844	1829	1817	1192
45°	1553	1536	1498	1471	1461	1198
55°	1175	1160	1131	1101	1089	1051
65°	793	778	753	731	718	784
75°	415	410	397	383	388	443
85°	101	99	96	89	86	113
90°	2	19	53	50	51	11
95°	79	94	96	96	94	88
105°	325	329	332	335	335	343
115°	604	613	610	608	604	597
125°	878	892	888	883	881	785
135°	1136	1153	1156	1154	1150	878
145°	1379	1390	1399	1400	1394	862
155°	1577	1582	1586	1594	1589	726
165°	1716	1714	1714	1725	1717	484
175°	1785	1781	1778	1789	1779	170
180°	1789	1789	1789	1789	1789	

TEST NUMBER: P904476

CATALOG NUMBER: DFN2DIP-TR3F0-070D060US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2567.2	2567.2	2567.2	2567.2	2567.2
2.5°	2582.2	2569.8	2542.6	2567.2	2562.5
5°	2567.2	2557.6	2530.3	2550.0	2545.2
7.5°	2550.0	2535.3	2508.0	2528.0	2523.0
10°	2523.0	2505.7	2476.1	2495.8	2488.4
12.5°	2485.8	2471.2	2441.6	2453.8	2448.8
15°	2443.9	2429.2	2397.0	2407.0	2394.6
17.5°	2392.0	2377.4	2345.1	2357.5	2345.1
20°	2335.1	2320.5	2285.9	2293.3	2283.6
22.5°	2278.6	2256.4	2224.1	2224.1	2219.1
25°	2211.9	2192.2	2150.3	2155.0	2150.3
27.5°	2137.7	2120.4	2088.5	2081.1	2068.8
30°	2063.9	2043.9	2007.0	1999.7	1989.7
32.5°	1984.7	1970.1	1930.5	1915.6	1905.6
35°	1908.3	1883.7	1844.1	1829.2	1816.8
37.5°	1821.8	1799.6	1760.0	1742.8	1730.4
40°	1733.1	1713.2	1673.6	1651.6	1641.6
42.5°	1646.6	1626.7	1587.4	1562.5	1547.8
45°	1552.8	1535.6	1498.4	1471.4	1461.4
47.5°	1461.4	1444.2	1404.6	1377.3	1362.7
50°	1365.1	1352.7	1318.1	1283.6	1271.3
52.5°	1271.3	1254.1	1222.1	1194.9	1177.5
55°	1175.2	1160.3	1130.7	1101.1	1088.7
57.5°	1078.8	1066.5	1034.3	1004.7	994.8
60°	982.4	972.7	938.2	911.0	903.6
62.5°	888.6	871.4	846.8	822.2	812.2
65°	792.6	777.6	753.0	730.8	718.4
67.5°	693.8	681.3	659.2	642.0	632.0
70°	602.4	592.5	570.1	552.9	543.2
72.5°	508.6	498.7	486.4	469.1	461.8
75°	414.6	409.9	397.3	382.7	387.7
77.5°	330.8	320.8	315.8	308.5	301.2
80°	246.9	244.4	239.4	232.1	227.1
82.5°	167.9	167.9	165.5	155.6	155.6
85°	101.1	98.8	96.4	88.8	86.4
87.5°	44.5	39.6	34.6	27.2	24.6
90°	1.6	19.4	52.9	49.6	51.2
92.5°	33.5	45.3	46.9	48.5	48.5
95°	78.7	93.8	96.5	96.5	93.8
97.5°	131.0	145.1	151.0	151.0	151.0
100°	191.4	203.8	208.1	208.1	206.5
102.5°	255.1	264.2	270.1	271.7	270.1
105°	324.6	328.9	332.2	334.9	334.9
107.5°	393.6	400.1	400.1	401.1	393.6
110°	460.5	469.1	469.1	469.1	464.8



TEST NUMBER: P904476

CATALOG NUMBER: DFN2DIP-TR3F0-070D060US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	532.7	541.9	540.3	535.9	532.7
115°	603.9	612.6	609.8	608.2	603.9
117.5°	674.6	686.5	678.8	674.6	670.2
120°	745.7	757.6	745.7	745.7	740.8
122.5°	810.4	825.5	817.9	813.7	810.4
125°	878.4	891.8	887.5	882.7	881.1
127.5°	944.7	961.4	955.5	949.0	944.7
130°	1006.7	1026.1	1023.4	1020.2	1014.3
132.5°	1076.3	1091.4	1092.4	1084.9	1080.5
135°	1136.1	1152.8	1156.0	1154.4	1150.1
137.5°	1203.0	1216.4	1219.2	1218.0	1211.6
140°	1261.8	1275.3	1282.8	1282.8	1276.9
142.5°	1322.1	1335.6	1339.9	1341.5	1335.6
145°	1379.3	1390.1	1398.7	1400.3	1394.4
147.5°	1430.5	1444.0	1450.5	1453.1	1447.2
150°	1483.4	1492.5	1498.5	1503.3	1498.5
152.5°	1530.2	1539.5	1547.0	1552.9	1547.0
155°	1577.2	1581.5	1586.3	1593.9	1589.0
157.5°	1617.6	1620.9	1623.5	1634.4	1626.8
160°	1653.8	1657.0	1658.6	1667.7	1661.3
162.5°	1687.2	1687.2	1688.8	1699.0	1691.5
165°	1715.7	1714.1	1714.1	1724.9	1717.4
167.5°	1741.6	1736.8	1736.8	1747.6	1740.0
170°	1761.0	1756.7	1755.1	1765.9	1756.7
172.5°	1774.5	1770.2	1768.6	1779.3	1770.2
175°	1785.3	1781.0	1777.7	1788.6	1779.3
177.5°	1791.2	1787.0	1783.7	1792.8	1783.7
180°	1788.6	1788.6	1788.6	1788.6	1788.6

TEST NUMBER: P904476

CATALOG NUMBER: DFN2DIP-TR3F0-070D060US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.85	12.78	12.75	13.70	14.87	11.42	12.35	12.32	13.27	14.44
	3H	13.51	14.34	14.42	15.27	16.46	13.04	13.87	13.95	14.80	15.99
	4H	14.09	14.88	15.02	15.81	17.02	13.63	14.41	14.55	15.34	16.55
	6H	14.49	15.21	15.42	16.15	17.37	14.02	14.74	14.96	15.68	16.90
	8H	14.59	15.28	15.54	16.24	17.45	14.12	14.81	15.07	15.77	16.99
	12H	14.64	15.29	15.59	16.24	17.49	14.17	14.82	15.11	15.77	17.01
4H	2H	12.32	13.10	13.25	14.04	15.24	11.98	12.76	12.91	13.69	14.90
	3H	14.18	14.83	15.12	15.80	17.02	13.79	14.45	14.73	15.41	16.63
	4H	14.89	15.49	15.84	16.44	17.69	14.49	15.09	15.44	16.04	17.29
	6H	15.40	15.91	16.36	16.90	18.14	15.00	15.51	15.96	16.49	17.74
	8H	15.55	16.03	16.51	17.00	18.26	15.14	15.62	16.11	16.60	17.86
	12H	15.62	16.05	16.60	17.04	18.31	15.20	15.64	16.19	16.63	17.89
8H	4H	15.09	15.57	16.05	16.54	17.80	14.73	15.21	15.70	16.19	17.45
	6H	15.71	16.11	16.70	17.12	18.38	15.35	15.75	16.34	16.77	18.03
	8H	15.92	16.28	16.92	17.28	18.56	15.56	15.91	16.56	16.92	18.19
	12H	16.05	16.36	17.06	17.36	18.68	15.67	15.99	16.68	16.98	18.31
12H	4H	15.07	15.51	16.06	16.50	17.77	14.73	15.16	15.71	16.15	17.42
	6H	15.74	16.09	16.74	17.10	18.37	15.39	15.74	16.39	16.75	18.02
	8H	15.98	16.29	16.98	17.28	18.61	15.62	15.93	16.63	16.93	18.26