

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904491

Luminaire Tested: DFN2DIP-TR3F0-080D030US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904491
REPORT IS A COMBINATION OF REPORTS P901801 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-080D030US830-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10264.3 lumens
Efficiency: N/A
Efficacy: 99.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 103.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904491

CATALOG NUMBER: DFN2DIP-TR3F0-080D030US830-FLLONL

Luminous Intensity Polar Plot

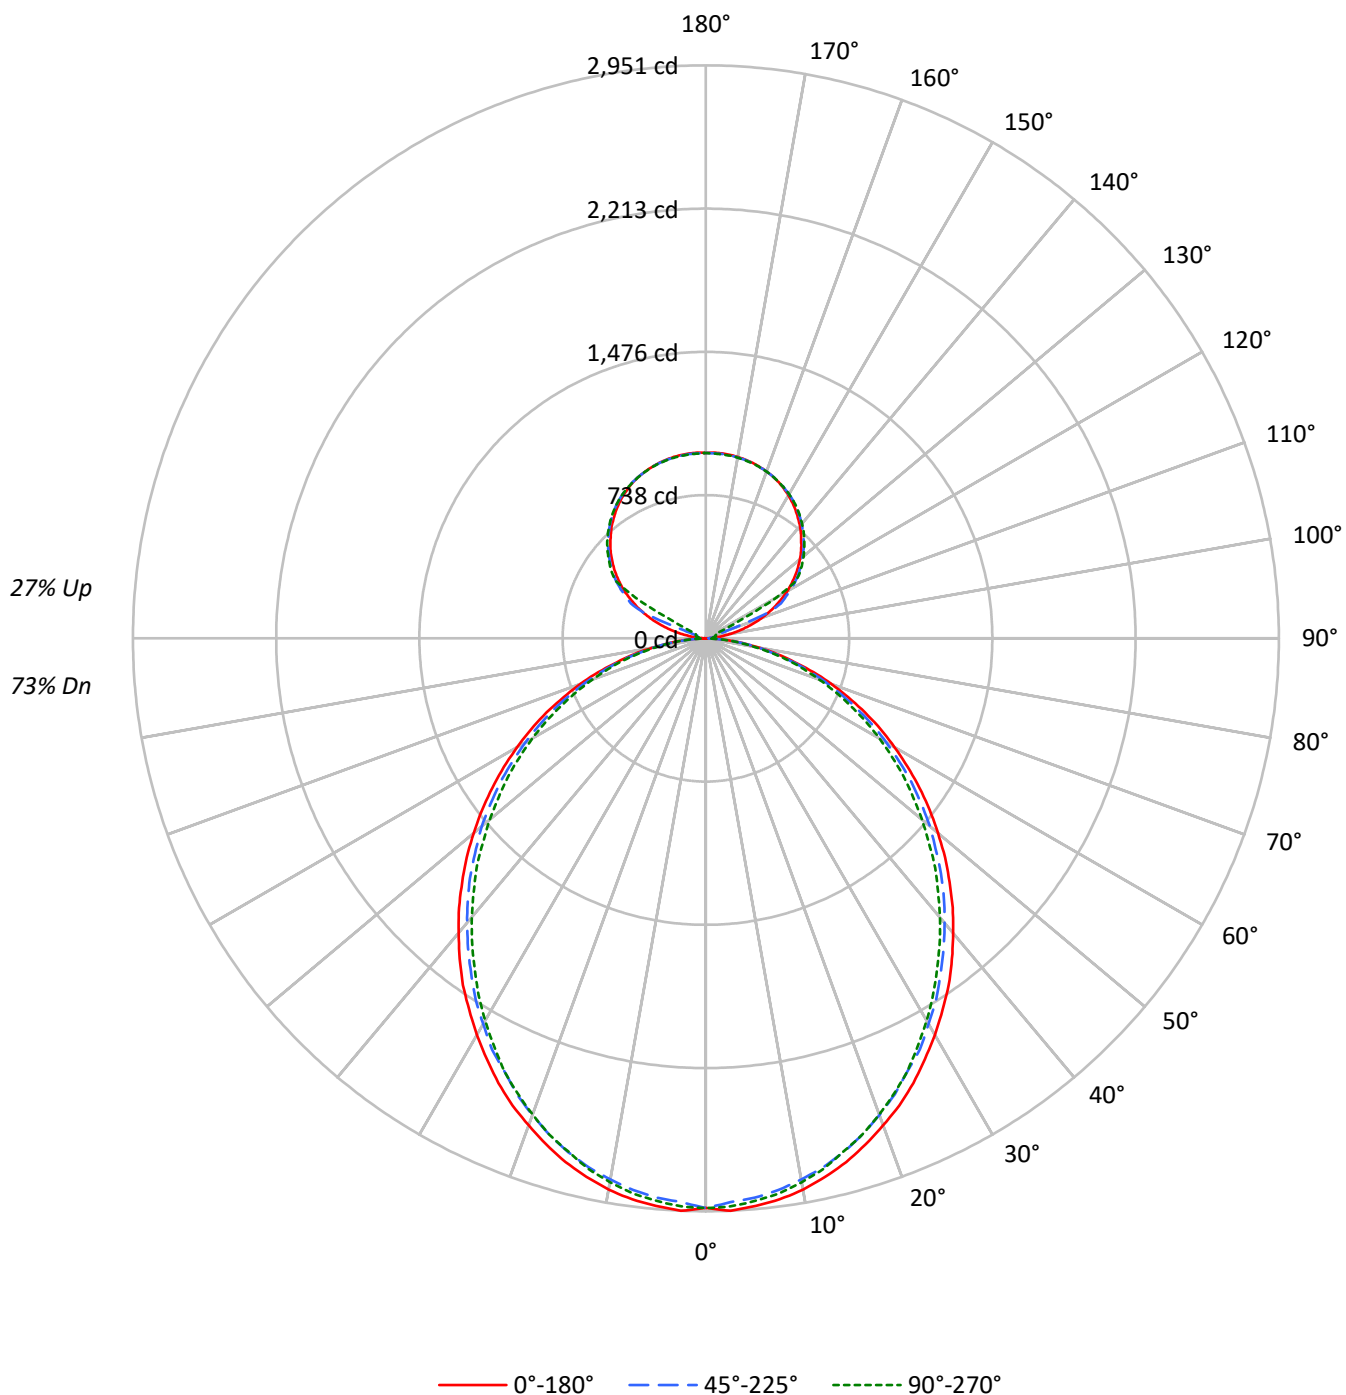

TEST NUMBER: P904491

CATALOG NUMBER: DFN2DIP-TR3F0-080D030US830-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	113	113	113	113	107	107	107	107	96	96	96	86	86	86	77	77	77
1	103	98	94	91	97	94	90	87	84	82	79	76	74	72	68	67	65
2	94	86	80	74	89	82	76	71	74	69	66	67	63	60	60	57	55
3	86	76	68	62	81	72	65	60	65	60	55	59	55	51	53	50	47
4	78	67	59	53	74	64	57	51	58	52	47	53	48	44	48	44	40
5	72	60	51	45	68	57	50	44	52	46	41	47	42	38	43	39	35
6	67	54	45	39	63	52	44	38	47	41	36	43	37	33	39	35	31
7	62	49	41	35	58	47	39	34	43	36	32	39	34	30	36	31	28
8	57	44	36	31	54	43	35	30	39	33	28	36	30	27	33	28	25
9	53	41	33	28	51	39	32	27	36	30	25	33	28	24	30	26	22
10	50	38	30	25	48	36	29	24	33	27	23	31	25	22	28	24	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3656	3656	3656
5°	3660	3602	3627
10°	3628	3550	3575
15°	3573	3489	3496
20°	3499	3405	3415
25°	3425	3305	3322
30°	3333	3211	3204
35°	3246	3101	3080
40°	3139	2990	2961
45°	3031	2879	2840
50°	2914	2762	2699
55°	2791	2626	2569
60°	2653	2466	2420
65°	2501	2299	2245
70°	2307	2097	2055
75°	2040	1853	1877
80°	1717	1542	1542
85°	1214	1016	996

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3031 cd/sqm

TEST NUMBER: P904491

CATALOG NUMBER: DFN2DIP-TR3F0-080D030US830-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	276.1	2.7
10°-20°	777.0	7.6
20°-30°	1141.8	11.1
30°-40°	1326.2	12.9
40°-50°	1324.5	12.9
50°-60°	1155.0	11.3
60°-70°	853.8	8.3
70°-80°	483.0	4.7
80°-90°	129.2	1.3
90°-100°	31.5	0.3
100°-110°	117.3	1.1
110°-120°	311.1	3.0
120°-130°	516.0	5.0
130°-140°	548.1	5.3
140°-150°	509.4	5.0
150°-160°	409.6	4.0
160°-170°	263.9	2.6
170°-180°	90.8	0.9
0°-30°	2195.0	21.4
0°-40°	3521.1	34.3
0°-60°	6000.6	58.5
0°-90°	7466.6	72.7
90°-120°	459.9	4.5
90°-150°	2033.4	19.8
90°-180°	2798.0	27.3
0°-180°	10264.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2934	2934	2934	2934	2934	
5°	2934	2923	2892	2914	2909	279
15°	2793	2776	2739	2751	2737	787
25°	2528	2505	2458	2463	2458	1163
35°	2181	2153	2108	2090	2076	1362
45°	1775	1755	1712	1682	1670	1370
55°	1343	1326	1292	1258	1244	1201
65°	906	889	860	835	821	896
75°	474	468	454	437	443	506
85°	116	113	110	102	99	129
90°	1	8	14	17	19	10
95°	45	22	27	30	30	53
105°	210	231	42	50	52	224
115°	397	409	426	106	57	391
125°	561	570	584	588	590	501
135°	695	706	712	719	718	537
145°	806	805	817	822	818	504
155°	887	881	889	894	888	409
165°	935	931	933	938	933	264
175°	956	952	953	958	951	91
180°	954	954	954	954	954	

TEST NUMBER: P904491

CATALOG NUMBER: DFN2DIP-TR3F0-080D030US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2933.9	2933.9	2933.9	2933.9	2933.9
2.5°	2951.0	2937.0	2905.9	2933.9	2928.6
5°	2933.9	2922.9	2891.8	2914.2	2908.9
7.5°	2914.2	2897.5	2866.4	2889.1	2883.4
10°	2883.4	2863.6	2829.8	2852.2	2843.9
12.5°	2840.9	2824.1	2790.3	2804.3	2798.7
15°	2793.0	2776.3	2739.4	2750.8	2736.8
17.5°	2733.7	2717.0	2680.1	2694.3	2680.1
20°	2668.8	2652.0	2612.5	2620.9	2609.8
22.5°	2604.2	2578.7	2541.8	2541.8	2536.2
25°	2527.8	2505.4	2457.5	2462.9	2457.5
27.5°	2443.1	2423.4	2386.8	2378.4	2364.4
30°	2358.7	2335.9	2293.8	2285.4	2274.0
32.5°	2268.3	2251.5	2206.3	2189.2	2177.9
35°	2180.9	2152.8	2107.5	2090.5	2076.4
37.5°	2082.1	2056.6	2011.5	1991.7	1977.6
40°	1980.7	1957.8	1912.7	1887.5	1876.1
42.5°	1881.9	1859.1	1814.2	1785.7	1769.1
45°	1774.7	1754.9	1712.4	1681.6	1670.3
47.5°	1670.3	1650.5	1605.2	1574.1	1557.4
50°	1560.1	1546.1	1506.5	1467.0	1452.9
52.5°	1452.9	1433.1	1396.7	1365.6	1345.8
55°	1343.0	1326.0	1292.2	1258.4	1244.3
57.5°	1232.9	1218.9	1182.0	1148.2	1136.8
60°	1122.8	1111.7	1072.1	1041.0	1032.6
62.5°	1015.6	995.9	967.7	939.6	928.2
65°	905.8	888.7	860.5	835.1	821.0
67.5°	792.9	778.5	753.4	733.7	722.3
70°	688.4	677.0	651.7	631.9	620.8
72.5°	581.3	570.0	555.8	536.1	527.7
75°	473.8	468.4	454.1	437.3	443.0
77.5°	378.1	366.6	361.0	352.6	344.2
80°	282.3	279.3	273.6	265.2	259.5
82.5°	191.9	191.9	189.2	177.8	177.8
85°	115.6	112.8	110.2	101.5	98.8
87.5°	50.9	45.2	39.5	31.1	28.2
90°	0.7	8.3	13.8	17.3	18.6
92.5°	17.3	14.5	16.6	18.0	18.6
95°	44.9	22.1	26.9	30.4	29.7
97.5°	80.8	24.2	35.2	37.3	38.0
100°	122.2	27.6	39.4	44.9	46.3
102.5°	167.8	166.5	40.7	48.3	50.4
105°	209.9	230.6	42.1	49.7	52.5
107.5°	258.9	276.2	43.5	51.1	53.9
110°	305.9	320.4	120.8	51.8	54.6

TEST NUMBER: P904491

CATALOG NUMBER: DFN2DIP-TR3F0-080D030US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	350.2	362.5	350.8	53.2	55.2
115°	397.0	408.8	426.0	106.3	56.6
117.5°	437.8	451.6	463.4	364.6	183.7
120°	483.3	493.7	506.1	514.4	421.2
122.5°	522.0	533.1	547.0	551.0	551.8
125°	561.4	570.3	583.5	588.3	590.4
127.5°	597.3	606.9	617.4	624.2	624.9
130°	631.1	642.2	649.8	657.3	656.8
132.5°	665.6	674.7	682.2	688.4	687.8
135°	694.7	705.8	711.9	718.9	717.5
137.5°	725.0	733.3	740.3	747.2	745.1
140°	754.7	760.3	767.8	774.0	770.6
142.5°	779.7	784.5	793.4	798.9	795.5
145°	805.9	805.1	816.9	821.7	818.2
147.5°	828.6	826.5	838.3	841.7	839.0
150°	850.7	845.9	857.0	861.0	857.6
152.5°	869.3	863.8	874.2	878.4	873.5
155°	887.3	881.2	889.4	893.5	888.1
157.5°	901.8	896.4	902.6	907.4	901.8
160°	914.3	910.1	914.3	918.4	913.5
162.5°	925.3	921.1	924.6	929.4	923.2
165°	934.9	930.9	932.9	937.7	932.9
167.5°	942.5	938.4	940.5	945.4	939.1
170°	948.8	944.6	946.0	950.8	944.6
172.5°	952.9	948.8	950.2	955.0	948.8
175°	956.3	951.5	952.9	957.7	950.8
177.5°	957.7	952.9	953.7	958.5	952.3
180°	954.3	954.3	954.3	954.3	954.3

TEST NUMBER: P904491

CATALOG NUMBER: DFN2DIP-TR3F0-080D030US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.60	14.71	14.34	15.47	16.37	13.17	14.28	13.91	15.04	15.94
	3H	15.27	16.27	16.02	17.03	17.97	14.80	15.80	15.55	16.57	17.50
	4H	15.86	16.81	16.63	17.58	18.53	15.40	16.34	16.16	17.11	18.06
	6H	16.27	17.14	17.05	17.92	18.88	15.80	16.67	16.58	17.45	18.41
	8H	16.38	17.21	17.17	18.01	18.97	15.91	16.74	16.70	17.54	18.50
	12H	16.43	17.22	17.22	18.02	19.01	15.96	16.75	16.75	17.54	18.53
4H	2H	14.09	15.03	14.86	15.81	16.75	13.75	14.69	14.52	15.46	16.41
	3H	15.97	16.75	16.75	17.56	18.53	15.58	16.36	16.36	17.17	18.14
	4H	16.68	17.40	17.48	18.21	19.20	16.28	17.00	17.08	17.81	18.80
	6H	17.20	17.82	18.02	18.66	19.66	16.80	17.42	17.61	18.25	19.25
	8H	17.35	17.93	18.17	18.76	19.78	16.95	17.53	17.77	18.36	19.37
	12H	17.44	17.96	18.27	18.81	19.83	17.02	17.54	17.86	18.39	19.41
8H	4H	16.90	17.48	17.71	18.31	19.32	16.54	17.12	17.36	17.95	18.96
	6H	17.53	18.01	18.37	18.88	19.89	17.17	17.65	18.01	18.52	19.53
	8H	17.74	18.17	18.60	19.04	20.07	17.38	17.81	18.24	18.67	19.70
	12H	17.88	18.26	18.74	19.12	20.20	17.50	17.88	18.36	18.74	19.82
12H	4H	16.89	17.41	17.73	18.27	19.28	16.54	17.07	17.38	17.92	18.93
	6H	17.56	17.98	18.41	18.85	19.88	17.21	17.64	18.07	18.50	19.53
	8H	17.80	18.18	18.66	19.04	20.12	17.45	17.83	18.31	18.69	19.77