

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904497

Luminaire Tested: DFN2DIP-TR3F0-080D040US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904497
REPORT IS A COMBINATION OF REPORTS P901816 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-080D040US830-RLLONL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10141.8 lumens
Efficiency: N/A
Efficacy: 91.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 110.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904497

CATALOG NUMBER: DFN2DIP-TR3F0-080D040US830-RLLONL

Luminous Intensity Polar Plot

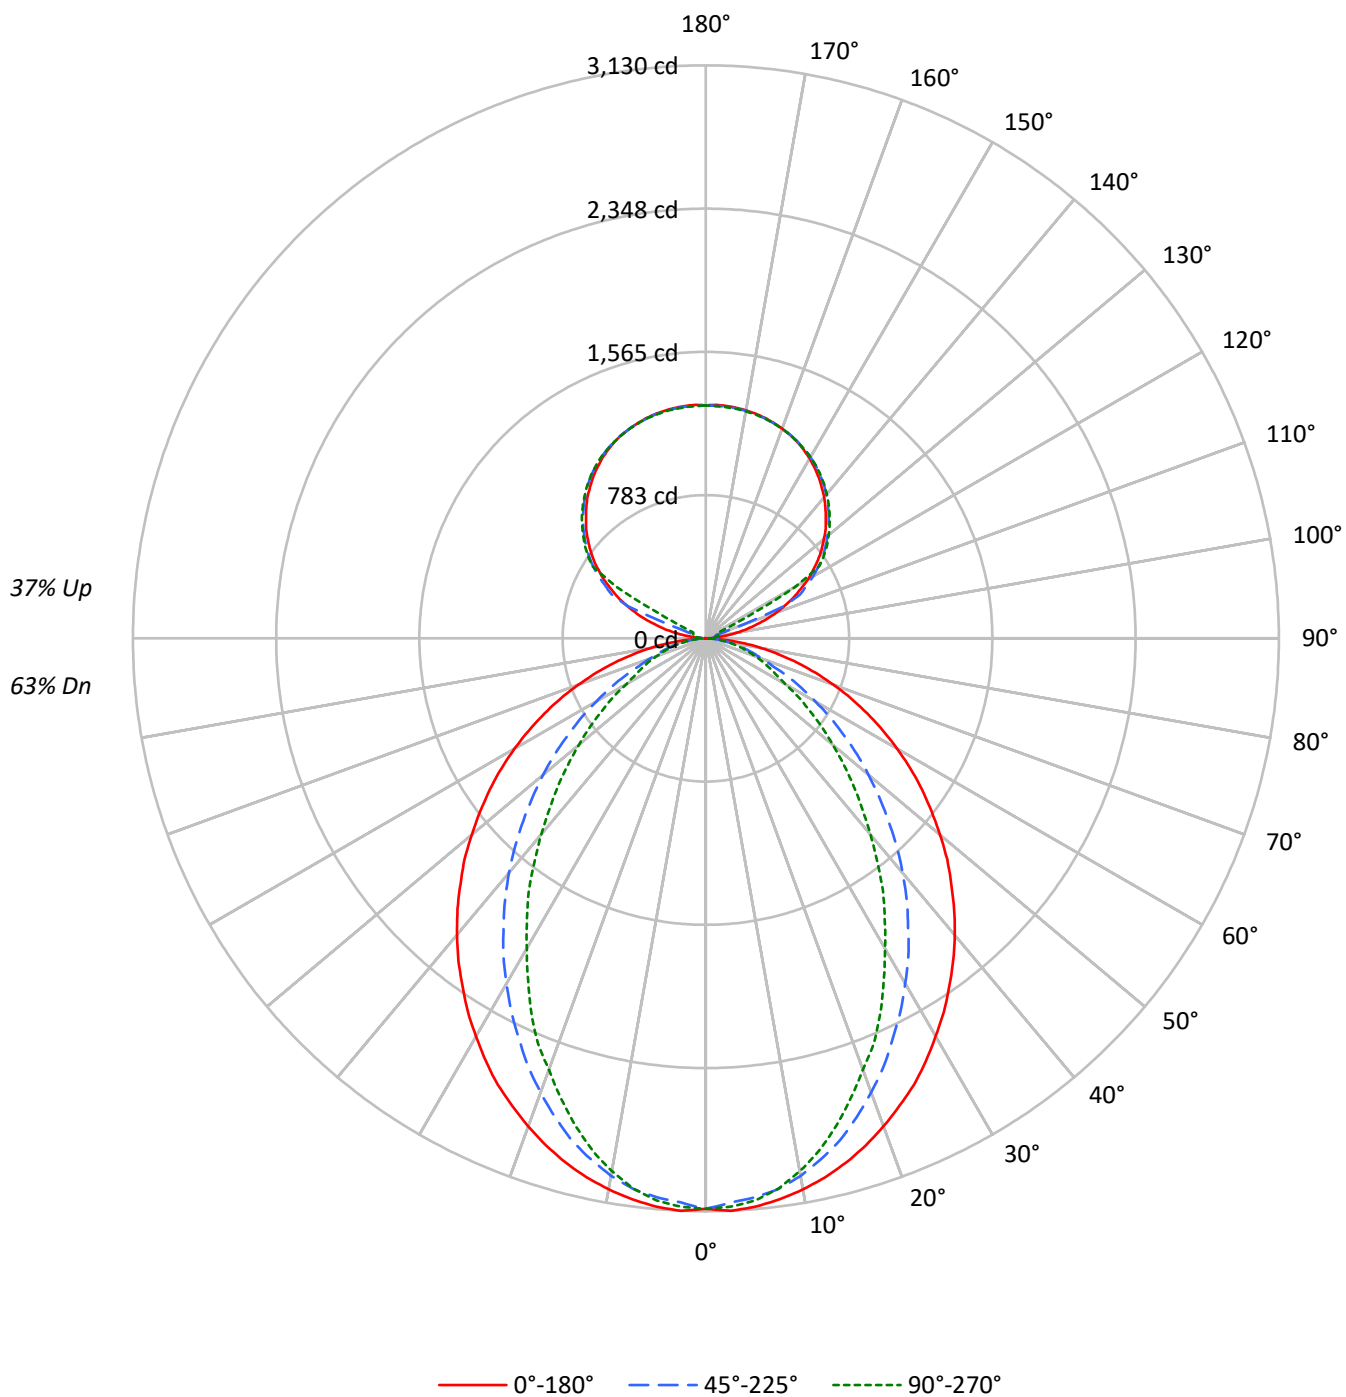

TEST NUMBER: P904497

CATALOG NUMBER: DFN2DIP-TR3F0-080D040US830-RLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	91	91	91	79	79	79	68	68	68
1	101	97	93	90	95	91	88	85	80	78	76	71	69	67	61	60	59
2	93	86	80	75	87	81	75	71	71	67	64	63	60	57	55	52	51
3	85	76	69	63	80	72	65	60	63	58	54	56	52	49	49	46	44
4	78	68	60	54	73	64	57	52	57	51	47	50	46	43	44	41	38
5	72	61	53	47	67	57	50	45	51	45	41	46	41	37	40	37	34
6	67	55	47	41	62	52	45	39	46	41	36	41	37	33	37	33	30
7	62	50	42	36	58	47	40	35	42	36	32	38	33	30	34	30	27
8	58	45	38	32	54	43	36	31	39	33	29	35	30	27	31	27	24
9	54	42	34	29	51	40	33	28	36	30	26	32	27	24	29	25	22
10	50	38	31	26	47	37	30	25	33	28	24	30	25	22	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3883	3883	3883
5°	3887	3818	3844
10°	3847	3740	3716
15°	3792	3613	3520
20°	3719	3440	3281
25°	3646	3246	3050
30°	3547	3048	2758
35°	3450	2835	2501
40°	3352	2615	2208
45°	3238	2371	1942
50°	3119	2125	1682
55°	2995	1863	1433
60°	2852	1589	1177
65°	2687	1311	1056
70°	2486	1052	952
75°	2234	920	861
80°	1869	762	738
85°	1272	493	539

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3238 cd/sqm

TEST NUMBER: P904497

CATALOG NUMBER: DFN2DIP-TR3F0-080D040US830-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	292.1	2.9
10°-20°	801.8	7.9
20°-30°	1125.7	11.1
30°-40°	1227.1	12.1
40°-50°	1127.8	11.1
50°-60°	885.7	8.7
60°-70°	576.5	5.7
70°-80°	296.8	2.9
80°-90°	78.0	0.8
90°-100°	41.9	0.4
100°-110°	156.4	1.5
110°-120°	414.8	4.1
120°-130°	688.0	6.8
130°-140°	730.8	7.2
140°-150°	679.2	6.7
150°-160°	546.1	5.4
160°-170°	351.9	3.5
170°-180°	121.1	1.2
0°-30°	2219.6	21.9
0°-40°	3446.7	34.0
0°-60°	5460.2	53.8
0°-90°	6411.6	63.2
90°-120°	613.2	6.0
90°-150°	2711.2	26.7
90°-180°	3730.0	36.8
0°-180°	10141.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3116	3116	3116	3116	3116	
5°	3116	3102	3066	3091	3083	296
15°	2964	2933	2837	2784	2756	835
25°	2691	2600	2414	2299	2256	1237
35°	2318	2174	1926	1749	1686	1451
45°	1895	1706	1410	1210	1142	1464
55°	1441	1221	916	747	694	1288
65°	973	744	491	395	386	965
75°	519	321	226	206	203	549
85°	121	62	54	54	54	139
90°	1	11	18	23	25	10
95°	60	29	36	40	40	71
105°	280	308	56	66	70	299
115°	529	545	568	142	76	521
125°	748	760	778	784	787	668
135°	926	941	949	958	957	715
145°	1074	1074	1089	1096	1091	672
155°	1183	1175	1186	1191	1184	545
165°	1247	1241	1244	1250	1244	352
175°	1275	1269	1270	1277	1268	121
180°	1272	1272	1272	1272	1272	

TEST NUMBER: P904497

CATALOG NUMBER: DFN2DIP-TR3F0-080D040US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3116.4	3116.4	3116.4	3116.4	3116.4
2.5°	3130.5	3116.4	3085.3	3113.7	3108.0
5°	3116.4	3102.4	3065.5	3091.0	3082.6
7.5°	3091.0	3074.2	3034.7	3045.8	3031.7
10°	3057.1	3037.4	2981.2	2972.5	2955.7
12.5°	3015.0	2989.6	2913.2	2896.4	2865.3
15°	2964.1	2933.0	2837.2	2783.7	2755.5
17.5°	2904.8	2859.7	2741.2	2679.3	2634.0
20°	2837.2	2780.7	2639.8	2569.5	2507.2
22.5°	2763.9	2699.0	2535.3	2439.6	2397.4
25°	2690.6	2600.3	2414.1	2298.7	2256.2
27.5°	2603.2	2507.2	2301.3	2168.8	2103.8
30°	2510.2	2402.7	2177.2	2033.5	1957.2
32.5°	2419.8	2290.0	2059.0	1889.6	1819.0
35°	2318.4	2174.4	1926.4	1748.7	1686.4
37.5°	2219.6	2064.4	1802.2	1607.4	1537.1
40°	2115.3	1946.2	1672.4	1472.2	1398.8
42.5°	2008.1	1827.7	1542.8	1334.0	1263.6
45°	1895.3	1706.2	1410.2	1209.8	1142.2
47.5°	1788.2	1588.0	1283.4	1082.9	1021.0
50°	1669.6	1469.5	1159.2	964.4	905.4
52.5°	1553.9	1342.3	1040.7	854.6	801.1
55°	1441.1	1221.2	916.5	747.4	693.9
57.5°	1325.6	1099.9	806.7	648.8	603.5
60°	1207.0	981.5	690.9	547.2	502.1
62.5°	1091.6	865.9	592.2	456.9	434.5
65°	973.1	744.4	490.7	395.0	386.3
67.5°	860.3	631.7	395.0	346.8	338.5
70°	741.8	521.9	327.1	298.9	287.6
72.5°	629.0	420.1	273.5	251.1	245.3
75°	518.9	321.4	225.6	205.9	203.2
77.5°	409.1	228.3	177.8	166.4	160.7
80°	307.3	163.7	135.3	124.1	124.1
82.5°	214.2	110.1	93.0	87.4	87.4
85°	121.2	61.9	53.5	53.5	53.5
87.5°	45.1	22.4	22.4	19.8	19.8
90°	0.8	11.0	18.4	23.1	24.8
92.5°	23.1	19.3	22.1	23.9	24.8
95°	59.8	29.4	35.8	40.5	39.6
97.5°	107.7	32.2	46.9	49.8	50.6
100°	163.0	36.9	52.5	59.8	61.6
102.5°	223.7	222.0	54.3	64.4	67.2
105°	279.8	307.6	56.2	66.3	69.9
107.5°	345.3	368.3	58.1	68.1	71.8
110°	407.9	427.2	161.2	69.1	72.7



TEST NUMBER: P904497

CATALOG NUMBER: DFN2DIP-TR3F0-080D040US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	466.8	483.3	467.7	70.9	73.7
115°	529.3	545.0	568.1	141.8	75.6
117.5°	583.7	602.1	617.8	486.1	244.9
120°	644.5	658.3	674.9	686.0	561.7
122.5°	696.0	710.8	729.2	734.7	735.7
125°	748.5	760.5	778.0	784.5	787.2
127.5°	796.4	809.3	823.1	832.4	833.2
130°	841.5	856.3	866.3	876.5	875.6
132.5°	887.5	899.6	909.6	917.9	917.1
135°	926.2	941.0	949.2	958.5	956.7
137.5°	966.7	977.7	987.0	996.2	993.4
140°	1006.3	1013.7	1023.8	1032.1	1027.5
142.5°	1039.5	1045.9	1057.9	1065.2	1060.6
145°	1074.5	1073.6	1089.1	1095.6	1091.0
147.5°	1104.8	1102.0	1117.7	1122.3	1118.7
150°	1134.3	1127.8	1142.6	1148.1	1143.5
152.5°	1159.1	1151.8	1165.5	1171.1	1164.7
155°	1183.1	1174.9	1185.9	1191.4	1184.0
157.5°	1202.4	1195.0	1203.4	1209.8	1202.4
160°	1219.0	1213.4	1219.0	1224.5	1218.0
162.5°	1233.7	1228.2	1232.8	1239.3	1231.0
165°	1246.6	1241.1	1243.9	1250.3	1243.9
167.5°	1256.8	1251.1	1254.1	1260.5	1252.2
170°	1265.1	1259.5	1261.3	1267.8	1259.5
172.5°	1270.5	1265.1	1267.0	1273.4	1265.1
175°	1275.1	1268.7	1270.5	1277.0	1267.8
177.5°	1277.0	1270.5	1271.5	1278.0	1269.7
180°	1272.4	1272.4	1272.4	1272.4	1272.4

TEST NUMBER: P904497

CATALOG NUMBER: DFN2DIP-TR3F0-080D040US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.96	13.91	13.80	14.77	15.84	8.94	9.89	9.78	10.75	11.82
	3H	14.64	15.49	15.49	16.36	17.46	10.13	10.98	10.99	11.85	12.95
	4H	15.25	16.05	16.12	16.92	18.03	10.58	11.39	11.45	12.26	13.37
	6H	15.67	16.41	16.55	17.29	18.41	10.91	11.64	11.79	12.53	13.65
	8H	15.79	16.50	16.68	17.40	18.52	11.00	11.70	11.89	12.60	13.72
	12H	15.85	16.52	16.75	17.42	18.56	11.04	11.71	11.94	12.60	13.75
4H	2H	12.99	13.80	13.87	14.67	15.78	9.54	10.35	10.42	11.22	12.33
	3H	14.82	15.49	15.71	16.40	17.52	10.90	11.56	11.78	12.47	13.60
	4H	15.51	16.12	16.41	17.02	18.17	11.45	12.05	12.34	12.96	14.11
	6H	16.03	16.55	16.94	17.48	18.63	11.87	12.39	12.78	13.32	14.47
	8H	16.20	16.69	17.11	17.61	18.77	11.99	12.48	12.91	13.40	14.57
	12H	16.29	16.73	17.23	17.67	18.84	12.06	12.50	13.00	13.44	14.61
8H	4H	15.49	15.98	16.40	16.90	18.06	11.73	12.22	12.65	13.14	14.31
	6H	16.05	16.45	16.99	17.41	18.58	12.24	12.65	13.19	13.61	14.78
	8H	16.26	16.62	17.21	17.57	18.75	12.43	12.79	13.38	13.74	14.93
	12H	16.40	16.71	17.35	17.66	18.89	12.55	12.86	13.50	13.81	15.04
12H	4H	15.44	15.88	16.38	16.82	18.00	11.74	12.18	12.67	13.12	14.29
	6H	16.02	16.38	16.97	17.34	18.52	12.29	12.65	13.24	13.60	14.79
	8H	16.24	16.56	17.20	17.50	18.74	12.50	12.82	13.46	13.76	15.00