

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904516

Luminaire Tested: DFN2DIP-TR3F0-090D030US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904516
REPORT IS A COMBINATION OF REPORTS P900283 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-090D030US830-FLLFLL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10900.5 lumens
Efficiency: N/A
Efficacy: 92.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 117.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904516

CATALOG NUMBER: DFN2DIP-TR3F0-090D030US830-FLLFLL

Luminous Intensity Polar Plot

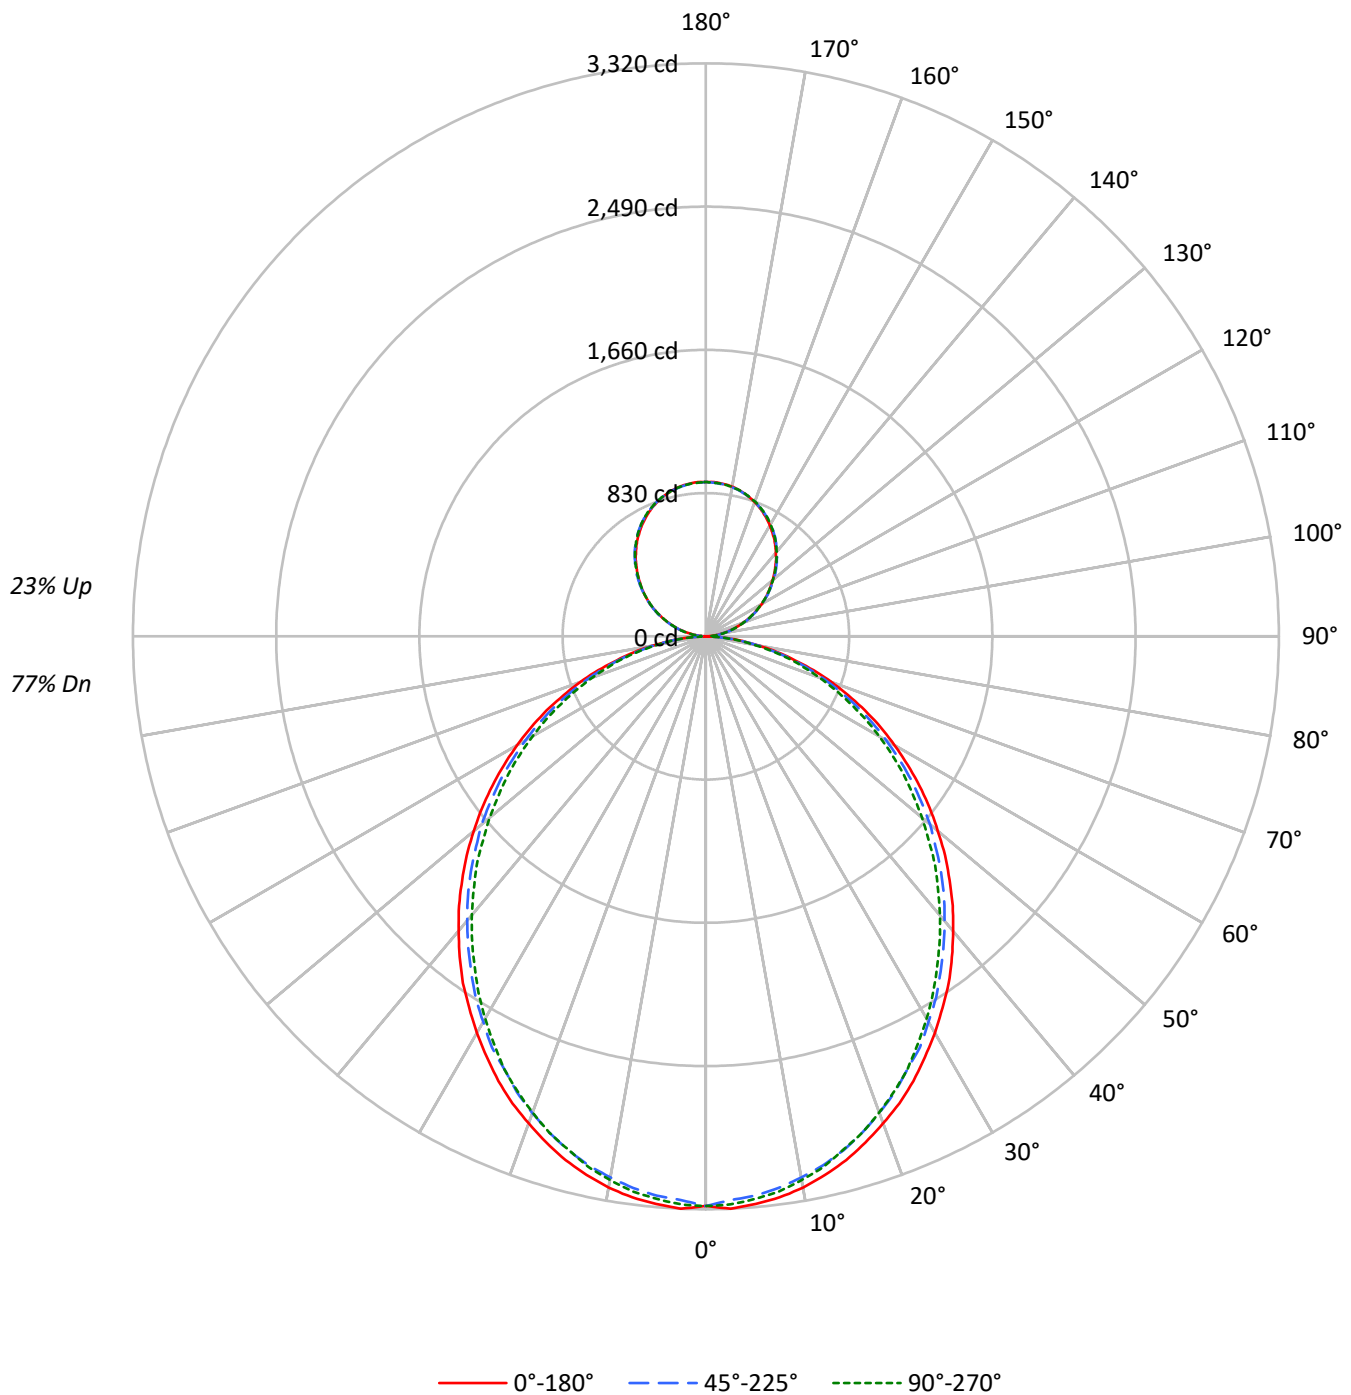

TEST NUMBER: P904516

CATALOG NUMBER: DFN2DIP-TR3F0-090D030US830-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	114	114	114	114	108	108	108	108	98	98	98	89	89	89	81	81	81
1	104	99	95	92	99	95	91	88	86	84	81	79	77	75	72	70	68
2	95	87	80	75	90	83	77	72	76	71	67	69	66	62	63	60	58
3	86	76	69	63	82	73	66	61	67	61	57	61	57	53	56	52	49
4	79	68	59	53	75	65	57	52	60	53	48	55	50	45	50	46	42
5	73	61	52	46	69	58	50	44	53	47	42	49	44	39	45	41	37
6	67	55	46	40	64	52	45	39	48	42	37	45	39	35	41	36	33
7	62	49	41	35	59	48	40	34	44	37	33	41	35	31	37	33	29
8	58	45	37	31	55	43	36	31	40	34	29	37	32	28	34	30	26
9	54	41	33	28	52	40	32	27	37	31	26	34	29	25	32	27	24
10	51	38	30	25	48	37	30	25	34	28	24	32	26	23	30	25	22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4113	4113	4113
5°	4117	4052	4080
10°	4082	3994	4022
15°	4020	3925	3933
20°	3936	3830	3842
25°	3853	3718	3738
30°	3750	3612	3605
35°	3651	3489	3465
40°	3531	3364	3331
45°	3410	3239	3195
50°	3279	3107	3037
55°	3141	2955	2890
60°	2984	2774	2723
65°	2814	2587	2526
70°	2596	2358	2312
75°	2295	2084	2111
80°	1932	1734	1736
85°	1365	1142	1120

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3410 cd/sqm

TEST NUMBER: P904516

CATALOG NUMBER: DFN2DIP-TR3F0-090D030US830-FLLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	310.7	2.9
10°-20°	874.1	8.0
20°-30°	1284.6	11.8
30°-40°	1492.0	13.7
40°-50°	1490.1	13.7
50°-60°	1299.3	11.9
60°-70°	960.5	8.8
70°-80°	543.4	5.0
80°-90°	146.0	1.3
90°-100°	55.3	0.5
100°-110°	175.8	1.6
110°-120°	300.9	2.8
120°-130°	395.7	3.6
130°-140°	444.2	4.1
140°-150°	435.6	4.0
150°-160°	365.4	3.4
160°-170°	242.3	2.2
170°-180°	84.7	0.8
0°-30°	2469.3	22.7
0°-40°	3961.3	36.3
0°-60°	6750.7	61.9
0°-90°	8400.6	77.1
90°-120°	532.1	4.9
90°-150°	1807.5	16.6
90°-180°	2500.0	22.9
0°-180°	10900.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3301	3301	3301	3301	3301	
5°	3301	3288	3253	3278	3272	313
15°	3142	3123	3082	3095	3079	885
25°	2844	2818	2765	2771	2765	1309
35°	2454	2422	2371	2352	2336	1532
45°	1996	1974	1926	1892	1879	1541
55°	1511	1492	1454	1416	1400	1351
65°	1019	1000	968	940	924	1007
75°	533	527	511	492	498	569
85°	130	127	124	114	111	145
90°	1	10	26	25	26	10
95°	39	47	48	48	47	44
105°	162	164	166	167	167	171
115°	302	306	305	304	302	299
125°	439	446	444	441	440	392
135°	568	576	578	577	575	439
145°	690	695	699	700	697	431
155°	789	791	793	797	795	363
165°	858	857	857	862	859	242
175°	893	890	889	894	890	85
180°	894	894	894	894	894	



TEST NUMBER: P904516

CATALOG NUMBER: DFN2DIP-TR3F0-090D030US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3300.7	3300.7	3300.7	3300.7	3300.7
2.5°	3319.9	3304.1	3269.1	3300.7	3294.7
5°	3300.7	3288.2	3253.3	3278.5	3272.4
7.5°	3278.5	3259.7	3224.6	3250.3	3243.9
10°	3243.9	3221.6	3183.5	3208.8	3199.4
12.5°	3196.0	3177.1	3139.1	3154.9	3148.6
15°	3142.2	3123.3	3081.8	3094.6	3078.8
17.5°	3075.4	3056.6	3015.2	3031.0	3015.2
20°	3002.4	2983.5	2939.0	2948.5	2936.0
22.5°	2929.6	2901.1	2859.6	2859.6	2853.2
25°	2843.7	2818.5	2764.7	2770.7	2764.7
27.5°	2748.5	2726.2	2685.2	2675.8	2659.9
30°	2653.5	2627.9	2580.4	2571.0	2558.2
32.5°	2551.8	2533.0	2482.1	2463.0	2450.1
35°	2453.5	2421.9	2371.0	2351.8	2336.0
37.5°	2342.4	2313.8	2262.9	2240.7	2224.9
40°	2228.2	2202.6	2151.7	2123.5	2110.7
42.5°	2117.0	2091.5	2041.0	2009.0	1990.2
45°	1996.5	1974.3	1926.5	1891.8	1879.1
47.5°	1879.1	1856.8	1805.9	1770.9	1752.1
50°	1755.1	1739.3	1694.8	1650.4	1634.6
52.5°	1634.6	1612.3	1571.2	1536.2	1514.0
55°	1511.0	1491.8	1453.7	1415.7	1399.9
57.5°	1387.0	1371.2	1329.8	1291.8	1278.9
60°	1263.1	1250.7	1206.2	1171.2	1161.8
62.5°	1142.5	1120.3	1088.6	1057.1	1044.2
65°	1019.0	999.8	968.1	939.5	923.7
67.5°	892.0	875.9	847.5	825.4	812.6
70°	774.5	761.7	733.1	710.9	698.4
72.5°	653.9	641.1	625.3	603.1	593.7
75°	533.1	527.0	510.9	492.0	498.4
77.5°	425.3	412.6	406.1	396.7	387.3
80°	317.5	314.1	307.7	298.3	292.0
82.5°	215.8	215.8	212.8	200.0	200.0
85°	130.0	127.0	123.9	114.1	111.1
87.5°	57.2	50.8	44.5	35.1	31.7
90°	0.8	9.7	26.4	24.8	25.6
92.5°	16.7	22.6	23.5	24.2	24.2
95°	39.4	46.9	48.3	48.3	46.9
97.5°	65.5	72.5	75.5	75.5	75.5
100°	95.7	101.9	104.1	104.1	103.3
102.5°	127.5	132.1	135.1	135.9	135.1
105°	162.3	164.5	166.1	167.4	167.4
107.5°	196.8	200.0	200.0	200.6	196.8
110°	230.3	234.6	234.6	234.6	232.4

TEST NUMBER: P904516

CATALOG NUMBER: DFN2DIP-TR3F0-090D030US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	266.4	271.0	270.1	268.0	266.4
115°	302.0	306.2	304.9	304.2	302.0
117.5°	337.2	343.2	339.4	337.2	335.1
120°	372.9	378.8	372.9	372.9	370.4
122.5°	405.2	412.7	409.0	406.8	405.2
125°	439.2	445.9	443.7	441.3	440.5
127.5°	472.3	480.7	477.8	474.5	472.3
130°	503.3	513.0	511.7	510.1	507.1
132.5°	538.1	545.6	546.2	542.4	540.3
135°	568.1	576.4	578.1	577.2	575.0
137.5°	601.4	608.2	609.5	609.1	605.8
140°	630.8	637.6	641.4	641.4	638.4
142.5°	661.1	667.8	670.0	670.8	667.8
145°	689.7	695.0	699.4	700.1	697.2
147.5°	715.3	722.0	725.2	726.6	723.6
150°	741.7	746.3	749.2	751.7	749.2
152.5°	765.2	769.7	773.5	776.5	773.5
155°	788.6	790.7	793.1	796.9	794.6
157.5°	808.8	810.4	811.8	817.2	813.4
160°	826.9	828.5	829.3	833.9	830.7
162.5°	843.6	843.6	844.4	849.5	845.7
165°	857.9	857.1	857.1	862.4	858.7
167.5°	870.8	868.4	868.4	873.7	870.0
170°	880.5	878.4	877.6	883.0	878.4
172.5°	887.2	885.1	884.3	889.7	885.1
175°	892.7	890.5	888.9	894.3	889.7
177.5°	895.6	893.4	891.8	896.5	891.8
180°	894.3	894.3	894.3	894.3	894.3

TEST NUMBER: P904516

CATALOG NUMBER: DFN2DIP-TR3F0-090D030US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.33	15.50	15.02	16.21	17.03	13.90	15.07	14.59	15.78	16.60
	3H	16.01	17.06	16.70	17.77	18.63	15.54	16.59	16.23	17.30	18.16
	4H	16.60	17.59	17.32	18.32	19.19	16.13	17.13	16.85	17.85	18.72
	6H	17.01	17.93	17.74	18.66	19.54	16.54	17.46	17.27	18.19	19.07
	8H	17.12	17.99	17.86	18.75	19.63	16.65	17.53	17.39	18.28	19.16
	12H	17.17	18.01	17.92	18.75	19.67	16.70	17.54	17.45	18.28	19.20
4H	2H	14.83	15.82	15.55	16.54	17.41	14.48	15.48	15.20	16.20	17.07
	3H	16.71	17.54	17.44	18.30	19.19	16.32	17.15	17.05	17.91	18.80
	4H	17.43	18.18	18.18	18.94	19.86	17.03	17.78	17.78	18.54	19.46
	6H	17.95	18.61	18.72	19.39	20.32	17.55	18.20	18.31	18.99	19.91
	8H	18.10	18.72	18.87	19.50	20.43	17.70	18.31	18.47	19.09	20.03
	12H	18.19	18.74	18.98	19.54	20.48	17.77	18.32	18.56	19.13	20.07
8H	4H	17.65	18.26	18.42	19.04	19.98	17.29	17.90	18.06	18.68	19.62
	6H	18.28	18.79	19.08	19.61	20.55	17.92	18.43	18.72	19.25	20.19
	8H	18.50	18.95	19.31	19.77	20.72	18.13	18.58	18.94	19.41	20.36
	12H	18.64	19.03	19.45	19.85	20.86	18.26	18.66	19.07	19.47	20.48
12H	4H	17.64	18.20	18.44	19.00	19.94	17.30	17.85	18.09	18.65	19.59
	6H	18.31	18.76	19.12	19.58	20.54	17.96	18.41	18.77	19.24	20.19
	8H	18.56	18.96	19.37	19.77	20.78	18.21	18.60	19.02	19.42	20.43

END OF REPORT