

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907127

Luminaire Tested: DFN2DIP-TR3F0-040D060US835-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907127
REPORT IS A COMBINATION OF REPORTS P901835 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-040D060US835-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9900.0 lumens
Efficiency: N/A
Efficacy: 123.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 80.1
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907127

CATALOG NUMBER: DFN2DIP-TR3F0-040D060US835-FLLONL

Luminous Intensity Polar Plot

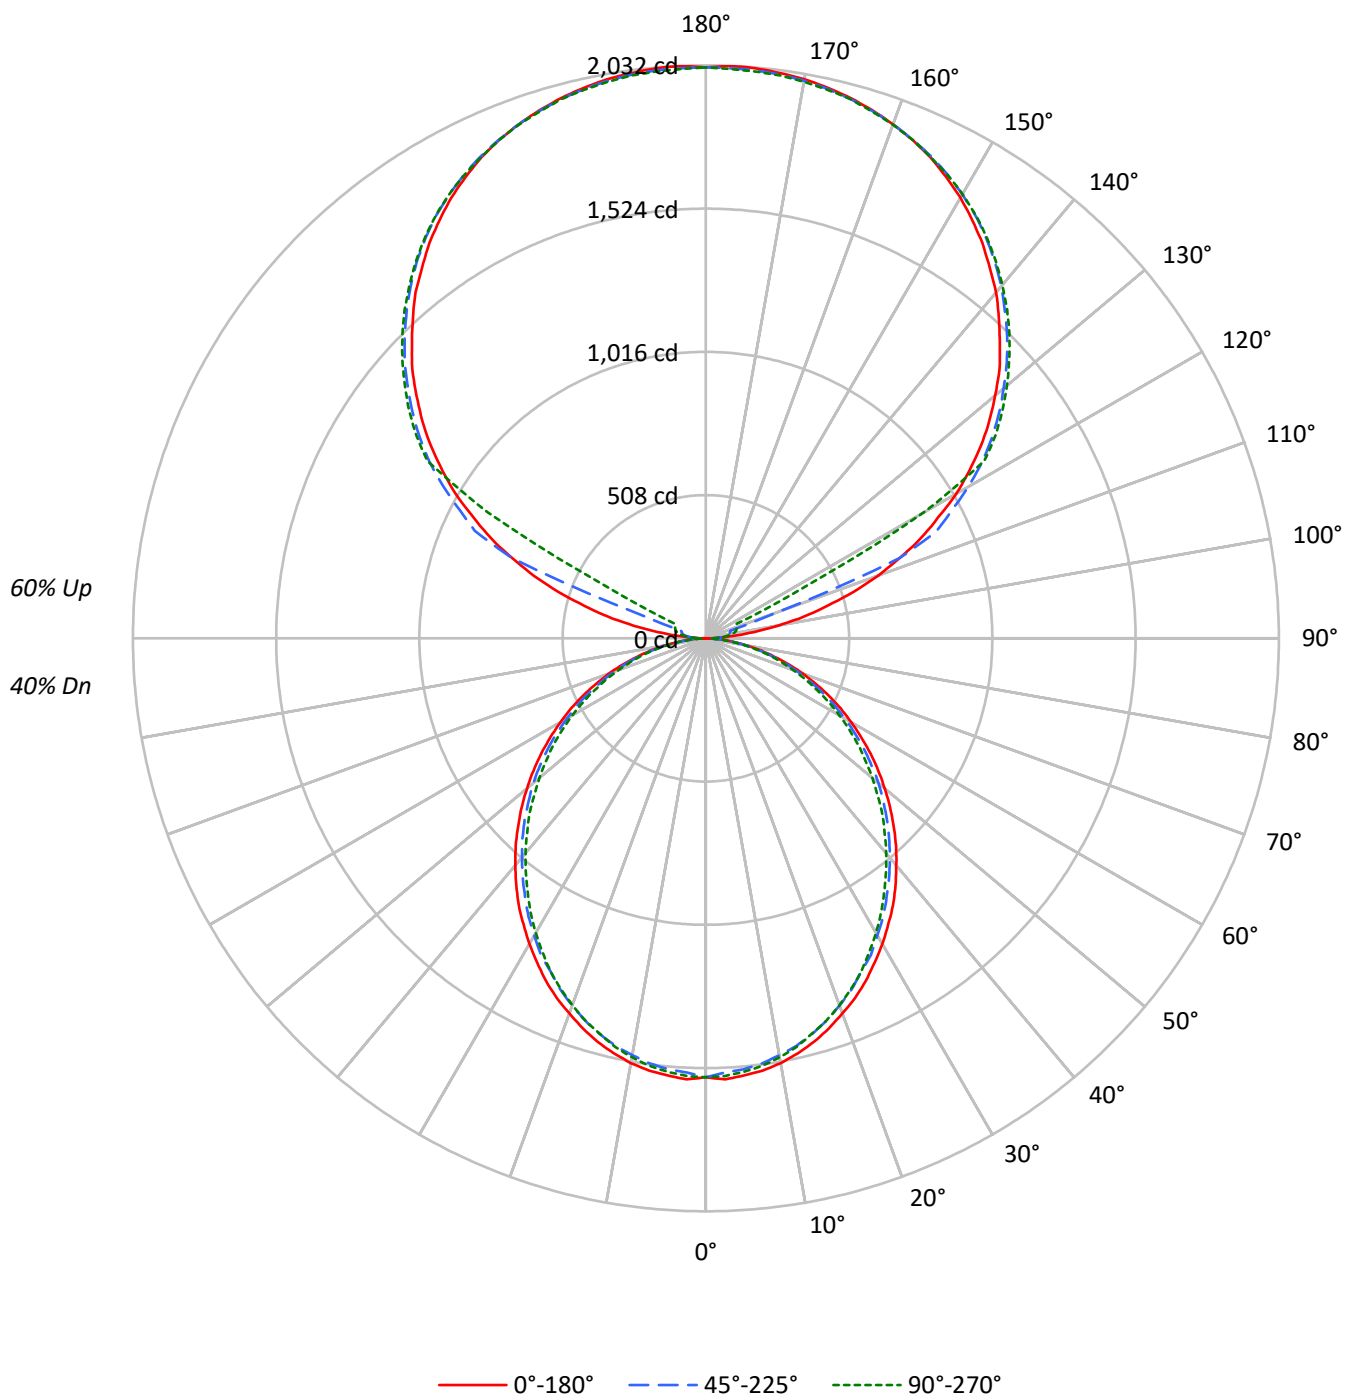

TEST NUMBER: P907127

CATALOG NUMBER: DFN2DIP-TR3F0-040D060US835-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	78	78	78	62	62	62	47	47	47
1	96	91	87	84	87	83	80	77	68	66	64	54	53	51	41	41	40
2	87	80	74	69	79	73	68	63	60	56	53	48	45	43	37	35	33
3	79	70	63	57	72	64	58	53	53	48	44	42	39	36	32	30	28
4	73	62	54	48	66	57	50	45	47	42	38	37	34	31	29	26	24
5	67	55	47	41	60	50	44	38	42	37	33	34	30	27	26	23	21
6	61	49	41	36	56	45	38	33	38	32	28	30	26	23	24	21	19
7	57	45	37	31	51	41	34	29	34	29	25	28	24	21	22	19	17
8	52	40	33	27	48	37	30	26	31	26	22	25	21	18	20	17	15
9	49	37	29	24	44	34	27	23	28	23	20	23	19	17	18	15	13
10	46	34	27	22	41	31	25	20	26	21	18	21	18	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1939	1939	1939
5°	1941	1911	1924
10°	1925	1883	1897
15°	1895	1851	1855
20°	1856	1806	1812
25°	1817	1753	1762
30°	1768	1703	1700
35°	1722	1645	1634
40°	1665	1586	1571
45°	1608	1527	1506
50°	1546	1465	1432
55°	1481	1393	1363
60°	1407	1308	1284
65°	1327	1220	1191
70°	1224	1112	1090
75°	1082	983	996
80°	911	818	818
85°	644	538	528

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1608 cd/sqm

TEST NUMBER: P907127

CATALOG NUMBER: DFN2DIP-TR3F0-040D060US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	146.5	1.5
10°-20°	412.2	4.2
20°-30°	605.7	6.1
30°-40°	703.5	7.1
40°-50°	702.6	7.1
50°-60°	612.7	6.2
60°-70°	452.9	4.6
70°-80°	256.2	2.6
80°-90°	71.2	0.7
90°-100°	66.8	0.7
100°-110°	248.9	2.5
110°-120°	660.2	6.7
120°-130°	1094.9	11.1
130°-140°	1163.0	11.7
140°-150°	1080.9	10.9
150°-160°	869.0	8.8
160°-170°	560.0	5.7
170°-180°	192.7	1.9
0°-30°	1164.4	11.8
0°-40°	1867.9	18.9
0°-60°	3183.2	32.2
0°-90°	3963.6	40.0
90°-120°	975.8	9.9
90°-150°	4314.7	43.6
90°-180°	5936.0	60.0
0°-180°	9900.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1556	1556	1556	1556	1556	
5°	1556	1550	1534	1546	1543	148
15°	1482	1473	1453	1459	1452	417
25°	1341	1329	1304	1306	1304	617
35°	1157	1142	1118	1109	1102	722
45°	941	931	908	892	886	727
55°	712	703	686	668	660	637
65°	480	471	456	443	436	475
75°	251	248	241	232	235	268
85°	61	60	58	54	52	68
90°	1	18	29	37	40	9
95°	95	47	57	65	63	113
105°	445	489	89	105	111	476
115°	842	867	904	226	120	829
125°	1191	1210	1238	1248	1253	1062
135°	1474	1498	1511	1525	1522	1139
145°	1710	1708	1733	1744	1736	1069
155°	1883	1870	1887	1896	1884	868
165°	1984	1975	1980	1990	1980	560
175°	2029	2019	2022	2032	2018	193
180°	2025	2025	2025	2025	2025	

TEST NUMBER: P907127

CATALOG NUMBER: DFN2DIP-TR3F0-040D060US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1556.4	1556.4	1556.4	1556.4	1556.4
2.5°	1565.5	1558.0	1541.5	1556.4	1553.6
5°	1556.4	1550.5	1534.0	1545.9	1543.1
7.5°	1545.9	1537.0	1520.5	1532.6	1529.6
10°	1529.6	1519.1	1501.2	1513.1	1508.6
12.5°	1507.0	1498.1	1480.2	1487.7	1484.6
15°	1481.6	1472.7	1453.2	1459.2	1451.8
17.5°	1450.2	1441.3	1421.8	1429.2	1421.8
20°	1415.7	1406.8	1385.9	1390.3	1384.5
22.5°	1381.4	1367.9	1348.4	1348.4	1345.4
25°	1340.9	1329.0	1303.6	1306.5	1303.6
27.5°	1296.0	1285.5	1266.2	1261.7	1254.3
30°	1251.2	1239.2	1216.8	1212.3	1206.3
32.5°	1203.3	1194.4	1170.4	1161.4	1155.3
35°	1156.9	1142.0	1118.0	1109.0	1101.5
37.5°	1104.5	1091.0	1067.0	1056.6	1049.1
40°	1050.7	1038.6	1014.6	1001.3	995.3
42.5°	998.3	986.2	962.4	947.3	938.4
45°	941.4	931.0	908.4	892.1	886.0
47.5°	886.0	875.5	851.6	835.1	826.2
50°	827.6	820.1	799.2	778.2	770.7
52.5°	770.7	760.3	740.9	724.4	713.9
55°	712.5	703.4	685.5	667.5	660.1
57.5°	654.0	646.6	627.0	609.1	603.1
60°	595.6	589.7	568.8	552.3	547.8
62.5°	538.8	528.3	513.4	498.4	492.4
65°	480.5	471.4	456.5	443.0	435.6
67.5°	420.6	413.0	399.7	389.2	383.2
70°	365.2	359.2	345.7	335.2	329.3
72.5°	308.4	302.3	294.9	284.4	279.9
75°	251.4	248.5	240.9	232.0	235.0
77.5°	200.5	194.5	191.5	187.0	182.6
80°	149.7	148.1	145.1	140.7	137.7
82.5°	101.8	101.8	100.4	94.3	94.3
85°	61.3	59.9	58.4	53.8	52.4
87.5°	27.0	24.0	21.0	16.5	14.9
90°	1.4	17.6	29.2	36.7	39.5
92.5°	36.7	30.8	35.1	38.1	39.5
95°	95.2	46.8	57.1	64.6	63.0
97.5°	171.4	51.3	74.6	79.2	80.6
100°	259.4	58.6	83.5	95.2	98.1
102.5°	356.0	353.2	86.5	102.5	107.0
105°	445.4	489.4	89.4	105.4	111.4
107.5°	549.5	586.0	92.4	108.4	114.3
110°	649.2	679.8	256.5	110.0	115.7

TEST NUMBER: P907127

CATALOG NUMBER: DFN2DIP-TR3F0-040D060US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	742.9	769.2	744.3	112.7	117.3
115°	842.5	867.4	904.1	225.7	120.2
117.5°	928.9	958.2	983.2	773.6	389.7
120°	1025.7	1047.6	1074.1	1091.6	893.8
122.5°	1107.6	1131.1	1160.5	1169.2	1170.8
125°	1191.2	1210.3	1238.1	1248.4	1252.7
127.5°	1267.4	1287.9	1310.0	1324.6	1326.0
130°	1339.2	1362.7	1378.7	1394.9	1393.5
132.5°	1412.5	1431.6	1447.6	1460.8	1459.4
135°	1474.1	1497.6	1510.6	1525.4	1522.4
137.5°	1538.4	1556.0	1570.8	1585.4	1581.1
140°	1601.4	1613.3	1629.3	1642.5	1635.2
142.5°	1654.3	1664.6	1683.6	1695.2	1687.9
145°	1710.0	1708.4	1733.3	1743.6	1736.3
147.5°	1758.2	1753.8	1778.7	1786.0	1780.3
150°	1805.2	1794.9	1818.4	1827.1	1819.8
152.5°	1844.7	1833.0	1854.9	1863.8	1853.5
155°	1882.8	1869.7	1887.3	1896.0	1884.3
157.5°	1913.6	1901.9	1915.1	1925.4	1913.6
160°	1940.0	1931.1	1940.0	1948.7	1938.5
162.5°	1963.3	1954.6	1961.9	1972.2	1959.0
165°	1983.9	1975.2	1979.5	1989.8	1979.5
167.5°	2000.0	1991.2	1995.7	2006.0	1992.7
170°	2013.3	2004.4	2007.4	2017.6	2004.4
172.5°	2022.0	2013.3	2016.2	2026.5	2013.3
175°	2029.3	2019.0	2022.0	2032.2	2017.6
177.5°	2032.2	2022.0	2023.5	2033.8	2020.6
180°	2024.9	2024.9	2024.9	2024.9	2024.9

TEST NUMBER: P907127

CATALOG NUMBER: DFN2DIP-TR3F0-040D060US835-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.52	9.30	9.56	10.35	11.75	8.10	8.87	9.13	9.92	11.33
	3H	10.17	10.87	11.22	11.92	13.35	9.70	10.40	10.75	11.45	12.88
	4H	10.75	11.41	11.81	12.46	13.90	10.28	10.94	11.34	12.00	13.43
	6H	11.13	11.74	12.20	12.80	14.25	10.67	11.27	11.74	12.33	13.78
	8H	11.23	11.81	12.31	12.89	14.33	10.77	11.34	11.84	12.42	13.86
	12H	11.28	11.83	12.35	12.90	14.36	10.80	11.35	11.88	12.42	13.89
4H	2H	8.97	9.63	10.04	10.69	12.12	8.63	9.29	9.70	10.35	11.78
	3H	10.82	11.37	11.89	12.45	13.90	10.43	10.98	11.51	12.07	13.51
	4H	11.52	12.03	12.60	13.10	14.57	11.12	11.63	12.20	12.70	14.17
	6H	12.03	12.46	13.11	13.56	15.02	11.62	12.06	12.71	13.15	14.61
	8H	12.17	12.57	13.26	13.66	15.14	11.76	12.17	12.85	13.26	14.73
	12H	12.23	12.60	13.34	13.70	15.18	11.82	12.19	12.92	13.29	14.77
8H	4H	11.71	12.12	12.80	13.20	14.68	11.35	11.76	12.44	12.85	14.32
	6H	12.33	12.66	13.44	13.79	15.27	11.97	12.30	13.08	13.43	14.91
	8H	12.54	12.83	13.66	13.95	15.44	12.18	12.47	13.29	13.58	15.08
	12H	12.66	12.92	13.78	14.03	15.56	12.28	12.54	13.40	13.65	15.18
12H	4H	11.69	12.06	12.80	13.16	14.64	11.34	11.71	12.45	12.81	14.29
	6H	12.35	12.65	13.47	13.76	15.25	12.01	12.30	13.12	13.41	14.91
	8H	12.58	12.84	13.71	13.95	15.48	12.23	12.49	13.35	13.60	15.13

END OF REPORT