

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907132

Luminaire Tested: DFN2DIP-TR3F0-040D070US835-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907132
REPORT IS A COMBINATION OF REPORTS P900330 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-040D070US835-RLLFLL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9595.0 lumens
Efficiency: N/A
Efficacy: 108.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 88.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907132

CATALOG NUMBER: DFN2DIP-TR3F0-040D070US835-RLLFLL

Luminous Intensity Polar Plot

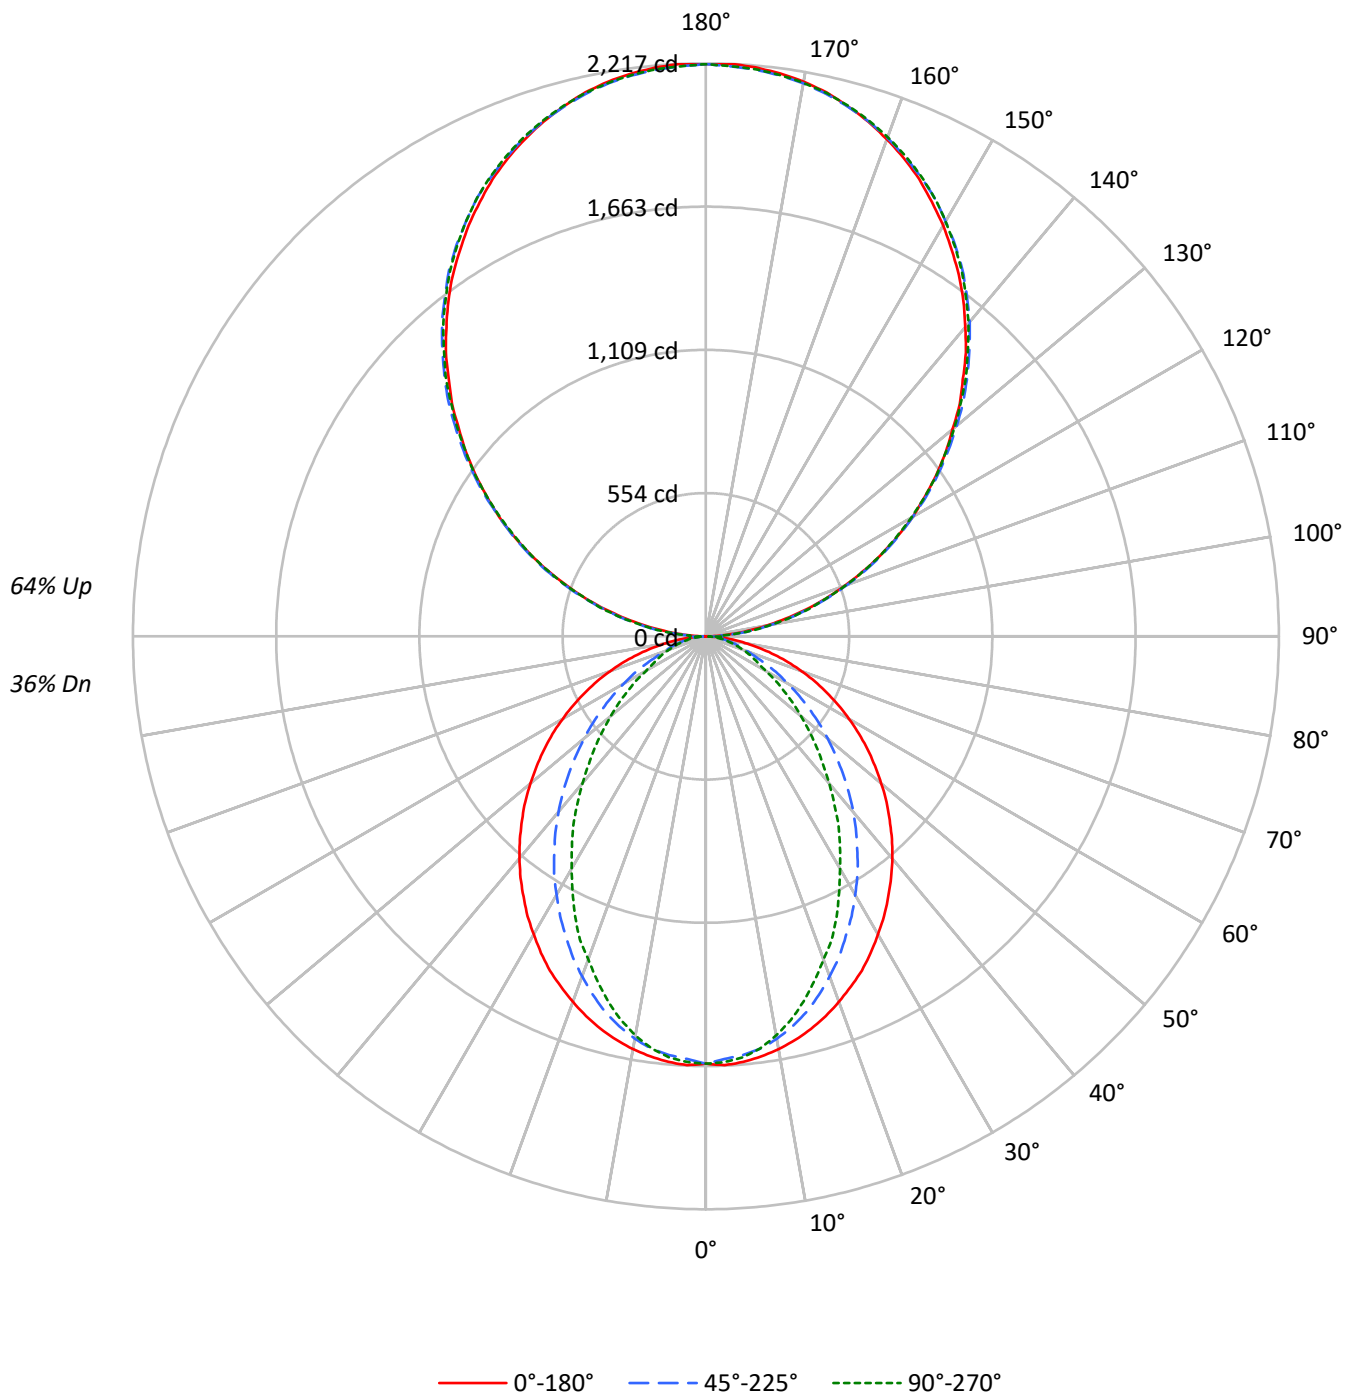

TEST NUMBER: P907132

CATALOG NUMBER: DFN2DIP-TR3F0-040D070US835-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	75	75	75	58	58	58	43	43	43
1	95	91	87	84	86	82	79	76	66	64	62	52	50	49	38	37	37
2	87	80	74	69	78	72	67	63	59	55	52	46	44	42	34	33	31
3	79	70	63	58	71	64	58	53	52	48	44	41	38	36	31	29	27
4	73	62	55	49	65	57	50	45	46	42	38	37	33	31	27	25	24
5	67	56	48	42	60	51	44	39	42	37	33	33	29	27	25	23	21
6	61	50	42	37	55	46	39	34	37	32	29	30	26	24	23	20	18
7	57	45	37	32	51	41	35	30	34	29	25	27	24	21	21	18	17
8	53	41	33	28	48	38	31	26	31	26	23	25	21	19	19	17	15
9	49	37	30	25	44	34	28	24	28	24	20	23	19	17	18	15	14
10	46	34	27	23	42	31	25	21	26	21	18	21	18	15	16	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2060	2060	2060
5°	2062	2026	2039
10°	2041	1984	1971
15°	2011	1917	1868
20°	1973	1825	1741
25°	1934	1722	1618
30°	1882	1617	1463
35°	1830	1504	1327
40°	1778	1387	1171
45°	1717	1258	1030
50°	1655	1127	892
55°	1589	988	760
60°	1513	843	624
65°	1425	696	560
70°	1319	558	505
75°	1185	488	457
80°	992	404	392
85°	675	262	286

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2161 cd/sqm

TEST NUMBER: P907132

CATALOG NUMBER: DFN2DIP-TR3F0-040D070US835-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	154.9	1.6
10°-20°	425.3	4.4
20°-30°	597.2	6.2
30°-40°	650.9	6.8
40°-50°	598.3	6.2
50°-60°	469.9	4.9
60°-70°	305.8	3.2
70°-80°	157.4	1.6
80°-90°	46.5	0.5
90°-100°	137.0	1.4
100°-110°	435.3	4.5
110°-120°	744.9	7.8
120°-130°	979.6	10.2
130°-140°	1099.6	11.5
140°-150°	1078.3	11.2
150°-160°	904.5	9.4
160°-170°	599.9	6.3
170°-180°	209.7	2.2
0°-30°	1177.4	12.3
0°-40°	1828.4	19.1
0°-60°	2896.5	30.2
0°-90°	3406.3	35.5
90°-120°	1317.2	13.7
90°-150°	4474.7	46.6
90°-180°	6189.0	64.5
0°-180°	9595.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1653	1653	1653	1653	1653	
5°	1653	1646	1626	1640	1635	157
15°	1572	1556	1505	1477	1462	443
25°	1427	1379	1281	1219	1197	656
35°	1230	1154	1022	928	895	770
45°	1005	905	748	642	606	776
55°	764	648	486	396	368	683
65°	516	395	260	210	205	512
75°	275	170	120	109	108	291
85°	64	33	28	28	28	74
90°	2	24	65	61	63	10
95°	97	116	120	120	116	108
105°	402	407	411	414	414	424
115°	748	758	755	753	748	739
125°	1087	1104	1099	1093	1091	972
135°	1406	1427	1431	1429	1424	1087
145°	1707	1721	1731	1733	1726	1067
155°	1952	1958	1964	1973	1967	899
165°	2124	2122	2122	2135	2126	599
175°	2210	2204	2200	2214	2202	210
180°	2214	2214	2214	2214	2214	

TEST NUMBER: P907132

CATALOG NUMBER: DFN2DIP-TR3F0-040D070US835-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1653.2	1653.2	1653.2	1653.2	1653.2
2.5°	1660.7	1653.2	1636.7	1651.8	1648.7
5°	1653.2	1645.7	1626.2	1639.7	1635.3
7.5°	1639.7	1630.8	1609.9	1615.7	1608.3
10°	1621.8	1611.3	1581.4	1576.8	1568.0
12.5°	1599.4	1585.9	1545.4	1536.5	1520.0
15°	1572.4	1555.9	1505.1	1476.7	1461.8
17.5°	1541.0	1517.0	1454.1	1421.3	1397.3
20°	1505.1	1475.1	1400.3	1363.0	1330.0
22.5°	1466.2	1431.8	1344.9	1294.1	1271.8
25°	1427.3	1379.4	1280.6	1219.4	1196.8
27.5°	1381.0	1330.0	1220.8	1150.5	1116.0
30°	1331.6	1274.6	1154.9	1078.7	1038.3
32.5°	1283.7	1214.8	1092.2	1002.4	964.9
35°	1229.9	1153.5	1021.9	927.6	894.6
37.5°	1177.5	1095.1	956.0	852.7	815.4
40°	1122.1	1032.4	887.2	781.0	742.1
42.5°	1065.2	969.5	818.4	707.6	670.3
45°	1005.4	905.1	748.1	641.8	605.9
47.5°	948.6	842.4	680.8	574.5	541.6
50°	885.7	779.5	614.9	511.6	480.3
52.5°	824.3	712.1	552.1	453.3	424.9
55°	764.5	647.8	486.2	396.5	368.1
57.5°	703.2	583.5	427.9	344.1	320.2
60°	640.3	520.6	366.5	290.3	266.4
62.5°	579.1	459.4	314.1	242.4	230.5
65°	516.2	394.9	260.3	209.5	204.9
67.5°	456.4	335.1	209.5	184.0	179.5
70°	393.5	276.8	173.5	158.6	152.5
72.5°	333.7	222.9	145.1	133.2	130.2
75°	275.2	170.5	119.7	109.2	107.8
77.5°	217.0	121.1	94.3	88.3	85.2
80°	163.0	86.8	71.7	65.9	65.9
82.5°	113.7	58.4	49.4	46.3	46.3
85°	64.3	32.9	28.4	28.4	28.4
87.5°	24.0	11.9	11.9	10.5	10.5
90°	2.0	24.0	65.4	61.4	63.4
92.5°	41.4	56.1	58.1	60.1	60.1
95°	97.4	116.1	119.5	119.5	116.1
97.5°	162.2	179.5	186.9	186.9	186.9
100°	236.9	252.3	257.6	257.6	255.6
102.5°	315.7	327.0	334.4	336.4	334.4
105°	401.8	407.1	411.1	414.5	414.5
107.5°	487.2	495.2	495.2	496.6	487.2
110°	570.0	580.7	580.7	580.7	575.3

TEST NUMBER: P907132

CATALOG NUMBER: DFN2DIP-TR3F0-040D070US835-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	659.4	670.8	668.8	663.4	659.4
115°	747.5	758.2	754.9	752.9	747.5
117.5°	834.9	849.6	840.3	834.9	829.6
120°	923.0	937.7	923.0	923.0	917.0
122.5°	1003.1	1021.8	1012.5	1007.1	1003.1
125°	1087.2	1103.9	1098.6	1092.6	1090.6
127.5°	1169.3	1190.0	1182.7	1174.7	1169.3
130°	1246.1	1270.1	1266.8	1262.8	1255.4
132.5°	1332.2	1350.9	1352.2	1342.9	1337.5
135°	1406.3	1426.9	1431.0	1428.9	1423.6
137.5°	1489.0	1505.7	1509.0	1507.7	1499.7
140°	1561.8	1578.5	1587.8	1587.8	1580.5
142.5°	1636.5	1653.2	1658.5	1660.5	1653.2
145°	1707.3	1720.6	1731.3	1733.3	1726.0
147.5°	1770.7	1787.4	1795.4	1798.7	1791.4
150°	1836.1	1847.4	1854.8	1860.8	1854.8
152.5°	1894.1	1905.5	1914.8	1922.2	1914.8
155°	1952.2	1957.5	1963.6	1972.9	1966.9
157.5°	2002.3	2006.3	2009.6	2023.0	2013.6
160°	2047.0	2051.0	2053.0	2064.3	2056.3
162.5°	2088.4	2088.4	2090.4	2103.0	2093.7
165°	2123.7	2121.7	2121.7	2135.1	2125.7
167.5°	2155.8	2149.8	2149.8	2163.1	2153.8
170°	2179.8	2174.5	2172.5	2185.8	2174.5
172.5°	2196.5	2191.1	2189.1	2202.5	2191.1
175°	2209.8	2204.5	2200.5	2213.8	2202.5
177.5°	2217.2	2211.8	2207.8	2219.2	2207.8
180°	2213.8	2213.8	2213.8	2213.8	2213.8

TEST NUMBER: P907132

CATALOG NUMBER: DFN2DIP-TR3F0-040D070US835-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.08	8.80	9.15	9.88	11.34	4.05	4.78	5.13	5.85	7.32
	3H	9.74	10.38	10.82	11.47	12.95	5.23	5.88	6.32	6.96	8.44
	4H	10.33	10.95	11.43	12.03	13.52	5.67	6.28	6.77	7.37	8.86
	6H	10.74	11.31	11.85	12.40	13.90	5.98	6.55	7.09	7.63	9.14
	8H	10.86	11.40	11.97	12.50	14.00	6.07	6.60	7.18	7.71	9.20
	12H	10.92	11.43	12.03	12.52	14.04	6.10	6.61	7.22	7.71	9.23
4H	2H	8.08	8.69	9.19	9.78	11.27	4.63	5.24	5.74	6.33	7.82
	3H	9.89	10.40	11.00	11.51	13.02	5.96	6.48	7.08	7.59	9.09
	4H	10.57	11.04	11.69	12.14	13.66	6.50	6.97	7.62	8.07	9.60
	6H	11.07	11.47	12.19	12.60	14.11	6.91	7.31	8.03	8.44	9.95
	8H	11.24	11.61	12.36	12.73	14.26	7.03	7.41	8.16	8.53	10.06
	12H	11.32	11.66	12.46	12.79	14.33	7.09	7.43	8.23	8.56	10.10
8H	4H	10.53	10.90	11.65	12.02	13.55	6.77	7.15	7.89	8.26	9.79
	6H	11.08	11.39	12.22	12.55	14.08	7.28	7.59	8.42	8.74	10.27
	8H	11.29	11.56	12.44	12.70	14.25	7.46	7.73	8.61	8.87	10.42
	12H	11.42	11.66	12.57	12.79	14.38	7.57	7.81	8.72	8.94	10.53
12H	4H	10.48	10.81	11.61	11.94	13.48	6.77	7.11	7.91	8.24	9.77
	6H	11.06	11.33	12.20	12.46	14.01	7.32	7.59	8.47	8.73	10.28
	8H	11.26	11.50	12.42	12.64	14.22	7.52	7.76	8.68	8.90	10.48

END OF REPORT