

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907162

Luminaire Tested: DFN2DIP-TR3F0-050D080US835-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907162
REPORT IS A COMBINATION OF REPORTS P900346 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-050D080US835-RLLFLL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11330.0 lumens
Efficiency: N/A
Efficacy: 106.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 106.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907162

CATALOG NUMBER: DFN2DIP-TR3F0-050D080US835-RLLFLL

Luminous Intensity Polar Plot

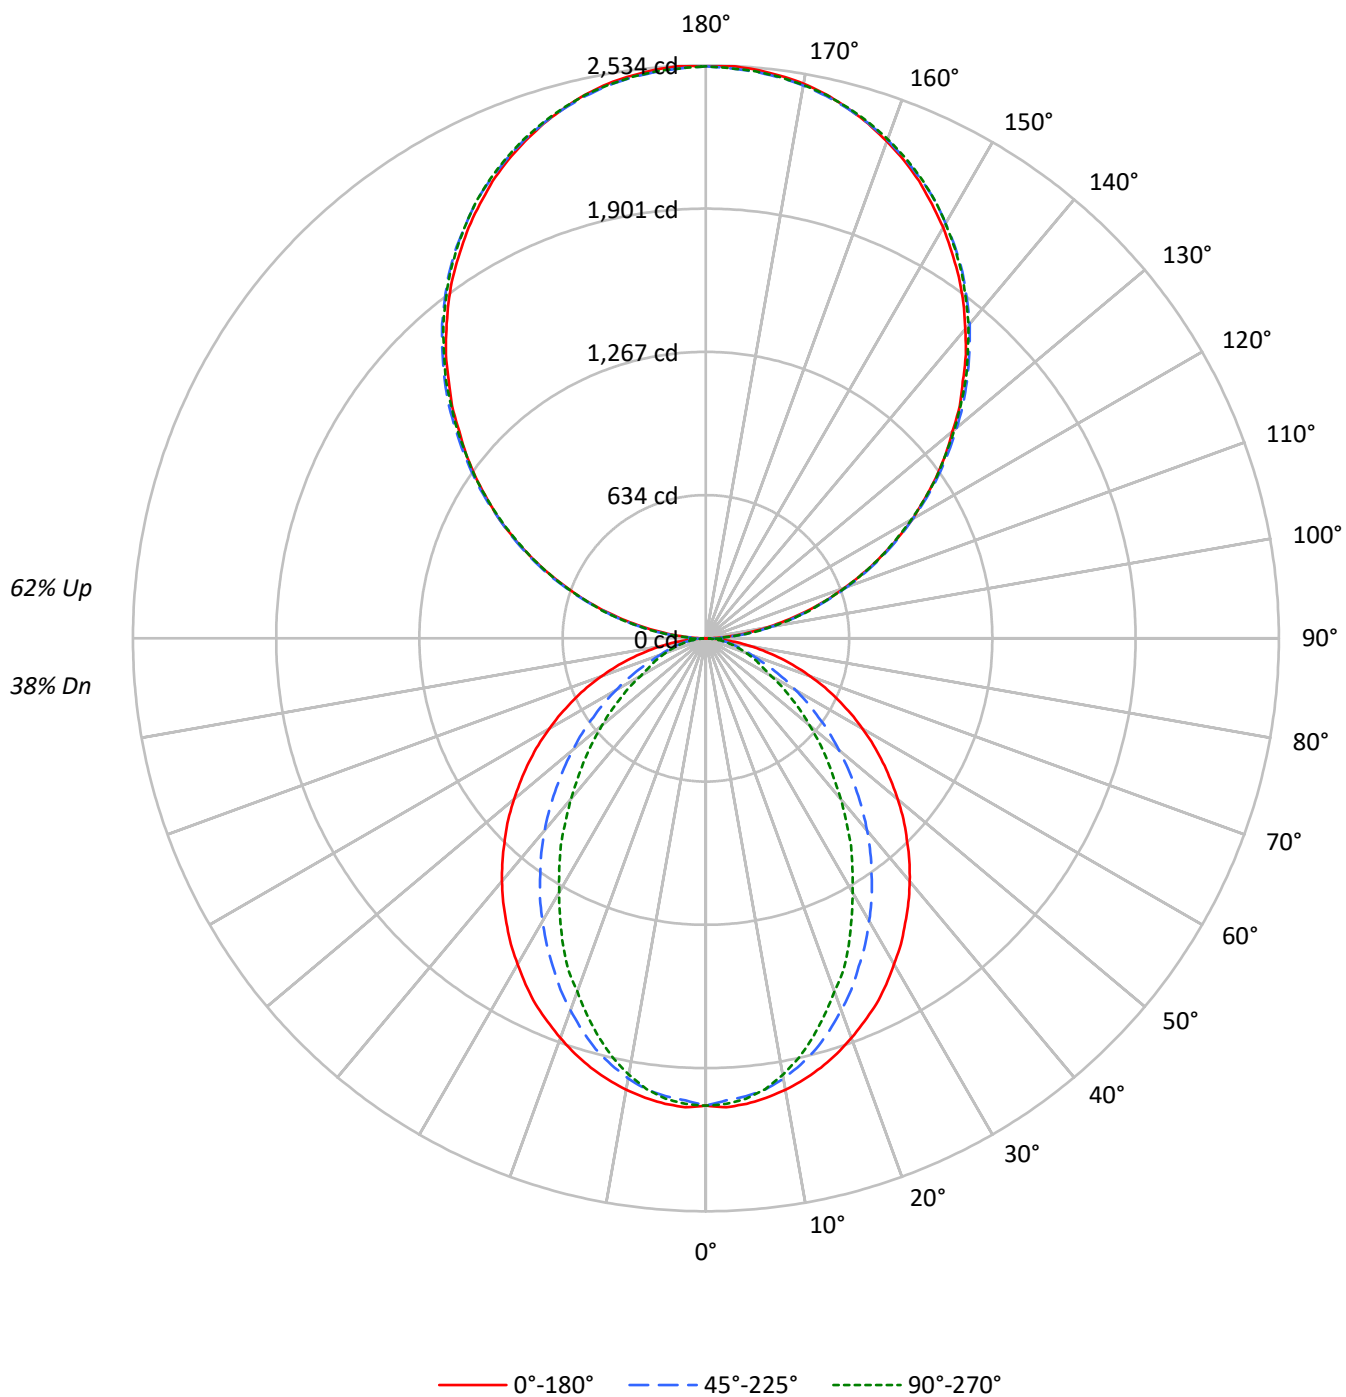

TEST NUMBER: P907162

CATALOG NUMBER: DFN2DIP-TR3F0-050D080US835-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	95	95	95	95	76	76	76	60	60	60	45	45	45
1	95	91	88	84	86	83	80	77	67	65	63	53	52	50	40	39	38
2	87	80	74	69	79	73	68	64	59	56	53	47	45	43	36	34	33
3	80	71	64	58	72	64	58	54	53	48	45	42	39	37	32	30	28
4	73	63	55	49	66	57	51	46	47	42	39	38	34	32	29	27	25
5	67	56	48	42	61	51	44	39	42	37	33	34	30	28	26	24	22
6	62	50	42	37	56	46	39	34	38	33	29	31	27	24	24	21	19
7	57	45	38	32	52	42	35	30	35	30	26	28	24	22	22	19	17
8	53	41	34	29	48	38	31	27	32	27	23	26	22	19	20	18	16
9	49	38	30	26	45	35	28	24	29	24	21	24	20	17	19	16	14
10	46	35	28	23	42	32	26	21	27	22	19	22	18	16	17	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2575	2575	2575
5°	2578	2532	2549
10°	2551	2480	2464
15°	2514	2396	2334
20°	2466	2281	2176
25°	2417	2153	2022
30°	2352	2021	1829
35°	2288	1880	1659
40°	2223	1734	1464
45°	2147	1572	1287
50°	2068	1409	1115
55°	1986	1235	950
60°	1891	1054	780
65°	1781	869	700
70°	1649	698	631
75°	1482	610	571
80°	1240	505	489
85°	844	327	358

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2471 cd/sqm

TEST NUMBER: P907162

CATALOG NUMBER: DFN2DIP-TR3F0-050D080US835-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	193.7	1.7
10°-20°	531.7	4.7
20°-30°	746.5	6.6
30°-40°	813.7	7.2
40°-50°	747.9	6.6
50°-60°	587.3	5.2
60°-70°	382.3	3.4
70°-80°	196.8	1.7
80°-90°	57.4	0.5
90°-100°	156.6	1.4
100°-110°	497.5	4.4
110°-120°	851.3	7.5
120°-130°	1119.6	9.9
130°-140°	1256.7	11.1
140°-150°	1232.3	10.9
150°-160°	1033.7	9.1
160°-170°	685.6	6.1
170°-180°	239.6	2.1
0°-30°	1471.8	13.0
0°-40°	2285.5	20.2
0°-60°	3620.7	32.0
0°-90°	4257.2	37.6
90°-120°	1505.3	13.3
90°-150°	5113.9	45.1
90°-180°	7073.0	62.4
0°-180°	11330.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2066	2066	2066	2066	2066	
5°	2066	2057	2033	2050	2044	196
15°	1966	1945	1881	1846	1827	554
25°	1784	1724	1601	1524	1496	821
35°	1537	1442	1277	1160	1118	962
45°	1257	1131	935	802	757	971
55°	956	810	608	496	460	854
65°	645	494	325	262	256	640
75°	344	213	150	136	135	364
85°	80	41	36	36	36	92
90°	2	28	75	70	72	11
95°	111	133	136	136	133	124
105°	459	465	470	474	474	485
115°	854	866	863	860	854	845
125°	1242	1262	1256	1249	1246	1110
135°	1607	1631	1635	1633	1627	1242
145°	1951	1966	1979	1981	1972	1219
155°	2231	2237	2244	2255	2248	1027
165°	2427	2425	2425	2440	2429	685
175°	2526	2519	2515	2530	2517	240
180°	2530	2530	2530	2530	2530	

TEST NUMBER: P907162

CATALOG NUMBER: DFN2DIP-TR3F0-050D080US835-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2066.5	2066.5	2066.5	2066.5	2066.5
2.5°	2075.8	2066.5	2045.9	2064.7	2060.9
5°	2066.5	2057.2	2032.8	2049.6	2044.1
7.5°	2049.6	2038.5	2012.3	2019.7	2010.3
10°	2027.2	2014.1	1976.8	1971.1	1959.9
12.5°	1999.2	1982.4	1931.8	1920.7	1900.0
15°	1965.5	1944.9	1881.4	1845.9	1827.2
17.5°	1926.2	1896.3	1817.7	1776.6	1746.6
20°	1881.4	1843.9	1750.4	1703.8	1662.5
22.5°	1832.8	1789.7	1681.2	1617.7	1589.7
25°	1784.1	1724.2	1600.8	1524.2	1496.0
27.5°	1726.2	1662.5	1526.0	1438.1	1395.1
30°	1664.5	1593.3	1443.7	1348.4	1297.8
32.5°	1604.6	1518.5	1365.3	1253.0	1206.2
35°	1537.3	1441.9	1277.4	1159.5	1118.3
37.5°	1471.8	1368.9	1195.1	1065.9	1019.3
40°	1402.6	1290.5	1108.9	976.2	927.6
42.5°	1331.6	1211.9	1023.0	884.5	837.9
45°	1256.8	1131.4	935.1	802.2	757.3
47.5°	1185.7	1053.0	851.0	718.1	677.0
50°	1107.2	974.4	768.7	639.5	600.4
52.5°	1030.4	890.1	690.1	566.7	531.2
55°	955.6	809.7	607.7	495.6	460.1
57.5°	879.0	729.4	534.9	430.2	400.2
60°	800.4	650.8	458.1	362.9	332.9
62.5°	723.8	574.2	392.7	303.0	288.1
65°	645.2	493.7	325.4	261.9	256.2
67.5°	570.4	418.9	261.9	230.0	224.4
70°	491.9	346.0	216.9	198.2	190.7
72.5°	417.1	278.6	181.4	166.5	162.7
75°	344.1	213.1	149.6	136.5	134.7
77.5°	271.2	151.4	117.9	110.3	106.5
80°	203.8	108.5	89.7	82.3	82.3
82.5°	142.1	73.0	61.7	57.9	57.9
85°	80.4	41.1	35.5	35.5	35.5
87.5°	30.0	14.9	14.9	13.1	13.1
90°	2.3	27.5	74.8	70.2	72.5
92.5°	47.3	64.1	66.4	68.6	68.6
95°	111.4	132.7	136.5	136.5	132.7
97.5°	185.4	205.2	213.6	213.6	213.6
100°	270.8	288.3	294.4	294.4	292.1
102.5°	360.8	373.8	382.1	384.4	382.1
105°	459.2	465.3	469.9	473.7	473.7
107.5°	556.8	566.0	566.0	567.5	556.8
110°	651.4	663.6	663.6	663.6	657.5

TEST NUMBER: P907162

CATALOG NUMBER: DFN2DIP-TR3F0-050D080US835-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	753.6	766.6	764.3	758.2	753.6
115°	854.3	866.5	862.7	860.4	854.3
117.5°	954.2	971.0	960.3	954.2	948.1
120°	1054.9	1071.7	1054.9	1054.9	1048.0
122.5°	1146.4	1167.8	1157.1	1151.0	1146.4
125°	1242.5	1261.6	1255.5	1248.6	1246.4
127.5°	1336.4	1360.0	1351.6	1342.5	1336.4
130°	1424.1	1451.5	1447.7	1443.2	1434.8
132.5°	1522.5	1543.8	1545.4	1534.7	1528.6
135°	1607.1	1630.8	1635.4	1633.1	1627.0
137.5°	1701.7	1720.8	1724.6	1723.1	1713.9
140°	1784.9	1803.9	1814.6	1814.6	1806.2
142.5°	1870.3	1889.4	1895.5	1897.8	1889.4
145°	1951.2	1966.4	1978.6	1980.9	1972.5
147.5°	2023.6	2042.7	2051.8	2055.7	2047.3
150°	2098.4	2111.3	2119.7	2126.6	2119.7
152.5°	2164.7	2177.7	2188.4	2196.8	2188.4
155°	2231.1	2237.2	2244.1	2254.7	2247.9
157.5°	2288.3	2292.9	2296.7	2311.9	2301.3
160°	2339.4	2344.0	2346.3	2359.2	2350.1
162.5°	2386.7	2386.7	2389.0	2403.5	2392.8
165°	2427.1	2424.8	2424.8	2440.1	2429.4
167.5°	2463.7	2456.9	2456.9	2472.1	2461.4
170°	2491.2	2485.1	2482.8	2498.1	2485.1
172.5°	2510.3	2504.2	2501.9	2517.1	2504.2
175°	2525.5	2519.4	2514.8	2530.1	2517.1
177.5°	2533.9	2527.8	2523.2	2536.2	2523.2
180°	2530.1	2530.1	2530.1	2530.1	2530.1

TEST NUMBER: P907162

CATALOG NUMBER: DFN2DIP-TR3F0-050D080US835-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.10	9.83	10.16	10.90	12.34	5.07	5.81	6.14	6.87	8.31
	3H	10.76	11.42	11.83	12.49	13.95	6.25	6.91	7.32	7.98	9.44
	4H	11.36	11.98	12.44	13.05	14.52	6.69	7.32	7.77	8.39	9.85
	6H	11.76	12.34	12.86	13.42	14.89	7.00	7.58	8.09	8.65	10.13
	8H	11.88	12.43	12.98	13.52	14.99	7.09	7.63	8.18	8.73	10.20
	12H	11.94	12.46	13.04	13.54	15.04	7.13	7.64	8.23	8.73	10.22
4H	2H	9.10	9.73	10.19	10.80	12.26	5.65	6.28	6.74	7.35	8.81
	3H	10.91	11.43	12.01	12.53	14.01	6.99	7.51	8.08	8.61	10.08
	4H	11.59	12.07	12.69	13.16	14.66	7.53	8.00	8.63	9.09	10.59
	6H	12.09	12.50	13.20	13.62	15.11	7.93	8.34	9.04	9.46	10.95
	8H	12.26	12.64	13.37	13.75	15.26	8.06	8.44	9.17	9.54	11.05
	12H	12.35	12.69	13.47	13.81	15.32	8.12	8.46	9.24	9.58	11.09
8H	4H	11.55	11.93	12.66	13.04	14.55	7.79	8.18	8.90	9.28	10.79
	6H	12.11	12.42	13.24	13.57	15.07	8.30	8.62	9.43	9.76	11.27
	8H	12.32	12.59	13.45	13.72	15.24	8.49	8.76	9.62	9.89	11.41
	12H	12.44	12.69	13.58	13.81	15.37	8.60	8.84	9.74	9.96	11.52
12H	4H	11.50	11.85	12.63	12.96	14.48	7.79	8.14	8.92	9.26	10.77
	6H	12.08	12.36	13.22	13.48	15.01	8.35	8.62	9.48	9.75	11.28
	8H	12.29	12.53	13.43	13.66	15.22	8.55	8.79	9.69	9.91	11.48

END OF REPORT