

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907181

Luminaire Tested: DFN2DIP-TR3F0-060D060US835-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907181
REPORT IS A COMBINATION OF REPORTS P901840 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-060D060US835-RLLONL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11040.0 lumens
Efficiency: N/A
Efficacy: 107.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 102.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907181

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US835-RLLONL

Luminous Intensity Polar Plot

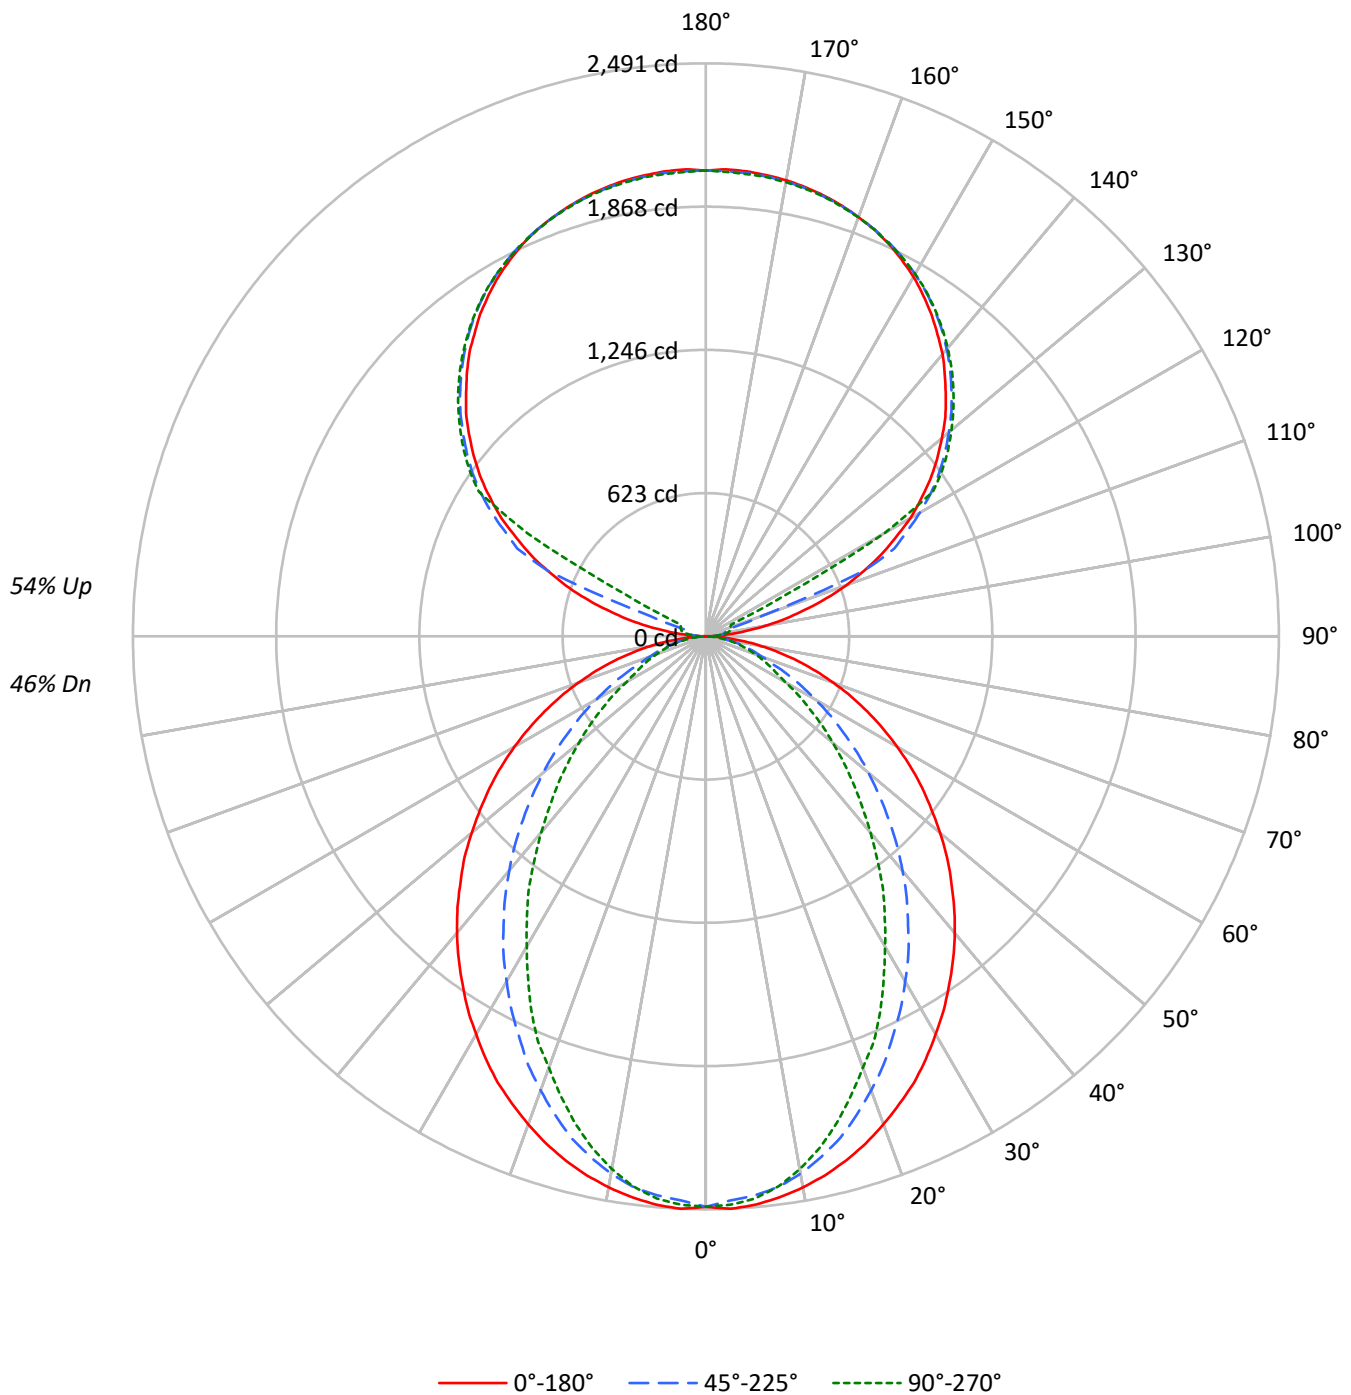

TEST NUMBER: P907181

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US835-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53	46		
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45	40		
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39	34		
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34	29		
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29	26		
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26	23		
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23	20		
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21	18		
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19	16		
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17	15		
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15	13		

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3090	3090	3090
5°	3093	3038	3058
10°	3061	2976	2957
15°	3017	2875	2801
20°	2960	2737	2611
25°	2901	2583	2427
30°	2822	2425	2195
35°	2745	2256	1990
40°	2667	2080	1757
45°	2576	1887	1545
50°	2482	1691	1338
55°	2383	1482	1140
60°	2269	1265	936
65°	2138	1043	840
70°	1978	837	758
75°	1778	732	685
80°	1487	606	587
85°	1012	393	430

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2576 cd/sqm

TEST NUMBER: P907181

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US835-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	232.4	2.1
10°-20°	638.0	5.8
20°-30°	895.7	8.1
30°-40°	976.4	8.8
40°-50°	897.4	8.1
50°-60°	704.8	6.4
60°-70°	458.8	4.2
70°-80°	236.1	2.1
80°-90°	63.8	0.6
90°-100°	66.8	0.6
100°-110°	248.9	2.3
110°-120°	660.2	6.0
120°-130°	1094.9	9.9
130°-140°	1163.0	10.5
140°-150°	1080.9	9.8
150°-160°	869.0	7.9
160°-170°	560.0	5.1
170°-180°	192.7	1.7
0°-30°	1766.2	16.0
0°-40°	2742.6	24.8
0°-60°	4344.8	39.4
0°-90°	5103.6	46.2
90°-120°	975.8	8.8
90°-150°	4314.7	39.1
90°-180°	5936.0	53.8
0°-180°	11040.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2480	2480	2480	2480	2480	
5°	2480	2469	2439	2460	2453	235
15°	2359	2334	2258	2215	2193	665
25°	2141	2069	1921	1829	1795	985
35°	1845	1730	1533	1391	1342	1155
45°	1508	1358	1122	963	909	1165
55°	1147	972	729	595	552	1025
65°	774	592	390	314	307	768
75°	413	256	180	164	162	437
85°	96	49	43	43	43	111
90°	1	18	29	37	40	10
95°	95	47	57	65	63	113
105°	445	489	89	105	111	476
115°	842	867	904	226	120	829
125°	1191	1210	1238	1248	1253	1062
135°	1474	1498	1511	1525	1522	1139
145°	1710	1708	1733	1744	1736	1069
155°	1883	1870	1887	1896	1884	868
165°	1984	1975	1980	1990	1980	560
175°	2029	2019	2022	2032	2018	193
180°	2025	2025	2025	2025	2025	

TEST NUMBER: P907181

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US835-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2479.8	2479.8	2479.8	2479.8	2479.8
2.5°	2491.0	2479.8	2455.0	2477.6	2473.1
5°	2479.8	2468.6	2439.3	2459.6	2452.9
7.5°	2459.6	2446.2	2414.8	2423.6	2412.4
10°	2432.6	2416.9	2372.2	2365.3	2351.9
12.5°	2399.1	2378.8	2318.1	2304.8	2280.0
15°	2358.6	2333.8	2257.6	2215.0	2192.6
17.5°	2311.5	2275.5	2181.2	2131.9	2096.0
20°	2257.6	2212.6	2100.5	2044.5	1995.0
22.5°	2199.3	2147.6	2017.4	1941.2	1907.6
25°	2141.0	2069.1	1921.0	1829.1	1795.3
27.5°	2071.5	1995.0	1831.2	1725.7	1674.1
30°	1997.4	1911.9	1732.4	1618.1	1557.4
32.5°	1925.5	1822.2	1638.4	1503.6	1447.4
35°	1844.8	1730.3	1532.9	1391.4	1341.9
37.5°	1766.2	1642.6	1434.1	1279.1	1223.1
40°	1683.1	1548.6	1330.7	1171.4	1113.1
42.5°	1597.9	1454.3	1227.6	1061.4	1005.5
45°	1508.1	1357.6	1122.2	962.6	908.8
47.5°	1422.9	1263.6	1021.2	861.7	812.4
50°	1328.6	1169.3	922.4	767.4	720.5
52.5°	1236.4	1068.1	828.1	680.0	637.4
55°	1146.7	971.7	729.3	594.8	552.1
57.5°	1054.8	875.2	641.9	516.2	480.2
60°	960.5	781.0	549.8	435.5	399.5
62.5°	868.6	689.1	471.2	363.6	345.7
65°	774.3	592.4	390.5	314.3	307.4
67.5°	684.5	502.6	314.3	276.0	269.3
70°	590.2	415.2	260.2	237.9	228.8
72.5°	500.5	334.3	217.6	199.8	195.2
75°	412.9	255.7	179.5	163.8	161.7
77.5°	325.5	181.7	141.4	132.4	127.9
80°	244.5	130.2	107.6	98.8	98.8
82.5°	170.5	87.6	74.0	69.5	69.5
85°	96.4	49.3	42.6	42.6	42.6
87.5°	36.0	17.9	17.9	15.7	15.7
90°	1.4	17.6	29.2	36.7	39.5
92.5°	36.7	30.8	35.1	38.1	39.5
95°	95.2	46.8	57.1	64.6	63.0
97.5°	171.4	51.3	74.6	79.2	80.6
100°	259.4	58.6	83.5	95.2	98.1
102.5°	356.0	353.2	86.5	102.5	107.0
105°	445.4	489.4	89.4	105.4	111.4
107.5°	549.5	586.0	92.4	108.4	114.3
110°	649.2	679.8	256.5	110.0	115.7



TEST NUMBER: P907181

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US835-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	742.9	769.2	744.3	112.7	117.3
115°	842.5	867.4	904.1	225.7	120.2
117.5°	928.9	958.2	983.2	773.6	389.7
120°	1025.7	1047.6	1074.1	1091.6	893.8
122.5°	1107.6	1131.1	1160.5	1169.2	1170.8
125°	1191.2	1210.3	1238.1	1248.4	1252.7
127.5°	1267.4	1287.9	1310.0	1324.6	1326.0
130°	1339.2	1362.7	1378.7	1394.9	1393.5
132.5°	1412.5	1431.6	1447.6	1460.8	1459.4
135°	1474.1	1497.6	1510.6	1525.4	1522.4
137.5°	1538.4	1556.0	1570.8	1585.4	1581.1
140°	1601.4	1613.3	1629.3	1642.5	1635.2
142.5°	1654.3	1664.6	1683.6	1695.2	1687.9
145°	1710.0	1708.4	1733.3	1743.6	1736.3
147.5°	1758.2	1753.8	1778.7	1786.0	1780.3
150°	1805.2	1794.9	1818.4	1827.1	1819.8
152.5°	1844.7	1833.0	1854.9	1863.8	1853.5
155°	1882.8	1869.7	1887.3	1896.0	1884.3
157.5°	1913.6	1901.9	1915.1	1925.4	1913.6
160°	1940.0	1931.1	1940.0	1948.7	1938.5
162.5°	1963.3	1954.6	1961.9	1972.2	1959.0
165°	1983.9	1975.2	1979.5	1989.8	1979.5
167.5°	2000.0	1991.2	1995.7	2006.0	1992.7
170°	2013.3	2004.4	2007.4	2017.6	2004.4
172.5°	2022.0	2013.3	2016.2	2026.5	2013.3
175°	2029.3	2019.0	2022.0	2032.2	2017.6
177.5°	2032.2	2022.0	2023.5	2033.8	2020.6
180°	2024.9	2024.9	2024.9	2024.9	2024.9

TEST NUMBER: P907181

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US835-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.65	11.45	11.65	12.45	13.78	6.63	7.43	7.62	8.43	9.76
	3H	12.32	13.03	13.32	14.04	15.39	7.81	8.53	8.82	9.54	10.88
	4H	12.92	13.60	13.94	14.61	15.97	8.25	8.93	9.27	9.95	11.30
	6H	13.33	13.95	14.36	14.97	16.34	8.57	9.19	9.60	10.21	11.58
	8H	13.45	14.04	14.49	15.08	16.44	8.66	9.25	9.69	10.28	11.65
	12H	13.51	14.07	14.55	15.10	16.49	8.70	9.26	9.74	10.29	11.68
4H	2H	10.66	11.34	11.69	12.36	13.71	7.22	7.89	8.24	8.91	10.26
	3H	12.48	13.04	13.51	14.09	15.46	8.56	9.12	9.59	10.16	11.53
	4H	13.16	13.68	14.20	14.71	16.11	9.10	9.61	10.14	10.65	12.04
	6H	13.67	14.11	14.72	15.17	16.56	9.51	9.95	10.56	11.01	12.40
	8H	13.84	14.25	14.89	15.30	16.70	9.63	10.05	10.69	11.10	12.50
	12H	13.93	14.30	15.00	15.36	16.77	9.70	10.07	10.76	11.13	12.54
8H	4H	13.13	13.54	14.18	14.59	15.99	9.37	9.78	10.42	10.83	12.24
	6H	13.68	14.02	14.76	15.12	16.52	9.88	10.22	10.95	11.31	12.71
	8H	13.89	14.19	14.98	15.27	16.69	10.07	10.37	11.15	11.44	12.86
	12H	14.02	14.29	15.11	15.36	16.82	10.18	10.44	11.26	11.51	12.97
12H	4H	13.08	13.45	14.15	14.52	15.92	9.37	9.74	10.44	10.81	12.22
	6H	13.66	13.96	14.74	15.03	16.45	9.93	10.23	11.01	11.30	12.72
	8H	13.87	14.13	14.96	15.21	16.67	10.13	10.39	11.21	11.46	12.93