

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907207

Luminaire Tested: DFN2DIP-TR3F0-070D060US835-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907207
REPORT IS A COMBINATION OF REPORTS P901842 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-070D060US835-RLLONL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11890.0 lumens
Efficiency: N/A
Efficacy: 103.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 115.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907207

CATALOG NUMBER: DFN2DIP-TR3F0-070D060US835-RLLONL

Luminous Intensity Polar Plot

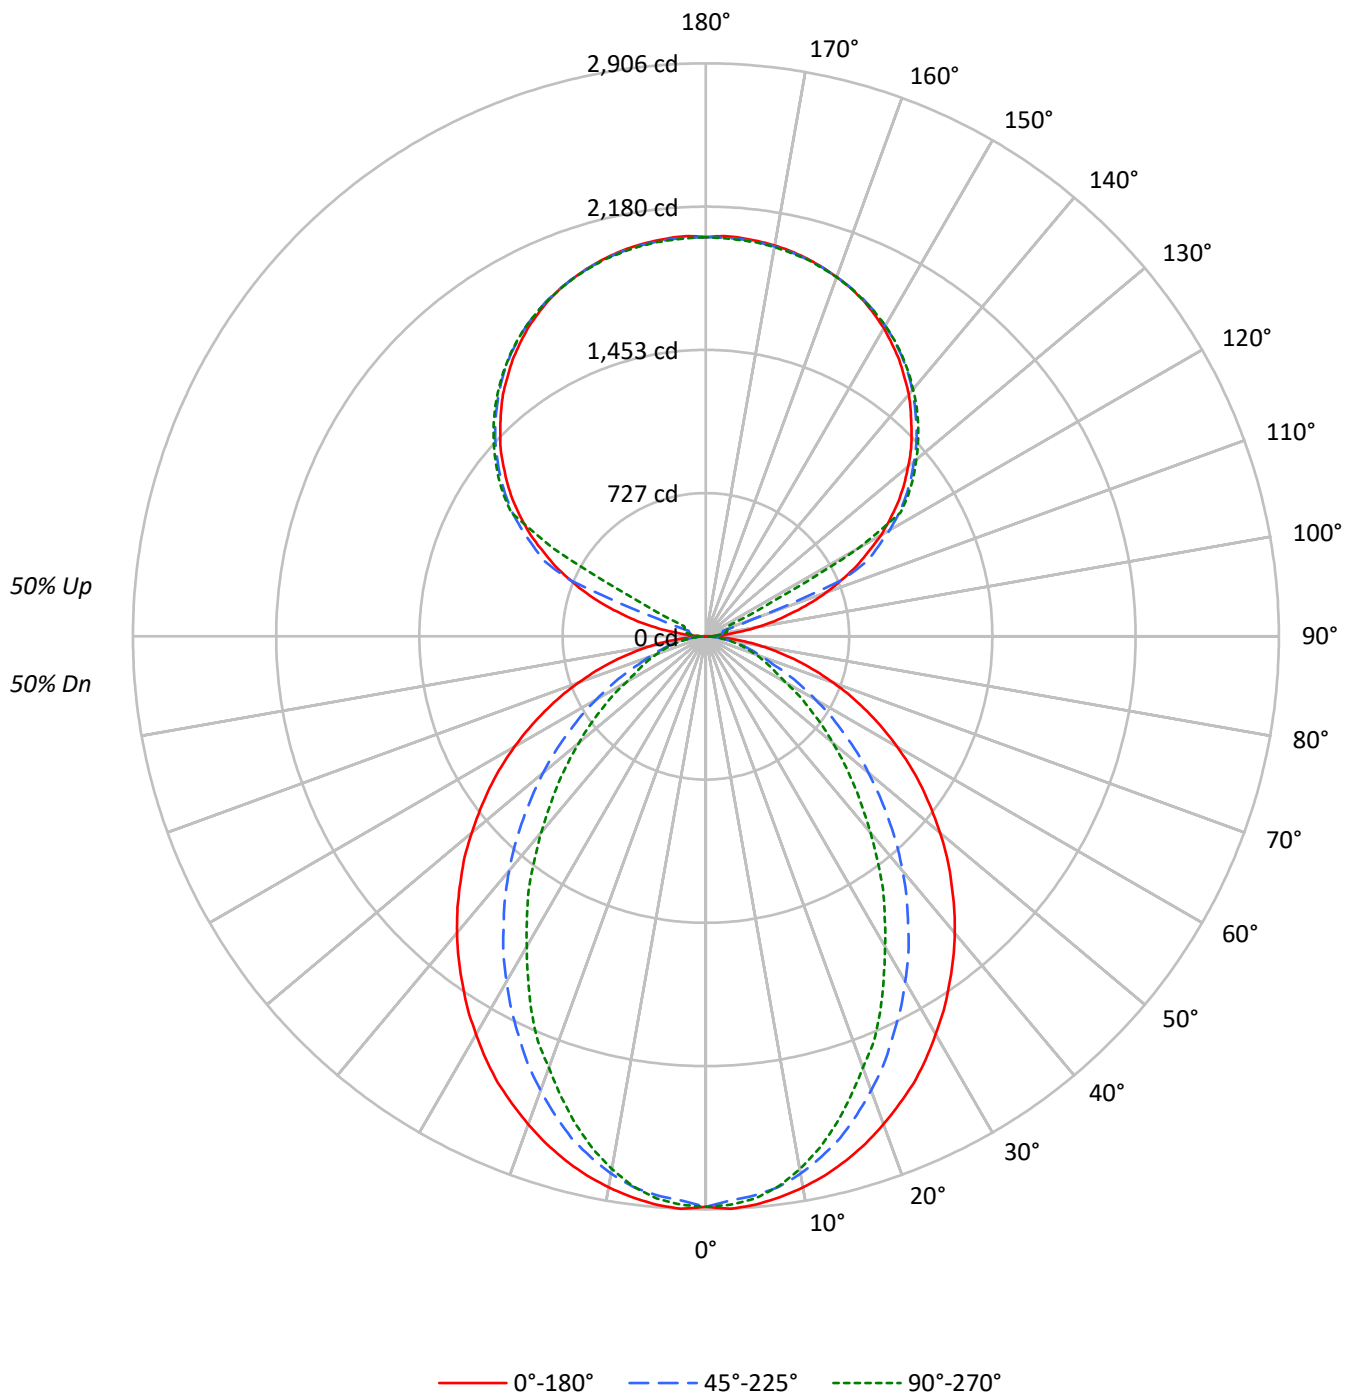

TEST NUMBER: P907207

CATALOG NUMBER: DFN2DIP-TR3F0-070D060US835-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	94	90	87	91	87	84	81	74	72	69	62	60	59	50	49	48
2	90	83	77	72	83	77	72	67	65	62	58	55	52	50	45	43	41
3	82	73	66	60	76	68	62	57	58	53	50	49	45	43	40	38	36
4	76	65	57	52	70	60	54	49	52	47	43	44	40	37	36	34	31
5	70	58	50	45	64	54	47	42	47	41	37	40	35	32	33	30	28
6	64	52	45	39	59	49	42	37	42	37	33	36	32	29	30	27	25
7	59	47	40	34	55	44	37	32	38	33	29	33	29	25	28	24	22
8	55	43	36	30	51	40	34	29	35	30	26	30	26	23	25	22	20
9	52	40	32	27	48	37	30	26	32	27	23	28	24	21	24	20	18
10	48	36	29	25	45	34	28	23	30	25	21	26	22	19	22	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3605	3605	3605
5°	3609	3545	3568
10°	3571	3472	3450
15°	3520	3355	3268
20°	3453	3194	3046
25°	3384	3014	2832
30°	3293	2829	2560
35°	3203	2632	2322
40°	3111	2427	2050
45°	3006	2201	1803
50°	2896	1973	1562
55°	2781	1729	1330
60°	2648	1475	1092
65°	2494	1217	980
70°	2308	977	884
75°	2074	854	799
80°	1736	708	685
85°	1181	458	501

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3006 cd/sqm

TEST NUMBER: P907207

CATALOG NUMBER: DFN2DIP-TR3F0-070D060US835-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	271.1	2.3
10°-20°	744.3	6.3
20°-30°	1045.0	8.8
30°-40°	1139.2	9.6
40°-50°	1047.0	8.8
50°-60°	822.3	6.9
60°-70°	535.2	4.5
70°-80°	275.5	2.3
80°-90°	73.9	0.6
90°-100°	66.8	0.6
100°-110°	248.9	2.1
110°-120°	660.2	5.6
120°-130°	1094.9	9.2
130°-140°	1163.0	9.8
140°-150°	1080.9	9.1
150°-160°	869.0	7.3
160°-170°	560.0	4.7
170°-180°	192.7	1.6
0°-30°	2060.5	17.3
0°-40°	3199.7	26.9
0°-60°	5068.9	42.6
0°-90°	5953.5	50.1
90°-120°	975.8	8.2
90°-150°	4314.7	36.3
90°-180°	5936.0	49.9
0°-180°	11890.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2893	2893	2893	2893	2893	
5°	2893	2880	2846	2870	2862	274
15°	2752	2723	2634	2584	2558	775
25°	2498	2414	2241	2134	2094	1149
35°	2152	2019	1788	1623	1566	1347
45°	1760	1584	1309	1123	1060	1359
55°	1338	1134	851	694	644	1195
65°	903	691	456	367	359	896
75°	482	298	209	191	189	509
85°	112	58	50	50	50	129
90°	1	18	29	37	40	11
95°	95	47	57	65	63	113
105°	445	489	89	105	111	476
115°	842	867	904	226	120	829
125°	1191	1210	1238	1248	1253	1062
135°	1474	1498	1511	1525	1522	1139
145°	1710	1708	1733	1744	1736	1069
155°	1883	1870	1887	1896	1884	868
165°	1984	1975	1980	1990	1980	560
175°	2029	2019	2022	2032	2018	193
180°	2025	2025	2025	2025	2025	

TEST NUMBER: P907207

CATALOG NUMBER: DFN2DIP-TR3F0-070D060US835-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2893.1	2893.1	2893.1	2893.1	2893.1
2.5°	2906.1	2893.1	2864.2	2890.6	2885.3
5°	2893.1	2880.0	2845.9	2869.5	2861.7
7.5°	2869.5	2853.9	2817.3	2827.5	2814.5
10°	2838.1	2819.8	2767.5	2759.5	2743.9
12.5°	2798.9	2775.3	2704.5	2688.9	2660.0
15°	2751.7	2722.8	2633.9	2584.2	2558.1
17.5°	2696.7	2654.8	2544.8	2487.2	2445.3
20°	2633.9	2581.4	2450.6	2385.3	2327.5
22.5°	2565.9	2505.6	2353.6	2264.7	2225.6
25°	2497.8	2413.9	2241.1	2133.9	2094.5
27.5°	2416.7	2327.5	2136.4	2013.4	1953.1
30°	2330.3	2230.6	2021.1	1887.8	1817.0
32.5°	2246.4	2125.9	1911.4	1754.2	1688.6
35°	2152.2	2018.6	1788.4	1623.4	1565.6
37.5°	2060.6	1916.4	1673.1	1492.2	1427.0
40°	1963.6	1806.7	1552.5	1366.7	1298.6
42.5°	1864.2	1696.7	1432.2	1238.3	1173.1
45°	1759.5	1583.9	1309.2	1123.1	1060.3
47.5°	1660.0	1474.2	1191.4	1005.3	947.8
50°	1550.0	1364.2	1076.1	895.3	840.6
52.5°	1442.5	1246.1	966.1	793.3	743.6
55°	1337.8	1133.6	850.8	693.9	644.2
57.5°	1230.6	1021.1	748.9	602.2	560.3
60°	1120.6	911.1	641.4	508.1	466.1
62.5°	1013.3	803.9	549.7	424.2	403.3
65°	903.3	691.1	455.6	366.7	358.6
67.5°	798.6	586.4	366.7	321.9	314.2
70°	688.6	484.4	303.6	277.5	266.9
72.5°	583.9	390.0	253.9	233.1	227.8
75°	481.7	298.3	209.4	191.1	188.6
77.5°	379.7	211.9	165.0	154.4	149.2
80°	285.3	151.9	125.6	115.3	115.3
82.5°	198.9	102.2	86.4	81.1	81.1
85°	112.5	57.5	49.7	49.7	49.7
87.5°	41.9	20.8	20.8	18.3	18.3
90°	1.4	17.6	29.2	36.7	39.5
92.5°	36.7	30.8	35.1	38.1	39.5
95°	95.2	46.8	57.1	64.6	63.0
97.5°	171.4	51.3	74.6	79.2	80.6
100°	259.4	58.6	83.5	95.2	98.1
102.5°	356.0	353.2	86.5	102.5	107.0
105°	445.4	489.4	89.4	105.4	111.4
107.5°	549.5	586.0	92.4	108.4	114.3
110°	649.2	679.8	256.5	110.0	115.7

TEST NUMBER: P907207

CATALOG NUMBER: DFN2DIP-TR3F0-070D060US835-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	742.9	769.2	744.3	112.7	117.3
115°	842.5	867.4	904.1	225.7	120.2
117.5°	928.9	958.2	983.2	773.6	389.7
120°	1025.7	1047.6	1074.1	1091.6	893.8
122.5°	1107.6	1131.1	1160.5	1169.2	1170.8
125°	1191.2	1210.3	1238.1	1248.4	1252.7
127.5°	1267.4	1287.9	1310.0	1324.6	1326.0
130°	1339.2	1362.7	1378.7	1394.9	1393.5
132.5°	1412.5	1431.6	1447.6	1460.8	1459.4
135°	1474.1	1497.6	1510.6	1525.4	1522.4
137.5°	1538.4	1556.0	1570.8	1585.4	1581.1
140°	1601.4	1613.3	1629.3	1642.5	1635.2
142.5°	1654.3	1664.6	1683.6	1695.2	1687.9
145°	1710.0	1708.4	1733.3	1743.6	1736.3
147.5°	1758.2	1753.8	1778.7	1786.0	1780.3
150°	1805.2	1794.9	1818.4	1827.1	1819.8
152.5°	1844.7	1833.0	1854.9	1863.8	1853.5
155°	1882.8	1869.7	1887.3	1896.0	1884.3
157.5°	1913.6	1901.9	1915.1	1925.4	1913.6
160°	1940.0	1931.1	1940.0	1948.7	1938.5
162.5°	1963.3	1954.6	1961.9	1972.2	1959.0
165°	1983.9	1975.2	1979.5	1989.8	1979.5
167.5°	2000.0	1991.2	1995.7	2006.0	1992.7
170°	2013.3	2004.4	2007.4	2017.6	2004.4
172.5°	2022.0	2013.3	2016.2	2026.5	2013.3
175°	2029.3	2019.0	2022.0	2032.2	2017.6
177.5°	2032.2	2022.0	2023.5	2033.8	2020.6
180°	2024.9	2024.9	2024.9	2024.9	2024.9

TEST NUMBER: P907207

CATALOG NUMBER: DFN2DIP-TR3F0-070D060US835-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.56	12.39	12.52	13.36	14.63	7.53	8.36	8.50	9.34	10.61
	3H	13.23	13.97	14.20	14.95	16.25	8.72	9.46	9.69	10.44	11.74
	4H	13.83	14.53	14.82	15.52	16.82	9.16	9.87	10.15	10.85	12.16
	6H	14.24	14.89	15.24	15.88	17.20	9.48	10.13	10.48	11.12	12.43
	8H	14.36	14.98	15.37	15.99	17.30	9.57	10.18	10.57	11.19	12.50
	12H	14.42	15.01	15.43	16.01	17.34	9.61	10.19	10.62	11.19	12.53
4H	2H	11.57	12.28	12.57	13.26	14.57	8.12	8.83	9.12	9.81	11.12
	3H	13.39	13.98	14.40	14.99	16.31	9.47	10.05	10.47	11.07	12.38
	4H	14.08	14.61	15.09	15.62	16.96	10.01	10.54	11.02	11.55	12.89
	6H	14.58	15.04	15.61	16.07	17.41	10.42	10.88	11.45	11.91	13.25
	8H	14.75	15.18	15.78	16.21	17.56	10.55	10.98	11.57	12.00	13.35
	12H	14.84	15.23	15.88	16.27	17.63	10.61	11.00	11.65	12.04	13.40
8H	4H	14.04	14.47	15.07	15.50	16.85	10.29	10.71	11.31	11.74	13.09
	6H	14.60	14.95	15.65	16.02	17.37	10.80	11.15	11.84	12.22	13.57
	8H	14.81	15.12	15.87	16.17	17.54	10.98	11.29	12.04	12.35	13.71
	12H	14.94	15.22	16.00	16.26	17.67	11.10	11.37	12.15	12.42	13.83
12H	4H	14.00	14.38	15.04	15.42	16.78	10.29	10.67	11.33	11.72	13.07
	6H	14.58	14.89	15.63	15.94	17.31	10.84	11.15	11.90	12.21	13.58
	8H	14.79	15.06	15.85	16.11	17.52	11.05	11.32	12.11	12.37	13.78