

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907239

Luminaire Tested: DFN2DIP-TR3F0-080D080US835-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907239
REPORT IS A COMBINATION OF REPORTS P901871 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-080D080US835-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15840.0 lumens
Efficiency: N/A
Efficacy: 111.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 142
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907239

CATALOG NUMBER: DFN2DIP-TR3F0-080D080US835-FLLONL

Luminous Intensity Polar Plot

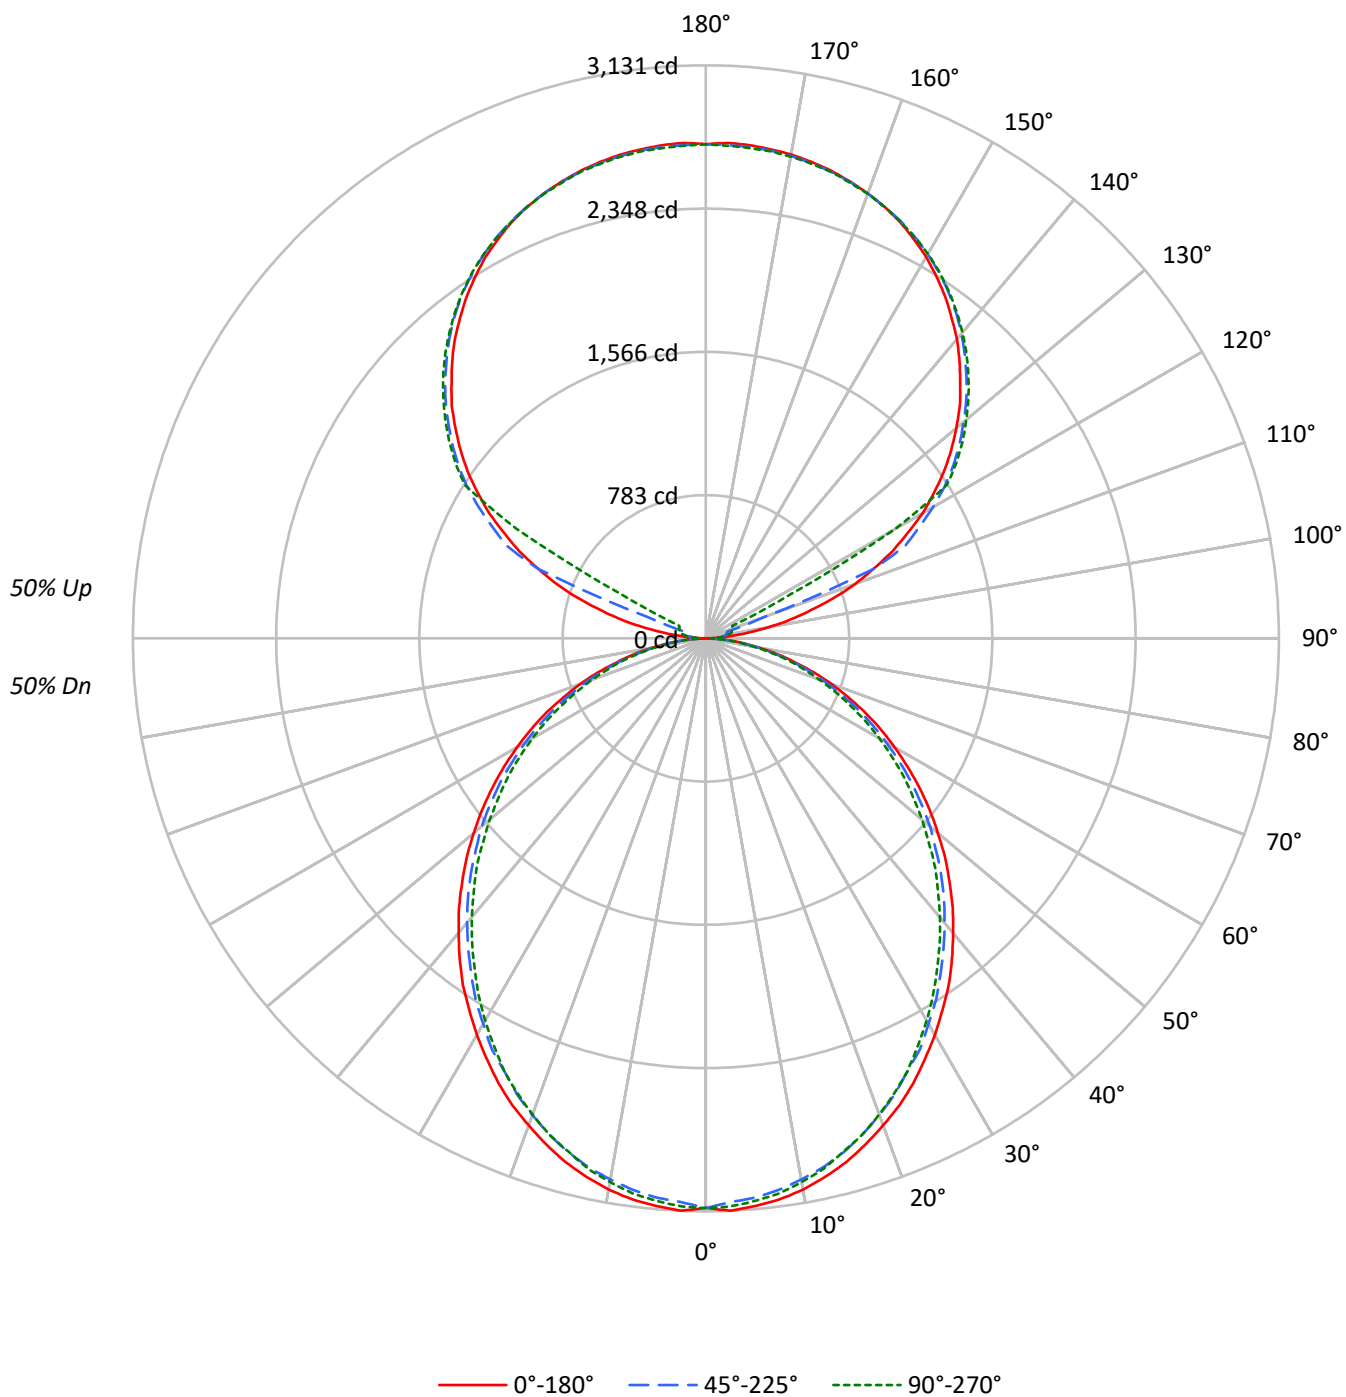

TEST NUMBER: P907239

CATALOG NUMBER: DFN2DIP-TR3F0-080D080US835-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3879	3879	3879
5°	3883	3822	3848
10°	3849	3767	3793
15°	3791	3702	3709
20°	3712	3612	3624
25°	3634	3506	3525
30°	3536	3407	3400
35°	3443	3290	3268
40°	3330	3173	3142
45°	3216	3054	3013
50°	3092	2930	2864
55°	2962	2787	2726
60°	2814	2616	2568
65°	2653	2440	2382
70°	2448	2224	2180
75°	2165	1966	1991
80°	1822	1636	1636
85°	1287	1077	1057

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3216 cd/sqm

TEST NUMBER: P907239

CATALOG NUMBER: DFN2DIP-TR3F0-080D080US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	293.0	1.8
10°-20°	824.3	5.2
20°-30°	1211.5	7.6
30°-40°	1407.0	8.9
40°-50°	1405.3	8.9
50°-60°	1225.4	7.7
60°-70°	905.8	5.7
70°-80°	512.5	3.2
80°-90°	140.0	0.9
90°-100°	89.0	0.6
100°-110°	331.9	2.1
110°-120°	880.2	5.6
120°-130°	1459.9	9.2
130°-140°	1550.7	9.8
140°-150°	1441.2	9.1
150°-160°	1158.7	7.3
160°-170°	746.6	4.7
170°-180°	257.0	1.6
0°-30°	2328.8	14.7
0°-40°	3735.8	23.6
0°-60°	6366.4	40.2
0°-90°	7924.8	50.0
90°-120°	1301.1	8.2
90°-150°	5752.9	36.3
90°-180°	7915.0	50.0
0°-180°	15840.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3113	3113	3113	3113	3113	
5°	3113	3101	3068	3092	3086	295
15°	2963	2946	2906	2918	2904	835
25°	2682	2658	2607	2613	2607	1234
35°	2314	2284	2236	2218	2203	1445
45°	1883	1862	1817	1784	1772	1453
55°	1425	1407	1371	1335	1320	1274
65°	961	943	913	886	871	950
75°	503	497	482	464	470	537
85°	123	120	117	108	105	137
90°	2	23	39	49	53	15
95°	127	62	76	86	84	150
105°	594	653	119	141	148	635
115°	1123	1156	1205	301	160	1106
125°	1588	1614	1651	1664	1670	1416
135°	1965	1997	2014	2034	2030	1518
145°	2280	2278	2311	2325	2315	1426
155°	2510	2493	2516	2528	2512	1157
165°	2645	2634	2639	2653	2639	747
175°	2706	2692	2696	2710	2690	258
180°	2700	2700	2700	2700	2700	

TEST NUMBER: P907239

CATALOG NUMBER: DFN2DIP-TR3F0-080D080US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3112.8	3112.8	3112.8	3112.8	3112.8
2.5°	3130.9	3116.0	3083.0	3112.8	3107.1
5°	3112.8	3101.1	3068.1	3091.9	3086.2
7.5°	3091.9	3074.1	3041.1	3065.2	3059.2
10°	3059.2	3038.2	3002.3	3026.1	3017.3
12.5°	3014.1	2996.3	2960.4	2975.3	2969.3
15°	2963.3	2945.5	2906.4	2918.5	2903.6
17.5°	2900.4	2882.6	2843.5	2858.5	2843.5
20°	2831.5	2813.7	2771.8	2780.7	2768.9
22.5°	2762.9	2735.9	2696.8	2696.8	2690.8
25°	2681.9	2658.1	2607.3	2613.0	2607.3
27.5°	2592.0	2571.1	2532.3	2523.4	2508.5
30°	2502.5	2478.3	2433.6	2424.7	2412.6
32.5°	2406.6	2388.8	2340.8	2322.7	2310.7
35°	2313.8	2284.0	2236.0	2217.9	2203.0
37.5°	2209.0	2182.0	2134.1	2113.1	2098.2
40°	2101.4	2077.2	2029.3	2002.6	1990.5
42.5°	1996.6	1972.4	1924.8	1894.6	1876.9
45°	1882.9	1861.9	1816.8	1784.1	1772.1
47.5°	1772.1	1751.1	1703.1	1670.1	1652.3
50°	1655.2	1640.3	1598.3	1556.4	1541.5
52.5°	1541.5	1520.5	1481.8	1448.8	1427.8
55°	1424.9	1406.8	1371.0	1335.1	1320.1
57.5°	1308.1	1293.2	1254.1	1218.2	1206.1
60°	1191.2	1179.5	1137.5	1104.5	1095.6
62.5°	1077.5	1056.6	1026.7	996.9	984.8
65°	961.0	942.9	913.0	886.0	871.1
67.5°	841.2	826.0	799.3	778.4	766.3
70°	730.4	718.3	691.4	670.4	658.6
72.5°	616.7	604.7	589.7	568.8	559.9
75°	502.7	497.0	481.8	464.0	470.0
77.5°	401.1	389.0	383.0	374.1	365.2
80°	299.5	296.3	290.3	281.4	275.3
82.5°	203.6	203.6	200.7	188.6	188.6
85°	122.6	119.7	116.9	107.7	104.8
87.5°	54.0	48.0	41.9	33.0	29.9
90°	1.9	23.4	39.0	48.9	52.7
92.5°	48.9	41.1	46.9	50.8	52.7
95°	126.9	62.4	76.1	86.1	84.0
97.5°	228.5	68.4	99.5	105.6	107.4
100°	345.9	78.2	111.4	126.9	130.8
102.5°	474.7	470.9	115.3	136.6	142.7
105°	593.9	652.6	119.2	140.6	148.5
107.5°	732.6	781.3	123.2	144.5	152.4
110°	865.6	906.4	342.0	146.6	154.3

TEST NUMBER: P907239

CATALOG NUMBER: DFN2DIP-TR3F0-080D080US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	990.6	1025.6	992.5	150.3	156.4
115°	1123.3	1156.5	1205.4	300.9	160.3
117.5°	1238.6	1277.6	1311.0	1031.4	519.7
120°	1367.6	1396.8	1432.1	1455.5	1191.7
122.5°	1476.8	1508.2	1547.4	1559.0	1561.1
125°	1588.2	1613.7	1650.8	1664.5	1670.3
127.5°	1689.8	1717.2	1746.7	1766.1	1768.0
130°	1785.6	1816.9	1838.3	1859.9	1858.0
132.5°	1883.3	1908.8	1930.2	1947.8	1945.9
135°	1965.4	1996.7	2014.1	2033.9	2029.9
137.5°	2051.3	2074.7	2094.4	2113.9	2108.1
140°	2135.2	2151.0	2172.4	2190.0	2180.2
142.5°	2205.8	2219.4	2244.7	2260.3	2250.5
145°	2280.0	2277.9	2311.1	2324.8	2315.0
147.5°	2344.3	2338.5	2371.6	2381.4	2373.7
150°	2406.9	2393.2	2424.5	2436.1	2426.4
152.5°	2459.6	2444.0	2473.2	2485.1	2471.4
155°	2510.4	2493.0	2516.4	2528.0	2512.5
157.5°	2551.4	2535.9	2553.5	2567.2	2551.4
160°	2586.7	2574.9	2586.7	2598.3	2584.6
162.5°	2617.8	2606.2	2615.9	2629.6	2612.0
165°	2645.2	2633.6	2639.4	2653.0	2639.4
167.5°	2666.7	2654.9	2660.9	2674.6	2657.0
170°	2684.4	2672.5	2676.5	2690.2	2672.5
172.5°	2696.0	2684.4	2688.3	2702.0	2684.4
175°	2705.7	2692.0	2696.0	2709.6	2690.2
177.5°	2709.6	2696.0	2698.0	2711.7	2694.1
180°	2699.9	2699.9	2699.9	2699.9	2699.9

TEST NUMBER: P907239

CATALOG NUMBER: DFN2DIP-TR3F0-080D080US835-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.93	12.79	12.89	13.77	15.04	11.50	12.37	12.46	13.34	14.61
	3H	13.58	14.36	14.55	15.34	16.63	13.12	13.89	14.08	14.87	16.16
	4H	14.17	14.90	15.15	15.88	17.18	13.70	14.43	14.68	15.41	16.72
	6H	14.56	15.23	15.55	16.22	17.54	14.09	14.76	15.08	15.75	17.07
	8H	14.66	15.30	15.66	16.31	17.62	14.19	14.83	15.19	15.84	17.15
	12H	14.70	15.31	15.71	16.32	17.65	14.23	14.84	15.23	15.84	17.18
4H	2H	12.39	13.12	13.38	14.11	15.41	12.05	12.78	13.04	13.77	15.07
	3H	14.25	14.86	15.24	15.87	17.19	13.86	14.47	14.85	15.48	16.80
	4H	14.95	15.51	15.96	16.52	17.86	14.55	15.11	15.56	16.12	17.46
	6H	15.46	15.94	16.48	16.97	18.31	15.06	15.54	16.07	16.57	17.90
	8H	15.60	16.05	16.62	17.08	18.43	15.20	15.65	16.22	16.67	18.02
	12H	15.67	16.08	16.71	17.12	18.47	15.26	15.66	16.29	16.70	18.06
8H	4H	15.15	15.60	16.16	16.62	17.97	14.79	15.24	15.81	16.26	17.61
	6H	15.77	16.14	16.81	17.20	18.55	15.41	15.78	16.45	16.84	18.19
	8H	15.98	16.31	17.03	17.36	18.73	15.62	15.94	16.67	16.99	18.36
	12H	16.11	16.39	17.16	17.44	18.85	15.73	16.02	16.78	17.06	18.47
12H	4H	15.13	15.54	16.17	16.58	17.93	14.78	15.19	15.82	16.23	17.58
	6H	15.79	16.12	16.84	17.17	18.54	15.45	15.77	16.50	16.83	18.19
	8H	16.03	16.32	17.08	17.36	18.77	15.68	15.96	16.73	17.01	18.42

END OF REPORT