

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907258

Luminaire Tested: DFN2DIP-TR3F0-090D060US835-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907258
REPORT IS A COMBINATION OF REPORTS P900326 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-090D060US835-RLLFLL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12960.0 lumens
Efficiency: N/A
Efficacy: 92.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 140
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907258

CATALOG NUMBER: DFN2DIP-TR3F0-090D060US835-RLLFLL

Luminous Intensity Polar Plot

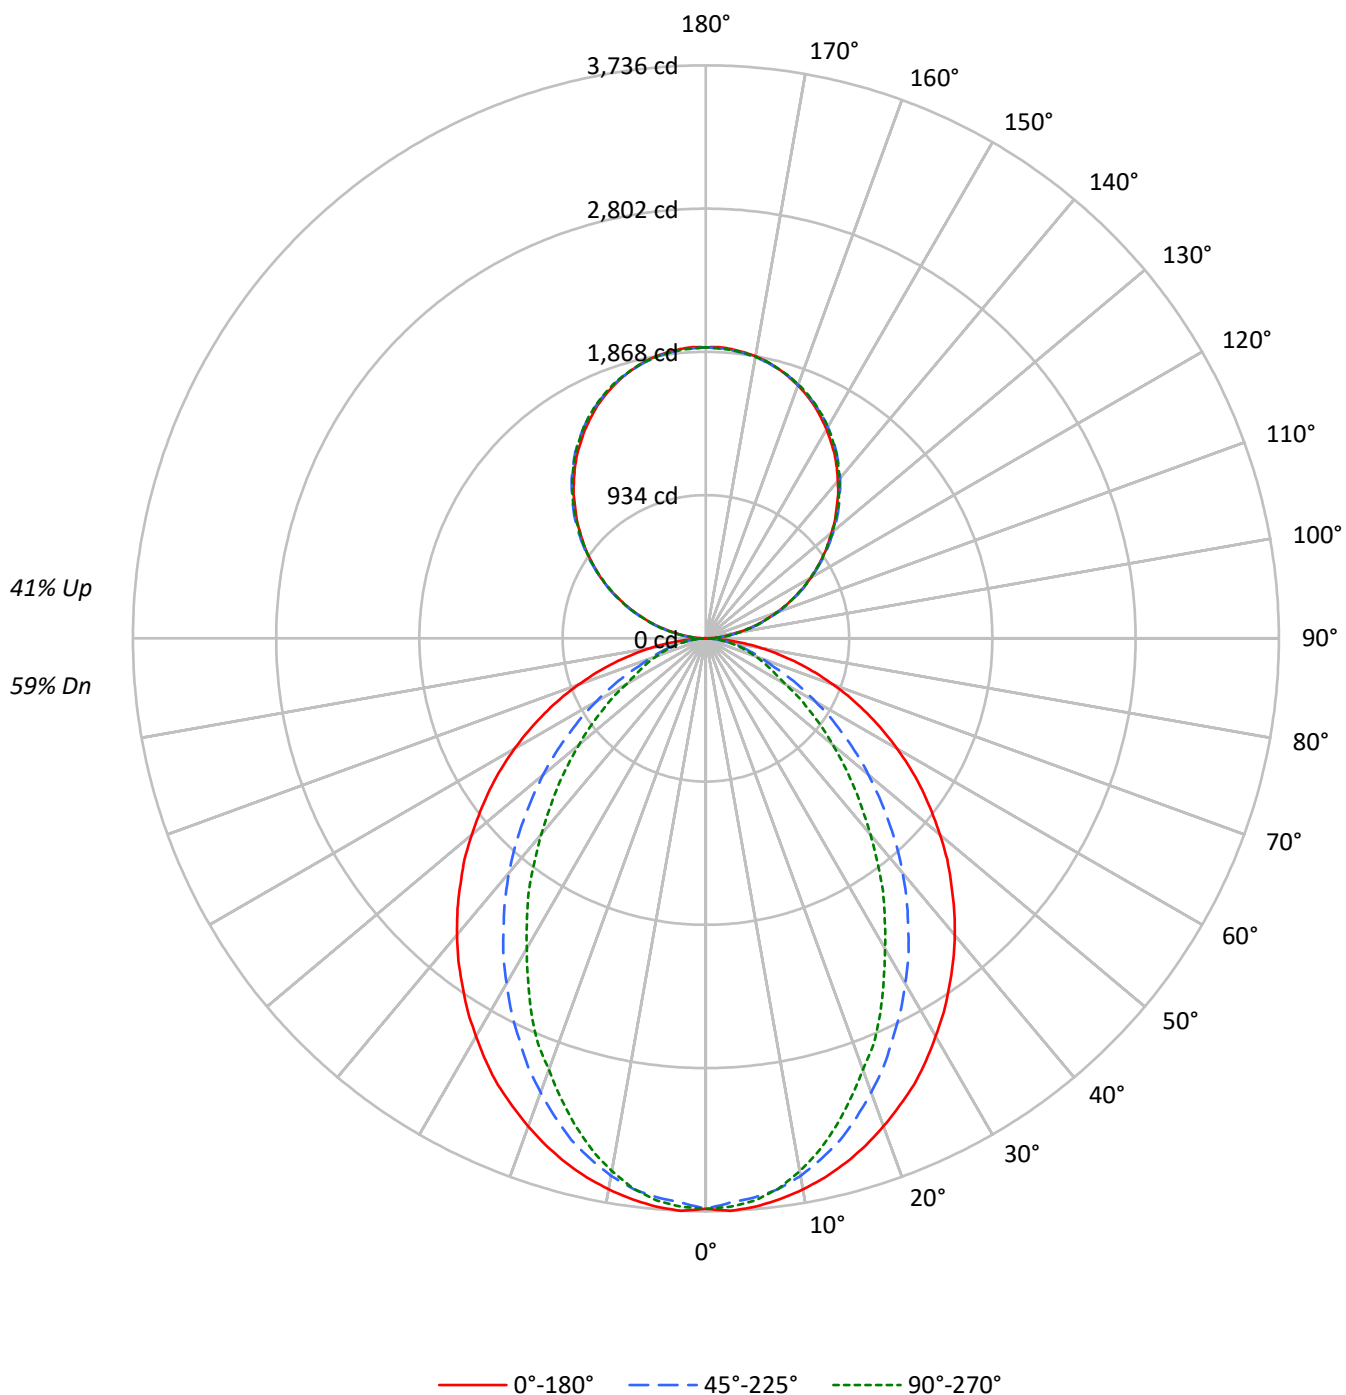

TEST NUMBER: P907258

CATALOG NUMBER: DFN2DIP-TR3F0-090D060US835-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	76	76	76	64	64	64
1	100	96	92	89	94	90	87	84	78	76	74	68	66	64	58	57	56
2	92	85	79	74	86	79	74	70	69	65	62	60	57	55	52	50	48
3	84	75	68	62	78	70	64	59	62	57	53	54	50	47	46	44	41
4	77	67	59	53	72	63	56	51	55	50	46	48	44	41	42	39	36
5	71	60	52	46	66	56	49	44	50	44	40	44	39	36	38	34	32
6	66	54	46	40	61	51	44	39	45	39	35	40	35	32	35	31	28
7	61	49	41	36	57	46	39	34	41	35	31	36	32	28	32	28	25
8	57	45	37	32	53	42	35	30	38	32	28	33	29	25	29	26	23
9	53	41	34	29	50	39	32	27	35	29	25	31	26	23	27	24	21
10	50	38	31	26	47	36	29	25	32	27	23	29	24	21	25	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4635	4635	4635
5°	4640	4558	4588
10°	4592	4464	4435
15°	4526	4313	4202
20°	4440	4106	3916
25°	4351	3875	3640
30°	4234	3638	3292
35°	4118	3383	2986
40°	4001	3121	2635
45°	3864	2830	2318
50°	3723	2536	2008
55°	3575	2223	1710
60°	3404	1897	1405
65°	3207	1565	1261
70°	2968	1256	1136
75°	2667	1099	1027
80°	2231	909	881
85°	1518	589	644

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3864 cd/sqm

TEST NUMBER: P907258

CATALOG NUMBER: DFN2DIP-TR3F0-090D060US835-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	348.6	2.7
10°-20°	957.0	7.4
20°-30°	1343.6	10.4
30°-40°	1464.6	11.3
40°-50°	1346.2	10.4
50°-60°	1057.2	8.2
60°-70°	688.1	5.3
70°-80°	354.2	2.7
80°-90°	95.8	0.7
90°-100°	117.4	0.9
100°-110°	373.1	2.9
110°-120°	638.5	4.9
120°-130°	839.7	6.5
130°-140°	942.5	7.3
140°-150°	924.2	7.1
150°-160°	775.3	6.0
160°-170°	514.2	4.0
170°-180°	179.7	1.4
0°-30°	2649.2	20.4
0°-40°	4113.9	31.7
0°-60°	6517.2	50.3
0°-90°	7655.4	59.1
90°-120°	1129.0	8.7
90°-150°	3835.4	29.6
90°-180°	5305.0	40.9
0°-180°	12960.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3720	3720	3720	3720	3720	
5°	3720	3703	3659	3689	3679	353
15°	3538	3501	3386	3322	3289	997
25°	3212	3104	2882	2744	2693	1477
35°	2767	2595	2299	2087	2013	1732
45°	2262	2036	1683	1444	1363	1747
55°	1720	1458	1094	892	828	1537
65°	1161	889	586	471	461	1151
75°	619	384	269	246	242	655
85°	145	74	64	64	64	166
90°	2	21	56	53	54	13
95°	84	100	102	102	100	93
105°	344	349	352	355	355	363
115°	641	650	647	645	641	634
125°	932	946	942	936	935	833
135°	1205	1223	1226	1225	1220	932
145°	1463	1475	1484	1486	1479	914
155°	1673	1678	1683	1691	1686	770
165°	1820	1819	1819	1830	1822	514
175°	1894	1890	1886	1898	1888	180
180°	1898	1898	1898	1898	1898	

TEST NUMBER: P907258

CATALOG NUMBER: DFN2DIP-TR3F0-090D060US835-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3719.7	3719.7	3719.7	3719.7	3719.7
2.5°	3736.5	3719.7	3682.5	3716.5	3709.7
5°	3719.7	3702.9	3659.0	3689.3	3679.3
7.5°	3689.3	3669.3	3622.2	3635.4	3618.6
10°	3649.0	3625.4	3558.3	3547.9	3527.9
12.5°	3598.6	3568.3	3477.2	3457.2	3420.0
15°	3537.9	3500.8	3386.5	3322.5	3289.0
17.5°	3467.2	3413.3	3271.8	3197.9	3144.0
20°	3386.5	3319.0	3150.7	3066.8	2992.5
22.5°	3299.0	3221.5	3026.1	2911.8	2861.5
25°	3211.5	3103.6	2881.5	2743.6	2692.9
27.5°	3107.2	2992.5	2746.8	2588.6	2511.1
30°	2996.1	2867.9	2598.6	2427.2	2336.1
32.5°	2888.2	2733.2	2457.5	2255.4	2171.1
35°	2767.2	2595.4	2299.3	2087.2	2012.9
37.5°	2649.3	2464.0	2151.1	1918.6	1834.7
40°	2524.7	2322.9	1996.1	1757.2	1669.7
42.5°	2396.8	2181.5	1841.4	1592.2	1508.2
45°	2262.2	2036.5	1683.2	1443.9	1363.2
47.5°	2134.3	1895.4	1531.8	1292.5	1218.6
50°	1992.9	1753.9	1383.6	1151.1	1080.7
52.5°	1854.7	1602.2	1242.2	1020.0	956.1
55°	1720.0	1457.5	1093.9	892.2	828.2
57.5°	1582.2	1312.9	962.9	774.3	720.4
60°	1440.7	1171.4	824.7	653.2	599.3
62.5°	1302.9	1033.6	706.8	545.4	518.6
65°	1161.4	888.6	585.7	471.4	461.1
67.5°	1026.8	753.9	471.4	413.9	403.9
70°	885.4	622.9	390.4	356.8	343.2
72.5°	750.7	501.4	326.4	299.6	292.9
75°	619.3	383.6	269.3	245.7	242.5
77.5°	488.2	272.5	212.1	198.6	191.8
80°	366.8	195.4	161.4	148.2	148.2
82.5°	255.7	131.4	111.1	104.3	104.3
85°	144.6	73.9	63.9	63.9	63.9
87.5°	53.9	26.8	26.8	23.6	23.6
90°	1.7	20.6	56.1	52.6	54.3
92.5°	35.5	48.1	49.8	51.5	51.5
95°	83.5	99.5	102.4	102.4	99.5
97.5°	139.0	153.9	160.2	160.2	160.2
100°	203.1	216.2	220.8	220.8	219.1
102.5°	270.6	280.3	286.6	288.3	286.6
105°	344.4	349.0	352.4	355.3	355.3
107.5°	417.6	424.5	424.5	425.6	417.6
110°	488.6	497.7	497.7	497.7	493.1

TEST NUMBER: P907258

CATALOG NUMBER: DFN2DIP-TR3F0-090D060US835-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	565.2	574.9	573.2	568.6	565.2
115°	640.7	649.9	647.0	645.3	640.7
117.5°	715.7	728.3	720.2	715.7	711.1
120°	791.2	803.8	791.2	791.2	786.0
122.5°	859.8	875.8	867.8	863.3	859.8
125°	931.9	946.2	941.6	936.5	934.8
127.5°	1002.3	1020.0	1013.7	1006.9	1002.3
130°	1068.1	1088.7	1085.8	1082.4	1076.1
132.5°	1141.9	1157.9	1159.0	1151.0	1146.4
135°	1205.4	1223.1	1226.5	1224.8	1220.2
137.5°	1276.3	1290.6	1293.5	1292.3	1285.5
140°	1338.7	1353.0	1361.0	1361.0	1354.7
142.5°	1402.7	1417.0	1421.6	1423.3	1417.0
145°	1463.4	1474.8	1484.0	1485.7	1479.4
147.5°	1517.7	1532.0	1538.9	1541.7	1535.4
150°	1573.8	1583.5	1589.8	1594.9	1589.8
152.5°	1623.5	1633.3	1641.3	1647.6	1641.3
155°	1673.3	1677.9	1683.0	1691.1	1685.9
157.5°	1716.2	1719.7	1722.5	1734.0	1726.0
160°	1754.6	1758.0	1759.7	1769.4	1762.6
162.5°	1790.0	1790.0	1791.7	1802.6	1794.6
165°	1820.3	1818.6	1818.6	1830.1	1822.1
167.5°	1847.8	1842.7	1842.7	1854.1	1846.1
170°	1868.4	1863.8	1862.1	1873.5	1863.8
172.5°	1882.7	1878.1	1876.4	1887.8	1878.1
175°	1894.1	1889.6	1886.1	1897.6	1887.8
177.5°	1900.4	1895.9	1892.4	1902.1	1892.4
180°	1897.6	1897.6	1897.6	1897.6	1897.6

TEST NUMBER: P907258

CATALOG NUMBER: DFN2DIP-TR3F0-090D060US835-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.23	14.14	14.11	15.04	16.18	9.21	10.12	10.09	11.01	12.15
	3H	14.90	15.72	15.80	16.63	17.79	10.40	11.21	11.29	12.12	13.28
	4H	15.51	16.28	16.42	17.19	18.37	10.85	11.61	11.76	12.53	13.70
	6H	15.93	16.64	16.85	17.56	18.74	11.17	11.87	12.09	12.79	13.98
	8H	16.05	16.73	16.98	17.66	18.85	11.26	11.93	12.19	12.87	14.05
	12H	16.11	16.75	17.05	17.68	18.89	11.30	11.94	12.23	12.87	14.08
4H	2H	13.26	14.02	14.17	14.94	16.11	9.81	10.57	10.72	11.49	12.66
	3H	15.08	15.72	16.01	16.67	17.85	11.16	11.80	12.08	12.74	13.93
	4H	15.77	16.35	16.71	17.29	18.51	11.70	12.29	12.64	13.22	14.44
	6H	16.28	16.78	17.23	17.74	18.96	12.12	12.62	13.07	13.58	14.80
	8H	16.45	16.92	17.40	17.88	19.10	12.25	12.72	13.20	13.67	14.90
	12H	16.55	16.97	17.52	17.94	19.17	12.31	12.73	13.28	13.71	14.94
8H	4H	15.74	16.21	16.69	17.17	18.39	11.98	12.45	12.94	13.41	14.64
	6H	16.30	16.69	17.28	17.69	18.91	12.50	12.88	13.47	13.88	15.11
	8H	16.51	16.85	17.50	17.84	19.09	12.68	13.03	13.67	14.01	15.26
	12H	16.65	16.95	17.64	17.93	19.22	12.80	13.10	13.79	14.08	15.38
12H	4H	15.70	16.12	16.67	17.09	18.33	11.99	12.41	12.96	13.39	14.62
	6H	16.28	16.62	17.26	17.61	18.85	12.54	12.89	13.53	13.87	15.12
	8H	16.49	16.79	17.48	17.78	19.07	12.75	13.05	13.74	14.03	15.33

END OF REPORT