

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909819

Luminaire Tested: DFN2DIP-TR3F0-030D030US840-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909819
REPORT IS A COMBINATION OF REPORTS P901792 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-030D030US840-RLLONL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5574.5 lumens
Efficiency: N/A
Efficacy: 119.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 46.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909819

CATALOG NUMBER: DFN2DIP-TR3F0-030D030US840-RLLONL

Luminous Intensity Polar Plot

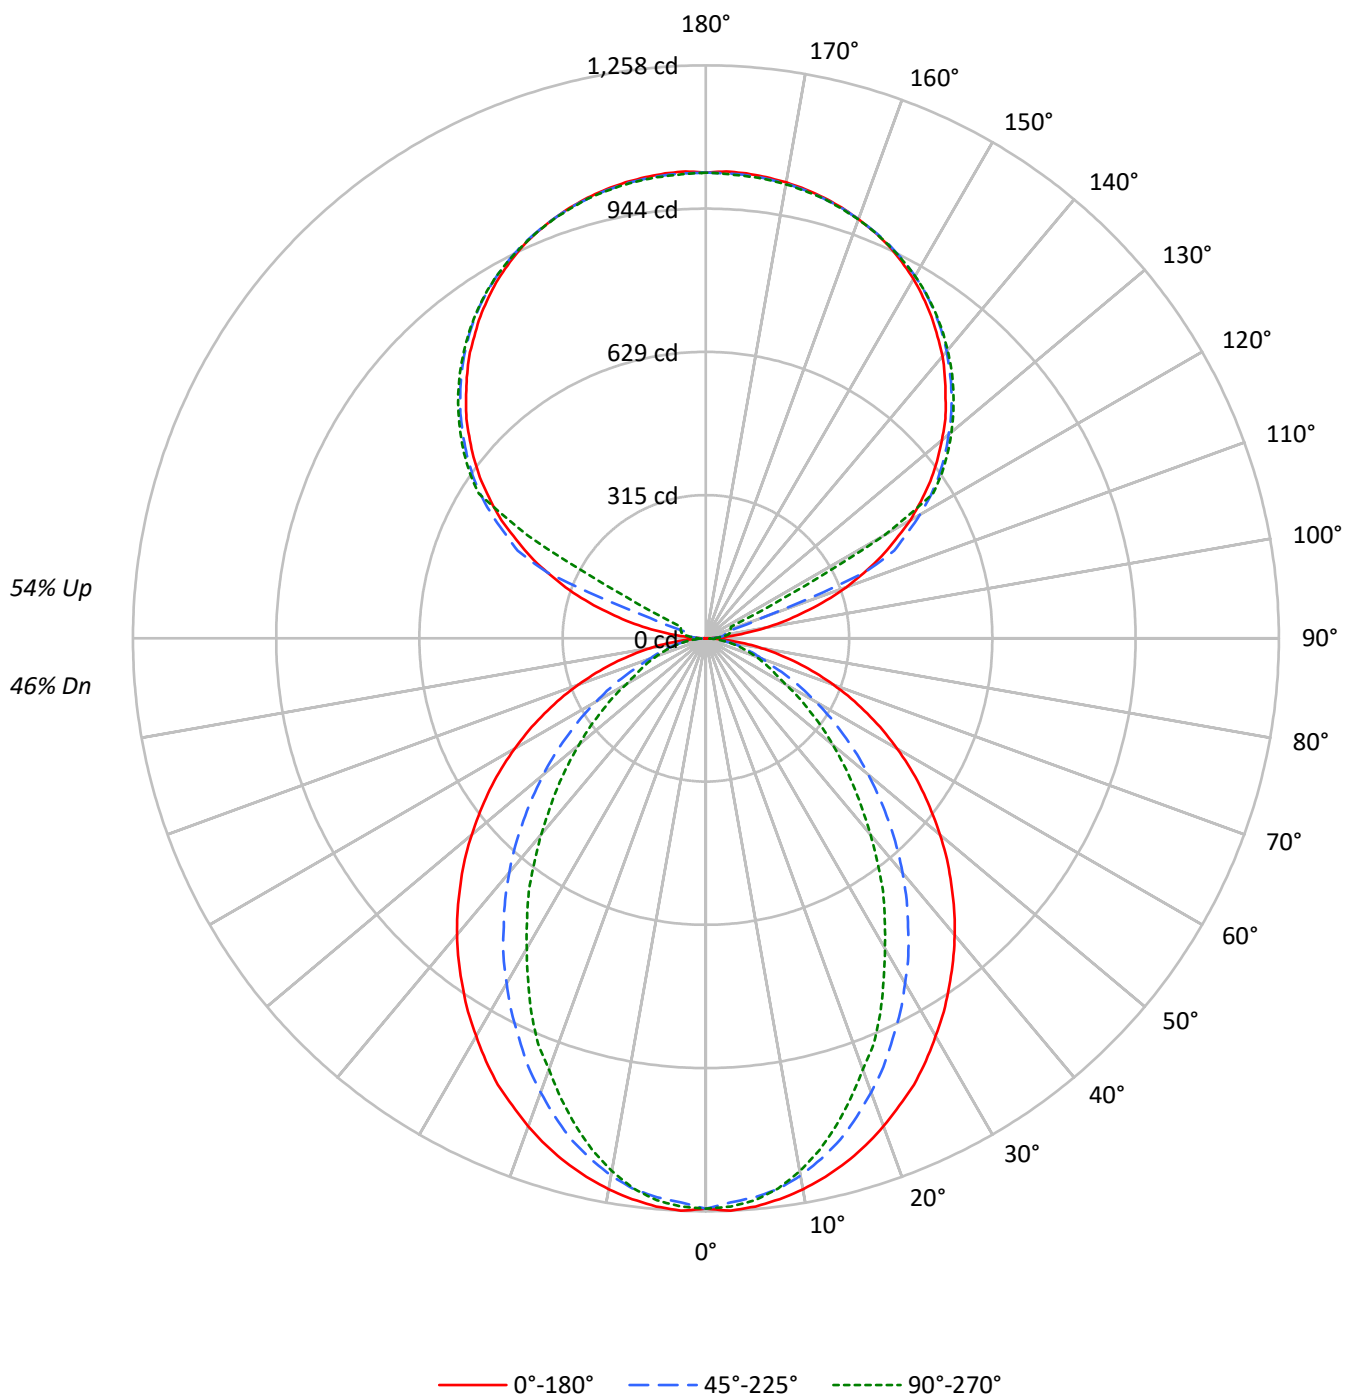

TEST NUMBER: P909819

CATALOG NUMBER: DFN2DIP-TR3F0-030D030US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53			46
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45			40
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39			34
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34			29
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29			26
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26			23
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23			20
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21			18
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19			16
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17			15
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15			13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1560	1560	1560
5°	1562	1534	1544
10°	1546	1503	1493
15°	1523	1452	1414
20°	1494	1382	1318
25°	1465	1304	1225
30°	1425	1224	1108
35°	1386	1139	1005
40°	1347	1051	887
45°	1301	953	780
50°	1253	854	676
55°	1203	748	576
60°	1146	638	473
65°	1079	527	424
70°	999	423	382
75°	897	370	346
80°	751	306	297
85°	511	198	217

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1301 cd/sqm

TEST NUMBER: P909819

CATALOG NUMBER: DFN2DIP-TR3F0-030D030US840-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	117.4	2.1
10°-20°	322.1	5.8
20°-30°	452.3	8.1
30°-40°	493.0	8.8
40°-50°	453.1	8.1
50°-60°	355.9	6.4
60°-70°	231.6	4.2
70°-80°	119.2	2.1
80°-90°	32.2	0.6
90°-100°	33.7	0.6
100°-110°	125.7	2.3
110°-120°	333.3	6.0
120°-130°	552.9	9.9
130°-140°	587.3	10.5
140°-150°	545.8	9.8
150°-160°	438.8	7.9
160°-170°	282.8	5.1
170°-180°	97.3	1.7
0°-30°	891.8	16.0
0°-40°	1384.8	24.8
0°-60°	2193.8	39.4
0°-90°	2576.9	46.2
90°-120°	492.7	8.8
90°-150°	2178.7	39.1
90°-180°	2998.0	53.8
0°-180°	5574.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1252	1252	1252	1252	1252	
5°	1252	1246	1232	1242	1238	119
15°	1191	1178	1140	1118	1107	336
25°	1081	1045	970	924	906	497
35°	932	874	774	703	678	583
45°	762	686	567	486	459	588
55°	579	491	368	300	279	517
65°	391	299	197	159	155	388
75°	208	129	91	83	82	220
85°	49	25	22	22	22	56
90°	1	9	15	19	20	5
95°	48	24	29	33	32	57
105°	225	247	45	53	56	240
115°	425	438	456	114	61	419
125°	602	611	625	630	633	536
135°	744	756	763	770	769	575
145°	863	863	875	880	877	540
155°	951	944	953	957	952	438
165°	1002	997	1000	1005	1000	283
175°	1025	1020	1021	1026	1019	98
180°	1022	1022	1022	1022	1022	

TEST NUMBER: P909819

CATALOG NUMBER: DFN2DIP-TR3F0-030D030US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1252.1	1252.1	1252.1	1252.1	1252.1
2.5°	1257.8	1252.1	1239.6	1251.0	1248.8
5°	1252.1	1246.5	1231.7	1241.9	1238.5
7.5°	1241.9	1235.2	1219.3	1223.8	1218.1
10°	1228.3	1220.4	1197.8	1194.3	1187.6
12.5°	1211.3	1201.1	1170.5	1163.8	1151.2
15°	1190.9	1178.4	1139.9	1118.4	1107.1
17.5°	1167.1	1149.0	1101.4	1076.5	1058.3
20°	1139.9	1117.2	1060.6	1032.4	1007.3
22.5°	1110.5	1084.4	1018.7	980.2	963.2
25°	1081.1	1044.7	970.0	923.5	906.5
27.5°	1045.9	1007.3	924.6	871.4	845.3
30°	1008.6	965.4	874.7	817.1	786.4
32.5°	972.2	920.1	827.3	759.2	730.8
35°	931.5	873.6	774.0	702.6	677.6
37.5°	891.8	829.4	724.1	645.8	617.6
40°	849.9	781.9	672.0	591.5	562.1
42.5°	806.8	734.4	619.9	535.9	507.7
45°	761.5	685.5	566.6	486.0	458.9
47.5°	718.4	638.0	515.6	435.1	410.2
50°	670.9	590.4	465.7	387.5	363.8
52.5°	624.3	539.4	418.2	343.4	321.8
55°	579.0	490.6	368.2	300.3	278.8
57.5°	532.6	441.9	324.2	260.6	242.5
60°	484.9	394.4	277.6	219.8	201.8
62.5°	438.6	347.9	237.9	183.6	174.6
65°	390.9	299.1	197.1	158.6	155.2
67.5°	345.7	253.8	158.6	139.4	135.9
70°	298.0	209.6	131.4	120.1	115.5
72.5°	252.7	168.7	109.9	100.9	98.6
75°	208.4	129.2	90.7	82.7	81.6
77.5°	164.3	91.7	71.4	66.9	64.5
80°	123.5	65.7	54.3	49.9	49.9
82.5°	86.0	44.2	37.4	35.1	35.1
85°	48.7	24.8	21.5	21.5	21.5
87.5°	18.2	9.0	9.0	8.0	8.0
90°	0.7	8.9	14.7	18.6	19.9
92.5°	18.6	15.6	17.8	19.3	19.9
95°	48.1	23.6	28.8	32.6	31.8
97.5°	86.5	26.0	37.7	40.0	40.7
100°	131.0	29.6	42.2	48.1	49.6
102.5°	179.8	178.3	43.6	51.7	54.0
105°	224.9	247.1	45.1	53.2	56.2
107.5°	277.4	295.9	46.7	54.7	57.8
110°	327.8	343.3	129.5	55.5	58.5

TEST NUMBER: P909819

CATALOG NUMBER: DFN2DIP-TR3F0-030D030US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	375.2	388.4	375.9	57.0	59.2
115°	425.4	438.0	456.5	113.9	60.7
117.5°	469.1	483.8	496.4	390.6	196.8
120°	517.9	529.0	542.3	551.2	451.3
122.5°	559.3	571.2	586.0	590.4	591.2
125°	601.5	611.1	625.2	630.4	632.6
127.5°	640.0	650.3	661.5	668.8	669.5
130°	676.2	688.1	696.2	704.3	703.7
132.5°	713.2	722.9	730.9	737.6	736.9
135°	744.3	756.2	762.8	770.2	768.7
137.5°	776.8	785.7	793.1	800.5	798.3
140°	808.6	814.6	822.6	829.3	825.7
142.5°	835.4	840.5	850.1	856.0	852.3
145°	863.4	862.6	875.3	880.4	876.7
147.5°	887.8	885.6	898.2	901.8	898.9
150°	911.5	906.4	918.2	922.5	918.9
152.5°	931.4	925.5	936.7	941.1	935.9
155°	950.7	944.1	952.9	957.4	951.5
157.5°	966.2	960.4	967.0	972.2	966.2
160°	979.6	975.1	979.6	984.0	978.8
162.5°	991.4	986.9	990.7	995.8	989.2
165°	1001.7	997.3	999.6	1004.7	999.6
167.5°	1009.9	1005.4	1007.6	1012.9	1006.2
170°	1016.5	1012.1	1013.6	1018.8	1012.1
172.5°	1021.0	1016.5	1018.0	1023.2	1016.5
175°	1024.6	1019.5	1021.0	1026.1	1018.8
177.5°	1026.1	1021.0	1021.8	1026.9	1020.3
180°	1022.5	1022.5	1022.5	1022.5	1022.5

TEST NUMBER: P909819

CATALOG NUMBER: DFN2DIP-TR3F0-030D030US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.28	9.08	9.27	10.08	11.41	4.25	5.05	5.25	6.06	7.38
	3H	9.94	10.66	10.95	11.67	13.02	5.43	6.15	6.44	7.16	8.51
	4H	10.54	11.22	11.56	12.24	13.59	5.88	6.56	6.90	7.57	8.93
	6H	10.96	11.58	11.99	12.60	13.97	6.19	6.82	7.22	7.84	9.20
	8H	11.08	11.67	12.11	12.71	14.07	6.28	6.87	7.32	7.91	9.27
	12H	11.13	11.70	12.17	12.73	14.11	6.32	6.88	7.36	7.91	9.30
4H	2H	8.29	8.97	9.32	9.98	11.34	4.84	5.52	5.87	6.53	7.89
	3H	10.11	10.67	11.14	11.71	13.08	6.18	6.74	7.21	7.79	9.16
	4H	10.79	11.31	11.83	12.34	13.73	6.72	7.24	7.76	8.27	9.66
	6H	11.29	11.74	12.35	12.79	14.18	7.13	7.58	8.19	8.63	10.02
	8H	11.46	11.88	12.51	12.93	14.33	7.26	7.67	8.31	8.72	10.13
	12H	11.55	11.92	12.62	12.99	14.40	7.32	7.69	8.39	8.76	10.17
8H	4H	10.75	11.17	11.81	12.22	13.62	7.00	7.41	8.05	8.46	9.86
	6H	11.31	11.65	12.38	12.74	14.14	7.51	7.85	8.58	8.94	10.34
	8H	11.52	11.82	12.60	12.89	14.31	7.69	7.99	8.77	9.07	10.49
	12H	11.65	11.91	12.73	12.98	14.44	7.80	8.07	8.89	9.14	10.60
12H	4H	10.70	11.08	11.77	12.14	13.55	7.00	7.37	8.07	8.44	9.84
	6H	11.28	11.58	12.37	12.66	14.08	7.55	7.85	8.63	8.93	10.35
	8H	11.50	11.76	12.58	12.83	14.29	7.76	8.02	8.84	9.09	10.55

END OF REPORT