

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909828

Luminaire Tested: DFN2DIP-TR3F0-030D060US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909828
REPORT IS A COMBINATION OF REPORTS P900313 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-030D060US840-FLLFLL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8361.7 lumens
Efficiency: N/A
Efficacy: 121.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 69.1
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909828

CATALOG NUMBER: DFN2DIP-TR3F0-030D060US840-FLLFLL

Luminous Intensity Polar Plot

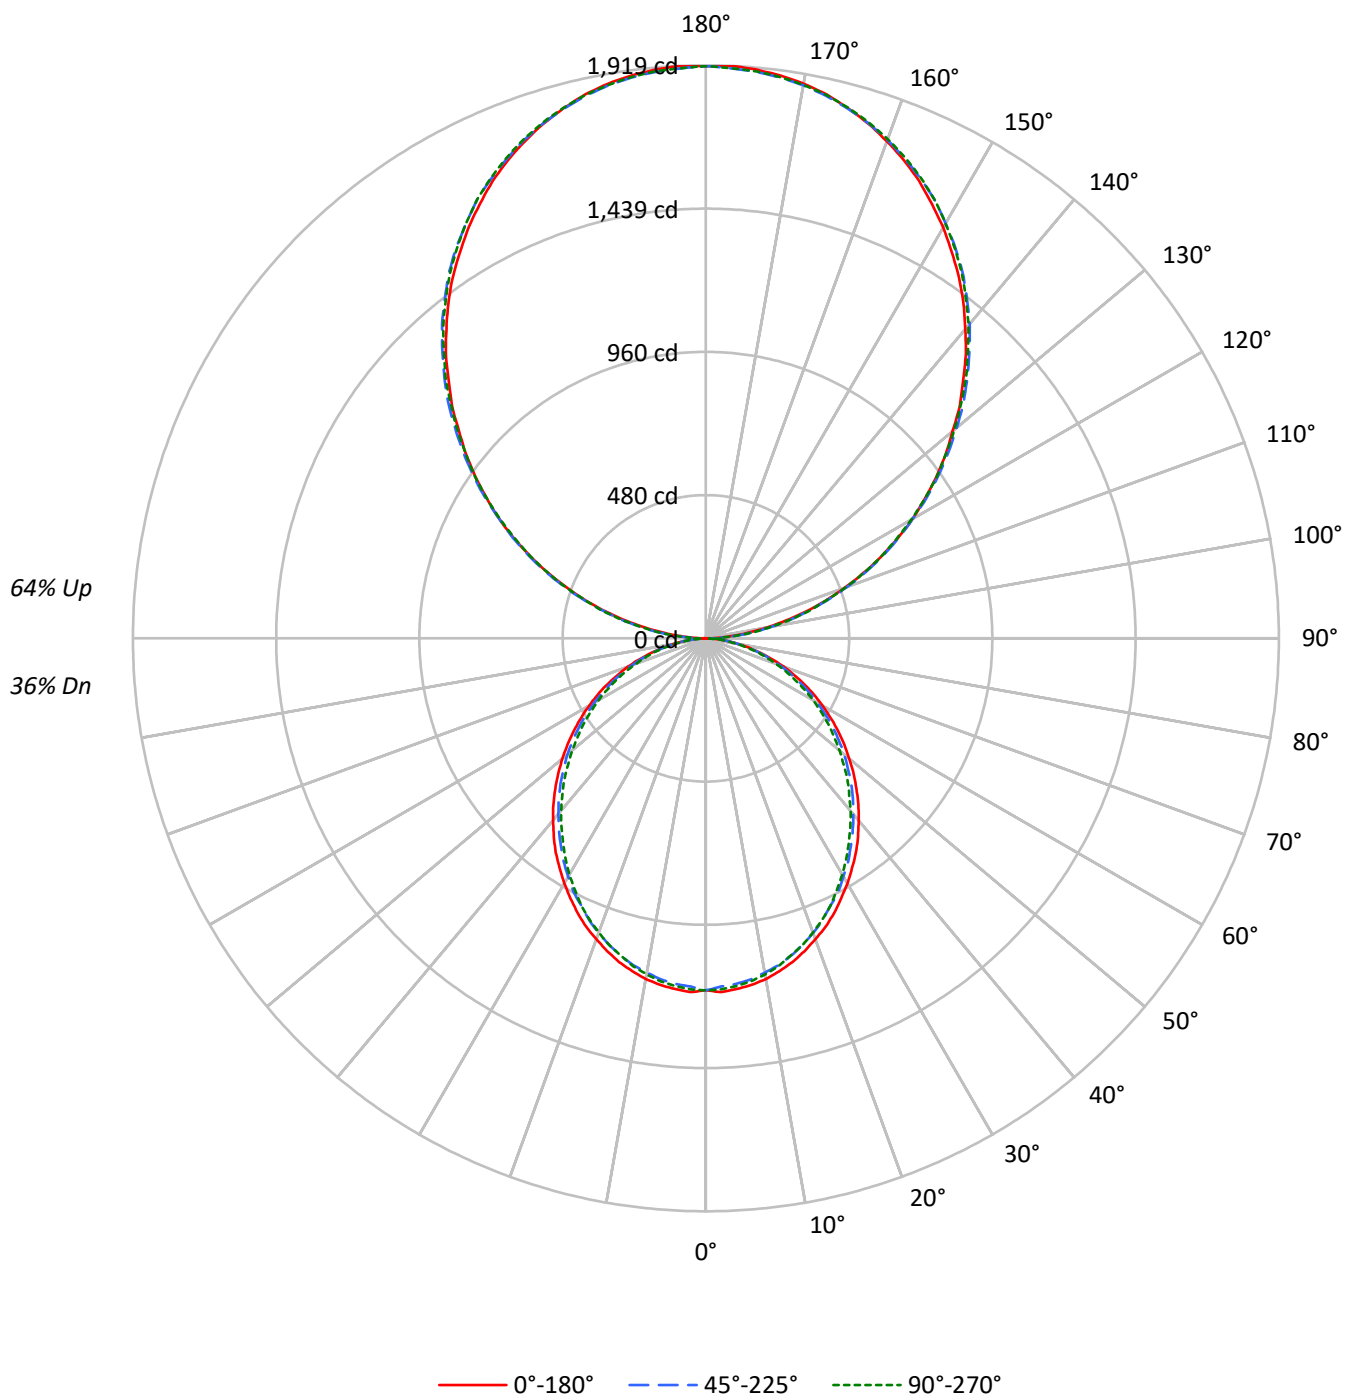

TEST NUMBER: P909828

CATALOG NUMBER: DFN2DIP-TR3F0-030D060US840-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	43	43	43
1	95	90	87	83	85	82	79	76	66	64	62	52	50	49	38	37	36
2	86	79	73	68	78	72	66	62	58	54	51	45	43	41	34	32	31
3	79	69	62	56	71	63	57	52	51	47	43	40	37	34	30	28	26
4	72	61	54	48	65	56	49	44	45	40	37	36	32	29	27	24	22
5	66	54	47	41	59	50	43	38	40	35	31	32	28	25	24	22	20
6	61	49	41	35	55	45	38	33	36	31	27	29	25	22	22	19	17
7	56	44	36	31	50	40	33	28	33	28	24	26	22	20	20	17	15
8	52	40	32	27	47	36	30	25	30	25	21	24	20	17	18	16	14
9	48	36	29	24	44	33	27	22	27	22	19	22	18	16	17	14	12
10	45	33	26	21	41	30	24	20	25	20	17	20	17	14	16	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1469	1469	1469
5°	1470	1447	1457
10°	1458	1427	1437
15°	1436	1402	1405
20°	1406	1368	1372
25°	1376	1328	1335
30°	1339	1290	1287
35°	1304	1246	1237
40°	1261	1201	1190
45°	1218	1157	1141
50°	1171	1110	1084
55°	1122	1055	1032
60°	1066	991	973
65°	1005	924	902
70°	927	843	826
75°	820	745	754
80°	690	619	620
85°	488	407	400

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1868 cd/sqm

TEST NUMBER: P909828

CATALOG NUMBER: DFN2DIP-TR3F0-030D060US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	111.0	1.3
10°-20°	312.2	3.7
20°-30°	458.8	5.5
30°-40°	532.8	6.4
40°-50°	532.2	6.4
50°-60°	464.1	5.5
60°-70°	343.1	4.1
70°-80°	194.1	2.3
80°-90°	56.7	0.7
90°-100°	118.6	1.4
100°-110°	376.8	4.5
110°-120°	644.8	7.7
120°-130°	848.0	10.1
130°-140°	951.8	11.4
140°-150°	933.4	11.2
150°-160°	783.0	9.4
160°-170°	519.2	6.2
170°-180°	181.5	2.2
0°-30°	881.9	10.5
0°-40°	1414.7	16.9
0°-60°	2411.0	28.8
0°-90°	3004.8	35.9
90°-120°	1140.1	13.6
90°-150°	3873.3	46.3
90°-180°	5357.0	64.1
0°-180°	8361.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1179	1179	1179	1179	1179	
5°	1179	1174	1162	1171	1169	112
15°	1122	1116	1101	1105	1100	316
25°	1016	1007	987	990	987	467
35°	876	865	847	840	834	547
45°	713	705	688	676	671	550
55°	540	533	519	506	500	482
65°	364	357	346	336	330	360
75°	190	188	182	176	178	203
85°	46	45	44	41	40	52
90°	2	21	57	53	55	8
95°	84	100	103	103	100	94
105°	348	352	356	359	359	367
115°	647	656	653	652	647	640
125°	941	956	951	946	944	841
135°	1217	1235	1239	1237	1232	941
145°	1478	1489	1499	1500	1494	923
155°	1690	1694	1700	1708	1702	778
165°	1838	1836	1836	1848	1840	519
175°	1913	1908	1905	1916	1906	182
180°	1916	1916	1916	1916	1916	

TEST NUMBER: P909828

CATALOG NUMBER: DFN2DIP-TR3F0-030D060US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1178.8	1178.8	1178.8	1178.8	1178.8
2.5°	1185.7	1180.0	1167.5	1178.8	1176.7
5°	1178.8	1174.4	1161.9	1170.9	1168.7
7.5°	1170.9	1164.2	1151.7	1160.8	1158.5
10°	1158.5	1150.5	1137.0	1146.0	1142.7
12.5°	1141.5	1134.7	1121.2	1126.7	1124.5
15°	1122.2	1115.5	1100.7	1105.2	1099.5
17.5°	1098.3	1091.7	1076.8	1082.5	1076.8
20°	1072.3	1065.5	1049.7	1053.0	1048.5
22.5°	1046.3	1036.1	1021.3	1021.3	1019.0
25°	1015.6	1006.6	987.3	989.6	987.3
27.5°	981.6	973.6	959.0	955.6	950.0
30°	947.7	938.6	921.6	918.2	913.6
32.5°	911.4	904.6	886.5	879.6	875.0
35°	876.3	864.9	846.8	839.9	834.2
37.5°	836.6	826.4	808.2	800.2	794.6
40°	795.8	786.7	768.5	758.4	753.9
42.5°	756.1	747.0	728.9	717.5	710.7
45°	713.1	705.1	688.0	675.6	671.1
47.5°	671.1	663.2	645.0	632.5	625.7
50°	626.8	621.2	605.3	589.5	583.8
52.5°	583.8	575.8	561.2	548.7	540.7
55°	539.7	532.8	519.2	505.6	500.0
57.5°	495.3	489.7	474.9	461.3	456.8
60°	451.1	446.7	430.8	418.3	415.0
62.5°	408.1	400.1	388.8	377.5	372.9
65°	364.0	357.1	345.8	335.6	329.9
67.5°	318.6	312.9	302.7	294.8	290.2
70°	276.6	272.1	261.9	253.9	249.4
72.5°	233.6	228.9	223.3	215.4	212.1
75°	190.4	188.2	182.5	175.7	178.0
77.5°	151.9	147.3	145.0	141.7	138.4
80°	113.4	112.2	109.9	106.5	104.3
82.5°	77.1	77.1	76.0	71.4	71.4
85°	46.5	45.3	44.2	40.8	39.7
87.5°	20.4	18.2	15.9	12.5	11.3
90°	1.7	20.8	56.7	53.1	54.8
92.5°	35.9	48.6	50.3	52.0	52.0
95°	84.3	100.5	103.4	103.4	100.5
97.5°	140.4	155.4	161.8	161.8	161.8
100°	205.1	218.3	223.0	223.0	221.3
102.5°	273.3	283.1	289.4	291.1	289.4
105°	347.8	352.4	355.9	358.8	358.8
107.5°	421.7	428.7	428.7	429.8	421.7
110°	493.4	502.6	502.6	502.6	498.0

TEST NUMBER: P909828

CATALOG NUMBER: DFN2DIP-TR3F0-030D060US840-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	570.8	580.6	578.9	574.2	570.8
115°	647.0	656.3	653.4	651.7	647.0
117.5°	722.8	735.5	727.3	722.8	718.1
120°	799.0	811.7	799.0	799.0	793.8
122.5°	868.3	884.4	876.4	871.8	868.3
125°	941.1	955.5	950.9	945.7	944.0
127.5°	1012.2	1030.1	1023.7	1016.8	1012.2
130°	1078.6	1099.4	1096.5	1093.1	1086.7
132.5°	1153.2	1169.3	1170.4	1162.4	1157.7
135°	1217.3	1235.2	1238.6	1236.9	1232.2
137.5°	1288.9	1303.3	1306.3	1305.0	1298.2
140°	1351.9	1366.3	1374.4	1374.4	1368.1
142.5°	1416.5	1431.0	1435.6	1437.3	1431.0
145°	1477.8	1489.3	1498.6	1500.4	1494.0
147.5°	1532.7	1547.1	1554.1	1556.9	1550.5
150°	1589.3	1599.1	1605.5	1610.6	1605.5
152.5°	1639.5	1649.4	1657.5	1663.9	1657.5
155°	1689.8	1694.5	1699.6	1707.8	1702.5
157.5°	1733.1	1736.7	1739.5	1751.1	1743.0
160°	1771.9	1775.3	1777.1	1786.9	1780.0
162.5°	1807.7	1807.7	1809.4	1820.4	1812.3
165°	1838.3	1836.5	1836.5	1848.2	1840.1
167.5°	1866.0	1860.9	1860.9	1872.4	1864.3
170°	1886.8	1882.2	1880.5	1892.0	1882.2
172.5°	1901.3	1896.6	1894.9	1906.4	1896.6
175°	1912.8	1908.2	1904.7	1916.3	1906.4
177.5°	1919.1	1914.6	1911.1	1920.9	1911.1
180°	1916.3	1916.3	1916.3	1916.3	1916.3

TEST NUMBER: P909828

CATALOG NUMBER: DFN2DIP-TR3F0-030D060US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.09	7.84	8.16	8.91	10.37	6.66	7.41	7.73	8.48	9.94
	3H	8.73	9.40	9.81	10.48	11.96	8.27	8.94	9.34	10.02	11.49
	4H	9.31	9.95	10.40	11.03	12.51	8.84	9.48	9.93	10.56	12.04
	6H	9.70	10.28	10.80	11.37	12.86	9.23	9.81	10.33	10.90	12.39
	8H	9.79	10.35	10.90	11.45	12.94	9.33	9.88	10.43	10.98	12.47
	12H	9.84	10.36	10.94	11.46	12.97	9.36	9.89	10.47	10.99	12.50
4H	2H	7.54	8.17	8.63	9.25	10.74	7.19	7.83	8.29	8.91	10.39
	3H	9.38	9.91	10.48	11.02	12.52	8.99	9.52	10.09	10.63	12.13
	4H	10.08	10.57	11.19	11.67	13.19	9.68	10.17	10.79	11.27	12.78
	6H	10.58	11.00	11.70	12.12	13.63	10.18	10.60	11.29	11.72	13.23
	8H	10.73	11.12	11.84	12.23	13.75	10.32	10.71	11.43	11.82	13.35
	12H	10.79	11.14	11.92	12.27	13.80	10.37	10.73	11.51	11.85	13.38
8H	4H	10.27	10.66	11.38	11.77	13.30	9.91	10.30	11.02	11.41	12.94
	6H	10.88	11.20	12.02	12.36	13.88	10.52	10.85	11.66	12.00	13.52
	8H	11.10	11.38	12.24	12.51	14.06	10.73	11.01	11.87	12.15	13.69
	12H	11.22	11.46	12.36	12.60	14.17	10.84	11.08	11.98	12.22	13.80
12H	4H	10.25	10.60	11.38	11.73	13.26	9.90	10.25	11.03	11.38	12.91
	6H	10.91	11.19	12.05	12.33	13.87	10.56	10.84	11.70	11.98	13.52
	8H	11.14	11.39	12.29	12.52	14.10	10.79	11.03	11.93	12.17	13.74

END OF REPORT