

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909848

Luminaire Tested: DFN2DIP-TR3F0-040D040US840-RLLFLL

Issue Date: 11/21/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P909848  
REPORT IS A COMBINATION OF REPORTS P900288 AND P897195  
Test Lab: INNOVATION CENTER  
Issue Date: 11/21/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: NEO-RAY  
Catalog Number: DFN2DIP-TR3F0-040D040US840-RLLFLL  
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens  
Light Source: -  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 7008.5 lumens  
Efficiency: N/A  
Efficacy: 108.7 lumens/watt  
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16  
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')  
CIE Type: General Diffuse  
  
Input Watts (W): 64.5  
Input Voltage (V):  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: 0.9951  
Total Harmonic Distortion (THDi): 0.07  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P909848

CATALOG NUMBER: DFN2DIP-TR3F0-040D040US840-RLLFLL

### Luminous Intensity Polar Plot

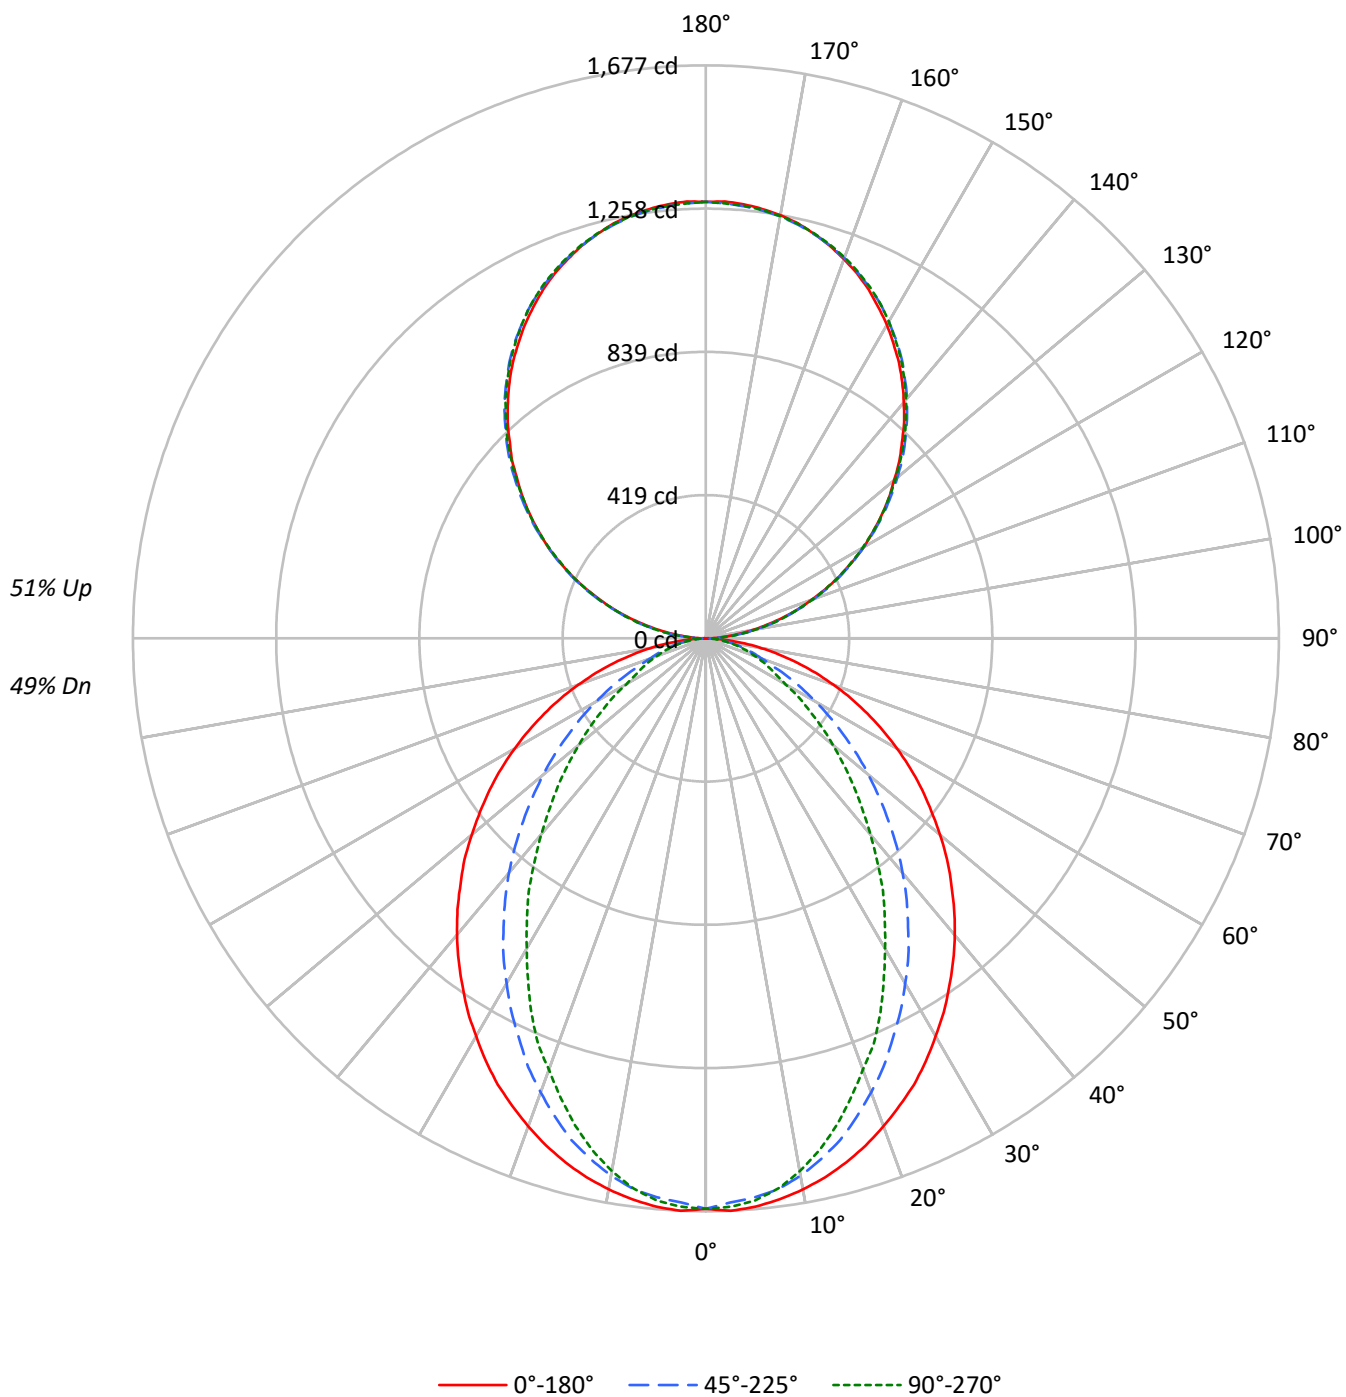

TEST NUMBER: P909848

CATALOG NUMBER: DFN2DIP-TR3F0-040D040US840-RLLFLL

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |    |    |    |    |    |    |    |    |    |    |    |    |    |
|-----|-----|-----|-----|-----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| RF  | 20  |     |     |     | 20 |    |    |    | 20 |    |    |    | 20 |    |    |    | 20 |
| RC  | 80  |     |     |     | 70 |    |    |    | 50 |    |    |    | 30 |    |    |    | 10 |
| RW  | 70  | 50  | 30  | 10  | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 |
| RCR |     |     |     |     |    |    |    |    |    |    |    |    |    |    |    |    |    |
| 0   | 107 | 107 | 107 | 107 | 99 | 99 | 99 | 99 | 83 | 83 | 83 | 68 | 68 | 68 | 55 | 55 | 55 |
| 1   | 98  | 94  | 90  | 87  | 90 | 87 | 84 | 81 | 73 | 71 | 69 | 61 | 59 | 58 | 50 | 49 | 48 |
| 2   | 90  | 83  | 77  | 72  | 82 | 76 | 71 | 67 | 65 | 61 | 58 | 54 | 51 | 49 | 44 | 42 | 41 |
| 3   | 82  | 73  | 66  | 60  | 75 | 68 | 61 | 57 | 58 | 53 | 49 | 48 | 45 | 42 | 40 | 37 | 35 |
| 4   | 75  | 65  | 57  | 51  | 69 | 60 | 54 | 48 | 51 | 46 | 42 | 43 | 40 | 36 | 36 | 33 | 31 |
| 5   | 69  | 58  | 50  | 44  | 64 | 54 | 47 | 42 | 46 | 41 | 37 | 39 | 35 | 32 | 32 | 29 | 27 |
| 6   | 64  | 52  | 44  | 39  | 59 | 49 | 42 | 37 | 42 | 36 | 32 | 35 | 31 | 28 | 30 | 26 | 24 |
| 7   | 59  | 47  | 40  | 34  | 55 | 44 | 37 | 32 | 38 | 33 | 29 | 32 | 28 | 25 | 27 | 24 | 22 |
| 8   | 55  | 43  | 36  | 30  | 51 | 40 | 33 | 29 | 35 | 29 | 26 | 30 | 26 | 23 | 25 | 22 | 20 |
| 9   | 51  | 39  | 32  | 27  | 47 | 37 | 30 | 26 | 32 | 27 | 23 | 27 | 23 | 20 | 23 | 20 | 18 |
| 10  | 48  | 36  | 29  | 24  | 44 | 34 | 28 | 23 | 30 | 24 | 21 | 25 | 21 | 19 | 22 | 18 | 16 |

**AVERAGE LUMINANCE (cd/sqm):**

|     | 0°   | 45°  | 90°  |
|-----|------|------|------|
| 0°  | 2080 | 2080 | 2080 |
| 5°  | 2083 | 2046 | 2059 |
| 10° | 2061 | 2004 | 1991 |
| 15° | 2031 | 1936 | 1886 |
| 20° | 1993 | 1843 | 1758 |
| 25° | 1953 | 1739 | 1634 |
| 30° | 1900 | 1633 | 1477 |
| 35° | 1848 | 1519 | 1340 |
| 40° | 1796 | 1401 | 1183 |
| 45° | 1734 | 1270 | 1040 |
| 50° | 1671 | 1138 | 901  |
| 55° | 1605 | 998  | 767  |
| 60° | 1528 | 851  | 630  |
| 65° | 1439 | 702  | 566  |
| 70° | 1332 | 564  | 510  |
| 75° | 1197 | 493  | 461  |
| 80° | 1001 | 408  | 396  |
| 85° | 681  | 264  | 289  |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1734 cd/sqm

TEST NUMBER: P909848

CATALOG NUMBER: DFN2DIP-TR3F0-040D040US840-RLLFLL

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 156.5  | 2.2       |
| 10°-20°   | 429.5  | 6.1       |
| 20°-30°   | 603.0  | 8.6       |
| 30°-40°   | 657.4  | 9.4       |
| 40°-50°   | 604.2  | 8.6       |
| 50°-60°   | 474.5  | 6.8       |
| 60°-70°   | 308.9  | 4.4       |
| 70°-80°   | 159.0  | 2.3       |
| 80°-90°   | 44.2   | 0.6       |
| 90°-100°  | 79.1   | 1.1       |
| 100°-110° | 251.2  | 3.6       |
| 110°-120° | 429.8  | 6.1       |
| 120°-130° | 565.3  | 8.1       |
| 130°-140° | 634.5  | 9.1       |
| 140°-150° | 622.2  | 8.9       |
| 150°-160° | 522.0  | 7.4       |
| 160°-170° | 346.2  | 4.9       |
| 170°-180° | 121.0  | 1.7       |
| 0°-30°    | 1189.0 | 17.0      |
| 0°-40°    | 1846.4 | 26.3      |
| 0°-60°    | 2925.1 | 41.7      |
| 0°-90°    | 3437.2 | 49.0      |
| 90°-120°  | 760.1  | 10.8      |
| 90°-150°  | 2582.2 | 36.8      |
| 90°-180°  | 3571.0 | 51.0      |
| 0°-180°   | 7008.5 | 100.0     |

**CANDELA DISTRIBUTION:**

|      | 0°   | 22.5° | 45°  | 67.5° | 90°  | Flux |
|------|------|-------|------|-------|------|------|
| 0°   | 1670 | 1670  | 1670 | 1670  | 1670 |      |
| 5°   | 1670 | 1662  | 1642 | 1656  | 1651 | 158  |
| 15°  | 1588 | 1571  | 1520 | 1491  | 1476 | 447  |
| 25°  | 1441 | 1393  | 1293 | 1231  | 1209 | 663  |
| 35°  | 1242 | 1165  | 1032 | 937   | 903  | 777  |
| 45°  | 1015 | 914   | 756  | 648   | 612  | 784  |
| 55°  | 772  | 654   | 491  | 400   | 372  | 690  |
| 65°  | 521  | 399   | 263  | 212   | 207  | 517  |
| 75°  | 278  | 172   | 121  | 110   | 109  | 294  |
| 85°  | 65   | 33    | 29   | 29    | 29   | 75   |
| 90°  | 1    | 14    | 38   | 35    | 37   | 7    |
| 95°  | 56   | 67    | 69   | 69    | 67   | 63   |
| 105° | 232  | 235   | 237  | 239   | 239  | 245  |
| 115° | 431  | 438   | 436  | 434   | 431  | 427  |
| 125° | 627  | 637   | 634  | 630   | 629  | 561  |
| 135° | 812  | 823   | 826  | 825   | 822  | 627  |
| 145° | 985  | 993   | 999  | 1000  | 996  | 616  |
| 155° | 1126 | 1130  | 1133 | 1138  | 1135 | 519  |
| 165° | 1226 | 1224  | 1224 | 1232  | 1227 | 346  |
| 175° | 1275 | 1272  | 1270 | 1278  | 1271 | 121  |
| 180° | 1278 | 1278  | 1278 | 1278  | 1278 |      |

TEST NUMBER: P909848

CATALOG NUMBER: DFN2DIP-TR3F0-040D040US840-RLLFLL

**CANDELA DISTRIBUTION (FULL):**

|        | 0°     | 22.5°  | 45°    | 67.5°  | 90°    |
|--------|--------|--------|--------|--------|--------|
| 0°     | 1669.5 | 1669.5 | 1669.5 | 1669.5 | 1669.5 |
| 2.5°   | 1677.1 | 1669.5 | 1652.8 | 1668.1 | 1665.0 |
| 5°     | 1669.5 | 1661.9 | 1642.2 | 1655.9 | 1651.4 |
| 7.5°   | 1655.9 | 1646.9 | 1625.8 | 1631.6 | 1624.2 |
| 10°    | 1637.8 | 1627.2 | 1597.0 | 1592.4 | 1583.5 |
| 12.5°  | 1615.2 | 1601.5 | 1560.6 | 1551.7 | 1535.0 |
| 15°    | 1587.9 | 1571.2 | 1519.9 | 1491.3 | 1476.2 |
| 17.5°  | 1556.2 | 1532.0 | 1468.4 | 1435.3 | 1411.1 |
| 20°    | 1519.9 | 1489.7 | 1414.1 | 1376.4 | 1343.1 |
| 22.5°  | 1480.7 | 1445.9 | 1358.2 | 1306.9 | 1284.3 |
| 25°    | 1441.4 | 1393.0 | 1293.2 | 1231.4 | 1208.6 |
| 27.5°  | 1394.6 | 1343.1 | 1232.8 | 1161.9 | 1127.0 |
| 30°    | 1344.7 | 1287.2 | 1166.3 | 1089.3 | 1048.5 |
| 32.5°  | 1296.4 | 1226.8 | 1103.0 | 1012.3 | 974.4  |
| 35°    | 1242.0 | 1164.9 | 1032.0 | 936.8  | 903.4  |
| 37.5°  | 1189.1 | 1105.9 | 965.4  | 861.1  | 823.4  |
| 40°    | 1133.2 | 1042.6 | 896.0  | 788.7  | 749.4  |
| 42.5°  | 1075.7 | 979.1  | 826.5  | 714.6  | 676.9  |
| 45°    | 1015.3 | 914.0  | 755.5  | 648.1  | 611.9  |
| 47.5°  | 958.0  | 850.7  | 687.5  | 580.2  | 546.9  |
| 50°    | 894.4  | 787.2  | 621.0  | 516.6  | 485.0  |
| 52.5°  | 832.4  | 719.1  | 557.5  | 457.8  | 429.1  |
| 55°    | 772.0  | 654.2  | 491.0  | 400.4  | 371.7  |
| 57.5°  | 710.1  | 589.3  | 432.1  | 347.5  | 323.4  |
| 60°    | 646.6  | 525.7  | 370.1  | 293.2  | 269.0  |
| 62.5°  | 584.8  | 463.9  | 317.2  | 244.8  | 232.8  |
| 65°    | 521.3  | 398.8  | 262.9  | 211.6  | 206.9  |
| 67.5°  | 460.9  | 338.4  | 211.6  | 185.8  | 181.3  |
| 70°    | 397.4  | 279.5  | 175.2  | 160.2  | 154.0  |
| 72.5°  | 337.0  | 225.1  | 146.5  | 134.5  | 131.5  |
| 75°    | 277.9  | 172.2  | 120.9  | 110.3  | 108.9  |
| 77.5°  | 219.1  | 122.3  | 95.2   | 89.2   | 86.0   |
| 80°    | 164.6  | 87.7   | 72.4   | 66.6   | 66.6   |
| 82.5°  | 114.8  | 59.0   | 49.9   | 46.8   | 46.8   |
| 85°    | 64.9   | 33.2   | 28.7   | 28.7   | 28.7   |
| 87.5°  | 24.2   | 12.0   | 12.0   | 10.6   | 10.6   |
| 90°    | 1.1    | 13.8   | 37.8   | 35.4   | 36.6   |
| 92.5°  | 23.8   | 32.3   | 33.5   | 34.6   | 34.6   |
| 95°    | 56.2   | 67.1   | 69.0   | 69.0   | 67.1   |
| 97.5°  | 93.6   | 103.6  | 107.9  | 107.9  | 107.9  |
| 100°   | 136.7  | 145.6  | 148.7  | 148.7  | 147.5  |
| 102.5° | 182.2  | 188.7  | 193.0  | 194.1  | 193.0  |
| 105°   | 231.9  | 234.9  | 237.2  | 239.1  | 239.1  |
| 107.5° | 281.1  | 285.8  | 285.8  | 286.5  | 281.1  |
| 110°   | 328.9  | 335.1  | 335.1  | 335.1  | 332.0  |

TEST NUMBER: P909848

CATALOG NUMBER: DFN2DIP-TR3F0-040D040US840-RLLFLL

**CANDELA DISTRIBUTION (continued):**

|        | 0°     | 22.5°  | 45°    | 67.5°  | 90°    |
|--------|--------|--------|--------|--------|--------|
| 112.5° | 380.5  | 387.1  | 385.9  | 382.8  | 380.5  |
| 115°   | 431.3  | 437.6  | 435.6  | 434.4  | 431.3  |
| 117.5° | 481.8  | 490.3  | 484.9  | 481.8  | 478.8  |
| 120°   | 532.7  | 541.1  | 532.7  | 532.7  | 529.2  |
| 122.5° | 578.9  | 589.7  | 584.3  | 581.2  | 578.9  |
| 125°   | 627.4  | 637.0  | 634.0  | 630.5  | 629.3  |
| 127.5° | 674.8  | 686.7  | 682.5  | 677.8  | 674.8  |
| 130°   | 719.0  | 733.0  | 731.0  | 728.7  | 724.5  |
| 132.5° | 768.7  | 779.5  | 780.3  | 774.9  | 771.8  |
| 135°   | 811.5  | 823.4  | 825.8  | 824.6  | 821.5  |
| 137.5° | 859.3  | 868.9  | 870.8  | 870.0  | 865.5  |
| 140°   | 901.2  | 910.9  | 916.3  | 916.3  | 912.0  |
| 142.5° | 944.4  | 954.0  | 957.0  | 958.3  | 954.0  |
| 145°   | 985.2  | 992.9  | 999.1  | 1000.3 | 996.0  |
| 147.5° | 1021.8 | 1031.4 | 1036.0 | 1037.9 | 1033.7 |
| 150°   | 1059.6 | 1066.1 | 1070.4 | 1073.8 | 1070.4 |
| 152.5° | 1093.1 | 1099.5 | 1105.0 | 1109.2 | 1105.0 |
| 155°   | 1126.5 | 1129.6 | 1133.1 | 1138.5 | 1135.0 |
| 157.5° | 1155.5 | 1157.7 | 1159.6 | 1167.4 | 1162.0 |
| 160°   | 1181.2 | 1183.6 | 1184.7 | 1191.2 | 1186.6 |
| 162.5° | 1205.1 | 1205.1 | 1206.3 | 1213.6 | 1208.2 |
| 165°   | 1225.6 | 1224.4 | 1224.4 | 1232.0 | 1226.7 |
| 167.5° | 1244.1 | 1240.5 | 1240.5 | 1248.3 | 1242.8 |
| 170°   | 1257.9 | 1254.8 | 1253.6 | 1261.3 | 1254.8 |
| 172.5° | 1267.5 | 1264.5 | 1263.2 | 1271.0 | 1264.5 |
| 175°   | 1275.3 | 1272.1 | 1269.8 | 1277.5 | 1271.0 |
| 177.5° | 1279.5 | 1276.4 | 1274.0 | 1280.6 | 1274.0 |
| 180°   | 1277.5 | 1277.5 | 1277.5 | 1277.5 | 1277.5 |



TEST NUMBER: P909848

CATALOG NUMBER: DFN2DIP-TR3F0-040D040US840-RLLFLL

**CIE UGR TABLE:**

| Reflectances:   |      |                  |       |       |       |       |                |      |       |       |       |
|-----------------|------|------------------|-------|-------|-------|-------|----------------|------|-------|-------|-------|
| Ceiling         |      | 0.7              | 0.7   | 0.5   | 0.5   | 0.3   | 0.7            | 0.7  | 0.5   | 0.5   | 0.3   |
| Wall            |      | 0.5              | 0.3   | 0.5   | 0.3   | 0.3   | 0.5            | 0.3  | 0.5   | 0.3   | 0.3   |
| Reference plane |      | 0.2              | 0.2   | 0.2   | 0.2   | 0.2   | 0.2            | 0.2  | 0.2   | 0.2   | 0.2   |
| Room dimensions |      | Viewed crosswise |       |       |       |       | Viewed endwise |      |       |       |       |
| X=2H            | Y=2H | 9.55             | 10.37 | 10.52 | 11.35 | 12.64 | 5.52           | 6.35 | 6.50  | 7.33  | 8.62  |
|                 | 3H   | 11.22            | 11.95 | 12.20 | 12.94 | 14.25 | 6.71           | 7.44 | 7.69  | 8.43  | 9.74  |
|                 | 4H   | 11.82            | 12.51 | 12.81 | 13.51 | 14.83 | 7.15           | 7.85 | 8.15  | 8.84  | 10.16 |
|                 | 6H   | 12.23            | 12.87 | 13.24 | 13.87 | 15.20 | 7.47           | 8.11 | 8.48  | 9.11  | 10.44 |
|                 | 8H   | 12.35            | 12.96 | 13.37 | 13.98 | 15.30 | 7.56           | 8.17 | 8.57  | 9.18  | 10.51 |
|                 | 12H  | 12.41            | 12.99 | 13.43 | 14.00 | 15.35 | 7.60           | 8.18 | 8.62  | 9.19  | 10.54 |
| 4H              | 2H   | 9.56             | 10.26 | 10.57 | 11.25 | 12.57 | 6.11           | 6.81 | 7.12  | 7.80  | 9.12  |
|                 | 3H   | 11.38            | 11.96 | 12.39 | 12.98 | 14.32 | 7.46           | 8.04 | 8.47  | 9.06  | 10.39 |
|                 | 4H   | 12.07            | 12.60 | 13.09 | 13.61 | 14.97 | 8.00           | 8.53 | 9.02  | 9.54  | 10.90 |
|                 | 6H   | 12.57            | 13.03 | 13.60 | 14.07 | 15.42 | 8.41           | 8.87 | 9.44  | 9.91  | 11.26 |
|                 | 8H   | 12.74            | 13.17 | 13.77 | 14.20 | 15.56 | 8.54           | 8.96 | 9.57  | 9.99  | 11.36 |
|                 | 12H  | 12.83            | 13.21 | 13.88 | 14.26 | 15.63 | 8.60           | 8.98 | 9.65  | 10.03 | 11.40 |
| 8H              | 4H   | 12.03            | 12.46 | 13.06 | 13.49 | 14.85 | 8.27           | 8.70 | 9.31  | 9.73  | 11.10 |
|                 | 6H   | 12.59            | 12.94 | 13.64 | 14.01 | 15.38 | 8.79           | 9.13 | 9.84  | 10.21 | 11.57 |
|                 | 8H   | 12.80            | 13.11 | 13.86 | 14.17 | 15.55 | 8.97           | 9.28 | 10.03 | 10.34 | 11.72 |
|                 | 12H  | 12.93            | 13.20 | 14.00 | 14.25 | 15.68 | 9.09           | 9.36 | 10.15 | 10.41 | 11.83 |
| 12H             | 4H   | 11.98            | 12.37 | 13.03 | 13.41 | 14.78 | 8.28           | 8.66 | 9.33  | 9.71  | 11.08 |
|                 | 6H   | 12.56            | 12.87 | 13.63 | 13.93 | 15.31 | 8.83           | 9.14 | 9.89  | 10.20 | 11.58 |
|                 | 8H   | 12.78            | 13.05 | 13.84 | 14.10 | 15.53 | 9.04           | 9.31 | 10.10 | 10.36 | 11.79 |