

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909849

Luminaire Tested: DFN2DIP-TR3F0-040D040US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909849
REPORT IS A COMBINATION OF REPORTS P901808 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-040D040US840-RLLONL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7432.6 lumens
Efficiency: N/A
Efficacy: 115.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 64.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909849

CATALOG NUMBER: DFN2DIP-TR3F0-040D040US840-RLLONL

Luminous Intensity Polar Plot

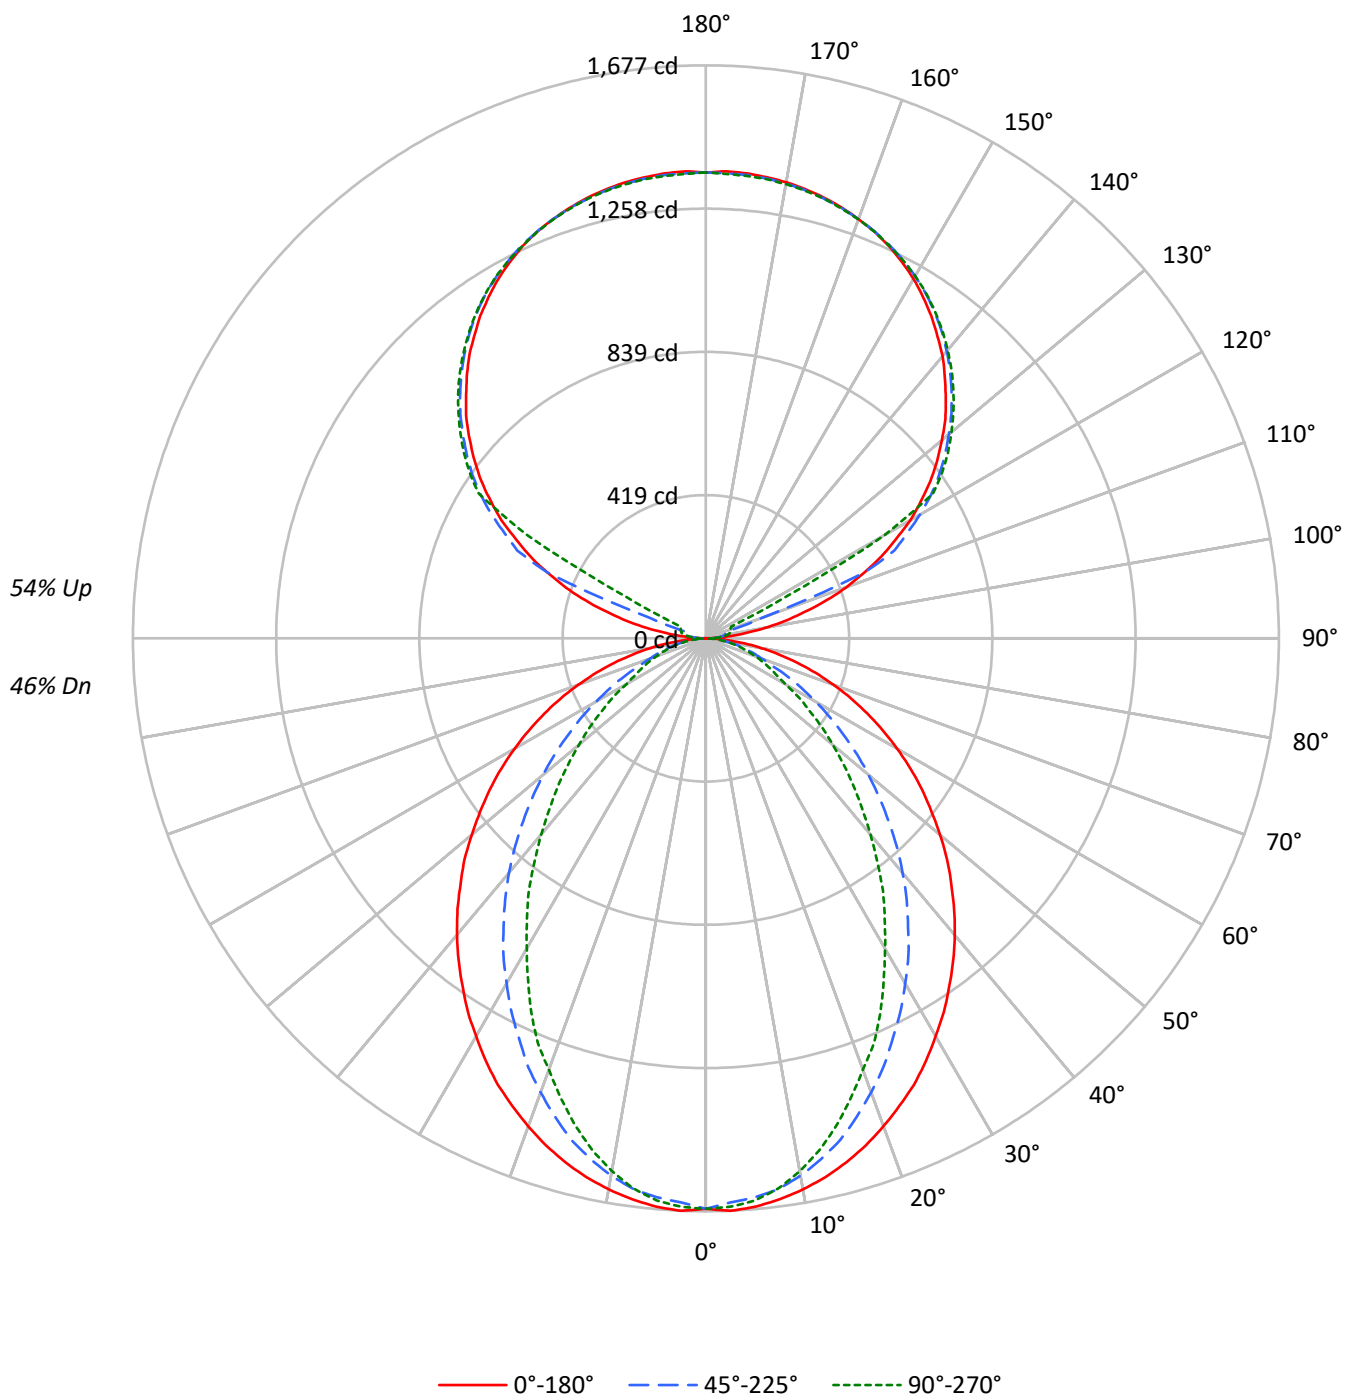

TEST NUMBER: P909849

CATALOG NUMBER: DFN2DIP-TR3F0-040D040US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53			46
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45			40
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39			34
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34			29
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29			26
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26			23
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23			20
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21			18
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19			16
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17			15
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15			13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2080	2080	2080
5°	2083	2046	2059
10°	2061	2004	1991
15°	2031	1936	1886
20°	1993	1843	1758
25°	1953	1739	1634
30°	1900	1633	1477
35°	1848	1519	1340
40°	1796	1401	1183
45°	1734	1270	1040
50°	1671	1138	901
55°	1605	998	767
60°	1528	851	630
65°	1439	702	566
70°	1332	564	510
75°	1197	493	461
80°	1001	408	396
85°	681	264	289

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1734 cd/sqm

TEST NUMBER: P909849

CATALOG NUMBER: DFN2DIP-TR3F0-040D040US840-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	156.5	2.1
10°-20°	429.5	5.8
20°-30°	603.0	8.1
30°-40°	657.4	8.8
40°-50°	604.2	8.1
50°-60°	474.5	6.4
60°-70°	308.9	4.2
70°-80°	159.0	2.1
80°-90°	43.0	0.6
90°-100°	44.9	0.6
100°-110°	167.6	2.3
110°-120°	444.4	6.0
120°-130°	737.1	9.9
130°-140°	783.0	10.5
140°-150°	727.7	9.8
150°-160°	585.1	7.9
160°-170°	377.0	5.1
170°-180°	129.8	1.7
0°-30°	1189.0	16.0
0°-40°	1846.4	24.8
0°-60°	2925.1	39.4
0°-90°	3435.9	46.2
90°-120°	656.9	8.8
90°-150°	2904.8	39.1
90°-180°	3997.0	53.8
0°-180°	7432.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1670	1670	1670	1670	1670	
5°	1670	1662	1642	1656	1651	158
15°	1588	1571	1520	1491	1476	447
25°	1441	1393	1293	1231	1209	663
35°	1242	1165	1032	937	903	777
45°	1015	914	756	648	612	784
55°	772	654	491	400	372	690
65°	521	399	263	212	207	517
75°	278	172	121	110	109	294
85°	65	33	29	29	29	75
90°	1	12	20	25	27	7
95°	64	32	38	43	42	76
105°	300	330	60	71	75	320
115°	567	584	609	152	81	558
125°	802	815	834	840	843	715
135°	992	1008	1017	1027	1025	767
145°	1151	1150	1167	1174	1169	720
155°	1268	1259	1271	1276	1269	584
165°	1336	1330	1333	1340	1333	377
175°	1366	1359	1361	1368	1358	130
180°	1363	1363	1363	1363	1363	

TEST NUMBER: P909849

CATALOG NUMBER: DFN2DIP-TR3F0-040D040US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1669.5	1669.5	1669.5	1669.5	1669.5
2.5°	1677.1	1669.5	1652.8	1668.1	1665.0
5°	1669.5	1661.9	1642.2	1655.9	1651.4
7.5°	1655.9	1646.9	1625.8	1631.6	1624.2
10°	1637.8	1627.2	1597.0	1592.4	1583.5
12.5°	1615.2	1601.5	1560.6	1551.7	1535.0
15°	1587.9	1571.2	1519.9	1491.3	1476.2
17.5°	1556.2	1532.0	1468.4	1435.3	1411.1
20°	1519.9	1489.7	1414.1	1376.4	1343.1
22.5°	1480.7	1445.9	1358.2	1306.9	1284.3
25°	1441.4	1393.0	1293.2	1231.4	1208.6
27.5°	1394.6	1343.1	1232.8	1161.9	1127.0
30°	1344.7	1287.2	1166.3	1089.3	1048.5
32.5°	1296.4	1226.8	1103.0	1012.3	974.4
35°	1242.0	1164.9	1032.0	936.8	903.4
37.5°	1189.1	1105.9	965.4	861.1	823.4
40°	1133.2	1042.6	896.0	788.7	749.4
42.5°	1075.7	979.1	826.5	714.6	676.9
45°	1015.3	914.0	755.5	648.1	611.9
47.5°	958.0	850.7	687.5	580.2	546.9
50°	894.4	787.2	621.0	516.6	485.0
52.5°	832.4	719.1	557.5	457.8	429.1
55°	772.0	654.2	491.0	400.4	371.7
57.5°	710.1	589.3	432.1	347.5	323.4
60°	646.6	525.7	370.1	293.2	269.0
62.5°	584.8	463.9	317.2	244.8	232.8
65°	521.3	398.8	262.9	211.6	206.9
67.5°	460.9	338.4	211.6	185.8	181.3
70°	397.4	279.5	175.2	160.2	154.0
72.5°	337.0	225.1	146.5	134.5	131.5
75°	277.9	172.2	120.9	110.3	108.9
77.5°	219.1	122.3	95.2	89.2	86.0
80°	164.6	87.7	72.4	66.6	66.6
82.5°	114.8	59.0	49.9	46.8	46.8
85°	64.9	33.2	28.7	28.7	28.7
87.5°	24.2	12.0	12.0	10.6	10.6
90°	0.9	11.8	19.7	24.7	26.6
92.5°	24.7	20.7	23.6	25.7	26.6
95°	64.0	31.5	38.4	43.4	42.4
97.5°	115.4	34.5	50.3	53.3	54.2
100°	174.6	39.5	56.2	64.0	66.0
102.5°	239.6	237.8	58.2	69.0	72.0
105°	299.8	329.5	60.2	71.0	74.9
107.5°	369.9	394.6	62.2	73.0	77.0
110°	437.1	457.7	172.7	74.0	77.9

TEST NUMBER: P909849

CATALOG NUMBER: DFN2DIP-TR3F0-040D040US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	500.2	517.9	501.1	75.9	79.0
115°	567.1	583.9	608.6	151.9	81.0
117.5°	625.4	645.1	662.0	520.8	262.4
120°	690.5	705.3	723.1	735.0	601.8
122.5°	745.7	761.5	781.3	787.2	788.2
125°	801.9	814.9	833.5	840.5	843.4
127.5°	853.2	867.1	881.9	891.8	892.7
130°	901.6	917.5	928.2	939.1	938.2
132.5°	950.9	963.8	974.6	983.5	982.6
135°	992.4	1008.2	1017.0	1026.9	1025.0
137.5°	1035.7	1047.5	1057.5	1067.3	1064.4
140°	1078.1	1086.1	1096.9	1105.8	1100.9
142.5°	1113.8	1120.6	1133.5	1141.2	1136.4
145°	1151.2	1150.2	1166.9	1173.9	1168.9
147.5°	1183.7	1180.7	1197.5	1202.4	1198.6
150°	1215.3	1208.4	1224.3	1230.1	1225.2
152.5°	1241.9	1234.1	1248.8	1254.8	1247.9
155°	1267.6	1258.8	1270.6	1276.5	1268.6
157.5°	1288.3	1280.4	1289.4	1296.3	1288.3
160°	1306.1	1300.1	1306.1	1311.9	1305.0
162.5°	1321.8	1316.0	1320.9	1327.8	1318.9
165°	1335.6	1329.8	1332.7	1339.6	1332.7
167.5°	1346.6	1340.5	1343.6	1350.5	1341.6
170°	1355.4	1349.5	1351.4	1358.4	1349.5
172.5°	1361.3	1355.4	1357.5	1364.3	1355.4
175°	1366.1	1359.3	1361.3	1368.2	1358.4
177.5°	1368.2	1361.3	1362.3	1369.3	1360.4
180°	1363.3	1363.3	1363.3	1363.3	1363.3

TEST NUMBER: P909849

CATALOG NUMBER: DFN2DIP-TR3F0-040D040US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.28	10.08	10.27	11.08	12.41	5.25	6.05	6.25	7.06	8.38
	3H	10.94	11.66	11.95	12.67	14.02	6.44	7.15	7.44	8.16	9.51
	4H	11.54	12.22	12.56	13.24	14.59	6.88	7.56	7.90	8.57	9.93
	6H	11.96	12.58	12.99	13.60	14.97	7.20	7.82	8.22	8.84	10.20
	8H	12.08	12.67	13.11	13.71	15.07	7.28	7.87	8.32	8.91	10.27
	12H	12.13	12.70	13.17	13.73	15.11	7.32	7.89	8.36	8.91	10.30
4H	2H	9.29	9.97	10.32	10.98	12.34	5.84	6.52	6.87	7.53	8.89
	3H	11.11	11.67	12.14	12.71	14.08	7.18	7.74	8.21	8.79	10.16
	4H	11.79	12.31	12.83	13.34	14.73	7.72	8.24	8.76	9.27	10.67
	6H	12.29	12.74	13.35	13.80	15.18	8.14	8.58	9.19	9.64	11.02
	8H	12.46	12.88	13.52	13.93	15.33	8.26	8.67	9.31	9.72	11.13
	12H	12.55	12.92	13.62	13.99	15.40	8.32	8.69	9.39	9.76	11.17
8H	4H	11.75	12.17	12.81	13.22	14.62	8.00	8.41	9.05	9.46	10.86
	6H	12.31	12.65	13.38	13.74	15.14	8.51	8.85	9.58	9.94	11.34
	8H	12.52	12.82	13.60	13.90	15.31	8.69	8.99	9.77	10.07	11.49
	12H	12.65	12.91	13.73	13.99	15.45	8.81	9.07	9.89	10.14	11.60
12H	4H	11.70	12.08	12.77	13.14	14.55	8.00	8.37	9.07	9.44	10.84
	6H	12.28	12.58	13.37	13.66	15.08	8.55	8.85	9.63	9.93	11.35
	8H	12.50	12.76	13.58	13.83	15.29	8.76	9.02	9.84	10.09	11.55

END OF REPORT