

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909851

Luminaire Tested: DFN2DIP-TR3F0-040D050US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909851
REPORT IS A COMBINATION OF REPORTS P901821 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-040D050US840-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8997.9 lumens
Efficiency: N/A
Efficacy: 124.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 72.1
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909851

CATALOG NUMBER: DFN2DIP-TR3F0-040D050US840-FLLONL

Luminous Intensity Polar Plot

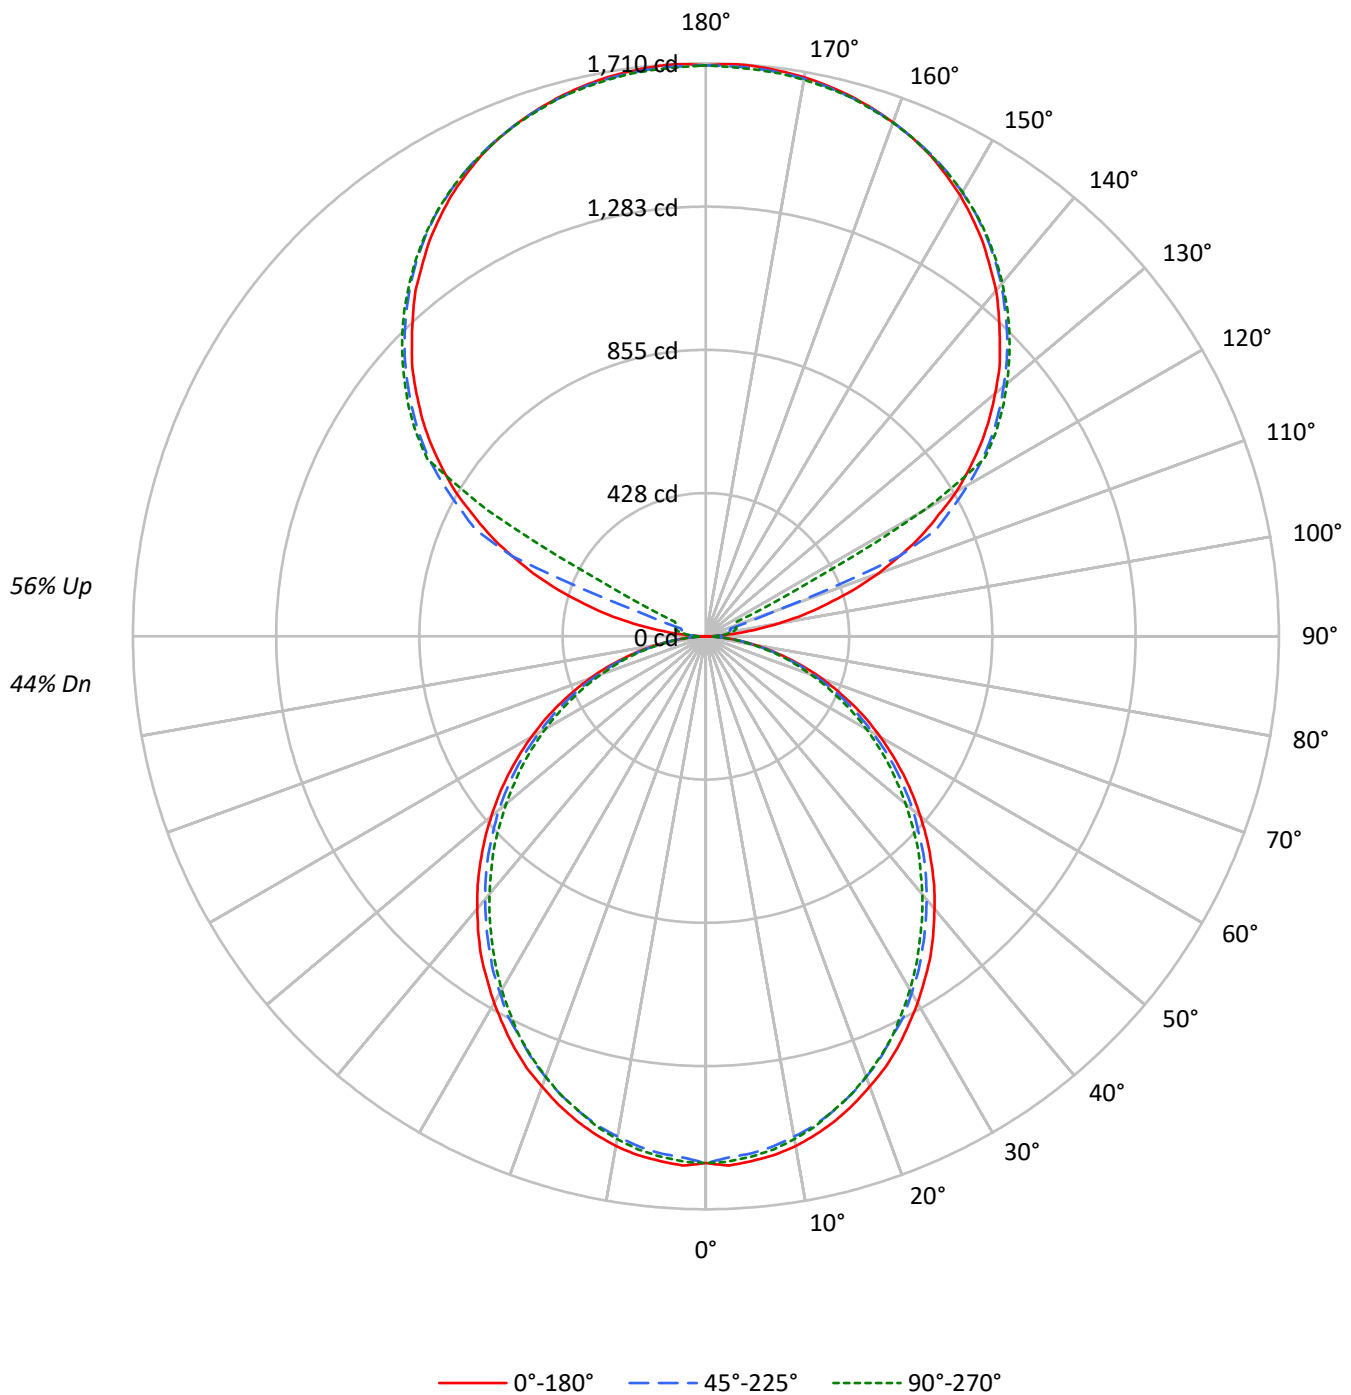

TEST NUMBER: P909851

CATALOG NUMBER: DFN2DIP-TR3F0-040D050US840-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	97	92	88	85	88	85	81	78	70	68	66	57	56	54	45	44	43
2	88	81	74	69	80	74	69	64	62	58	55	50	48	45	40	38	36
3	80	71	64	58	73	65	59	54	54	50	46	44	41	38	35	33	31
4	73	63	55	49	67	58	51	46	48	43	39	40	36	33	31	29	27
5	67	56	48	42	61	51	44	39	43	38	34	35	31	28	28	25	23
6	62	50	42	36	57	46	39	34	39	33	29	32	28	25	26	23	20
7	57	45	37	32	52	42	35	30	35	30	26	29	25	22	23	20	18
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	16
9	49	37	30	25	45	35	28	23	29	24	20	25	20	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	18	23	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1959	1959	1959
5°	1961	1930	1943
10°	1944	1902	1915
15°	1914	1869	1873
20°	1874	1824	1830
25°	1835	1770	1780
30°	1785	1720	1717
35°	1739	1661	1650
40°	1681	1602	1586
45°	1624	1542	1521
50°	1561	1480	1446
55°	1496	1407	1376
60°	1421	1321	1297
65°	1340	1232	1203
70°	1236	1123	1101
75°	1093	993	1005
80°	920	825	827
85°	650	544	533

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1624 cd/sqm

TEST NUMBER: P909851

CATALOG NUMBER: DFN2DIP-TR3F0-040D050US840-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	147.9	1.6
10°-20°	416.2	4.6
20°-30°	611.7	6.8
30°-40°	710.5	7.9
40°-50°	709.6	7.9
50°-60°	618.7	6.9
60°-70°	457.4	5.1
70°-80°	258.8	2.9
80°-90°	71.3	0.8
90°-100°	56.2	0.6
100°-110°	209.5	2.3
110°-120°	555.6	6.2
120°-130°	921.4	10.2
130°-140°	978.8	10.9
140°-150°	909.7	10.1
150°-160°	731.3	8.1
160°-170°	471.2	5.2
170°-180°	162.2	1.8
0°-30°	1175.9	13.1
0°-40°	1886.3	21.0
0°-60°	3214.6	35.7
0°-90°	4002.0	44.5
90°-120°	821.2	9.1
90°-150°	3631.1	40.4
90°-180°	4996.0	55.5
0°-180°	8997.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1572	1572	1572	1572	1572	
5°	1572	1566	1549	1561	1558	149
15°	1496	1487	1468	1474	1466	421
25°	1354	1342	1316	1319	1316	623
35°	1168	1153	1129	1120	1112	730
45°	951	940	917	901	895	734
55°	720	710	692	674	667	643
65°	485	476	461	447	440	480
75°	254	251	243	234	237	271
85°	62	60	59	54	53	69
90°	1	15	25	31	33	8
95°	80	39	48	54	53	95
105°	375	412	75	89	94	401
115°	709	730	761	190	101	698
125°	1002	1019	1042	1051	1054	894
135°	1240	1260	1271	1284	1281	958
145°	1439	1438	1459	1467	1461	900
155°	1584	1574	1588	1596	1586	730
165°	1670	1662	1666	1674	1666	472
175°	1708	1699	1702	1710	1698	163
180°	1704	1704	1704	1704	1704	

TEST NUMBER: P909851

CATALOG NUMBER: DFN2DIP-TR3F0-040D050US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1571.8	1571.8	1571.8	1571.8	1571.8
2.5°	1580.9	1573.4	1556.7	1571.8	1568.9
5°	1571.8	1565.8	1549.1	1561.2	1558.3
7.5°	1561.2	1552.2	1535.5	1547.7	1544.7
10°	1544.7	1534.1	1516.0	1528.0	1523.5
12.5°	1521.9	1512.9	1494.8	1502.4	1499.2
15°	1496.2	1487.2	1467.5	1473.6	1466.1
17.5°	1464.5	1455.5	1435.8	1443.3	1435.8
20°	1429.7	1420.7	1399.6	1404.0	1398.2
22.5°	1395.0	1381.4	1361.7	1361.7	1358.7
25°	1354.1	1342.1	1316.5	1319.4	1316.5
27.5°	1308.8	1298.2	1278.7	1274.1	1266.7
30°	1263.5	1251.4	1228.8	1224.3	1218.2
32.5°	1215.2	1206.2	1181.9	1172.9	1166.7
35°	1168.3	1153.3	1129.0	1119.9	1112.4
37.5°	1115.4	1101.8	1077.5	1067.0	1059.4
40°	1061.1	1048.8	1024.6	1011.2	1005.1
42.5°	1008.1	995.9	971.9	956.6	947.7
45°	950.7	940.2	917.4	900.9	894.7
47.5°	894.7	884.1	860.0	843.3	834.4
50°	835.8	828.2	807.1	785.9	778.3
52.5°	778.3	767.8	748.2	731.5	720.9
55°	719.5	710.3	692.3	674.1	666.6
57.5°	660.5	653.0	633.2	615.1	609.0
60°	601.5	595.5	574.4	557.7	553.2
62.5°	544.1	533.5	518.5	503.3	497.3
65°	485.2	476.1	461.0	447.4	439.9
67.5°	424.7	417.1	403.6	393.0	387.0
70°	368.8	362.7	349.1	338.5	332.5
72.5°	311.4	305.3	297.8	287.2	282.7
75°	253.9	251.0	243.3	234.3	237.3
77.5°	202.5	196.4	193.4	188.8	184.4
80°	151.2	149.6	146.5	142.1	139.1
82.5°	102.8	102.8	101.4	95.2	95.2
85°	61.9	60.5	59.0	54.3	52.9
87.5°	27.3	24.2	21.2	16.7	15.0
90°	1.2	14.7	24.6	30.9	33.2
92.5°	30.9	26.0	29.6	32.1	33.2
95°	80.1	39.4	48.1	54.3	53.0
97.5°	144.2	43.2	62.8	66.7	67.8
100°	218.3	49.4	70.3	80.1	82.6
102.5°	299.6	297.2	72.8	86.2	90.1
105°	374.9	411.9	75.2	88.8	93.7
107.5°	462.4	493.1	77.8	91.2	96.2
110°	546.3	572.1	215.8	92.5	97.4

TEST NUMBER: P909851

CATALOG NUMBER: DFN2DIP-TR3F0-040D050US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	625.2	647.3	626.4	94.9	98.7
115°	709.0	729.9	760.8	190.0	101.2
117.5°	781.7	806.4	827.5	651.0	328.0
120°	863.1	881.6	903.8	918.7	752.1
122.5°	932.1	951.9	976.6	984.0	985.3
125°	1002.4	1018.6	1042.0	1050.6	1054.3
127.5°	1066.5	1083.8	1102.5	1114.7	1115.9
130°	1127.0	1146.8	1160.2	1173.9	1172.8
132.5°	1188.7	1204.8	1218.2	1229.4	1228.2
135°	1240.5	1260.3	1271.2	1283.7	1281.2
137.5°	1294.6	1309.5	1321.9	1334.2	1330.6
140°	1347.7	1357.7	1371.1	1382.2	1376.1
142.5°	1392.2	1400.9	1416.8	1426.6	1420.5
145°	1439.1	1437.7	1458.6	1467.3	1461.2
147.5°	1479.7	1475.9	1496.9	1503.1	1498.2
150°	1519.1	1510.6	1530.2	1537.6	1531.5
152.5°	1552.4	1542.6	1561.1	1568.5	1559.8
155°	1584.5	1573.5	1588.2	1595.6	1585.8
157.5°	1610.3	1600.5	1611.6	1620.3	1610.3
160°	1632.6	1625.2	1632.6	1639.9	1631.3
162.5°	1652.2	1645.0	1651.0	1659.7	1648.6
165°	1669.5	1662.2	1665.9	1674.5	1665.9
167.5°	1683.1	1675.7	1679.5	1688.1	1677.0
170°	1694.3	1686.8	1689.3	1697.9	1686.8
172.5°	1701.6	1694.3	1696.8	1705.4	1694.3
175°	1707.8	1699.1	1701.6	1710.2	1697.9
177.5°	1710.2	1701.6	1702.9	1711.5	1700.4
180°	1704.0	1704.0	1704.0	1704.0	1704.0

TEST NUMBER: P909851

CATALOG NUMBER: DFN2DIP-TR3F0-040D050US840-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.02	9.84	10.03	10.85	12.20	8.59	9.41	9.60	10.42	11.77
	3H	10.67	11.40	11.68	12.42	13.79	10.20	10.93	11.22	11.95	13.32
	4H	11.25	11.94	12.28	12.97	14.34	10.78	11.47	11.81	12.50	13.87
	6H	11.64	12.28	12.68	13.31	14.69	11.17	11.81	12.21	12.84	14.23
	8H	11.74	12.35	12.78	13.39	14.78	11.27	11.88	12.31	12.92	14.31
	12H	11.78	12.36	12.83	13.40	14.81	11.31	11.88	12.36	12.92	14.33
4H	2H	9.48	10.17	10.51	11.19	12.57	9.13	9.82	10.17	10.85	12.23
	3H	11.33	11.90	12.37	12.96	14.35	10.94	11.51	11.98	12.57	13.96
	4H	12.03	12.56	13.08	13.60	15.02	11.63	12.16	12.68	13.20	14.62
	6H	12.53	12.99	13.59	14.06	15.46	12.13	12.58	13.19	13.65	15.06
	8H	12.68	13.10	13.74	14.16	15.59	12.27	12.70	13.33	13.76	15.18
	12H	12.74	13.13	13.82	14.20	15.63	12.33	12.71	13.41	13.79	15.22
8H	4H	12.22	12.64	13.28	13.71	15.13	11.86	12.29	12.92	13.35	14.77
	6H	12.84	13.19	13.92	14.29	15.71	12.48	12.83	13.56	13.93	15.35
	8H	13.05	13.36	14.14	14.45	15.89	12.69	13.00	13.78	14.08	15.52
	12H	13.18	13.45	14.27	14.53	16.01	12.80	13.07	13.89	14.15	15.63
12H	4H	12.20	12.59	13.28	13.66	15.09	11.85	12.24	12.93	13.31	14.74
	6H	12.87	13.17	13.95	14.26	15.70	12.52	12.83	13.61	13.91	15.35
	8H	13.10	13.37	14.19	14.45	15.93	12.75	13.02	13.84	14.10	15.58

END OF REPORT