

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909859

Luminaire Tested: DFN2DIP-TR3F0-040D070US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909859
REPORT IS A COMBINATION OF REPORTS P901849 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-040D070US840-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10997.4 lumens
Efficiency: N/A
Efficacy: 124.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 88.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909859

CATALOG NUMBER: DFN2DIP-TR3F0-040D070US840-FLLONL

Luminous Intensity Polar Plot

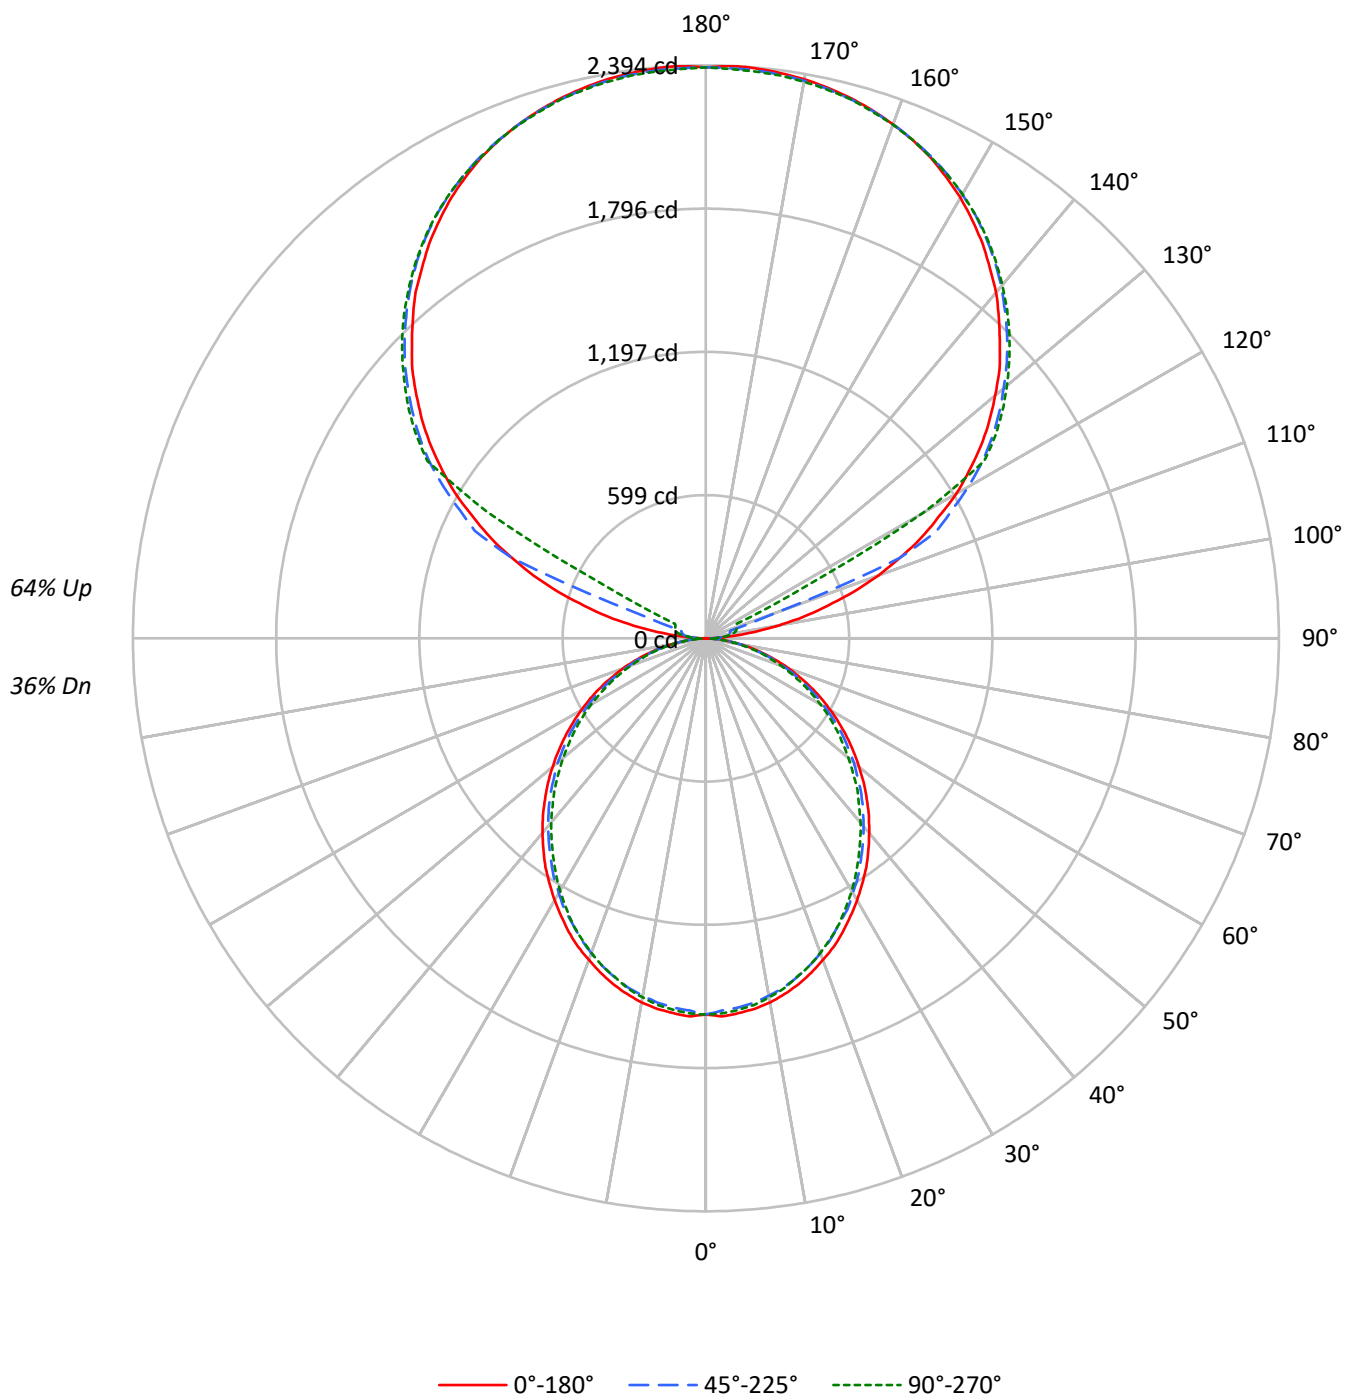

TEST NUMBER: P909859

CATALOG NUMBER: DFN2DIP-TR3F0-040D070US840-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	44	44	44
1	95	90	87	83	86	82	79	76	66	64	62	52	50	49	39	38	37
2	86	79	73	68	78	72	67	62	58	54	51	46	43	41	34	32	31
3	79	69	62	57	71	63	57	52	51	47	43	40	37	35	30	28	26
4	72	61	54	48	65	56	49	44	45	41	37	36	32	30	27	25	23
5	66	55	47	41	59	50	43	38	41	35	32	32	28	26	24	22	20
6	61	49	41	35	55	45	38	33	37	31	27	29	25	22	22	19	17
7	56	44	36	31	51	40	33	29	33	28	24	26	23	20	20	17	15
8	52	40	32	27	47	37	30	25	30	25	21	24	20	18	18	16	14
9	48	36	29	24	44	33	27	22	28	23	19	22	18	16	17	14	12
10	45	33	26	21	41	31	24	20	25	20	17	20	17	14	16	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1959	1959	1959
5°	1961	1930	1943
10°	1944	1902	1915
15°	1914	1869	1873
20°	1874	1824	1830
25°	1835	1770	1780
30°	1785	1720	1717
35°	1739	1661	1650
40°	1681	1602	1586
45°	1624	1542	1521
50°	1561	1480	1446
55°	1496	1407	1376
60°	1421	1321	1297
65°	1340	1232	1203
70°	1236	1123	1101
75°	1093	993	1005
80°	920	825	827
85°	650	544	533

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1624 cd/sqm

TEST NUMBER: P909859

CATALOG NUMBER: DFN2DIP-TR3F0-040D070US840-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	147.9	1.3
10°-20°	416.2	3.8
20°-30°	611.7	5.6
30°-40°	710.5	6.5
40°-50°	709.6	6.5
50°-60°	618.7	5.6
60°-70°	457.4	4.2
70°-80°	258.8	2.4
80°-90°	72.5	0.7
90°-100°	78.7	0.7
100°-110°	293.3	2.7
110°-120°	777.8	7.1
120°-130°	1290.0	11.7
130°-140°	1370.3	12.5
140°-150°	1273.5	11.6
150°-160°	1023.9	9.3
160°-170°	659.7	6.0
170°-180°	227.1	2.1
0°-30°	1175.9	10.7
0°-40°	1886.3	17.2
0°-60°	3214.6	29.2
0°-90°	4003.2	36.4
90°-120°	1149.7	10.5
90°-150°	5083.5	46.2
90°-180°	6994.0	63.6
0°-180°	10997.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1572	1572	1572	1572	1572	
5°	1572	1566	1549	1561	1558	149
15°	1496	1487	1468	1474	1466	421
25°	1354	1342	1316	1319	1316	623
35°	1168	1153	1129	1120	1112	730
45°	951	940	917	901	895	734
55°	720	710	692	674	667	643
65°	485	476	461	447	440	480
75°	254	251	243	234	237	271
85°	62	60	59	54	53	69
90°	2	21	34	43	47	10
95°	112	55	67	76	74	133
105°	525	577	105	124	131	561
115°	993	1022	1065	266	142	977
125°	1403	1426	1459	1471	1476	1252
135°	1737	1764	1780	1797	1794	1342
145°	2015	2013	2042	2054	2046	1260
155°	2218	2203	2224	2234	2220	1022
165°	2337	2327	2332	2344	2332	660
175°	2391	2379	2382	2394	2377	228
180°	2386	2386	2386	2386	2386	

TEST NUMBER: P909859

CATALOG NUMBER: DFN2DIP-TR3F0-040D070US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1571.8	1571.8	1571.8	1571.8	1571.8
2.5°	1580.9	1573.4	1556.7	1571.8	1568.9
5°	1571.8	1565.8	1549.1	1561.2	1558.3
7.5°	1561.2	1552.2	1535.5	1547.7	1544.7
10°	1544.7	1534.1	1516.0	1528.0	1523.5
12.5°	1521.9	1512.9	1494.8	1502.4	1499.2
15°	1496.2	1487.2	1467.5	1473.6	1466.1
17.5°	1464.5	1455.5	1435.8	1443.3	1435.8
20°	1429.7	1420.7	1399.6	1404.0	1398.2
22.5°	1395.0	1381.4	1361.7	1361.7	1358.7
25°	1354.1	1342.1	1316.5	1319.4	1316.5
27.5°	1308.8	1298.2	1278.7	1274.1	1266.7
30°	1263.5	1251.4	1228.8	1224.3	1218.2
32.5°	1215.2	1206.2	1181.9	1172.9	1166.7
35°	1168.3	1153.3	1129.0	1119.9	1112.4
37.5°	1115.4	1101.8	1077.5	1067.0	1059.4
40°	1061.1	1048.8	1024.6	1011.2	1005.1
42.5°	1008.1	995.9	971.9	956.6	947.7
45°	950.7	940.2	917.4	900.9	894.7
47.5°	894.7	884.1	860.0	843.3	834.4
50°	835.8	828.2	807.1	785.9	778.3
52.5°	778.3	767.8	748.2	731.5	720.9
55°	719.5	710.3	692.3	674.1	666.6
57.5°	660.5	653.0	633.2	615.1	609.0
60°	601.5	595.5	574.4	557.7	553.2
62.5°	544.1	533.5	518.5	503.3	497.3
65°	485.2	476.1	461.0	447.4	439.9
67.5°	424.7	417.1	403.6	393.0	387.0
70°	368.8	362.7	349.1	338.5	332.5
72.5°	311.4	305.3	297.8	287.2	282.7
75°	253.9	251.0	243.3	234.3	237.3
77.5°	202.5	196.4	193.4	188.8	184.4
80°	151.2	149.6	146.5	142.1	139.1
82.5°	102.8	102.8	101.4	95.2	95.2
85°	61.9	60.5	59.0	54.3	52.9
87.5°	27.3	24.2	21.2	16.7	15.0
90°	1.6	20.7	34.4	43.2	46.6
92.5°	43.2	36.3	41.4	44.9	46.6
95°	112.1	55.1	67.3	76.0	74.2
97.5°	201.9	60.5	88.0	93.3	94.9
100°	305.7	69.1	98.4	112.1	115.6
102.5°	419.4	416.2	101.9	120.8	126.0
105°	524.8	576.6	105.3	124.2	131.2
107.5°	647.3	690.4	108.9	127.7	134.7
110°	764.9	800.9	302.2	129.6	136.3

TEST NUMBER: P909859

CATALOG NUMBER: DFN2DIP-TR3F0-040D070US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	875.4	906.3	877.0	132.8	138.1
115°	992.6	1021.9	1065.1	265.9	141.7
117.5°	1094.5	1128.9	1158.4	911.4	459.2
120°	1208.4	1234.3	1265.5	1286.2	1053.1
122.5°	1304.9	1332.6	1367.4	1377.6	1379.4
125°	1403.4	1425.9	1458.8	1470.9	1475.9
127.5°	1493.2	1517.3	1543.4	1560.6	1562.3
130°	1577.8	1605.5	1624.4	1643.5	1641.8
132.5°	1664.2	1686.7	1705.6	1721.1	1719.5
135°	1736.7	1764.3	1779.8	1797.2	1793.7
137.5°	1812.5	1833.3	1850.7	1867.9	1862.8
140°	1886.7	1900.7	1919.6	1935.1	1926.5
142.5°	1949.0	1961.2	1983.5	1997.2	1988.6
145°	2014.7	2012.9	2042.2	2054.3	2045.7
147.5°	2071.4	2066.4	2095.7	2104.3	2097.5
150°	2126.8	2114.8	2142.4	2152.6	2144.0
152.5°	2173.3	2159.6	2185.5	2195.9	2183.8
155°	2218.3	2202.8	2223.5	2233.8	2220.1
157.5°	2254.5	2240.8	2256.3	2268.5	2254.5
160°	2285.7	2275.2	2285.7	2295.9	2283.8
162.5°	2313.2	2302.9	2311.5	2323.6	2308.0
165°	2337.3	2327.1	2332.2	2344.3	2332.2
167.5°	2356.4	2345.9	2351.3	2363.4	2347.8
170°	2372.0	2361.6	2365.0	2377.1	2361.6
172.5°	2382.3	2372.0	2375.5	2387.5	2372.0
175°	2390.9	2378.7	2382.3	2394.3	2377.1
177.5°	2394.3	2382.3	2384.1	2396.2	2380.6
180°	2385.7	2385.7	2385.7	2385.7	2385.7

TEST NUMBER: P909859

CATALOG NUMBER: DFN2DIP-TR3F0-040D070US840-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.15	8.90	9.22	9.97	11.42	7.72	8.47	8.79	9.54	10.99
	3H	9.79	10.46	10.87	11.54	13.01	9.32	10.00	10.40	11.07	12.54
	4H	10.37	11.01	11.45	12.08	13.56	9.90	10.54	10.99	11.62	13.09
	6H	10.75	11.34	11.85	12.42	13.91	10.29	10.87	11.38	11.95	13.44
	8H	10.85	11.41	11.95	12.51	13.99	10.38	10.94	11.48	12.04	13.52
	12H	10.89	11.42	12.00	12.52	14.02	10.42	10.95	11.52	12.04	13.55
4H	2H	8.59	9.23	9.69	10.31	11.79	8.25	8.89	9.34	9.97	11.45
	3H	10.44	10.97	11.54	12.08	13.57	10.05	10.58	11.15	11.69	13.18
	4H	11.14	11.63	12.25	12.73	14.24	10.74	11.23	11.84	12.32	13.84
	6H	11.64	12.06	12.75	13.18	14.68	11.24	11.66	12.35	12.78	14.28
	8H	11.78	12.18	12.90	13.29	14.81	11.38	11.77	12.49	12.88	14.40
	12H	11.85	12.20	12.98	13.32	14.85	11.43	11.79	12.56	12.91	14.43
8H	4H	11.33	11.72	12.44	12.83	14.35	10.97	11.36	12.08	12.47	13.99
	6H	11.94	12.26	13.07	13.42	14.93	11.58	11.91	12.72	13.06	14.57
	8H	12.15	12.44	13.29	13.57	15.11	11.79	12.07	12.93	13.21	14.74
	12H	12.27	12.52	13.42	13.65	15.23	11.90	12.14	13.04	13.27	14.85
12H	4H	11.30	11.66	12.43	12.78	14.31	10.96	11.31	12.08	12.43	13.96
	6H	11.97	12.25	13.11	13.38	14.92	11.62	11.90	12.76	13.04	14.57
	8H	12.20	12.45	13.34	13.58	15.15	11.84	12.09	12.99	13.22	14.80