

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909879

Luminaire Tested: DFN2DIP-TR3F0-050D050US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909879
REPORT IS A COMBINATION OF REPORTS P901824 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-050D050US840-RLLONL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9290.8 lumens
Efficiency: N/A
Efficacy: 112.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 82.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909879

CATALOG NUMBER: DFN2DIP-TR3F0-050D050US840-RLLONL

Luminous Intensity Polar Plot

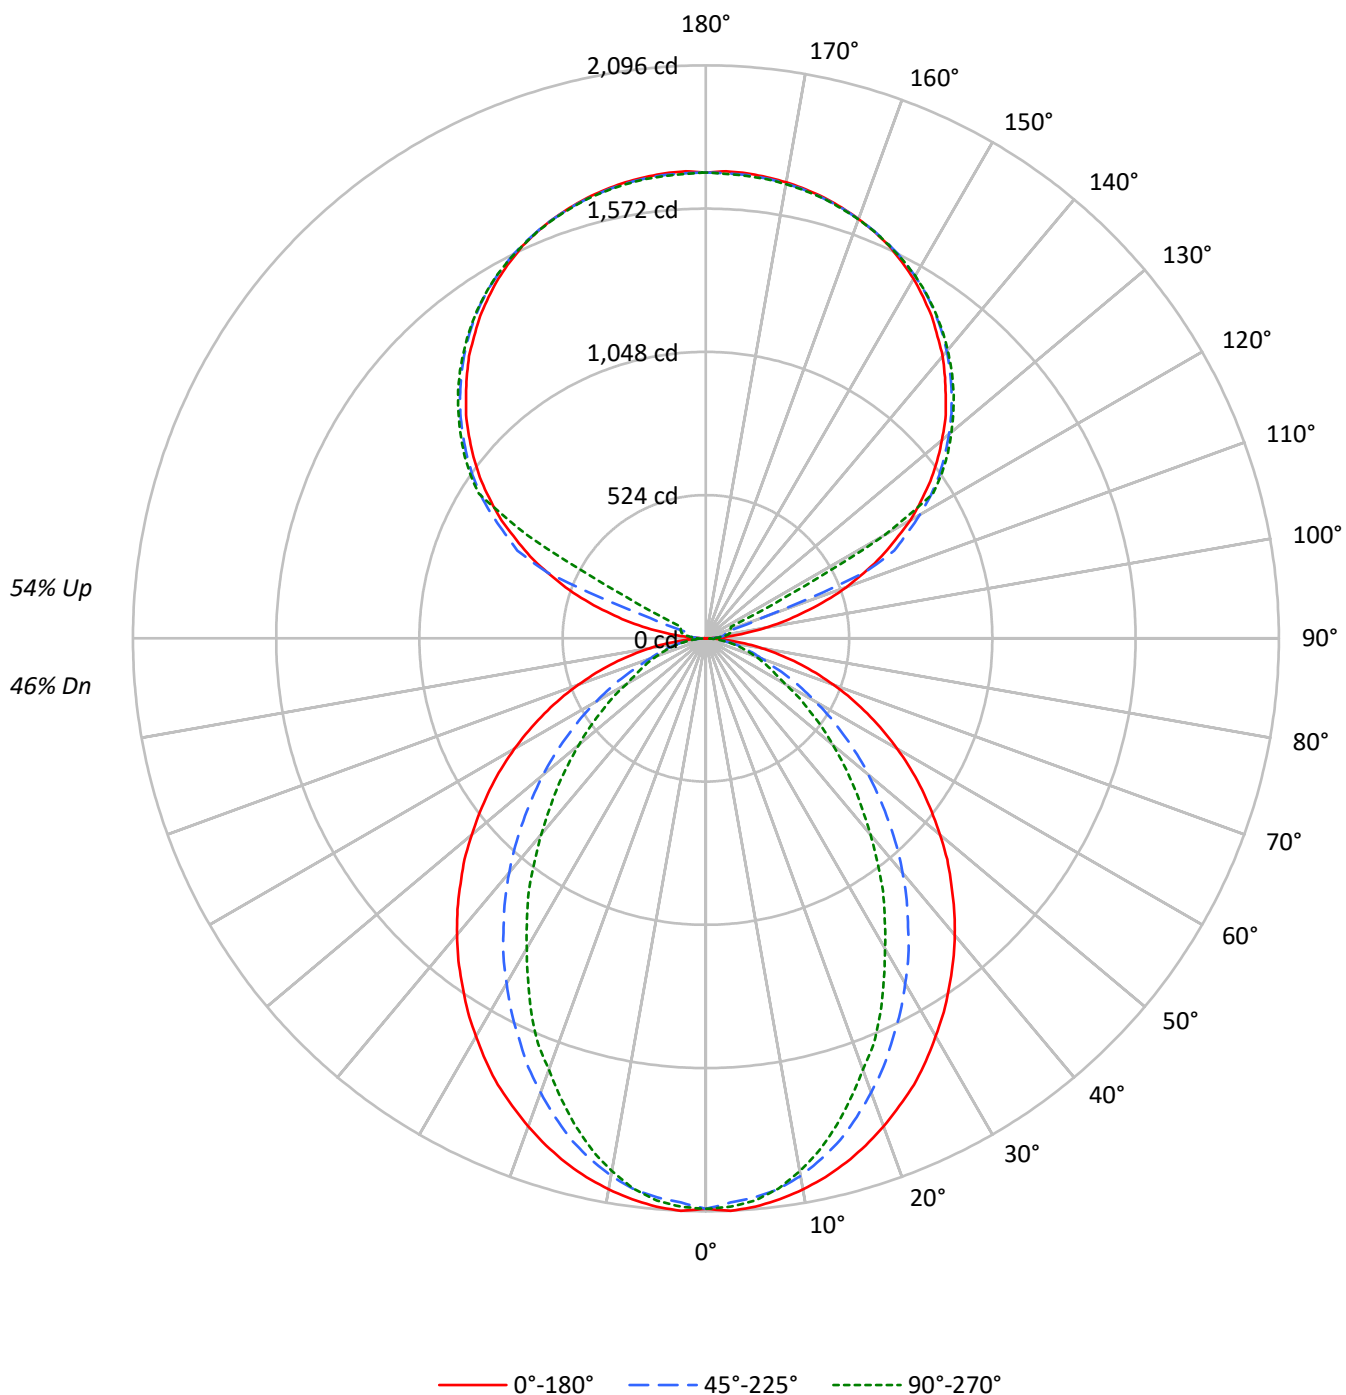

TEST NUMBER: P909879

CATALOG NUMBER: DFN2DIP-TR3F0-050D050US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53			46
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45			40
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39			34
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34			29
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29			26
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26			23
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23			20
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21			18
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19			16
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17			15
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15			13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2600	2600	2600
5°	2603	2557	2574
10°	2576	2505	2488
15°	2539	2420	2357
20°	2491	2304	2197
25°	2441	2174	2042
30°	2375	2041	1847
35°	2310	1898	1675
40°	2244	1751	1479
45°	2168	1588	1300
50°	2089	1423	1126
55°	2006	1247	959
60°	1910	1064	788
65°	1799	878	707
70°	1665	705	638
75°	1496	616	576
80°	1252	510	494
85°	852	331	362

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2168 cd/sqm

TEST NUMBER: P909879

CATALOG NUMBER: DFN2DIP-TR3F0-050D050US840-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	195.6	2.1
10°-20°	536.9	5.8
20°-30°	753.8	8.1
30°-40°	821.7	8.8
40°-50°	755.2	8.1
50°-60°	593.1	6.4
60°-70°	386.1	4.2
70°-80°	198.7	2.1
80°-90°	53.7	0.6
90°-100°	56.2	0.6
100°-110°	209.5	2.3
110°-120°	555.6	6.0
120°-130°	921.4	9.9
130°-140°	978.8	10.5
140°-150°	909.7	9.8
150°-160°	731.3	7.9
160°-170°	471.2	5.1
170°-180°	162.2	1.7
0°-30°	1486.3	16.0
0°-40°	2308.0	24.8
0°-60°	3656.4	39.4
0°-90°	4294.9	46.2
90°-120°	821.2	8.8
90°-150°	3631.1	39.1
90°-180°	4996.0	53.8
0°-180°	9290.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2087	2087	2087	2087	2087	
5°	2087	2078	2053	2070	2064	198
15°	1985	1964	1900	1864	1845	559
25°	1802	1741	1617	1539	1511	829
35°	1552	1456	1290	1171	1129	972
45°	1269	1143	944	810	765	980
55°	965	818	614	500	465	862
65°	652	499	329	264	259	646
75°	348	215	151	138	136	368
85°	81	42	36	36	36	93
90°	1	15	25	31	33	9
95°	80	39	48	54	53	95
105°	375	412	75	89	94	401
115°	709	730	761	190	101	698
125°	1002	1019	1042	1051	1054	894
135°	1240	1260	1271	1284	1281	958
145°	1439	1438	1459	1467	1461	900
155°	1584	1574	1588	1596	1586	730
165°	1670	1662	1666	1674	1666	472
175°	1708	1699	1702	1710	1698	163
180°	1704	1704	1704	1704	1704	



TEST NUMBER: P909879

CATALOG NUMBER: DFN2DIP-TR3F0-050D050US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2086.9	2086.9	2086.9	2086.9	2086.9
2.5°	2096.3	2086.9	2066.1	2085.1	2081.2
5°	2086.9	2077.5	2052.9	2069.8	2064.3
7.5°	2069.8	2058.6	2032.2	2039.6	2030.1
10°	2047.2	2034.0	1996.3	1990.5	1979.2
12.5°	2018.9	2002.0	1950.9	1939.6	1918.7
15°	1984.9	1964.1	1900.0	1864.1	1845.2
17.5°	1945.2	1915.0	1835.6	1794.1	1763.8
20°	1900.0	1862.1	1767.7	1720.6	1678.9
22.5°	1850.9	1807.4	1697.8	1633.7	1605.4
25°	1801.7	1741.2	1616.6	1539.2	1510.8
27.5°	1743.2	1678.9	1541.1	1452.3	1408.9
30°	1680.9	1609.0	1457.9	1361.7	1310.6
32.5°	1620.4	1533.5	1378.8	1265.4	1218.1
35°	1552.5	1456.1	1290.0	1170.9	1129.3
37.5°	1486.3	1382.4	1206.9	1076.4	1029.4
40°	1416.4	1303.2	1119.8	985.8	936.8
42.5°	1344.7	1223.9	1033.1	893.2	846.2
45°	1269.2	1142.6	944.3	810.1	764.8
47.5°	1197.4	1063.4	859.4	725.2	683.7
50°	1118.1	984.0	776.3	645.8	606.3
52.5°	1040.6	898.9	696.9	572.3	536.4
55°	965.0	817.7	613.7	500.5	464.6
57.5°	887.7	736.6	540.2	434.4	404.1
60°	808.3	657.2	462.6	366.5	336.2
62.5°	730.9	579.9	396.6	306.0	290.9
65°	651.6	498.6	328.6	264.5	258.7
67.5°	576.0	423.0	264.5	232.3	226.6
70°	496.8	349.4	219.0	200.2	192.6
72.5°	421.2	281.3	183.2	168.1	164.3
75°	347.5	215.2	151.1	137.8	136.0
77.5°	273.9	152.9	119.1	111.4	107.6
80°	205.8	109.6	90.6	83.1	83.1
82.5°	143.5	73.7	62.3	58.5	58.5
85°	81.2	41.5	35.9	35.9	35.9
87.5°	30.3	15.0	15.0	13.2	13.2
90°	1.2	14.7	24.6	30.9	33.2
92.5°	30.9	26.0	29.6	32.1	33.2
95°	80.1	39.4	48.1	54.3	53.0
97.5°	144.2	43.2	62.8	66.7	67.8
100°	218.3	49.4	70.3	80.1	82.6
102.5°	299.6	297.2	72.8	86.2	90.1
105°	374.9	411.9	75.2	88.8	93.7
107.5°	462.4	493.1	77.8	91.2	96.2
110°	546.3	572.1	215.8	92.5	97.4

TEST NUMBER: P909879

CATALOG NUMBER: DFN2DIP-TR3F0-050D050US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	625.2	647.3	626.4	94.9	98.7
115°	709.0	729.9	760.8	190.0	101.2
117.5°	781.7	806.4	827.5	651.0	328.0
120°	863.1	881.6	903.8	918.7	752.1
122.5°	932.1	951.9	976.6	984.0	985.3
125°	1002.4	1018.6	1042.0	1050.6	1054.3
127.5°	1066.5	1083.8	1102.5	1114.7	1115.9
130°	1127.0	1146.8	1160.2	1173.9	1172.8
132.5°	1188.7	1204.8	1218.2	1229.4	1228.2
135°	1240.5	1260.3	1271.2	1283.7	1281.2
137.5°	1294.6	1309.5	1321.9	1334.2	1330.6
140°	1347.7	1357.7	1371.1	1382.2	1376.1
142.5°	1392.2	1400.9	1416.8	1426.6	1420.5
145°	1439.1	1437.7	1458.6	1467.3	1461.2
147.5°	1479.7	1475.9	1496.9	1503.1	1498.2
150°	1519.1	1510.6	1530.2	1537.6	1531.5
152.5°	1552.4	1542.6	1561.1	1568.5	1559.8
155°	1584.5	1573.5	1588.2	1595.6	1585.8
157.5°	1610.3	1600.5	1611.6	1620.3	1610.3
160°	1632.6	1625.2	1632.6	1639.9	1631.3
162.5°	1652.2	1645.0	1651.0	1659.7	1648.6
165°	1669.5	1662.2	1665.9	1674.5	1665.9
167.5°	1683.1	1675.7	1679.5	1688.1	1677.0
170°	1694.3	1686.8	1689.3	1697.9	1686.8
172.5°	1701.6	1694.3	1696.8	1705.4	1694.3
175°	1707.8	1699.1	1701.6	1710.2	1697.9
177.5°	1710.2	1701.6	1702.9	1711.5	1700.4
180°	1704.0	1704.0	1704.0	1704.0	1704.0

TEST NUMBER: P909879

CATALOG NUMBER: DFN2DIP-TR3F0-050D050US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.05	10.85	11.05	11.86	13.18	6.03	6.83	7.02	7.83	9.16
	3H	11.72	12.43	12.72	13.45	14.79	7.21	7.93	8.22	8.94	10.29
	4H	12.32	13.00	13.34	14.01	15.37	7.66	8.33	8.67	9.35	10.70
	6H	12.73	13.35	13.76	14.37	15.74	7.97	8.59	9.00	9.61	10.98
	8H	12.85	13.45	13.89	14.48	15.84	8.06	8.65	9.09	9.68	11.05
	12H	12.91	13.47	13.95	14.50	15.89	8.10	8.66	9.14	9.69	11.08
4H	2H	10.07	10.74	11.09	11.76	13.11	6.62	7.29	7.64	8.31	9.66
	3H	11.88	12.44	12.92	13.49	14.86	7.96	8.52	8.99	9.56	10.93
	4H	12.57	13.08	13.61	14.12	15.51	8.50	9.01	9.54	10.05	11.44
	6H	13.07	13.51	14.12	14.57	15.96	8.91	9.35	9.96	10.41	11.80
	8H	13.24	13.65	14.29	14.70	16.11	9.03	9.45	10.09	10.50	11.90
	12H	13.33	13.70	14.40	14.77	16.17	9.10	9.47	10.16	10.53	11.94
8H	4H	12.53	12.94	13.58	13.99	15.40	8.77	9.18	9.82	10.23	11.64
	6H	13.08	13.43	14.16	14.52	15.92	9.28	9.62	10.35	10.71	12.11
	8H	13.30	13.59	14.38	14.67	16.09	9.47	9.77	10.55	10.84	12.26
	12H	13.43	13.69	14.51	14.76	16.22	9.58	9.84	10.66	10.91	12.37
12H	4H	12.48	12.85	13.55	13.92	15.33	8.77	9.15	9.84	10.21	11.62
	6H	13.06	13.36	14.14	14.44	15.85	9.33	9.63	10.41	10.70	12.12
	8H	13.27	13.54	14.36	14.61	16.07	9.53	9.79	10.62	10.87	12.33

END OF REPORT