

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909886

Luminaire Tested: DFN2DIP-TR3F0-050D070US840-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909886
REPORT IS A COMBINATION OF REPORTS P900332 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-050D070US840-RLLFLL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 10548.1 lumens
Efficiency: N/A
Efficacy: 107.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 98.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909886
CATALOG NUMBER: DFN2DIP-TR3F0-050D070US840-RLLFLL

Luminous Intensity Polar Plot

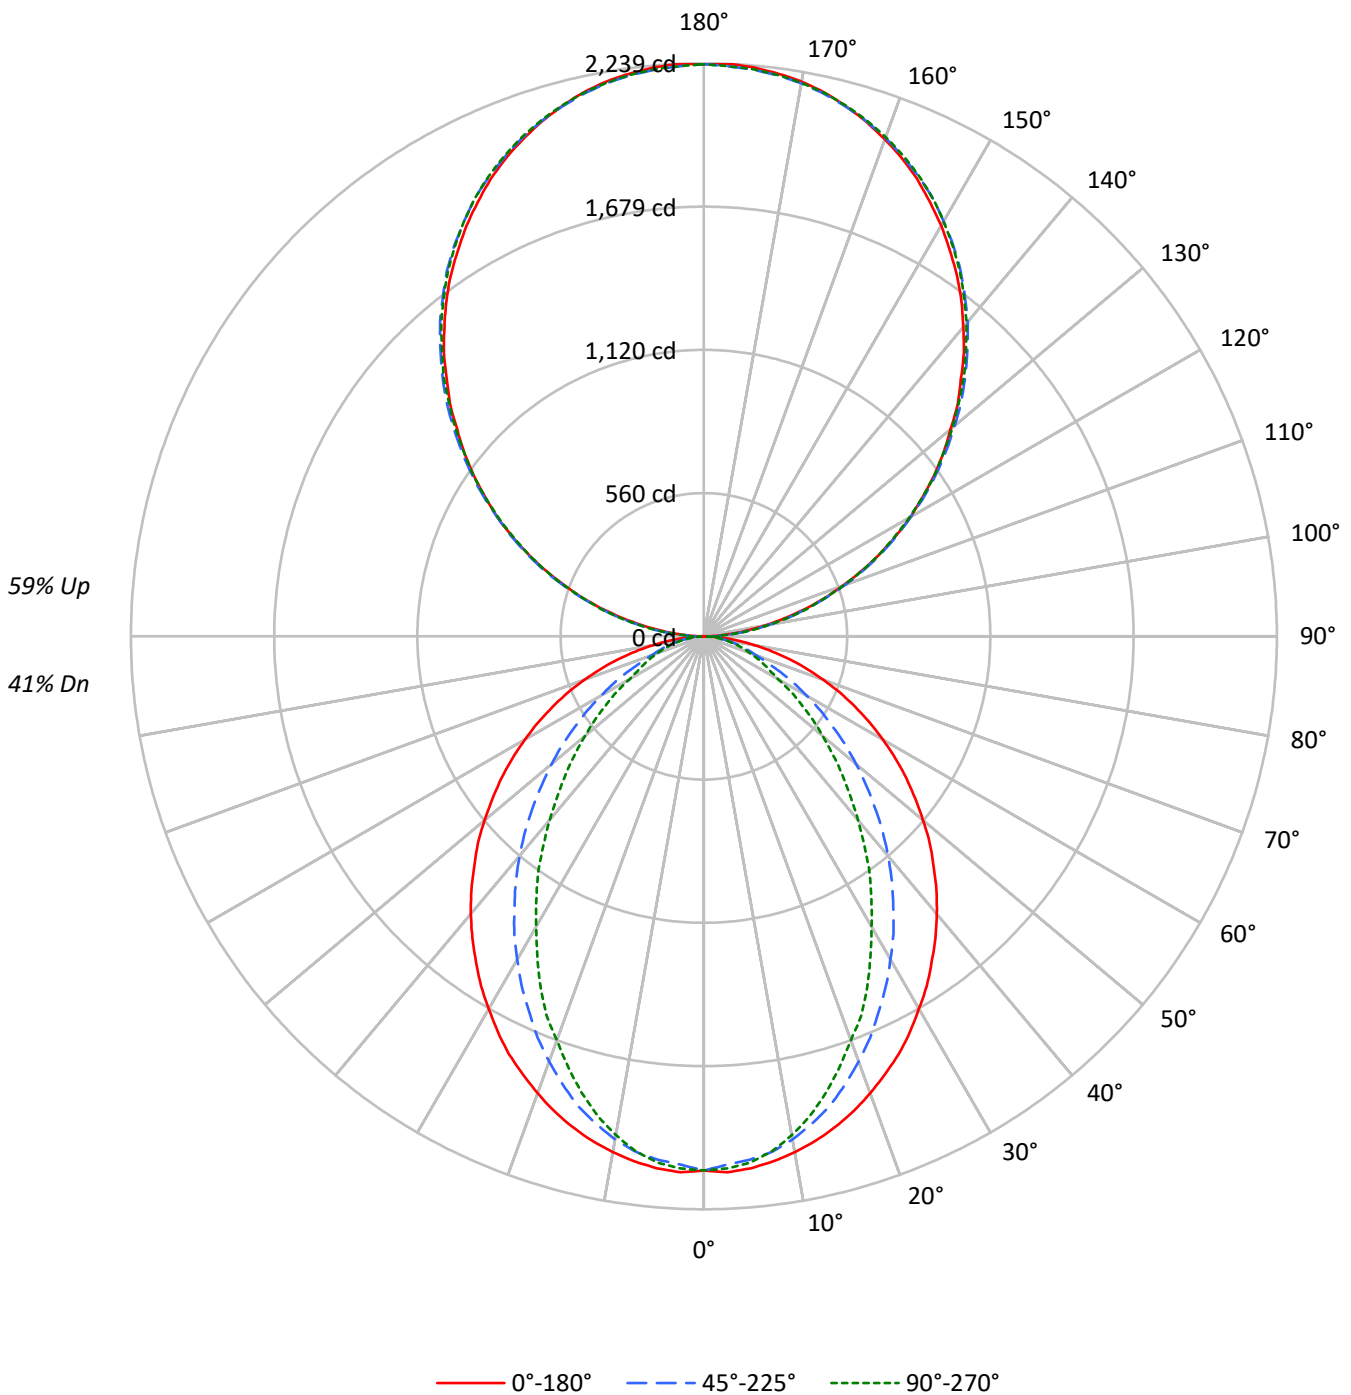



TEST NUMBER: P909886

CATALOG NUMBER: DFN2DIP-TR3F0-050D070US840-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20
RC	80				70				50				30				10				0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	105	105	105	105	96	96	96	96	78	78	78	62	62	62	48	48	48	48	48	48	41
1	96	92	88	85	87	84	81	78	69	67	65	55	54	53	43	42	41	41	41	41	35
2	88	81	75	70	80	74	69	65	61	57	54	49	47	44	38	36	35	35	35	35	30
3	80	71	64	59	73	65	59	54	54	50	46	44	41	38	34	32	30	30	30	30	26
4	74	63	56	50	67	58	52	46	48	43	40	39	36	33	31	28	26	26	26	26	23
5	68	57	49	43	62	52	45	40	43	38	34	35	32	29	28	25	23	23	23	23	20
6	62	51	43	37	57	47	40	35	39	34	30	32	28	25	25	23	21	21	21	21	18
7	58	46	38	33	53	42	36	31	36	30	27	29	25	23	23	21	19	19	19	19	16
8	54	42	34	29	49	39	32	27	32	27	24	27	23	20	21	19	17	17	17	17	14
9	50	38	31	26	46	35	29	24	30	25	21	25	21	18	20	17	15	15	15	15	13
10	47	35	28	23	43	32	26	22	27	23	19	23	19	17	18	16	14	14	14	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2600	2600	2600
5°	2603	2557	2574
10°	2576	2505	2488
15°	2539	2420	2357
20°	2491	2304	2197
25°	2441	2174	2042
30°	2375	2041	1847
35°	2310	1898	1675
40°	2244	1751	1479
45°	2168	1588	1300
50°	2089	1423	1126
55°	2006	1247	959
60°	1910	1064	788
65°	1799	878	707
70°	1665	705	638
75°	1496	616	576
80°	1252	510	494
85°	852	331	362

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°
 Vertical Angle: 90°
 Luminance: 2181 cd/sqm



TEST NUMBER: P909886

CATALOG NUMBER: DFN2DIP-TR3F0-050D070US840-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	195.6	1.9
10°-20°	536.9	5.1
20°-30°	753.8	7.1
30°-40°	821.7	7.8
40°-50°	755.2	7.2
50°-60°	593.1	5.6
60°-70°	386.1	3.7
70°-80°	198.7	1.9
80°-90°	57.1	0.5
90°-100°	138.3	1.3
100°-110°	439.6	4.2
110°-120°	752.2	7.1
120°-130°	989.3	9.4
130°-140°	1110.5	10.5
140°-150°	1088.9	10.3
150°-160°	913.5	8.7
160°-170°	605.8	5.7
170°-180°	211.7	2.0
0°-30°	1486.3	14.1
0°-40°	2308.0	21.9
0°-60°	3656.4	34.7
0°-90°	4298.3	40.7
90°-120°	1330.1	12.6
90°-150°	4518.8	42.8
90°-180°	6250.0	59.3
0°-180°	10548.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2087	2087	2087	2087	2087	
5°	2087	2078	2053	2070	2064	198
15°	1985	1964	1900	1864	1845	559
25°	1802	1741	1617	1539	1511	829
35°	1552	1456	1290	1171	1129	972
45°	1269	1143	944	810	765	980
55°	965	818	614	500	465	862
65°	652	499	329	264	259	646
75°	348	215	151	138	136	368
85°	81	42	36	36	36	93
90°	2	24	66	62	64	10
95°	98	117	121	121	117	109
105°	406	411	415	419	419	428
115°	755	766	762	760	755	747
125°	1098	1115	1109	1103	1101	981
135°	1420	1441	1445	1443	1438	1098
145°	1724	1738	1748	1750	1743	1077
155°	1972	1977	1983	1992	1986	907
165°	2145	2143	2143	2156	2147	605
175°	2232	2226	2222	2236	2224	212
180°	2236	2236	2236	2236	2236	



TEST NUMBER: P909886

CATALOG NUMBER: DFN2DIP-TR3F0-050D070US840-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2086.9	2086.9	2086.9	2086.9	2086.9
2.5°	2096.3	2086.9	2066.1	2085.1	2081.2
5°	2086.9	2077.5	2052.9	2069.8	2064.3
7.5°	2069.8	2058.6	2032.2	2039.6	2030.1
10°	2047.2	2034.0	1996.3	1990.5	1979.2
12.5°	2018.9	2002.0	1950.9	1939.6	1918.7
15°	1984.9	1964.1	1900.0	1864.1	1845.2
17.5°	1945.2	1915.0	1835.6	1794.1	1763.8
20°	1900.0	1862.1	1767.7	1720.6	1678.9
22.5°	1850.9	1807.4	1697.8	1633.7	1605.4
25°	1801.7	1741.2	1616.6	1539.2	1510.8
27.5°	1743.2	1678.9	1541.1	1452.3	1408.9
30°	1680.9	1609.0	1457.9	1361.7	1310.6
32.5°	1620.4	1533.5	1378.8	1265.4	1218.1
35°	1552.5	1456.1	1290.0	1170.9	1129.3
37.5°	1486.3	1382.4	1206.9	1076.4	1029.4
40°	1416.4	1303.2	1119.8	985.8	936.8
42.5°	1344.7	1223.9	1033.1	893.2	846.2
45°	1269.2	1142.6	944.3	810.1	764.8
47.5°	1197.4	1063.4	859.4	725.2	683.7
50°	1118.1	984.0	776.3	645.8	606.3
52.5°	1040.6	898.9	696.9	572.3	536.4
55°	965.0	817.7	613.7	500.5	464.6
57.5°	887.7	736.6	540.2	434.4	404.1
60°	808.3	657.2	462.6	366.5	336.2
62.5°	730.9	579.9	396.6	306.0	290.9
65°	651.6	498.6	328.6	264.5	258.7
67.5°	576.0	423.0	264.5	232.3	226.6
70°	496.8	349.4	219.0	200.2	192.6
72.5°	421.2	281.3	183.2	168.1	164.3
75°	347.5	215.2	151.1	137.8	136.0
77.5°	273.9	152.9	119.1	111.4	107.6
80°	205.8	109.6	90.6	83.1	83.1
82.5°	143.5	73.7	62.3	58.5	58.5
85°	81.2	41.5	35.9	35.9	35.9
87.5°	30.3	15.0	15.0	13.2	13.2
90°	2.0	24.2	66.0	62.0	64.0
92.5°	41.8	56.7	58.7	60.7	60.7
95°	98.4	117.2	120.7	120.7	117.2
97.5°	163.8	181.3	188.7	188.7	188.7
100°	239.2	254.8	260.1	260.1	258.1
102.5°	318.8	330.2	337.7	339.7	337.7
105°	405.8	411.1	415.2	418.6	418.6
107.5°	492.0	500.1	500.1	501.5	492.0
110°	575.6	586.4	586.4	586.4	581.0



TEST NUMBER: P909886

CATALOG NUMBER: DFN2DIP-TR3F0-050D070US840-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	665.9	677.4	675.4	669.9	665.9
115°	754.9	765.7	762.3	760.3	754.9
117.5°	843.1	858.0	848.6	843.1	837.8
120°	932.1	947.0	932.1	932.1	926.0
122.5°	1013.0	1031.9	1022.5	1017.0	1013.0
125°	1097.9	1114.8	1109.4	1103.4	1101.4
127.5°	1180.8	1201.7	1194.4	1186.3	1180.8
130°	1258.4	1282.6	1279.3	1275.3	1267.8
132.5°	1345.3	1364.2	1365.5	1356.1	1350.7
135°	1420.2	1441.0	1445.1	1443.0	1437.6
137.5°	1503.7	1520.6	1523.9	1522.6	1514.5
140°	1577.2	1594.1	1603.5	1603.5	1596.1
142.5°	1652.6	1669.5	1674.9	1676.9	1669.5
145°	1724.1	1737.6	1748.4	1750.4	1743.0
147.5°	1788.2	1805.0	1813.1	1816.4	1809.1
150°	1854.2	1865.6	1873.1	1879.2	1873.1
152.5°	1912.8	1924.3	1933.7	1941.2	1933.7
155°	1971.5	1976.8	1983.0	1992.4	1986.3
157.5°	2022.1	2026.1	2029.4	2043.0	2033.5
160°	2067.2	2071.2	2073.3	2084.7	2076.6
162.5°	2109.0	2109.0	2111.0	2123.7	2114.4
165°	2144.7	2142.6	2142.6	2156.2	2146.7
167.5°	2177.1	2171.0	2171.0	2184.4	2175.0
170°	2201.3	2196.0	2193.9	2207.4	2196.0
172.5°	2218.2	2212.7	2210.7	2224.2	2212.7
175°	2231.6	2226.2	2222.2	2235.6	2224.2
177.5°	2239.1	2233.6	2229.6	2241.1	2229.6
180°	2235.6	2235.6	2235.6	2235.6	2235.6



TEST NUMBER: P909886
 CATALOG NUMBER: DFN2DIP-TR3F0-050D070US840-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.48	10.24	10.52	11.29	12.69	5.46	6.22	6.50	7.26	8.66
	3H	11.15	11.83	12.20	12.88	14.30	6.64	7.32	7.69	8.37	9.79
	4H	11.75	12.39	12.81	13.44	14.87	7.08	7.73	8.14	8.78	10.20
	6H	12.16	12.75	13.23	13.80	15.24	7.39	7.99	8.46	9.04	10.48
	8H	12.28	12.84	13.35	13.91	15.34	7.48	8.04	8.55	9.11	10.55
	12H	12.33	12.87	13.41	13.93	15.39	7.52	8.05	8.60	9.12	10.58
4H	2H	9.49	10.14	10.56	11.19	12.61	6.04	6.69	7.11	7.74	9.16
	3H	11.30	11.84	12.38	12.92	14.36	7.38	7.92	8.45	8.99	10.43
	4H	11.99	12.48	13.07	13.55	15.01	7.92	8.41	9.00	9.48	10.94
	6H	12.49	12.91	13.58	14.00	15.46	8.33	8.75	9.42	9.84	11.30
	8H	12.66	13.05	13.75	14.14	15.61	8.45	8.85	9.54	9.93	11.40
	12H	12.74	13.10	13.85	14.20	15.67	8.51	8.87	9.62	9.97	11.44
8H	4H	11.95	12.34	13.04	13.43	14.90	8.19	8.58	9.28	9.67	11.14
	6H	12.50	12.83	13.61	13.95	15.42	8.70	9.02	9.81	10.15	11.62
	8H	12.71	13.00	13.83	14.11	15.59	8.88	9.17	10.00	10.28	11.76
	12H	12.84	13.09	13.96	14.20	15.72	8.99	9.24	10.11	10.35	11.87
12H	4H	11.90	12.25	13.00	13.35	14.83	8.19	8.54	9.30	9.64	11.12
	6H	12.48	12.76	13.59	13.87	15.36	8.74	9.03	9.86	10.14	11.62
	8H	12.69	12.94	13.81	14.04	15.57	8.95	9.20	10.07	10.30	11.83