

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909890

Luminaire Tested: DFN2DIP-TR3F0-050D080US840-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909890
REPORT IS A COMBINATION OF REPORTS P900346 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-050D080US840-RLLFLL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11441.8 lumens
Efficiency: N/A
Efficacy: 107.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 106.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909890

CATALOG NUMBER: DFN2DIP-TR3F0-050D080US840-RLLFLL

Luminous Intensity Polar Plot

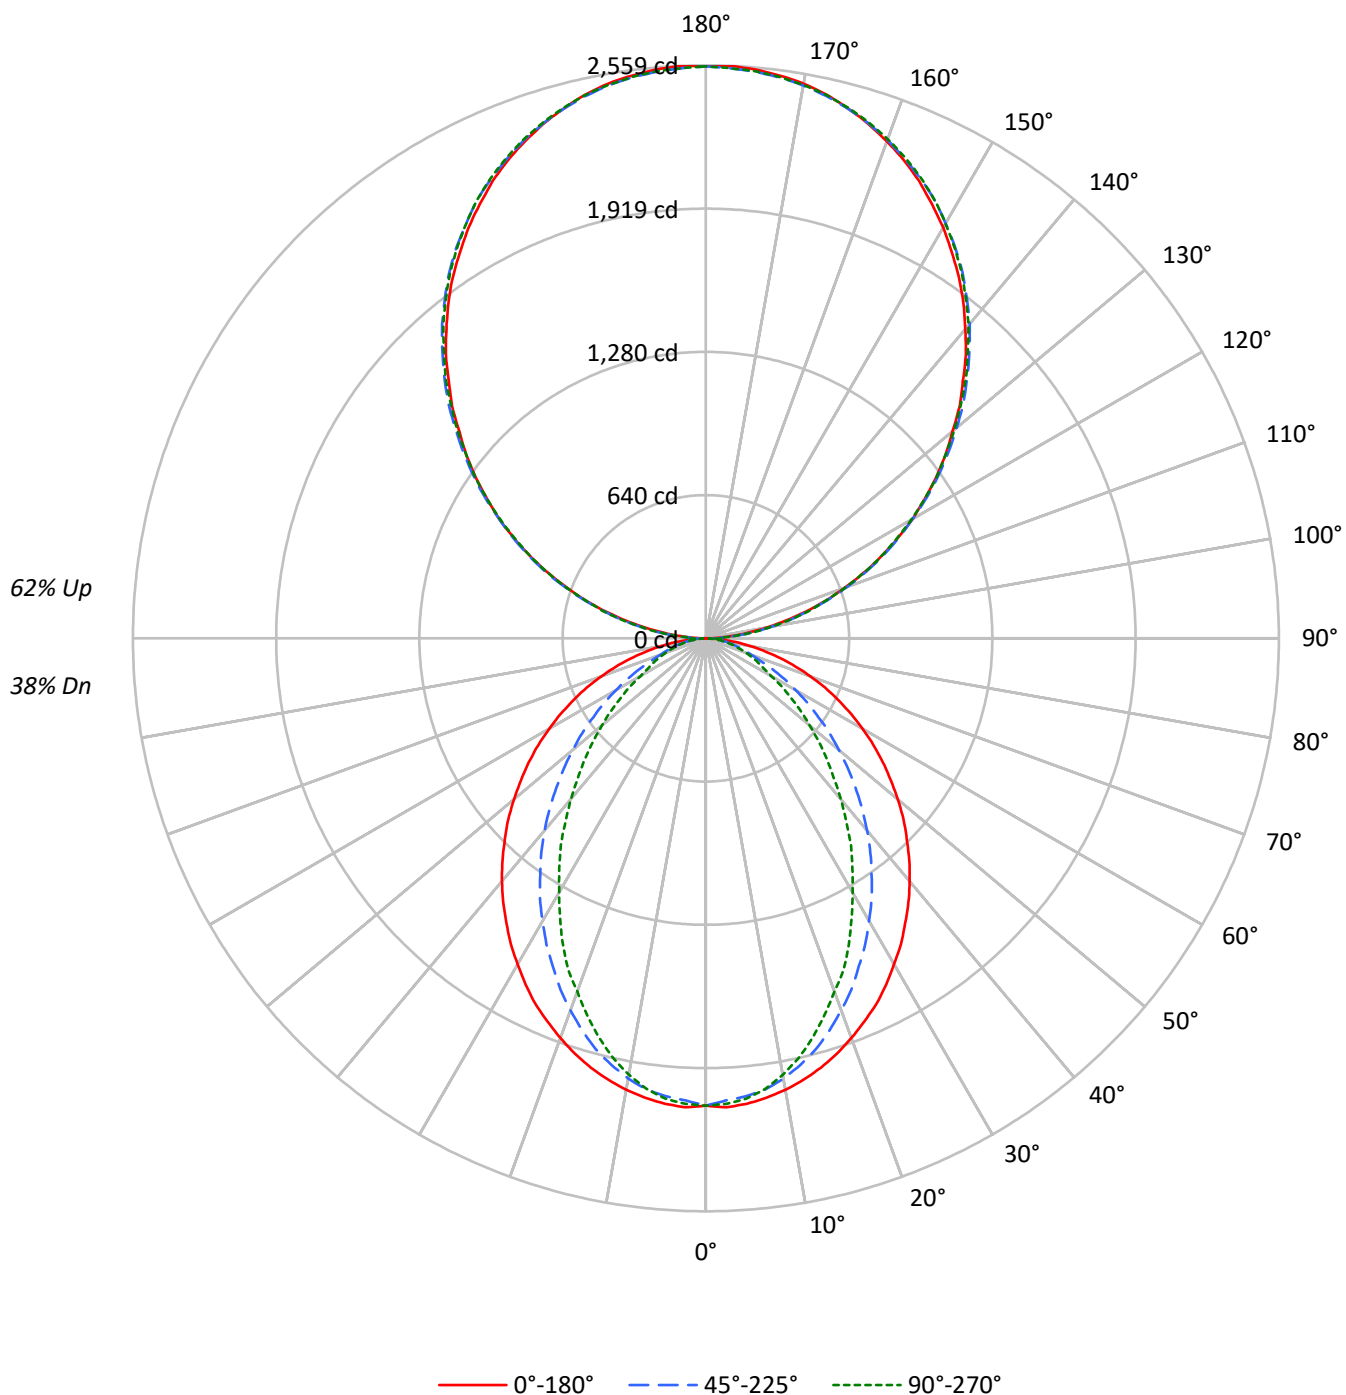

TEST NUMBER: P909890

CATALOG NUMBER: DFN2DIP-TR3F0-050D080US840-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	95	95	95	95	76	76	76	60	60	60	45	45	45
1	95	91	88	84	86	83	80	77	67	65	63	53	52	50	40	39	38
2	87	80	74	69	79	73	68	64	59	56	53	47	45	43	36	34	33
3	80	71	64	58	72	64	58	54	53	48	45	42	39	37	32	30	28
4	73	63	55	49	66	57	51	46	47	42	39	38	34	32	29	27	25
5	67	56	48	42	61	51	44	39	42	37	33	34	30	28	26	24	22
6	62	50	42	37	56	46	39	34	38	33	29	31	27	24	24	21	19
7	57	45	38	32	52	42	35	30	35	30	26	28	24	22	22	19	17
8	53	41	34	29	48	38	31	27	32	27	23	26	22	19	20	18	16
9	49	38	30	26	45	35	28	24	29	24	21	24	20	17	19	16	14
10	46	35	28	23	42	32	26	21	27	22	19	22	18	16	17	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2600	2600	2600
5°	2603	2557	2574
10°	2576	2505	2488
15°	2539	2420	2357
20°	2491	2304	2197
25°	2441	2174	2042
30°	2375	2041	1847
35°	2310	1898	1675
40°	2244	1751	1479
45°	2168	1588	1300
50°	2089	1423	1126
55°	2006	1247	959
60°	1910	1064	788
65°	1799	878	707
70°	1665	705	638
75°	1496	616	576
80°	1252	510	494
85°	852	331	362

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2495 cd/sqm

TEST NUMBER: P909890

CATALOG NUMBER: DFN2DIP-TR3F0-050D080US840-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	195.6	1.7
10°-20°	536.9	4.7
20°-30°	753.8	6.6
30°-40°	821.7	7.2
40°-50°	755.2	6.6
50°-60°	593.1	5.2
60°-70°	386.1	3.4
70°-80°	198.7	1.7
80°-90°	58.0	0.5
90°-100°	158.1	1.4
100°-110°	502.4	4.4
110°-120°	859.7	7.5
120°-130°	1130.6	9.9
130°-140°	1269.1	11.1
140°-150°	1244.5	10.9
150°-160°	1043.9	9.1
160°-170°	692.3	6.1
170°-180°	242.0	2.1
0°-30°	1486.3	13.0
0°-40°	2308.0	20.2
0°-60°	3656.4	32.0
0°-90°	4299.2	37.6
90°-120°	1520.1	13.3
90°-150°	5164.3	45.1
90°-180°	7143.0	62.4
0°-180°	11441.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2087	2087	2087	2087	2087	
5°	2087	2078	2053	2070	2064	198
15°	1985	1964	1900	1864	1845	559
25°	1802	1741	1617	1539	1511	829
35°	1552	1456	1290	1171	1129	972
45°	1269	1143	944	810	765	980
55°	965	818	614	500	465	862
65°	652	499	329	264	259	646
75°	348	215	151	138	136	368
85°	81	42	36	36	36	93
90°	2	28	76	71	73	11
95°	112	134	138	138	134	125
105°	464	470	474	478	478	489
115°	863	875	871	869	863	853
125°	1255	1274	1268	1261	1259	1121
135°	1623	1647	1652	1649	1643	1254
145°	1970	1986	1998	2000	1992	1231
155°	2253	2259	2266	2277	2270	1037
165°	2451	2449	2449	2464	2453	691
175°	2550	2544	2540	2555	2542	242
180°	2555	2555	2555	2555	2555	

TEST NUMBER: P909890

CATALOG NUMBER: DFN2DIP-TR3F0-050D080US840-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2086.9	2086.9	2086.9	2086.9	2086.9
2.5°	2096.3	2086.9	2066.1	2085.1	2081.2
5°	2086.9	2077.5	2052.9	2069.8	2064.3
7.5°	2069.8	2058.6	2032.2	2039.6	2030.1
10°	2047.2	2034.0	1996.3	1990.5	1979.2
12.5°	2018.9	2002.0	1950.9	1939.6	1918.7
15°	1984.9	1964.1	1900.0	1864.1	1845.2
17.5°	1945.2	1915.0	1835.6	1794.1	1763.8
20°	1900.0	1862.1	1767.7	1720.6	1678.9
22.5°	1850.9	1807.4	1697.8	1633.7	1605.4
25°	1801.7	1741.2	1616.6	1539.2	1510.8
27.5°	1743.2	1678.9	1541.1	1452.3	1408.9
30°	1680.9	1609.0	1457.9	1361.7	1310.6
32.5°	1620.4	1533.5	1378.8	1265.4	1218.1
35°	1552.5	1456.1	1290.0	1170.9	1129.3
37.5°	1486.3	1382.4	1206.9	1076.4	1029.4
40°	1416.4	1303.2	1119.8	985.8	936.8
42.5°	1344.7	1223.9	1033.1	893.2	846.2
45°	1269.2	1142.6	944.3	810.1	764.8
47.5°	1197.4	1063.4	859.4	725.2	683.7
50°	1118.1	984.0	776.3	645.8	606.3
52.5°	1040.6	898.9	696.9	572.3	536.4
55°	965.0	817.7	613.7	500.5	464.6
57.5°	887.7	736.6	540.2	434.4	404.1
60°	808.3	657.2	462.6	366.5	336.2
62.5°	730.9	579.9	396.6	306.0	290.9
65°	651.6	498.6	328.6	264.5	258.7
67.5°	576.0	423.0	264.5	232.3	226.6
70°	496.8	349.4	219.0	200.2	192.6
72.5°	421.2	281.3	183.2	168.1	164.3
75°	347.5	215.2	151.1	137.8	136.0
77.5°	273.9	152.9	119.1	111.4	107.6
80°	205.8	109.6	90.6	83.1	83.1
82.5°	143.5	73.7	62.3	58.5	58.5
85°	81.2	41.5	35.9	35.9	35.9
87.5°	30.3	15.0	15.0	13.2	13.2
90°	2.3	27.8	75.5	70.9	73.2
92.5°	47.8	64.7	67.1	69.3	69.3
95°	112.5	134.0	137.8	137.8	134.0
97.5°	187.2	207.2	215.7	215.7	215.7
100°	273.5	291.1	297.3	297.3	295.0
102.5°	364.4	377.5	385.9	388.2	385.9
105°	463.7	469.9	474.5	478.4	478.4
107.5°	562.3	571.6	571.6	573.1	562.3
110°	657.8	670.1	670.1	670.1	664.0

TEST NUMBER: P909890

CATALOG NUMBER: DFN2DIP-TR3F0-050D080US840-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	761.0	774.2	771.8	765.7	761.0
115°	862.7	875.0	871.2	868.9	862.7
117.5°	963.6	980.6	969.8	963.6	957.5
120°	1065.3	1082.3	1065.3	1065.3	1058.3
122.5°	1157.7	1179.3	1168.5	1162.4	1157.7
125°	1254.8	1274.0	1267.9	1260.9	1258.7
127.5°	1349.6	1373.4	1364.9	1355.7	1349.6
130°	1438.1	1465.8	1462.0	1457.4	1449.0
132.5°	1537.5	1559.0	1560.6	1549.8	1543.7
135°	1623.0	1646.9	1651.5	1649.2	1643.1
137.5°	1718.5	1737.8	1741.6	1740.1	1730.8
140°	1802.5	1821.7	1832.5	1832.5	1824.0
142.5°	1888.8	1908.0	1914.2	1916.5	1908.0
145°	1970.4	1985.8	1998.1	2000.4	1992.0
147.5°	2043.6	2062.9	2072.0	2076.0	2067.5
150°	2119.1	2132.1	2140.6	2147.6	2140.6
152.5°	2186.1	2199.2	2210.0	2218.5	2210.0
155°	2253.1	2259.3	2266.2	2276.9	2270.1
157.5°	2310.9	2315.5	2319.4	2334.7	2324.0
160°	2362.5	2367.1	2369.4	2382.5	2373.3
162.5°	2410.2	2410.2	2412.6	2427.2	2416.4
165°	2451.0	2448.7	2448.7	2464.2	2453.4
167.5°	2488.0	2481.1	2481.1	2496.5	2485.7
170°	2515.8	2509.6	2507.3	2522.7	2509.6
172.5°	2535.1	2528.9	2526.6	2541.9	2528.9
175°	2550.4	2544.3	2539.6	2555.1	2541.9
177.5°	2558.9	2552.7	2548.1	2561.2	2548.1
180°	2555.1	2555.1	2555.1	2555.1	2555.1

TEST NUMBER: P909890

CATALOG NUMBER: DFN2DIP-TR3F0-050D080US840-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.13	9.87	10.19	10.93	12.37	5.11	5.84	6.17	6.91	8.35
	3H	10.79	11.45	11.86	12.52	13.98	6.28	6.94	7.36	8.01	9.47
	4H	11.39	12.01	12.47	13.09	14.55	6.72	7.35	7.81	8.42	9.89
	6H	11.80	12.37	12.89	13.45	14.93	7.04	7.61	8.13	8.69	10.16
	8H	11.92	12.47	13.01	13.56	15.03	7.12	7.67	8.22	8.76	10.23
	12H	11.97	12.49	13.07	13.58	15.07	7.16	7.68	8.26	8.76	10.26
4H	2H	9.14	9.76	10.23	10.83	12.30	5.69	6.31	6.78	7.38	8.85
	3H	10.95	11.47	12.04	12.57	14.04	7.02	7.54	8.12	8.64	10.12
	4H	11.63	12.10	12.73	13.19	14.69	7.56	8.04	8.66	9.13	10.63
	6H	12.13	12.54	13.24	13.65	15.14	7.97	8.38	9.08	9.49	10.98
	8H	12.30	12.68	13.41	13.78	15.29	8.09	8.47	9.20	9.58	11.09
	12H	12.38	12.73	13.51	13.84	15.36	8.15	8.49	9.28	9.61	11.12
8H	4H	11.59	11.97	12.70	13.07	14.58	7.83	8.21	8.94	9.31	10.82
	6H	12.14	12.45	13.27	13.60	15.11	8.33	8.65	9.47	9.80	11.30
	8H	12.35	12.62	13.49	13.75	15.28	8.52	8.80	9.66	9.92	11.45
	12H	12.48	12.72	13.62	13.84	15.40	8.63	8.87	9.77	10.00	11.56
12H	4H	11.53	11.88	12.66	13.00	14.51	7.83	8.17	8.95	9.29	10.80
	6H	12.11	12.39	13.25	13.52	15.04	8.38	8.66	9.52	9.78	11.31
	8H	12.32	12.57	13.46	13.69	15.25	8.58	8.82	9.72	9.95	11.51

END OF REPORT