

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909906

Luminaire Tested: DFN2DIP-TR3F0-060D060US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909906
REPORT IS A COMBINATION OF REPORTS P900319 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-060D060US840-FLLFLL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11361.0 lumens
Efficiency: N/A
Efficacy: 110.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 102.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909906

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US840-FLLFLL

Luminous Intensity Polar Plot

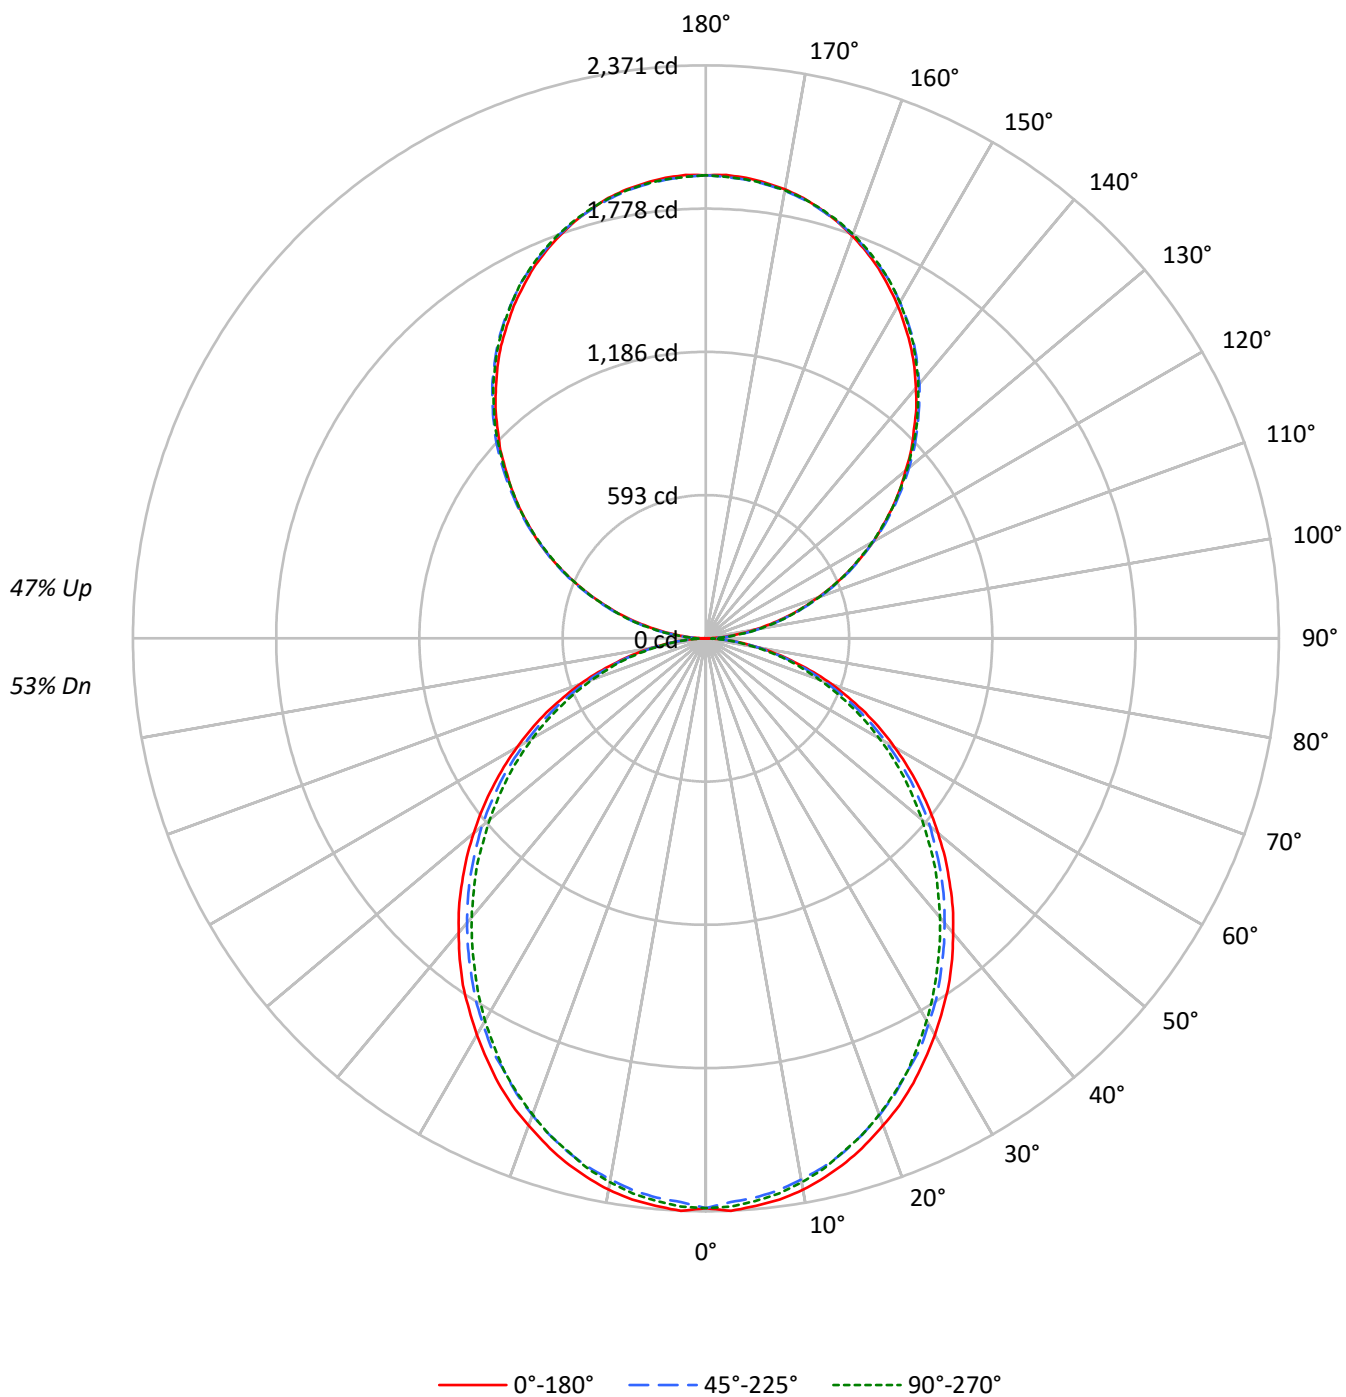

TEST NUMBER: P909906

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US840-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2938	2938	2938
5°	2941	2894	2914
10°	2915	2853	2873
15°	2871	2804	2810
20°	2812	2736	2745
25°	2752	2655	2670
30°	2678	2580	2575
35°	2608	2492	2475
40°	2522	2403	2379
45°	2436	2313	2282
50°	2342	2219	2169
55°	2243	2110	2064
60°	2132	1982	1945
65°	2010	1848	1804
70°	1854	1684	1652
75°	1639	1489	1508
80°	1380	1238	1239
85°	974	816	801

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2436 cd/sqm

TEST NUMBER: P909906

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.9	2.0
10°-20°	624.4	5.5
20°-30°	917.5	8.1
30°-40°	1065.7	9.4
40°-50°	1064.4	9.4
50°-60°	928.1	8.2
60°-70°	686.1	6.0
70°-80°	388.2	3.4
80°-90°	107.9	0.9
90°-100°	118.6	1.0
100°-110°	376.8	3.3
110°-120°	644.8	5.7
120°-130°	848.0	7.5
130°-140°	951.8	8.4
140°-150°	933.4	8.2
150°-160°	783.0	6.9
160°-170°	519.2	4.6
170°-180°	181.5	1.6
0°-30°	1763.8	15.5
0°-40°	2829.5	24.9
0°-60°	4821.9	42.4
0°-90°	6004.0	52.8
90°-120°	1140.1	10.0
90°-150°	3873.3	34.1
90°-180°	5357.0	47.2
0°-180°	11361.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2358	2358	2358	2358	2358	
5°	2358	2349	2324	2342	2337	224
15°	2244	2231	2201	2210	2199	632
25°	2031	2013	1975	1979	1975	935
35°	1752	1730	1694	1680	1668	1094
45°	1426	1410	1376	1351	1342	1101
55°	1079	1066	1038	1011	1000	965
65°	728	714	692	671	660	720
75°	381	376	365	351	356	406
85°	93	91	88	82	79	104
90°	2	21	57	53	55	11
95°	84	100	103	103	100	94
105°	348	352	356	359	359	367
115°	647	656	653	652	647	640
125°	941	956	951	946	944	841
135°	1217	1235	1239	1237	1232	941
145°	1478	1489	1499	1500	1494	923
155°	1690	1694	1700	1708	1702	778
165°	1838	1836	1836	1848	1840	519
175°	1913	1908	1905	1916	1906	182
180°	1916	1916	1916	1916	1916	

TEST NUMBER: P909906

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2357.6	2357.6	2357.6	2357.6	2357.6
2.5°	2371.4	2360.1	2335.0	2357.6	2353.3
5°	2357.6	2348.7	2323.7	2341.8	2337.4
7.5°	2341.8	2328.3	2303.3	2321.6	2317.0
10°	2317.0	2301.2	2273.9	2292.0	2285.2
12.5°	2282.9	2269.4	2242.2	2253.5	2249.0
15°	2244.3	2230.9	2201.3	2210.5	2199.2
17.5°	2196.8	2183.3	2153.7	2164.9	2153.7
20°	2144.6	2131.1	2099.3	2106.1	2097.2
22.5°	2092.6	2072.1	2042.6	2042.6	2038.0
25°	2031.2	2013.3	1974.7	1979.0	1974.7
27.5°	1963.2	1947.3	1917.9	1911.3	1900.0
30°	1895.4	1877.0	1843.2	1836.4	1827.3
32.5°	1822.7	1809.3	1772.9	1759.2	1750.1
35°	1752.5	1729.9	1693.5	1679.8	1668.5
37.5°	1673.1	1652.6	1616.4	1600.4	1589.1
40°	1591.5	1573.3	1537.0	1516.8	1507.6
42.5°	1512.2	1493.9	1457.8	1435.0	1421.5
45°	1426.1	1410.2	1376.0	1351.3	1342.1
47.5°	1342.1	1326.3	1290.0	1265.0	1251.4
50°	1253.6	1242.3	1210.6	1178.8	1167.5
52.5°	1167.5	1151.7	1122.3	1097.3	1081.5
55°	1079.2	1065.5	1038.3	1011.2	999.9
57.5°	990.8	979.5	949.9	922.7	913.5
60°	902.2	893.3	861.6	836.6	829.8
62.5°	816.1	800.2	777.6	755.0	745.9
65°	727.8	714.2	691.6	671.1	659.7
67.5°	637.1	625.6	605.4	589.6	580.4
70°	553.2	544.1	523.6	507.8	498.9
72.5°	467.1	458.0	446.7	430.8	424.0
75°	380.7	376.5	364.9	351.4	356.0
77.5°	303.8	294.7	290.0	283.4	276.6
80°	226.8	224.4	219.8	213.1	208.5
82.5°	154.2	154.2	152.0	142.9	142.9
85°	92.8	90.7	88.5	81.5	79.4
87.5°	40.9	36.4	31.7	25.0	22.6
90°	1.7	20.8	56.7	53.1	54.8
92.5°	35.9	48.6	50.3	52.0	52.0
95°	84.3	100.5	103.4	103.4	100.5
97.5°	140.4	155.4	161.8	161.8	161.8
100°	205.1	218.3	223.0	223.0	221.3
102.5°	273.3	283.1	289.4	291.1	289.4
105°	347.8	352.4	355.9	358.8	358.8
107.5°	421.7	428.7	428.7	429.8	421.7
110°	493.4	502.6	502.6	502.6	498.0

TEST NUMBER: P909906

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	570.8	580.6	578.9	574.2	570.8
115°	647.0	656.3	653.4	651.7	647.0
117.5°	722.8	735.5	727.3	722.8	718.1
120°	799.0	811.7	799.0	799.0	793.8
122.5°	868.3	884.4	876.4	871.8	868.3
125°	941.1	955.5	950.9	945.7	944.0
127.5°	1012.2	1030.1	1023.7	1016.8	1012.2
130°	1078.6	1099.4	1096.5	1093.1	1086.7
132.5°	1153.2	1169.3	1170.4	1162.4	1157.7
135°	1217.3	1235.2	1238.6	1236.9	1232.2
137.5°	1288.9	1303.3	1306.3	1305.0	1298.2
140°	1351.9	1366.3	1374.4	1374.4	1368.1
142.5°	1416.5	1431.0	1435.6	1437.3	1431.0
145°	1477.8	1489.3	1498.6	1500.4	1494.0
147.5°	1532.7	1547.1	1554.1	1556.9	1550.5
150°	1589.3	1599.1	1605.5	1610.6	1605.5
152.5°	1639.5	1649.4	1657.5	1663.9	1657.5
155°	1689.8	1694.5	1699.6	1707.8	1702.5
157.5°	1733.1	1736.7	1739.5	1751.1	1743.0
160°	1771.9	1775.3	1777.1	1786.9	1780.0
162.5°	1807.7	1807.7	1809.4	1820.4	1812.3
165°	1838.3	1836.5	1836.5	1848.2	1840.1
167.5°	1866.0	1860.9	1860.9	1872.4	1864.3
170°	1886.8	1882.2	1880.5	1892.0	1882.2
172.5°	1901.3	1896.6	1894.9	1906.4	1896.6
175°	1912.8	1908.2	1904.7	1916.3	1906.4
177.5°	1919.1	1914.6	1911.1	1920.9	1911.1
180°	1916.3	1916.3	1916.3	1916.3	1916.3

TEST NUMBER: P909906

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.22	12.11	12.16	13.06	14.29	10.79	11.68	11.73	12.63	13.86
	3H	12.88	13.67	13.82	14.63	15.88	12.41	13.20	13.35	14.16	15.42
	4H	13.46	14.21	14.42	15.18	16.44	12.99	13.74	13.95	14.71	15.97
	6H	13.85	14.55	14.82	15.52	16.79	13.38	14.08	14.35	15.05	16.32
	8H	13.95	14.62	14.93	15.60	16.87	13.49	14.15	14.46	15.13	16.41
	12H	14.00	14.63	14.98	15.61	16.91	13.53	14.16	14.51	15.14	16.43
4H	2H	11.68	12.44	12.65	13.40	14.66	11.34	12.10	12.31	13.06	14.32
	3H	13.54	14.17	14.52	15.16	16.44	13.15	13.78	14.13	14.77	16.05
	4H	14.25	14.82	15.23	15.81	17.11	13.85	14.42	14.83	15.41	16.71
	6H	14.76	15.25	15.75	16.26	17.56	14.35	14.85	15.35	15.86	17.16
	8H	14.90	15.37	15.90	16.37	17.68	14.50	14.96	15.49	15.96	17.28
	12H	14.97	15.39	15.99	16.41	17.73	14.56	14.98	15.57	16.00	17.31
8H	4H	14.44	14.91	15.44	15.91	17.22	14.09	14.55	15.08	15.55	16.87
	6H	15.07	15.45	16.09	16.49	17.81	14.71	15.09	15.73	16.14	17.45
	8H	15.28	15.62	16.31	16.65	17.98	14.92	15.25	15.95	16.29	17.62
	12H	15.41	15.70	16.44	16.73	18.10	15.03	15.33	16.06	16.35	17.73
12H	4H	14.43	14.85	15.45	15.87	17.19	14.08	14.50	15.10	15.52	16.84
	6H	15.09	15.43	16.12	16.46	17.79	14.75	15.08	15.78	16.12	17.45
	8H	15.33	15.63	16.36	16.65	18.03	14.98	15.27	16.01	16.30	17.67

END OF REPORT