

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909909

Luminaire Tested: DFN2DIP-TR3F0-060D060US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909909
REPORT IS A COMBINATION OF REPORTS P901840 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-060D060US840-RLLONL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11148.9 lumens
Efficiency: N/A
Efficacy: 108.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 102.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909909

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US840-RLLONL

Luminous Intensity Polar Plot

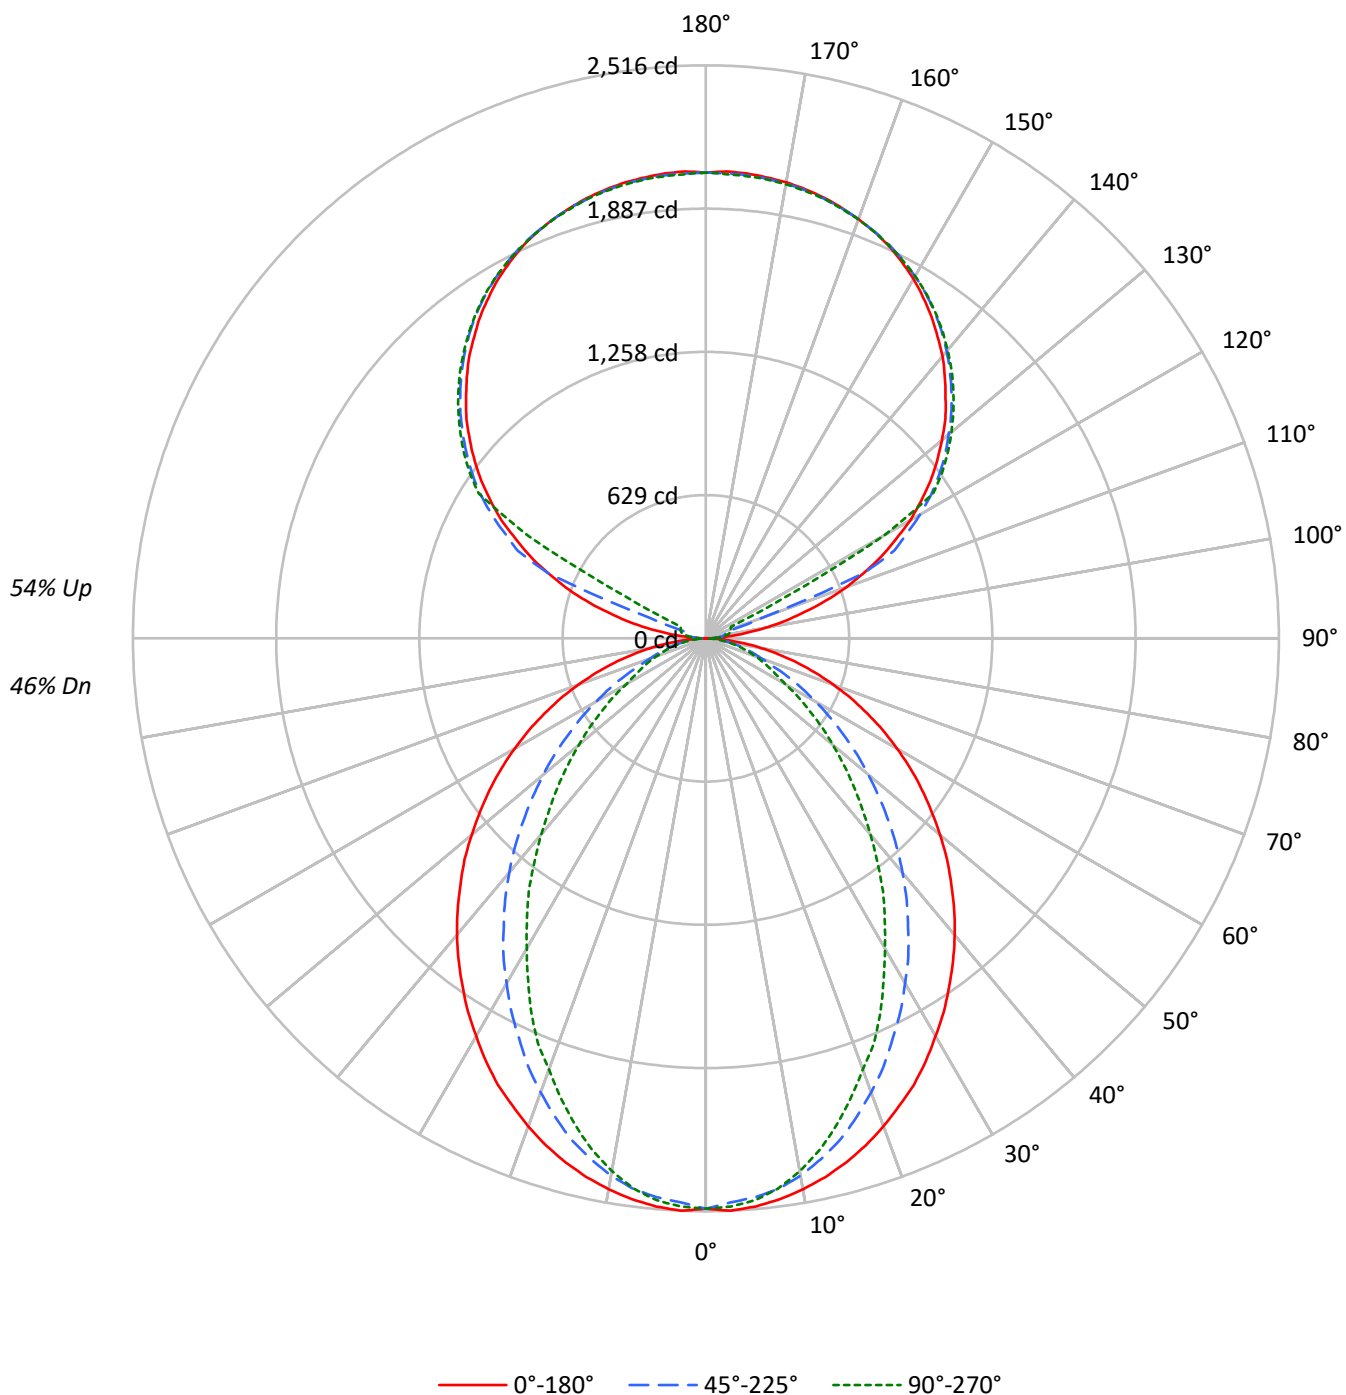

TEST NUMBER: P909909

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3121	3121	3121
5°	3124	3068	3089
10°	3091	3006	2986
15°	3047	2904	2829
20°	2989	2764	2637
25°	2929	2609	2451
30°	2850	2449	2216
35°	2773	2278	2010
40°	2693	2101	1774
45°	2602	1905	1560
50°	2506	1708	1352
55°	2407	1497	1151
60°	2292	1277	945
65°	2159	1054	849
70°	1998	845	765
75°	1796	740	692
80°	1502	612	593
85°	1023	396	434

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2602 cd/sqm

TEST NUMBER: P909909

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US840-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	234.7	2.1
10°-20°	644.3	5.8
20°-30°	904.6	8.1
30°-40°	986.1	8.8
40°-50°	906.3	8.1
50°-60°	711.7	6.4
60°-70°	463.3	4.2
70°-80°	238.5	2.1
80°-90°	64.5	0.6
90°-100°	67.4	0.6
100°-110°	251.4	2.3
110°-120°	666.7	6.0
120°-130°	1105.7	9.9
130°-140°	1174.5	10.5
140°-150°	1091.6	9.8
150°-160°	877.6	7.9
160°-170°	565.5	5.1
170°-180°	194.6	1.7
0°-30°	1783.6	16.0
0°-40°	2769.6	24.8
0°-60°	4387.7	39.4
0°-90°	5153.9	46.2
90°-120°	985.5	8.8
90°-150°	4357.2	39.1
90°-180°	5995.0	53.8
0°-180°	11148.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2504	2504	2504	2504	2504	
5°	2504	2493	2463	2484	2477	237
15°	2382	2357	2280	2237	2214	671
25°	2162	2090	1940	1847	1813	994
35°	1863	1747	1548	1405	1355	1166
45°	1523	1371	1133	972	918	1176
55°	1158	981	736	601	558	1035
65°	782	598	394	317	310	775
75°	417	258	181	165	163	441
85°	97	50	43	43	43	112
90°	1	18	30	37	40	10
95°	96	47	58	65	64	114
105°	450	494	90	106	112	481
115°	851	876	913	228	121	838
125°	1203	1222	1250	1261	1265	1073
135°	1489	1512	1526	1540	1537	1150
145°	1727	1725	1750	1761	1753	1080
155°	1901	1888	1906	1915	1903	876
165°	2004	1995	1999	2009	1999	566
175°	2049	2039	2042	2052	2038	195
180°	2045	2045	2045	2045	2045	

TEST NUMBER: P909909

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2504.3	2504.3	2504.3	2504.3	2504.3
2.5°	2515.6	2504.3	2479.2	2502.0	2497.5
5°	2504.3	2493.0	2463.4	2483.9	2477.1
7.5°	2483.9	2470.3	2438.6	2447.5	2436.2
10°	2456.6	2440.7	2395.6	2388.6	2375.1
12.5°	2422.8	2402.3	2341.0	2327.5	2302.5
15°	2381.9	2356.8	2279.9	2236.9	2214.2
17.5°	2334.3	2297.9	2202.7	2152.9	2116.7
20°	2279.9	2234.4	2121.2	2064.7	2014.7
22.5°	2221.0	2168.8	2037.3	1960.4	1926.4
25°	2162.1	2089.5	1940.0	1847.1	1813.0
27.5°	2091.9	2014.7	1849.3	1742.7	1690.6
30°	2017.1	1930.8	1749.5	1634.1	1572.8
32.5°	1944.5	1840.2	1654.6	1518.4	1461.7
35°	1863.0	1747.4	1548.0	1405.1	1355.1
37.5°	1783.6	1658.8	1448.2	1291.7	1235.2
40°	1699.7	1563.9	1343.8	1183.0	1124.1
42.5°	1613.7	1468.6	1239.7	1071.9	1015.4
45°	1523.0	1371.0	1133.3	972.1	917.8
47.5°	1436.9	1276.1	1031.3	870.2	820.4
50°	1341.7	1180.8	931.5	775.0	727.6
52.5°	1248.6	1078.6	836.3	686.7	643.7
55°	1158.0	981.3	736.5	600.7	557.5
57.5°	1065.2	883.8	648.2	521.3	484.9
60°	970.0	788.7	555.2	439.8	403.4
62.5°	877.2	695.9	475.8	367.2	349.1
65°	781.9	598.2	394.4	317.4	310.4
67.5°	691.3	507.6	317.4	278.7	272.0
70°	596.0	419.3	262.8	240.2	231.1
72.5°	505.4	337.6	219.7	201.8	197.1
75°	417.0	258.2	181.3	165.4	163.3
77.5°	328.7	183.5	142.8	133.7	129.2
80°	246.9	131.5	108.7	99.8	99.8
82.5°	172.2	88.5	74.7	70.2	70.2
85°	97.4	49.8	43.0	43.0	43.0
87.5°	36.4	18.1	18.1	15.9	15.9
90°	1.4	17.8	29.5	37.1	39.9
92.5°	37.1	31.1	35.4	38.5	39.9
95°	96.1	47.3	57.7	65.2	63.6
97.5°	173.1	51.8	75.3	80.0	81.4
100°	262.0	59.2	84.3	96.1	99.1
102.5°	359.5	356.7	87.4	103.5	108.1
105°	449.8	494.2	90.3	106.4	112.5
107.5°	554.9	591.8	93.3	109.5	115.4
110°	655.6	686.5	259.0	111.1	116.8

TEST NUMBER: P909909

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	750.2	776.8	751.6	113.8	118.5
115°	850.8	876.0	913.0	227.9	121.4
117.5°	938.1	967.7	992.9	781.2	393.5
120°	1035.8	1057.9	1084.7	1102.4	902.6
122.5°	1118.5	1142.3	1171.9	1180.7	1182.4
125°	1203.0	1222.2	1250.3	1260.7	1265.1
127.5°	1279.9	1300.6	1322.9	1337.7	1339.1
130°	1352.4	1376.1	1392.3	1408.7	1407.2
132.5°	1426.4	1445.7	1461.9	1475.2	1473.8
135°	1488.6	1512.4	1525.5	1540.4	1537.4
137.5°	1553.6	1571.4	1586.3	1601.0	1596.7
140°	1617.2	1629.2	1645.4	1658.7	1651.3
142.5°	1670.6	1681.0	1700.2	1711.9	1704.6
145°	1726.9	1725.3	1750.4	1760.8	1753.4
147.5°	1775.5	1771.1	1796.2	1803.6	1797.9
150°	1823.0	1812.6	1836.3	1845.1	1837.8
152.5°	1862.9	1851.1	1873.2	1882.2	1871.8
155°	1901.4	1888.1	1905.9	1914.7	1902.9
157.5°	1932.5	1920.7	1934.0	1944.4	1932.5
160°	1959.1	1950.2	1959.1	1967.9	1957.6
162.5°	1982.7	1973.9	1981.3	1991.7	1978.3
165°	2003.5	1994.7	1999.0	2009.4	1999.0
167.5°	2019.7	2010.8	2015.4	2025.8	2012.4
170°	2033.2	2024.2	2027.2	2037.5	2024.2
172.5°	2041.9	2033.2	2036.1	2046.5	2033.2
175°	2049.3	2038.9	2041.9	2052.2	2037.5
177.5°	2052.2	2041.9	2043.5	2053.9	2040.5
180°	2044.9	2044.9	2044.9	2044.9	2044.9

TEST NUMBER: P909909

CATALOG NUMBER: DFN2DIP-TR3F0-060D060US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.69	11.49	11.68	12.49	13.82	6.66	7.46	7.66	8.47	9.79
	3H	12.35	13.07	13.36	14.08	15.43	7.84	8.56	8.85	9.57	10.92
	4H	12.95	13.63	13.97	14.64	16.00	8.29	8.97	9.31	9.98	11.34
	6H	13.37	13.99	14.39	15.01	16.37	8.60	9.23	9.63	10.25	11.61
	8H	13.49	14.08	14.52	15.11	16.48	8.69	9.28	9.73	10.32	11.68
	12H	13.54	14.11	14.58	15.14	16.52	8.73	9.29	9.77	10.32	11.71
4H	2H	10.70	11.38	11.72	12.39	13.75	7.25	7.93	8.27	8.94	10.30
	3H	12.52	13.08	13.55	14.12	15.49	8.59	9.15	9.62	10.20	11.57
	4H	13.20	13.71	14.24	14.75	16.14	9.13	9.65	10.17	10.68	12.07
	6H	13.70	14.15	14.75	15.20	16.59	9.54	9.99	10.59	11.04	12.43
	8H	13.87	14.29	14.92	15.34	16.74	9.67	10.08	10.72	11.13	12.53
	12H	13.96	14.33	15.03	15.40	16.81	9.73	10.10	10.80	11.17	12.57
8H	4H	13.16	13.58	14.21	14.63	16.03	9.40	9.82	10.46	10.87	12.27
	6H	13.72	14.06	14.79	15.15	16.55	9.91	10.25	10.99	11.35	12.75
	8H	13.93	14.23	15.01	15.30	16.72	10.10	10.40	11.18	11.48	12.90
	12H	14.06	14.32	15.14	15.39	16.85	10.21	10.48	11.30	11.55	13.01
12H	4H	13.11	13.49	14.18	14.55	15.96	9.41	9.78	10.48	10.84	12.25
	6H	13.69	13.99	14.77	15.07	16.49	9.96	10.26	11.04	11.34	12.76
	8H	13.91	14.17	14.99	15.24	16.70	10.16	10.43	11.25	11.50	12.96

END OF REPORT