

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909925

Luminaire Tested: DFN2DIP-TR3F0-070D040US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909925
REPORT IS A COMBINATION OF REPORTS P901813 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-070D040US840-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10997.4 lumens
Efficiency: N/A
Efficacy: 110.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 99.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909925

CATALOG NUMBER: DFN2DIP-TR3F0-070D040US840-FLLONL

Luminous Intensity Polar Plot

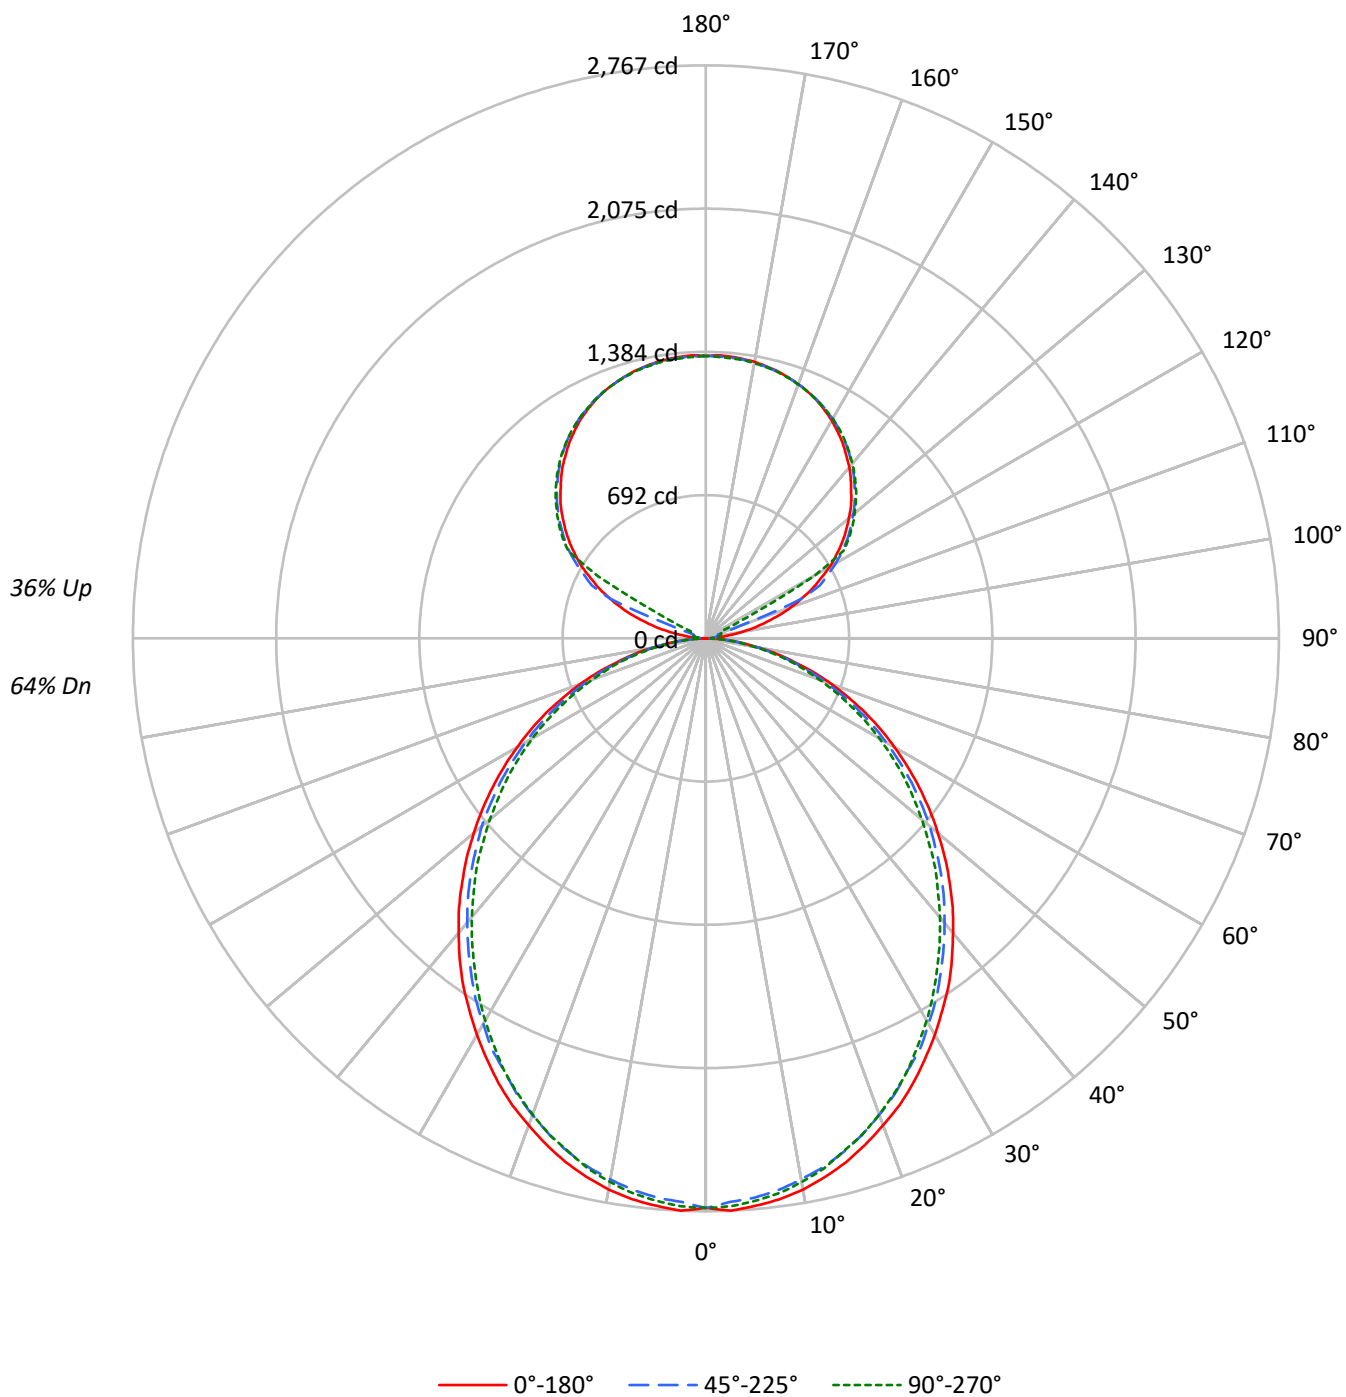

TEST NUMBER: P909925

CATALOG NUMBER: DFN2DIP-TR3F0-070D040US840-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	110	110	110	110	104	104	104	104	91	91	91		79	79	79		69
1	101	96	92	89	94	91	87	84	80	77	75		70	68	66		61
2	92	84	78	73	86	79	74	69	70	66	62		61	58	55		53
3	84	74	67	61	78	70	63	58	62	57	52		54	50	47		47
4	77	66	58	51	72	62	55	49	55	49	45		48	44	40		42
5	71	59	50	44	66	55	48	42	49	43	39		44	39	35		38
6	65	53	44	38	61	50	42	37	44	38	34		39	34	31		35
7	60	48	39	34	56	45	38	32	40	34	30		36	31	27		32
8	56	43	35	30	52	41	34	29	37	31	27		33	28	24		29
9	52	40	32	27	49	38	31	26	34	28	24		30	25	22		27
10	49	36	29	24	46	35	28	23	31	26	22		28	23	20		25

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3428	3428	3428
5°	3431	3377	3400
10°	3401	3328	3352
15°	3350	3271	3278
20°	3280	3192	3202
25°	3211	3098	3115
30°	3125	3010	3004
35°	3043	2907	2887
40°	2942	2803	2776
45°	2842	2699	2662
50°	2732	2589	2530
55°	2617	2462	2408
60°	2487	2312	2269
65°	2345	2156	2104
70°	2163	1965	1927
75°	1913	1737	1760
80°	1610	1445	1446
85°	1138	952	934

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2842 cd/sqm

TEST NUMBER: P909925

CATALOG NUMBER: DFN2DIP-TR3F0-070D040US840-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	258.9	2.4
10°-20°	728.4	6.6
20°-30°	1070.5	9.7
30°-40°	1243.3	11.3
40°-50°	1241.7	11.3
50°-60°	1082.8	9.8
60°-70°	800.4	7.3
70°-80°	452.9	4.1
80°-90°	121.9	1.1
90°-100°	44.9	0.4
100°-110°	167.6	1.5
110°-120°	444.4	4.0
120°-130°	737.1	6.7
130°-140°	783.0	7.1
140°-150°	727.7	6.6
150°-160°	585.1	5.3
160°-170°	377.0	3.4
170°-180°	129.8	1.2
0°-30°	2057.8	18.7
0°-40°	3301.1	30.0
0°-60°	5625.6	51.2
0°-90°	7000.8	63.7
90°-120°	656.9	6.0
90°-150°	2904.8	26.4
90°-180°	3997.0	36.3
0°-180°	10997.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2751	2751	2751	2751	2751	
5°	2751	2740	2711	2732	2727	261
15°	2618	2603	2568	2579	2566	737
25°	2370	2349	2304	2309	2304	1090
35°	2045	2018	1976	1960	1947	1277
45°	1664	1645	1605	1576	1566	1284
55°	1259	1243	1211	1180	1166	1126
65°	849	833	807	783	770	840
75°	444	439	426	410	415	474
85°	108	106	103	95	93	121
90°	1	12	20	25	27	10
95°	64	32	38	43	42	76
105°	300	330	60	71	75	320
115°	567	584	609	152	81	558
125°	802	815	834	840	843	715
135°	992	1008	1017	1027	1025	767
145°	1151	1150	1167	1174	1169	720
155°	1268	1259	1271	1276	1269	584
165°	1336	1330	1333	1340	1333	377
175°	1366	1359	1361	1368	1358	130
180°	1363	1363	1363	1363	1363	

TEST NUMBER: P909925

CATALOG NUMBER: DFN2DIP-TR3F0-070D040US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2750.6	2750.6	2750.6	2750.6	2750.6
2.5°	2766.6	2753.4	2724.2	2750.6	2745.5
5°	2750.6	2740.3	2711.1	2732.1	2727.0
7.5°	2732.1	2716.3	2687.2	2708.6	2703.2
10°	2703.2	2684.6	2652.9	2674.0	2666.1
12.5°	2663.3	2647.7	2616.0	2629.1	2623.7
15°	2618.5	2602.7	2568.2	2578.9	2565.7
17.5°	2562.8	2547.2	2512.6	2525.9	2512.6
20°	2501.9	2486.3	2449.2	2457.1	2446.7
22.5°	2441.3	2417.5	2383.0	2383.0	2377.6
25°	2369.9	2348.7	2303.9	2309.0	2303.9
27.5°	2290.4	2271.9	2237.7	2229.8	2216.6
30°	2211.3	2189.9	2150.4	2142.5	2131.8
32.5°	2126.5	2110.8	2068.4	2052.5	2041.7
35°	2044.6	2018.2	1975.8	1959.8	1946.6
37.5°	1952.0	1928.1	1885.7	1867.2	1854.0
40°	1856.8	1835.5	1793.1	1769.6	1758.9
42.5°	1764.2	1742.9	1700.8	1674.2	1658.4
45°	1663.8	1645.3	1605.4	1576.5	1565.8
47.5°	1565.8	1547.3	1504.9	1475.7	1460.1
50°	1462.6	1449.4	1412.3	1375.3	1362.1
52.5°	1362.1	1343.6	1309.4	1280.2	1261.6
55°	1259.1	1243.1	1211.4	1179.7	1166.5
57.5°	1155.9	1142.7	1108.1	1076.4	1065.8
60°	1052.6	1042.2	1005.2	976.0	968.2
62.5°	952.1	933.6	907.3	880.9	870.2
65°	849.2	833.1	806.8	782.9	769.7
67.5°	743.4	729.9	706.3	687.8	677.1
70°	645.4	634.8	610.9	592.4	582.0
72.5°	544.9	534.3	521.1	502.6	494.7
75°	444.2	439.2	425.7	410.0	415.4
77.5°	354.5	343.8	338.4	330.5	322.8
80°	264.6	261.9	256.5	248.6	243.3
82.5°	179.9	179.9	177.3	166.7	166.7
85°	108.4	105.8	103.3	95.1	92.6
87.5°	47.7	42.4	37.1	29.2	26.4
90°	0.9	11.8	19.7	24.7	26.6
92.5°	24.7	20.7	23.6	25.7	26.6
95°	64.0	31.5	38.4	43.4	42.4
97.5°	115.4	34.5	50.3	53.3	54.2
100°	174.6	39.5	56.2	64.0	66.0
102.5°	239.6	237.8	58.2	69.0	72.0
105°	299.8	329.5	60.2	71.0	74.9
107.5°	369.9	394.6	62.2	73.0	77.0
110°	437.1	457.7	172.7	74.0	77.9

TEST NUMBER: P909925

CATALOG NUMBER: DFN2DIP-TR3F0-070D040US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	500.2	517.9	501.1	75.9	79.0
115°	567.1	583.9	608.6	151.9	81.0
117.5°	625.4	645.1	662.0	520.8	262.4
120°	690.5	705.3	723.1	735.0	601.8
122.5°	745.7	761.5	781.3	787.2	788.2
125°	801.9	814.9	833.5	840.5	843.4
127.5°	853.2	867.1	881.9	891.8	892.7
130°	901.6	917.5	928.2	939.1	938.2
132.5°	950.9	963.8	974.6	983.5	982.6
135°	992.4	1008.2	1017.0	1026.9	1025.0
137.5°	1035.7	1047.5	1057.5	1067.3	1064.4
140°	1078.1	1086.1	1096.9	1105.8	1100.9
142.5°	1113.8	1120.6	1133.5	1141.2	1136.4
145°	1151.2	1150.2	1166.9	1173.9	1168.9
147.5°	1183.7	1180.7	1197.5	1202.4	1198.6
150°	1215.3	1208.4	1224.3	1230.1	1225.2
152.5°	1241.9	1234.1	1248.8	1254.8	1247.9
155°	1267.6	1258.8	1270.6	1276.5	1268.6
157.5°	1288.3	1280.4	1289.4	1296.3	1288.3
160°	1306.1	1300.1	1306.1	1311.9	1305.0
162.5°	1321.8	1316.0	1320.9	1327.8	1318.9
165°	1335.6	1329.8	1332.7	1339.6	1332.7
167.5°	1346.6	1340.5	1343.6	1350.5	1341.6
170°	1355.4	1349.5	1351.4	1358.4	1349.5
172.5°	1361.3	1355.4	1357.5	1364.3	1355.4
175°	1366.1	1359.3	1361.3	1368.2	1358.4
177.5°	1368.2	1361.3	1362.3	1369.3	1360.4
180°	1363.3	1363.3	1363.3	1363.3	1363.3

TEST NUMBER: P909925

CATALOG NUMBER: DFN2DIP-TR3F0-070D040US840-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.67	13.67	13.50	14.53	15.59	12.24	13.24	13.07	14.10	15.16
	3H	14.33	15.23	15.18	16.09	17.18	13.87	14.76	14.71	15.63	16.71
	4H	14.92	15.77	15.78	16.64	17.74	14.45	15.30	15.31	16.17	17.27
	6H	15.32	16.10	16.19	16.98	18.09	14.85	15.63	15.72	16.51	17.62
	8H	15.43	16.17	16.31	17.07	18.18	14.96	15.70	15.84	16.60	17.71
	12H	15.48	16.19	16.36	17.07	18.21	15.00	15.71	15.89	16.60	17.74
4H	2H	13.15	14.00	14.01	14.86	15.96	12.81	13.65	13.67	14.52	15.62
	3H	15.02	15.72	15.89	16.62	17.74	14.63	15.33	15.50	16.23	17.35
	4H	15.73	16.37	16.62	17.27	18.41	15.33	15.97	16.21	16.87	18.01
	6H	16.24	16.80	17.14	17.72	18.87	15.84	16.40	16.74	17.32	18.46
	8H	16.39	16.91	17.30	17.83	18.99	15.98	16.50	16.89	17.42	18.58
	12H	16.47	16.94	17.39	17.87	19.03	16.05	16.52	16.98	17.46	18.62
8H	4H	15.93	16.45	16.84	17.37	18.53	15.57	16.10	16.48	17.01	18.17
	6H	16.56	16.99	17.49	17.95	19.10	16.20	16.63	17.13	17.59	18.75
	8H	16.77	17.16	17.72	18.11	19.28	16.41	16.79	17.35	17.74	18.92
	12H	16.91	17.24	17.85	18.18	19.41	16.53	16.86	17.47	17.81	19.03
12H	4H	15.92	16.39	16.85	17.33	18.49	15.57	16.04	16.50	16.98	18.14
	6H	16.59	16.97	17.53	17.92	19.09	16.24	16.62	17.18	17.57	18.75
	8H	16.83	17.17	17.77	18.11	19.33	16.48	16.81	17.42	17.75	18.98