

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909933

Luminaire Tested: DFN2DIP-TR3F0-070D060US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909933
REPORT IS A COMBINATION OF REPORTS P901841 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-070D060US840-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12997.0 lumens
Efficiency: N/A
Efficacy: 112.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 115.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909933

CATALOG NUMBER: DFN2DIP-TR3F0-070D060US840-FLLONL

Luminous Intensity Polar Plot

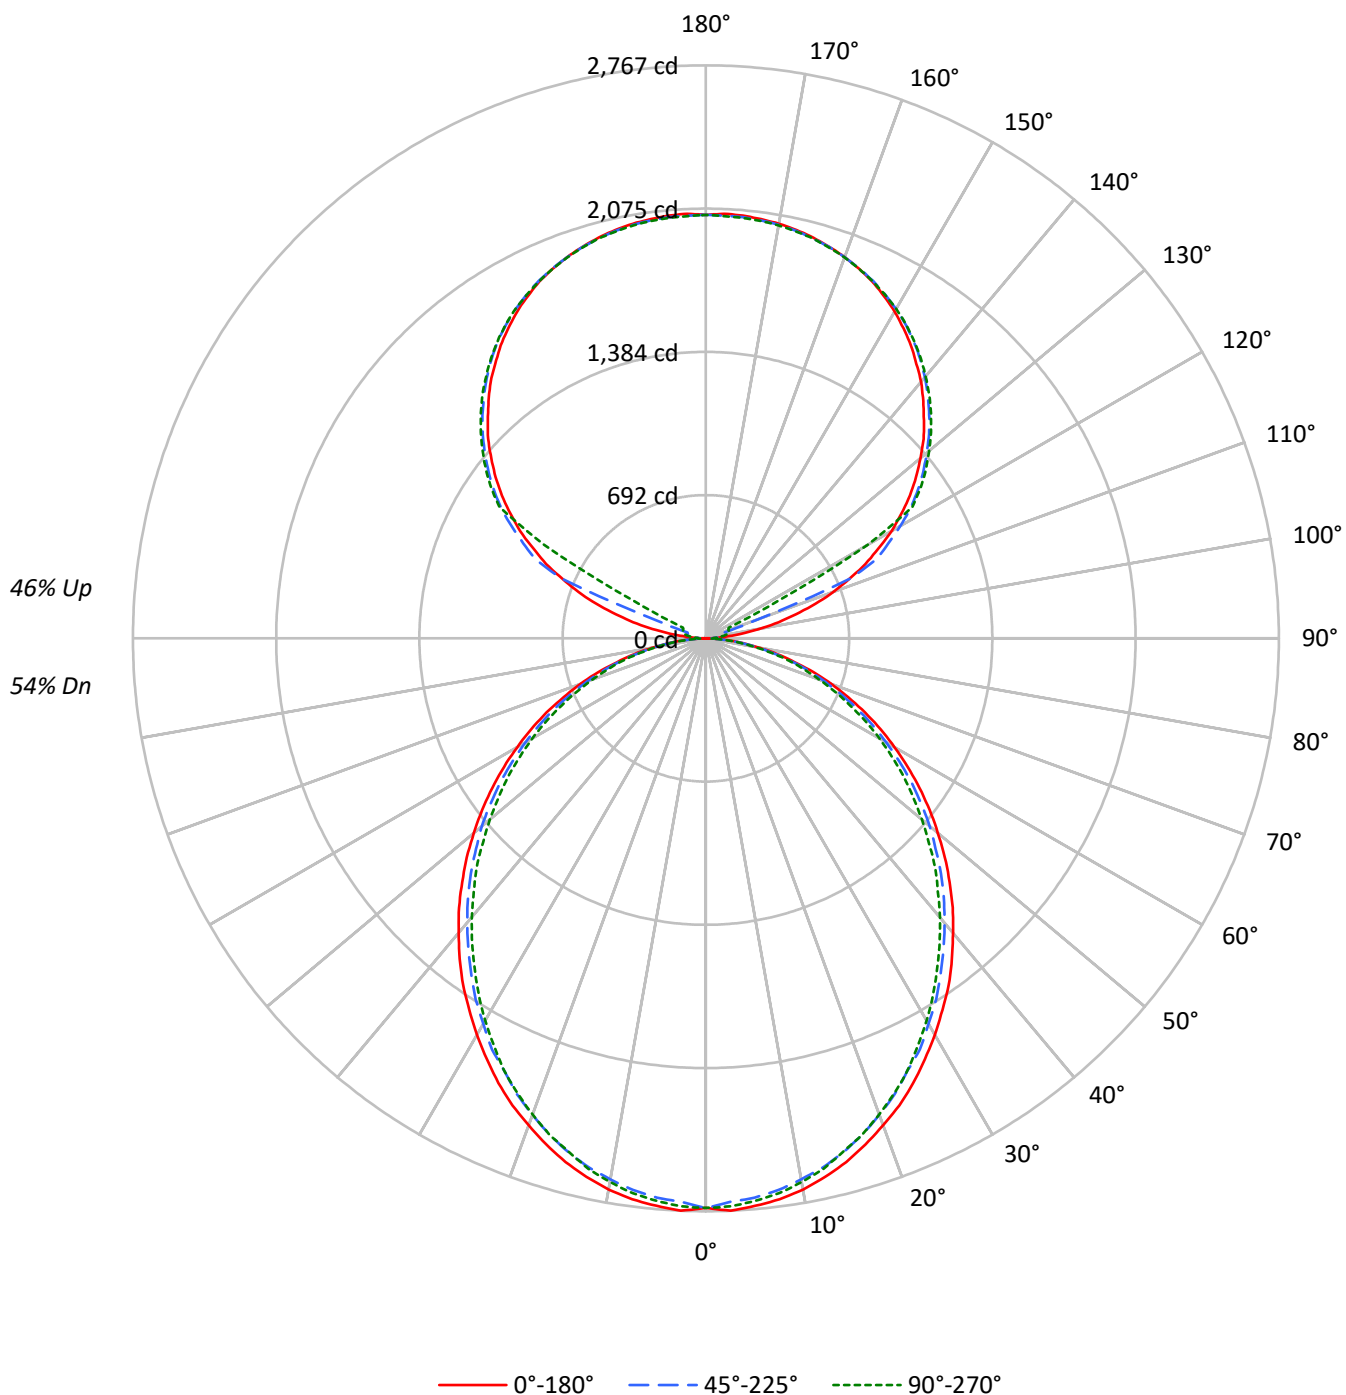

TEST NUMBER: P909933

CATALOG NUMBER: DFN2DIP-TR3F0-070D060US840-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	60	60	60
1	99	94	90	87	91	88	84	81	75	73	70	63	62	60	53	52	50
2	90	82	76	71	83	77	71	67	66	62	58	56	53	50	46	44	42
3	82	72	65	59	76	67	61	56	58	53	49	49	46	42	41	38	36
4	75	64	56	50	69	60	53	47	52	46	42	44	40	36	37	34	31
5	69	57	49	43	64	53	46	41	46	40	36	39	35	32	33	30	27
6	63	51	43	37	59	48	41	35	42	36	31	36	31	28	30	27	24
7	59	46	38	33	54	43	36	31	38	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	28	34	29	25	30	25	22	25	22	19
9	51	38	31	26	47	36	29	25	32	26	22	27	23	20	23	20	17
10	47	35	28	23	44	33	27	22	29	24	20	25	21	18	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3428	3428	3428
5°	3431	3377	3400
10°	3401	3328	3352
15°	3350	3271	3278
20°	3280	3192	3202
25°	3211	3098	3115
30°	3125	3010	3004
35°	3043	2907	2887
40°	2942	2803	2776
45°	2842	2699	2662
50°	2732	2589	2530
55°	2617	2462	2408
60°	2487	2312	2269
65°	2345	2156	2104
70°	2163	1965	1927
75°	1913	1737	1760
80°	1610	1445	1446
85°	1138	952	934

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2842 cd/sqm

TEST NUMBER: P909933

CATALOG NUMBER: DFN2DIP-TR3F0-070D060US840-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	258.9	2.0
10°-20°	728.4	5.6
20°-30°	1070.5	8.2
30°-40°	1243.3	9.6
40°-50°	1241.7	9.6
50°-60°	1082.8	8.3
60°-70°	800.4	6.2
70°-80°	452.9	3.5
80°-90°	123.1	0.9
90°-100°	67.4	0.5
100°-110°	251.4	1.9
110°-120°	666.7	5.1
120°-130°	1105.7	8.5
130°-140°	1174.5	9.0
140°-150°	1091.6	8.4
150°-160°	877.6	6.8
160°-170°	565.5	4.4
170°-180°	194.6	1.5
0°-30°	2057.8	15.8
0°-40°	3301.1	25.4
0°-60°	5625.6	43.3
0°-90°	7002.0	53.9
90°-120°	985.5	7.6
90°-150°	4357.2	33.5
90°-180°	5995.0	46.1
0°-180°	12997.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2751	2751	2751	2751	2751	
5°	2751	2740	2711	2732	2727	261
15°	2618	2603	2568	2579	2566	737
25°	2370	2349	2304	2309	2304	1090
35°	2045	2018	1976	1960	1947	1277
45°	1664	1645	1605	1576	1566	1284
55°	1259	1243	1211	1180	1166	1126
65°	849	833	807	783	770	840
75°	444	439	426	410	415	474
85°	108	106	103	95	93	121
90°	1	18	30	37	40	12
95°	96	47	58	65	64	114
105°	450	494	90	106	112	481
115°	851	876	913	228	121	838
125°	1203	1222	1250	1261	1265	1073
135°	1489	1512	1526	1540	1537	1150
145°	1727	1725	1750	1761	1753	1080
155°	1901	1888	1906	1915	1903	876
165°	2004	1995	1999	2009	1999	566
175°	2049	2039	2042	2052	2038	195
180°	2045	2045	2045	2045	2045	

TEST NUMBER: P909933

CATALOG NUMBER: DFN2DIP-TR3F0-070D060US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2750.6	2750.6	2750.6	2750.6	2750.6
2.5°	2766.6	2753.4	2724.2	2750.6	2745.5
5°	2750.6	2740.3	2711.1	2732.1	2727.0
7.5°	2732.1	2716.3	2687.2	2708.6	2703.2
10°	2703.2	2684.6	2652.9	2674.0	2666.1
12.5°	2663.3	2647.7	2616.0	2629.1	2623.7
15°	2618.5	2602.7	2568.2	2578.9	2565.7
17.5°	2562.8	2547.2	2512.6	2525.9	2512.6
20°	2501.9	2486.3	2449.2	2457.1	2446.7
22.5°	2441.3	2417.5	2383.0	2383.0	2377.6
25°	2369.9	2348.7	2303.9	2309.0	2303.9
27.5°	2290.4	2271.9	2237.7	2229.8	2216.6
30°	2211.3	2189.9	2150.4	2142.5	2131.8
32.5°	2126.5	2110.8	2068.4	2052.5	2041.7
35°	2044.6	2018.2	1975.8	1959.8	1946.6
37.5°	1952.0	1928.1	1885.7	1867.2	1854.0
40°	1856.8	1835.5	1793.1	1769.6	1758.9
42.5°	1764.2	1742.9	1700.8	1674.2	1658.4
45°	1663.8	1645.3	1605.4	1576.5	1565.8
47.5°	1565.8	1547.3	1504.9	1475.7	1460.1
50°	1462.6	1449.4	1412.3	1375.3	1362.1
52.5°	1362.1	1343.6	1309.4	1280.2	1261.6
55°	1259.1	1243.1	1211.4	1179.7	1166.5
57.5°	1155.9	1142.7	1108.1	1076.4	1065.8
60°	1052.6	1042.2	1005.2	976.0	968.2
62.5°	952.1	933.6	907.3	880.9	870.2
65°	849.2	833.1	806.8	782.9	769.7
67.5°	743.4	729.9	706.3	687.8	677.1
70°	645.4	634.8	610.9	592.4	582.0
72.5°	544.9	534.3	521.1	502.6	494.7
75°	444.2	439.2	425.7	410.0	415.4
77.5°	354.5	343.8	338.4	330.5	322.8
80°	264.6	261.9	256.5	248.6	243.3
82.5°	179.9	179.9	177.3	166.7	166.7
85°	108.4	105.8	103.3	95.1	92.6
87.5°	47.7	42.4	37.1	29.2	26.4
90°	1.4	17.8	29.5	37.1	39.9
92.5°	37.1	31.1	35.4	38.5	39.9
95°	96.1	47.3	57.7	65.2	63.6
97.5°	173.1	51.8	75.3	80.0	81.4
100°	262.0	59.2	84.3	96.1	99.1
102.5°	359.5	356.7	87.4	103.5	108.1
105°	449.8	494.2	90.3	106.4	112.5
107.5°	554.9	591.8	93.3	109.5	115.4
110°	655.6	686.5	259.0	111.1	116.8

TEST NUMBER: P909933

CATALOG NUMBER: DFN2DIP-TR3F0-070D060US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	750.2	776.8	751.6	113.8	118.5
115°	850.8	876.0	913.0	227.9	121.4
117.5°	938.1	967.7	992.9	781.2	393.5
120°	1035.8	1057.9	1084.7	1102.4	902.6
122.5°	1118.5	1142.3	1171.9	1180.7	1182.4
125°	1203.0	1222.2	1250.3	1260.7	1265.1
127.5°	1279.9	1300.6	1322.9	1337.7	1339.1
130°	1352.4	1376.1	1392.3	1408.7	1407.2
132.5°	1426.4	1445.7	1461.9	1475.2	1473.8
135°	1488.6	1512.4	1525.5	1540.4	1537.4
137.5°	1553.6	1571.4	1586.3	1601.0	1596.7
140°	1617.2	1629.2	1645.4	1658.7	1651.3
142.5°	1670.6	1681.0	1700.2	1711.9	1704.6
145°	1726.9	1725.3	1750.4	1760.8	1753.4
147.5°	1775.5	1771.1	1796.2	1803.6	1797.9
150°	1823.0	1812.6	1836.3	1845.1	1837.8
152.5°	1862.9	1851.1	1873.2	1882.2	1871.8
155°	1901.4	1888.1	1905.9	1914.7	1902.9
157.5°	1932.5	1920.7	1934.0	1944.4	1932.5
160°	1959.1	1950.2	1959.1	1967.9	1957.6
162.5°	1982.7	1973.9	1981.3	1991.7	1978.3
165°	2003.5	1994.7	1999.0	2009.4	1999.0
167.5°	2019.7	2010.8	2015.4	2025.8	2012.4
170°	2033.2	2024.2	2027.2	2037.5	2024.2
172.5°	2041.9	2033.2	2036.1	2046.5	2033.2
175°	2049.3	2038.9	2041.9	2052.2	2037.5
177.5°	2052.2	2041.9	2043.5	2053.9	2040.5
180°	2044.9	2044.9	2044.9	2044.9	2044.9

TEST NUMBER: P909933

CATALOG NUMBER: DFN2DIP-TR3F0-070D060US840-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.85	12.75	12.77	13.69	14.90	11.42	12.32	12.35	13.26	14.48
	3H	13.51	14.31	14.44	15.26	16.50	13.04	13.84	13.97	14.79	16.03
	4H	14.09	14.85	15.04	15.80	17.05	13.62	14.38	14.57	15.34	16.58
	6H	14.48	15.18	15.44	16.15	17.41	14.01	14.71	14.97	15.68	16.94
	8H	14.58	15.25	15.55	16.23	17.49	14.12	14.78	15.08	15.76	17.02
	12H	14.63	15.27	15.60	16.24	17.52	14.16	14.79	15.13	15.76	17.05
4H	2H	12.31	13.08	13.27	14.03	15.28	11.97	12.73	12.93	13.69	14.94
	3H	14.17	14.81	15.14	15.79	17.05	13.78	14.42	14.75	15.40	16.67
	4H	14.88	15.46	15.85	16.44	17.73	14.48	15.06	15.45	16.04	17.33
	6H	15.39	15.89	16.38	16.89	18.18	14.98	15.49	15.97	16.49	17.77
	8H	15.54	16.00	16.52	17.00	18.30	15.13	15.60	16.12	16.59	17.89
	12H	15.61	16.03	16.61	17.04	18.34	15.19	15.61	16.20	16.62	17.93
8H	4H	15.08	15.54	16.06	16.54	17.84	14.72	15.19	15.71	16.18	17.48
	6H	15.70	16.09	16.71	17.12	18.42	15.34	15.73	16.35	16.76	18.06
	8H	15.91	16.25	16.93	17.28	18.59	15.55	15.89	16.57	16.91	18.23
	12H	16.04	16.34	17.07	17.36	18.72	15.66	15.96	16.69	16.98	18.34
12H	4H	15.06	15.48	16.07	16.50	17.80	14.71	15.14	15.72	16.15	17.45
	6H	15.73	16.07	16.75	17.09	18.41	15.38	15.72	16.40	16.74	18.06
	8H	15.96	16.26	16.99	17.28	18.64	15.61	15.91	16.64	16.93	18.29