

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909949

Luminaire Tested: DFN2DIP-TR3F0-080D030US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909949
REPORT IS A COMBINATION OF REPORTS P901802 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-080D030US840-RLLONL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9866.4 lumens
Efficiency: N/A
Efficacy: 95.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 103.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909949

CATALOG NUMBER: DFN2DIP-TR3F0-080D030US840-RLLONL

Luminous Intensity Polar Plot

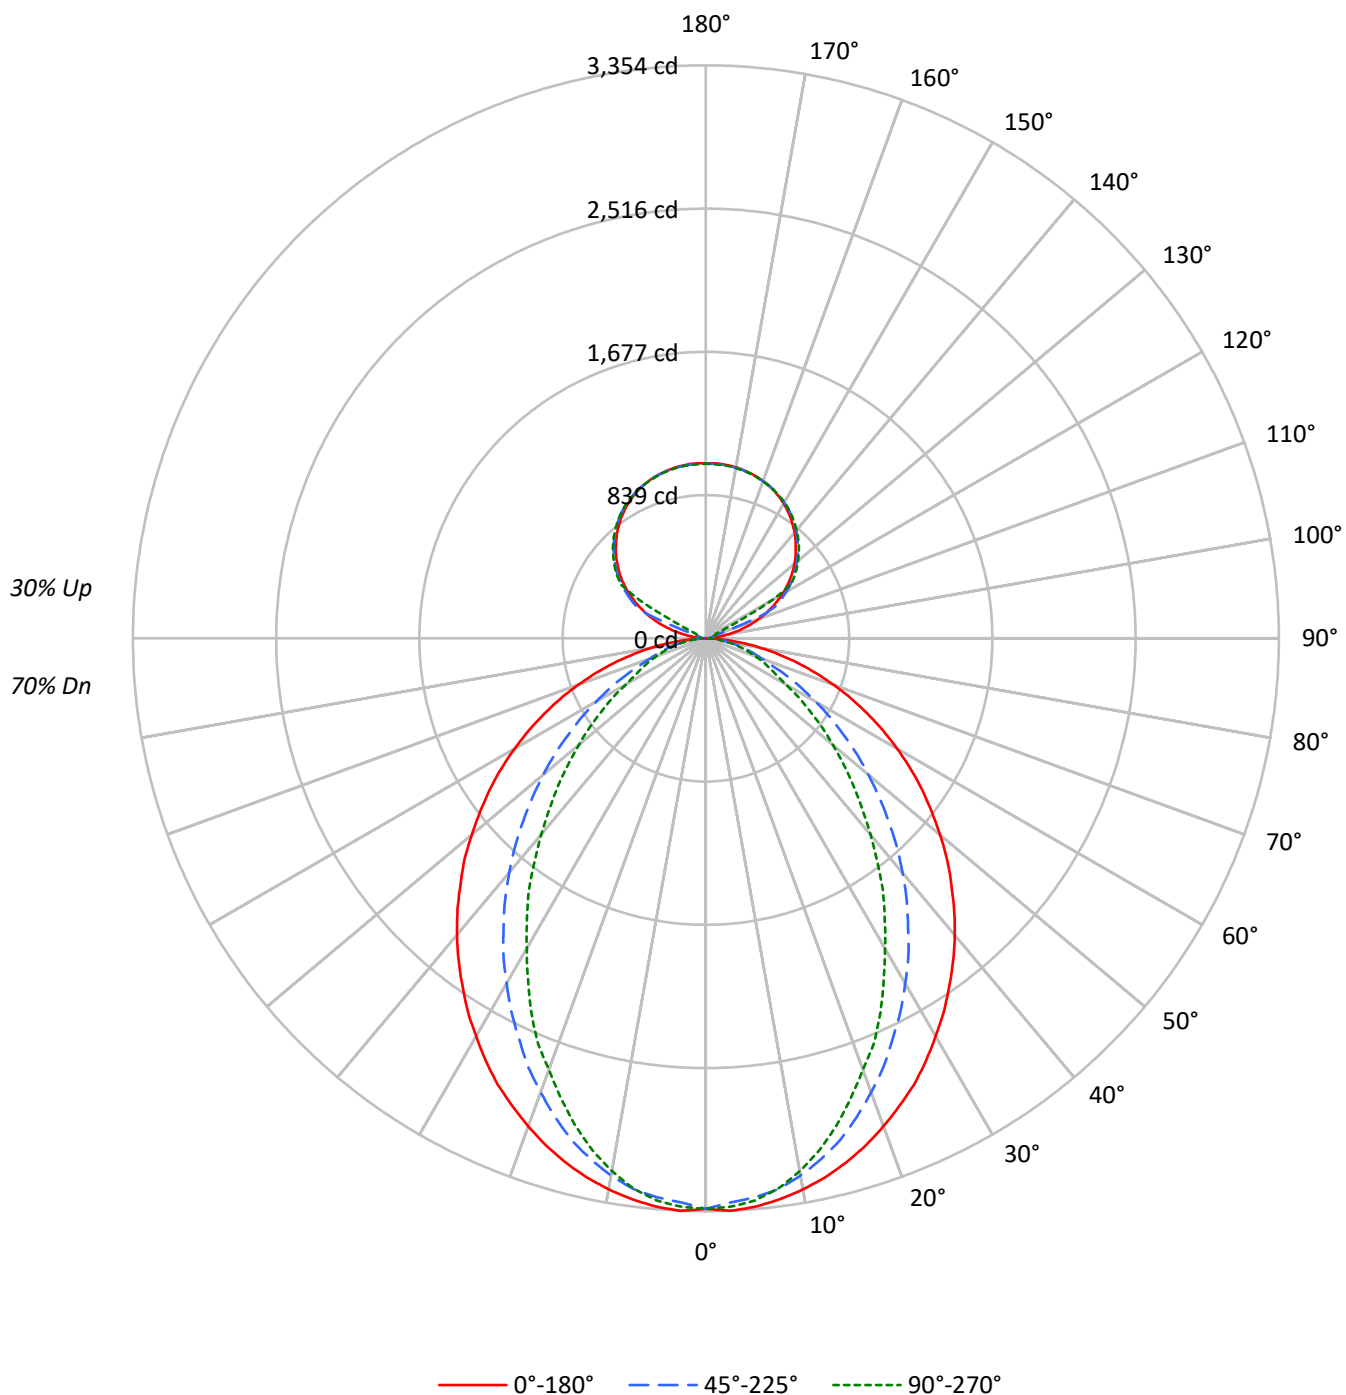

TEST NUMBER: P909949

CATALOG NUMBER: DFN2DIP-TR3F0-080D030US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	84	84	84	74	74	74
1	103	99	95	92	97	93	90	87	84	81	79	75	73	71	67	65	64
2	94	87	81	76	89	83	77	73	74	70	67	67	63	61	59	57	55
3	86	77	70	64	82	73	67	62	66	61	57	59	55	52	53	50	48
4	79	69	61	55	75	65	58	53	59	54	49	53	49	45	48	45	42
5	73	62	54	48	69	59	52	46	53	47	43	48	44	40	44	40	37
6	68	56	48	42	64	53	46	41	49	42	38	44	39	35	40	36	33
7	63	51	43	37	60	49	41	36	44	38	34	40	35	32	37	32	29
8	59	46	39	33	56	44	37	32	41	35	30	37	32	28	34	30	27
9	55	43	35	30	52	41	34	29	37	32	27	34	29	26	31	27	24
10	51	39	32	27	49	38	31	26	35	29	25	32	27	24	29	25	22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4161	4161	4161
5°	4165	4091	4118
10°	4122	4007	3981
15°	4063	3872	3772
20°	3985	3686	3515
25°	3906	3478	3268
30°	3800	3266	2955
35°	3697	3037	2680
40°	3591	2801	2365
45°	3469	2540	2081
50°	3342	2277	1802
55°	3209	1996	1535
60°	3055	1702	1261
65°	2879	1405	1131
70°	2664	1127	1020
75°	2394	987	922
80°	2003	816	790
85°	1364	529	579

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3469 cd/sqm

TEST NUMBER: P909949

CATALOG NUMBER: DFN2DIP-TR3F0-080D030US840-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	312.9	3.2
10°-20°	859.1	8.7
20°-30°	1206.1	12.2
30°-40°	1314.7	13.3
40°-50°	1208.4	12.2
50°-60°	949.0	9.6
60°-70°	617.7	6.3
70°-80°	318.0	3.2
80°-90°	83.0	0.8
90°-100°	33.7	0.3
100°-110°	125.7	1.3
110°-120°	333.3	3.4
120°-130°	552.9	5.6
130°-140°	587.3	6.0
140°-150°	545.8	5.5
150°-160°	438.8	4.4
160°-170°	282.8	2.9
170°-180°	97.3	1.0
0°-30°	2378.1	24.1
0°-40°	3692.9	37.4
0°-60°	5850.2	59.3
0°-90°	6868.9	69.6
90°-120°	492.7	5.0
90°-150°	2178.7	22.1
90°-180°	2998.0	30.4
0°-180°	9866.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3339	3339	3339	3339	3339	
5°	3339	3324	3284	3312	3303	317
15°	3176	3142	3040	2982	2952	895
25°	2883	2786	2587	2463	2417	1326
35°	2484	2330	2064	1874	1807	1555
45°	2031	1828	1511	1296	1224	1568
55°	1544	1308	982	801	744	1380
65°	1043	798	526	423	414	1034
75°	556	344	242	221	218	588
85°	130	66	57	57	57	149
90°	1	9	15	19	20	9
95°	48	24	29	33	32	57
105°	225	247	45	53	56	240
115°	425	438	456	114	61	419
125°	602	611	625	630	633	536
135°	744	756	763	770	769	575
145°	863	863	875	880	877	540
155°	951	944	953	957	952	438
165°	1002	997	1000	1005	1000	283
175°	1025	1020	1021	1026	1019	98
180°	1022	1022	1022	1022	1022	

TEST NUMBER: P909949

CATALOG NUMBER: DFN2DIP-TR3F0-080D030US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3339.0	3339.0	3339.0	3339.0	3339.0
2.5°	3354.1	3339.0	3305.7	3336.1	3330.0
5°	3339.0	3324.0	3284.5	3311.8	3302.8
7.5°	3311.8	3293.8	3251.5	3263.4	3248.2
10°	3275.5	3254.4	3194.1	3184.8	3166.8
12.5°	3230.4	3203.1	3121.3	3103.3	3070.0
15°	3175.8	3142.5	3039.9	2982.5	2952.3
17.5°	3112.3	3063.9	2937.0	2870.6	2822.2
20°	3039.9	2979.3	2828.3	2753.0	2686.2
22.5°	2961.3	2891.7	2716.4	2613.8	2568.6
25°	2882.8	2786.0	2586.6	2462.9	2417.3
27.5°	2789.1	2686.2	2465.7	2323.7	2254.1
30°	2689.5	2574.3	2332.7	2178.8	2097.0
32.5°	2592.6	2453.6	2206.1	2024.6	1948.9
35°	2484.0	2329.8	2064.0	1873.6	1806.9
37.5°	2378.1	2211.8	1931.0	1722.2	1646.9
40°	2266.3	2085.2	1791.8	1577.3	1498.7
42.5°	2151.5	1958.2	1652.9	1429.3	1353.8
45°	2030.6	1828.1	1511.0	1296.2	1223.8
47.5°	1915.9	1701.4	1375.0	1160.2	1093.9
50°	1788.9	1574.5	1242.0	1033.3	970.1
52.5°	1664.9	1438.1	1115.0	915.6	858.3
55°	1544.0	1308.4	982.0	800.8	743.5
57.5°	1420.3	1178.5	864.3	695.1	646.6
60°	1293.2	1051.6	740.2	586.3	538.0
62.5°	1169.5	927.8	634.5	489.6	465.5
65°	1042.6	797.6	525.7	423.2	413.8
67.5°	921.7	676.8	423.2	371.5	362.6
70°	794.8	559.2	350.4	320.2	308.1
72.5°	673.9	450.1	293.1	269.0	262.9
75°	555.9	344.4	241.8	220.6	217.7
77.5°	438.3	244.6	190.5	178.2	172.2
80°	329.2	175.4	144.9	133.0	133.0
82.5°	229.5	118.0	99.7	93.6	93.6
85°	129.9	66.3	57.4	57.4	57.4
87.5°	48.4	24.0	24.0	21.2	21.2
90°	0.7	8.9	14.7	18.6	19.9
92.5°	18.6	15.6	17.8	19.3	19.9
95°	48.1	23.6	28.8	32.6	31.8
97.5°	86.5	26.0	37.7	40.0	40.7
100°	131.0	29.6	42.2	48.1	49.6
102.5°	179.8	178.3	43.6	51.7	54.0
105°	224.9	247.1	45.1	53.2	56.2
107.5°	277.4	295.9	46.7	54.7	57.8
110°	327.8	343.3	129.5	55.5	58.5

TEST NUMBER: P909949

CATALOG NUMBER: DFN2DIP-TR3F0-080D030US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	375.2	388.4	375.9	57.0	59.2
115°	425.4	438.0	456.5	113.9	60.7
117.5°	469.1	483.8	496.4	390.6	196.8
120°	517.9	529.0	542.3	551.2	451.3
122.5°	559.3	571.2	586.0	590.4	591.2
125°	601.5	611.1	625.2	630.4	632.6
127.5°	640.0	650.3	661.5	668.8	669.5
130°	676.2	688.1	696.2	704.3	703.7
132.5°	713.2	722.9	730.9	737.6	736.9
135°	744.3	756.2	762.8	770.2	768.7
137.5°	776.8	785.7	793.1	800.5	798.3
140°	808.6	814.6	822.6	829.3	825.7
142.5°	835.4	840.5	850.1	856.0	852.3
145°	863.4	862.6	875.3	880.4	876.7
147.5°	887.8	885.6	898.2	901.8	898.9
150°	911.5	906.4	918.2	922.5	918.9
152.5°	931.4	925.5	936.7	941.1	935.9
155°	950.7	944.1	952.9	957.4	951.5
157.5°	966.2	960.4	967.0	972.2	966.2
160°	979.6	975.1	979.6	984.0	978.8
162.5°	991.4	986.9	990.7	995.8	989.2
165°	1001.7	997.3	999.6	1004.7	999.6
167.5°	1009.9	1005.4	1007.6	1012.9	1006.2
170°	1016.5	1012.1	1013.6	1018.8	1012.1
172.5°	1021.0	1016.5	1018.0	1023.2	1016.5
175°	1024.6	1019.5	1021.0	1026.1	1018.8
177.5°	1026.1	1021.0	1021.8	1026.9	1020.3
180°	1022.5	1022.5	1022.5	1022.5	1022.5

TEST NUMBER: P909949

CATALOG NUMBER: DFN2DIP-TR3F0-080D030US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.71	14.73	14.49	15.53	16.49	9.69	10.71	10.46	11.50	12.47
	3H	15.39	16.31	16.18	17.11	18.10	10.89	11.80	11.68	12.60	13.60
	4H	16.01	16.87	16.81	17.68	18.68	11.34	12.20	12.15	13.01	14.02
	6H	16.43	17.22	17.25	18.04	19.06	11.67	12.46	12.49	13.28	14.30
	8H	16.56	17.31	17.38	18.15	19.17	11.76	12.51	12.59	13.35	14.37
	12H	16.62	17.34	17.45	18.17	19.21	11.81	12.53	12.64	13.36	14.40
4H	2H	13.75	14.61	14.56	15.42	16.43	10.30	11.16	11.11	11.97	12.98
	3H	15.59	16.30	16.41	17.15	18.17	11.66	12.38	12.48	13.22	14.24
	4H	16.28	16.93	17.12	17.77	18.82	12.21	12.86	13.05	13.71	14.75
	6H	16.80	17.36	17.65	18.22	19.28	12.64	13.20	13.49	14.06	15.12
	8H	16.97	17.49	17.83	18.36	19.42	12.77	13.29	13.62	14.15	15.22
	12H	17.07	17.54	17.94	18.42	19.49	12.84	13.31	13.71	14.19	15.26
8H	4H	16.26	16.78	17.12	17.65	18.71	12.50	13.02	13.36	13.89	14.95
	6H	16.82	17.26	17.71	18.16	19.23	13.02	13.45	13.90	14.36	15.42
	8H	17.03	17.42	17.93	18.32	19.40	13.21	13.59	14.10	14.49	15.57
	12H	17.17	17.51	18.07	18.40	19.54	13.33	13.67	14.22	14.56	15.69
12H	4H	16.22	16.69	17.10	17.57	18.64	12.51	12.98	13.39	13.87	14.94
	6H	16.80	17.18	17.69	18.08	19.16	13.07	13.45	13.96	14.35	15.43
	8H	17.02	17.36	17.92	18.25	19.39	13.28	13.62	14.18	14.51	15.64