

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912587

Luminaire Tested: DFN2DIP-TR3F0-040D070US850-FLLONL

Issue Date: 11/21/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P912587  
REPORT IS A COMBINATION OF REPORTS P901849 AND P898751  
Test Lab: INNOVATION CENTER  
Issue Date: 11/21/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: NEO-RAY  
Catalog Number: DFN2DIP-TR3F0-040D070US850-FLLONL  
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 12077.0 lumens  
Efficiency: N/A  
Efficacy: 136.9 lumens/watt  
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29  
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')  
CIE Type: Semi-Indirect

Input Watts (W): 88.2  
Input Voltage (V):  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: 0.9951  
Total Harmonic Distortion (THDi): 0.07  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P912587

CATALOG NUMBER: DFN2DIP-TR3F0-040D070US850-FLLONL

### Luminous Intensity Polar Plot

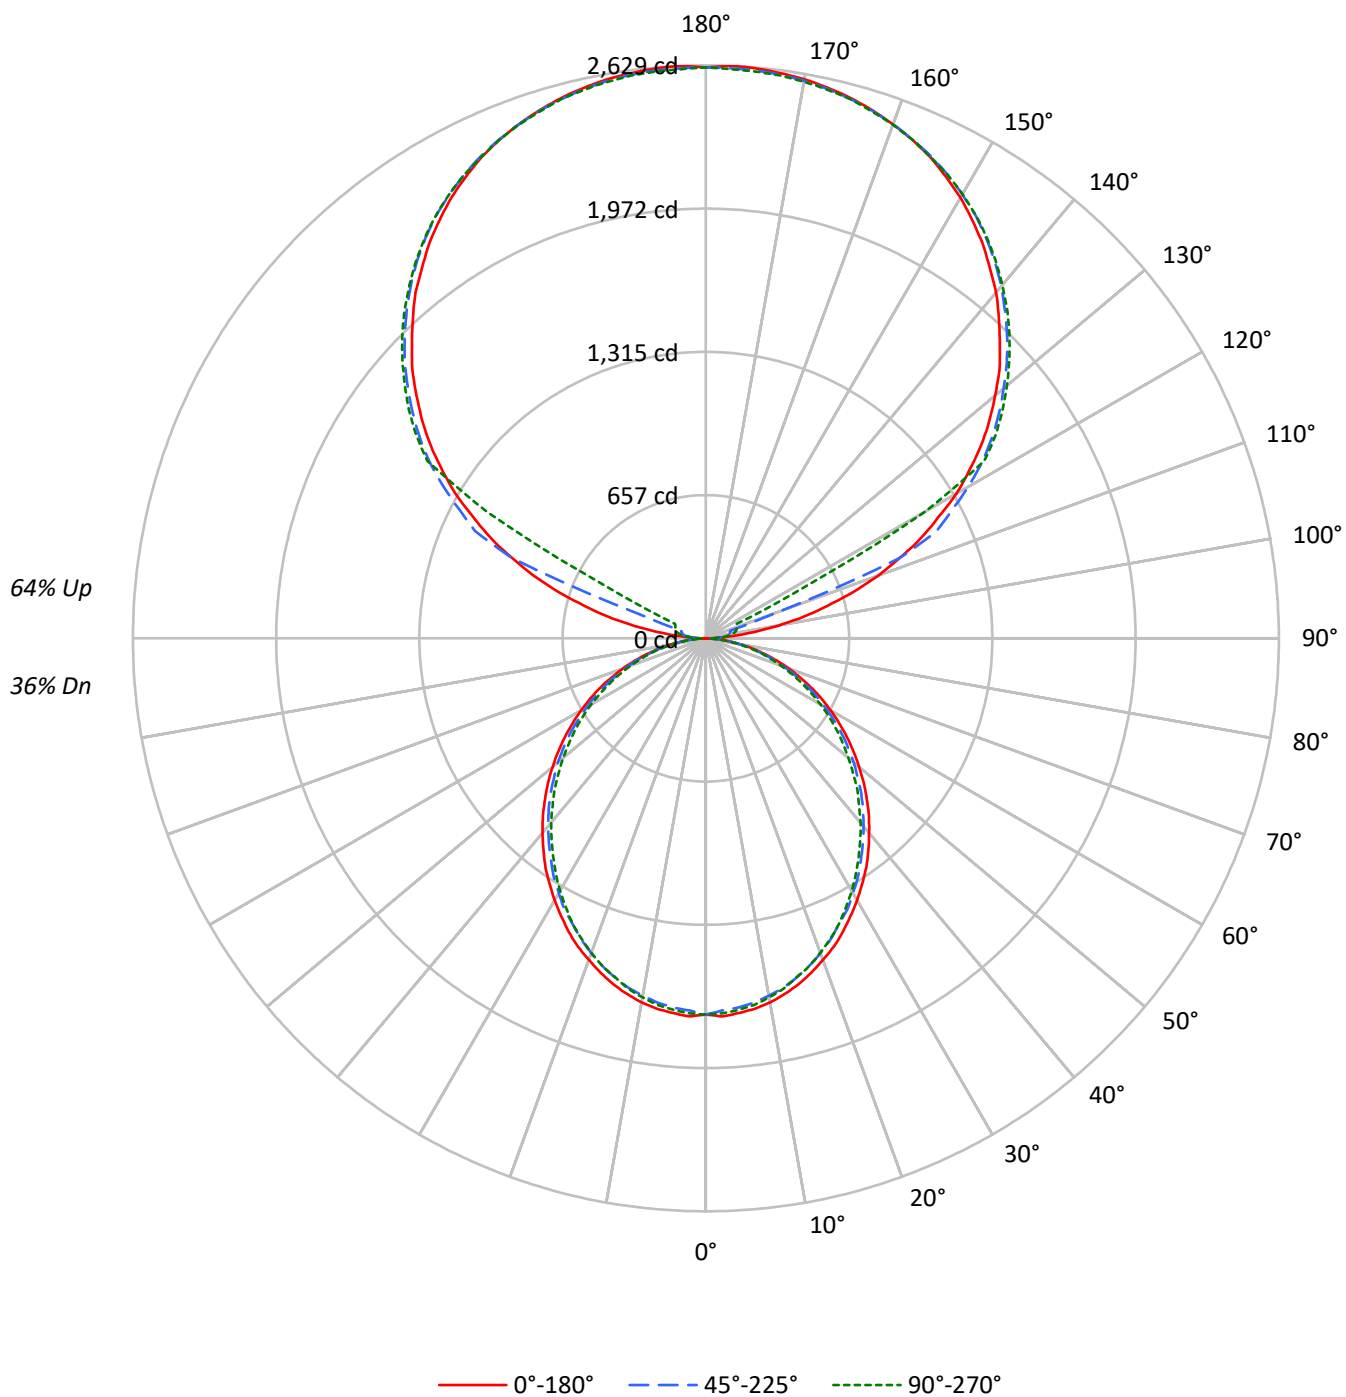

TEST NUMBER: P912587

CATALOG NUMBER: DFN2DIP-TR3F0-040D070US850-FLONL

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |    |    |    |    |    |    |    |    |    |    |    |    |    |
|-----|-----|-----|-----|-----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| RF  | 20  |     |     |     | 20 |    |    |    | 20 |    |    |    | 20 |    |    |    | 20 |
| RC  | 80  |     |     |     | 70 |    |    |    | 50 |    |    |    | 30 |    |    |    | 10 |
| RW  | 70  | 50  | 30  | 10  | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 |
| RCR |     |     |     |     |    |    |    |    |    |    |    |    |    |    |    |    |    |
| 0   | 104 | 104 | 104 | 104 | 94 | 94 | 94 | 94 | 76 | 76 | 76 | 59 | 59 | 59 | 44 | 44 | 44 |
| 1   | 95  | 90  | 87  | 83  | 86 | 82 | 79 | 76 | 66 | 64 | 62 | 52 | 50 | 49 | 39 | 38 | 37 |
| 2   | 86  | 79  | 73  | 68  | 78 | 72 | 67 | 62 | 58 | 54 | 51 | 46 | 43 | 41 | 34 | 32 | 31 |
| 3   | 79  | 69  | 62  | 57  | 71 | 63 | 57 | 52 | 51 | 47 | 43 | 40 | 37 | 35 | 30 | 28 | 26 |
| 4   | 72  | 61  | 54  | 48  | 65 | 56 | 49 | 44 | 45 | 41 | 37 | 36 | 32 | 30 | 27 | 25 | 23 |
| 5   | 66  | 55  | 47  | 41  | 59 | 50 | 43 | 38 | 41 | 35 | 32 | 32 | 28 | 26 | 24 | 22 | 20 |
| 6   | 61  | 49  | 41  | 35  | 55 | 45 | 38 | 33 | 37 | 31 | 27 | 29 | 25 | 22 | 22 | 19 | 17 |
| 7   | 56  | 44  | 36  | 31  | 51 | 40 | 33 | 29 | 33 | 28 | 24 | 26 | 23 | 20 | 20 | 17 | 15 |
| 8   | 52  | 40  | 32  | 27  | 47 | 37 | 30 | 25 | 30 | 25 | 21 | 24 | 20 | 18 | 18 | 16 | 14 |
| 9   | 48  | 36  | 29  | 24  | 44 | 33 | 27 | 22 | 28 | 23 | 19 | 22 | 18 | 16 | 17 | 14 | 12 |
| 10  | 45  | 33  | 26  | 21  | 41 | 31 | 24 | 20 | 25 | 20 | 17 | 20 | 17 | 14 | 16 | 13 | 11 |

**AVERAGE LUMINANCE (cd/sqm):**

|     | 0°   | 45°  | 90°  |
|-----|------|------|------|
| 0°  | 2151 | 2151 | 2151 |
| 5°  | 2153 | 2119 | 2134 |
| 10° | 2134 | 2089 | 2103 |
| 15° | 2102 | 2053 | 2057 |
| 20° | 2058 | 2003 | 2009 |
| 25° | 2015 | 1944 | 1954 |
| 30° | 1961 | 1889 | 1885 |
| 35° | 1909 | 1825 | 1812 |
| 40° | 1846 | 1759 | 1742 |
| 45° | 1783 | 1694 | 1671 |
| 50° | 1715 | 1625 | 1588 |
| 55° | 1642 | 1545 | 1512 |
| 60° | 1561 | 1451 | 1424 |
| 65° | 1471 | 1353 | 1321 |
| 70° | 1357 | 1233 | 1209 |
| 75° | 1200 | 1090 | 1104 |
| 80° | 1010 | 907  | 908  |
| 85° | 714  | 597  | 586  |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
Vertical Angle: 45°  
Luminance: 1783 cd/sqm

TEST NUMBER: P912587

CATALOG NUMBER: DFN2DIP-TR3F0-040D070US850-FLLONL

**ZONAL LUMENS:**

| Zone      | Lumens  | % Fixture |
|-----------|---------|-----------|
| 0°-10°    | 162.5   | 1.3       |
| 10°-20°   | 457.1   | 3.8       |
| 20°-30°   | 671.7   | 5.6       |
| 30°-40°   | 780.2   | 6.5       |
| 40°-50°   | 779.2   | 6.5       |
| 50°-60°   | 679.5   | 5.6       |
| 60°-70°   | 502.3   | 4.2       |
| 70°-80°   | 284.2   | 2.4       |
| 80°-90°   | 79.6    | 0.7       |
| 90°-100°  | 86.4    | 0.7       |
| 100°-110° | 322.1   | 2.7       |
| 110°-120° | 854.1   | 7.1       |
| 120°-130° | 1416.6  | 11.7      |
| 130°-140° | 1504.8  | 12.5      |
| 140°-150° | 1398.5  | 11.6      |
| 150°-160° | 1124.4  | 9.3       |
| 160°-170° | 724.5   | 6.0       |
| 170°-180° | 249.4   | 2.1       |
| 0°-30°    | 1291.3  | 10.7      |
| 0°-40°    | 2071.5  | 17.2      |
| 0°-60°    | 3530.2  | 29.2      |
| 0°-90°    | 4396.3  | 36.4      |
| 90°-120°  | 1262.6  | 10.5      |
| 90°-150°  | 5582.5  | 46.2      |
| 90°-180°  | 7681.0  | 63.6      |
| 0°-180°   | 12077.0 | 100.0     |

**CANDELA DISTRIBUTION:**

|      | 0°   | 22.5° | 45°  | 67.5° | 90°  | Flux |
|------|------|-------|------|-------|------|------|
| 0°   | 1726 | 1726  | 1726 | 1726  | 1726 |      |
| 5°   | 1726 | 1720  | 1701 | 1714  | 1711 | 164  |
| 15°  | 1643 | 1633  | 1612 | 1618  | 1610 | 463  |
| 25°  | 1487 | 1474  | 1446 | 1449  | 1446 | 684  |
| 35°  | 1283 | 1266  | 1240 | 1230  | 1222 | 801  |
| 45°  | 1044 | 1032  | 1007 | 989   | 983  | 806  |
| 55°  | 790  | 780   | 760  | 740   | 732  | 706  |
| 65°  | 533  | 523   | 506  | 491   | 483  | 527  |
| 75°  | 279  | 276   | 267  | 257   | 261  | 298  |
| 85°  | 68   | 66    | 65   | 60    | 58   | 76   |
| 90°  | 2    | 23    | 38   | 48    | 51   | 11   |
| 95°  | 123  | 61    | 74   | 84    | 82   | 146  |
| 105° | 576  | 633   | 116  | 136   | 144  | 616  |
| 115° | 1090 | 1122  | 1170 | 292   | 156  | 1073 |
| 125° | 1541 | 1566  | 1602 | 1615  | 1621 | 1375 |
| 135° | 1907 | 1938  | 1954 | 1974  | 1970 | 1473 |
| 145° | 2212 | 2210  | 2243 | 2256  | 2246 | 1384 |
| 155° | 2436 | 2419  | 2442 | 2453  | 2438 | 1123 |
| 165° | 2567 | 2556  | 2561 | 2574  | 2561 | 725  |
| 175° | 2626 | 2612  | 2616 | 2629  | 2610 | 250  |
| 180° | 2620 | 2620  | 2620 | 2620  | 2620 |      |

TEST NUMBER: P912587

CATALOG NUMBER: DFN2DIP-TR3F0-040D070US850-FLLONL

**CANDELA DISTRIBUTION (FULL):**

|        | 0°     | 22.5°  | 45°    | 67.5°  | 90°    |
|--------|--------|--------|--------|--------|--------|
| 0°     | 1726.0 | 1726.0 | 1726.0 | 1726.0 | 1726.0 |
| 2.5°   | 1736.1 | 1727.8 | 1709.5 | 1726.0 | 1722.9 |
| 5°     | 1726.0 | 1719.5 | 1701.2 | 1714.4 | 1711.3 |
| 7.5°   | 1714.4 | 1704.5 | 1686.2 | 1699.7 | 1696.3 |
| 10°    | 1696.3 | 1684.7 | 1664.8 | 1678.0 | 1673.0 |
| 12.5°  | 1671.3 | 1661.4 | 1641.5 | 1649.9 | 1646.4 |
| 15°    | 1643.1 | 1633.2 | 1611.6 | 1618.3 | 1610.0 |
| 17.5°  | 1608.3 | 1598.4 | 1576.8 | 1585.0 | 1576.8 |
| 20°    | 1570.0 | 1560.1 | 1537.0 | 1541.8 | 1535.4 |
| 22.5°  | 1532.0 | 1517.0 | 1495.4 | 1495.4 | 1492.0 |
| 25°    | 1487.1 | 1473.9 | 1445.7 | 1448.9 | 1445.7 |
| 27.5°  | 1437.3 | 1425.6 | 1404.2 | 1399.2 | 1391.0 |
| 30°    | 1387.6 | 1374.3 | 1349.4 | 1344.4 | 1337.8 |
| 32.5°  | 1334.5 | 1324.6 | 1298.0 | 1288.0 | 1281.2 |
| 35°    | 1283.0 | 1266.5 | 1239.9 | 1229.9 | 1221.6 |
| 37.5°  | 1224.9 | 1209.9 | 1183.3 | 1171.8 | 1163.5 |
| 40°    | 1165.2 | 1151.8 | 1125.2 | 1110.4 | 1103.8 |
| 42.5°  | 1107.1 | 1093.7 | 1067.3 | 1050.6 | 1040.7 |
| 45°    | 1044.0 | 1032.5 | 1007.4 | 989.3  | 982.6  |
| 47.5°  | 982.6  | 970.9  | 944.4  | 926.1  | 916.3  |
| 50°    | 917.8  | 909.5  | 886.3  | 863.0  | 854.7  |
| 52.5°  | 854.7  | 843.2  | 821.7  | 803.4  | 791.7  |
| 55°    | 790.2  | 780.1  | 760.2  | 740.3  | 732.1  |
| 57.5°  | 725.3  | 717.1  | 695.3  | 675.5  | 668.8  |
| 60°    | 660.5  | 654.0  | 630.8  | 612.5  | 607.5  |
| 62.5°  | 597.5  | 585.9  | 569.4  | 552.7  | 546.1  |
| 65°    | 532.9  | 522.8  | 506.3  | 491.3  | 483.1  |
| 67.5°  | 466.4  | 458.0  | 443.3  | 431.6  | 425.0  |
| 70°    | 405.0  | 398.4  | 383.4  | 371.7  | 365.2  |
| 72.5°  | 342.0  | 335.3  | 327.0  | 315.4  | 310.4  |
| 75°    | 278.8  | 275.6  | 267.2  | 257.3  | 260.6  |
| 77.5°  | 222.4  | 215.7  | 212.4  | 207.4  | 202.5  |
| 80°    | 166.0  | 164.2  | 160.9  | 156.0  | 152.7  |
| 82.5°  | 112.9  | 112.9  | 111.3  | 104.6  | 104.6  |
| 85°    | 68.0   | 66.4   | 64.8   | 59.7   | 58.1   |
| 87.5°  | 29.9   | 26.6   | 23.3   | 18.3   | 16.5   |
| 90°    | 1.8    | 22.7   | 37.8   | 47.5   | 51.1   |
| 92.5°  | 47.5   | 39.8   | 45.5   | 49.4   | 51.1   |
| 95°    | 123.1  | 60.6   | 73.9   | 83.5   | 81.5   |
| 97.5°  | 221.7  | 66.4   | 96.6   | 102.5  | 104.2  |
| 100°   | 335.7  | 75.9   | 108.0  | 123.1  | 127.0  |
| 102.5° | 460.6  | 457.0  | 111.9  | 132.6  | 138.4  |
| 105°   | 576.3  | 633.2  | 115.7  | 136.4  | 144.1  |
| 107.5° | 710.9  | 758.2  | 119.6  | 140.3  | 147.9  |
| 110°   | 840.0  | 879.5  | 331.8  | 142.3  | 149.7  |

TEST NUMBER: P912587

CATALOG NUMBER: DFN2DIP-TR3F0-040D070US850-FLLONL

**CANDELA DISTRIBUTION (continued):**

|        | 0°     | 22.5°  | 45°    | 67.5°  | 90°    |
|--------|--------|--------|--------|--------|--------|
| 112.5° | 961.3  | 995.2  | 963.1  | 145.8  | 151.7  |
| 115°   | 1090.0 | 1122.2 | 1169.7 | 292.0  | 155.6  |
| 117.5° | 1201.9 | 1239.8 | 1272.1 | 1000.9 | 504.3  |
| 120°   | 1327.0 | 1355.4 | 1389.7 | 1412.4 | 1156.5 |
| 122.5° | 1433.0 | 1463.4 | 1501.6 | 1512.8 | 1514.8 |
| 125°   | 1541.2 | 1565.9 | 1602.0 | 1615.3 | 1620.8 |
| 127.5° | 1639.8 | 1666.3 | 1694.9 | 1713.8 | 1715.6 |
| 130°   | 1732.7 | 1763.1 | 1783.8 | 1804.8 | 1803.0 |
| 132.5° | 1827.5 | 1852.3 | 1873.0 | 1890.1 | 1888.3 |
| 135°   | 1907.1 | 1937.5 | 1954.5 | 1973.6 | 1969.8 |
| 137.5° | 1990.4 | 2013.3 | 2032.4 | 2051.3 | 2045.7 |
| 140°   | 2071.9 | 2087.2 | 2108.0 | 2125.1 | 2115.6 |
| 142.5° | 2140.4 | 2153.7 | 2178.2 | 2193.3 | 2183.8 |
| 145°   | 2212.5 | 2210.5 | 2242.6 | 2255.9 | 2246.5 |
| 147.5° | 2274.8 | 2269.2 | 2301.4 | 2310.8 | 2303.4 |
| 150°   | 2335.6 | 2322.4 | 2352.7 | 2363.9 | 2354.5 |
| 152.5° | 2386.7 | 2371.6 | 2400.0 | 2411.4 | 2398.2 |
| 155°   | 2436.0 | 2419.1 | 2441.8 | 2453.1 | 2438.0 |
| 157.5° | 2475.8 | 2460.8 | 2477.8 | 2491.1 | 2475.8 |
| 160°   | 2510.1 | 2498.6 | 2510.1 | 2521.3 | 2508.0 |
| 162.5° | 2540.3 | 2529.0 | 2538.4 | 2551.7 | 2534.6 |
| 165°   | 2566.8 | 2555.6 | 2561.1 | 2574.4 | 2561.1 |
| 167.5° | 2587.7 | 2576.2 | 2582.1 | 2595.4 | 2578.3 |
| 170°   | 2604.8 | 2593.4 | 2597.2 | 2610.5 | 2593.4 |
| 172.5° | 2616.1 | 2604.8 | 2608.7 | 2621.9 | 2604.8 |
| 175°   | 2625.6 | 2612.2 | 2616.1 | 2629.3 | 2610.5 |
| 177.5° | 2629.3 | 2616.1 | 2618.1 | 2631.4 | 2614.2 |
| 180°   | 2619.9 | 2619.9 | 2619.9 | 2619.9 | 2619.9 |

TEST NUMBER: P912587

CATALOG NUMBER: DFN2DIP-TR3F0-040D070US850-FLLONL

**CIE UGR TABLE:**

| Reflectances:   |      |                  |       |       |       |       |                |       |       |       |       |
|-----------------|------|------------------|-------|-------|-------|-------|----------------|-------|-------|-------|-------|
| Ceiling         |      | 0.7              | 0.7   | 0.5   | 0.5   | 0.3   | 0.7            | 0.7   | 0.5   | 0.5   | 0.3   |
| Wall            |      | 0.5              | 0.3   | 0.5   | 0.3   | 0.3   | 0.5            | 0.3   | 0.5   | 0.3   | 0.3   |
| Reference plane |      | 0.2              | 0.2   | 0.2   | 0.2   | 0.2   | 0.2            | 0.2   | 0.2   | 0.2   | 0.2   |
| Room dimensions |      | Viewed crosswise |       |       |       |       | Viewed endwise |       |       |       |       |
| X=2H            | Y=2H | 8.47             | 9.23  | 9.54  | 10.29 | 11.75 | 8.05           | 8.80  | 9.11  | 9.87  | 11.32 |
|                 | 3H   | 10.12            | 10.79 | 11.19 | 11.87 | 13.34 | 9.65           | 10.32 | 10.72 | 11.40 | 12.87 |
|                 | 4H   | 10.69            | 11.33 | 11.78 | 12.41 | 13.89 | 10.23          | 10.86 | 11.31 | 11.94 | 13.42 |
|                 | 6H   | 11.08            | 11.67 | 12.18 | 12.75 | 14.24 | 10.61          | 11.20 | 11.71 | 12.28 | 13.77 |
|                 | 8H   | 11.18            | 11.74 | 12.28 | 12.83 | 14.32 | 10.71          | 11.27 | 11.81 | 12.37 | 13.85 |
|                 | 12H  | 11.22            | 11.75 | 12.32 | 12.84 | 14.35 | 10.75          | 11.28 | 11.85 | 12.37 | 13.88 |
| 4H              | 2H   | 8.92             | 9.56  | 10.01 | 10.64 | 12.11 | 8.58           | 9.22  | 9.67  | 10.29 | 11.77 |
|                 | 3H   | 10.76            | 11.30 | 11.86 | 12.40 | 13.89 | 10.38          | 10.91 | 11.48 | 12.01 | 13.50 |
|                 | 4H   | 11.47            | 11.96 | 12.57 | 13.05 | 14.56 | 11.07          | 11.55 | 12.17 | 12.65 | 14.16 |
|                 | 6H   | 11.97            | 12.39 | 13.08 | 13.50 | 15.01 | 11.56          | 11.98 | 12.67 | 13.10 | 14.60 |
|                 | 8H   | 12.11            | 12.50 | 13.22 | 13.61 | 15.13 | 11.70          | 12.09 | 12.82 | 13.20 | 14.73 |
|                 | 12H  | 12.17            | 12.53 | 13.30 | 13.65 | 15.18 | 11.76          | 12.11 | 12.89 | 13.23 | 14.76 |
| 8H              | 4H   | 11.65            | 12.04 | 12.76 | 13.15 | 14.67 | 11.29          | 11.69 | 12.41 | 12.80 | 14.32 |
|                 | 6H   | 12.27            | 12.59 | 13.40 | 13.74 | 15.26 | 11.91          | 12.23 | 13.04 | 13.38 | 14.90 |
|                 | 8H   | 12.48            | 12.76 | 13.62 | 13.90 | 15.43 | 12.12          | 12.40 | 13.26 | 13.53 | 15.07 |
|                 | 12H  | 12.60            | 12.85 | 13.74 | 13.98 | 15.55 | 12.22          | 12.47 | 13.37 | 13.60 | 15.17 |
| 12H             | 4H   | 11.63            | 11.98 | 12.76 | 13.11 | 14.63 | 11.28          | 11.64 | 12.41 | 12.76 | 14.28 |
|                 | 6H   | 12.29            | 12.58 | 13.43 | 13.71 | 15.25 | 11.95          | 12.23 | 13.09 | 13.36 | 14.90 |
|                 | 8H   | 12.52            | 12.77 | 13.67 | 13.90 | 15.47 | 12.17          | 12.42 | 13.31 | 13.55 | 15.12 |