

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912596

Luminaire Tested: DFN2DIP-TR3F0-050D030US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912596
REPORT IS A COMBINATION OF REPORTS P900275 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-050D030US850-FLLFLL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8433.9 lumens
Efficiency: N/A
Efficacy: 123.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 68.1
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912596

CATALOG NUMBER: DFN2DIP-TR3F0-050D030US850-FLLFLL

Luminous Intensity Polar Plot

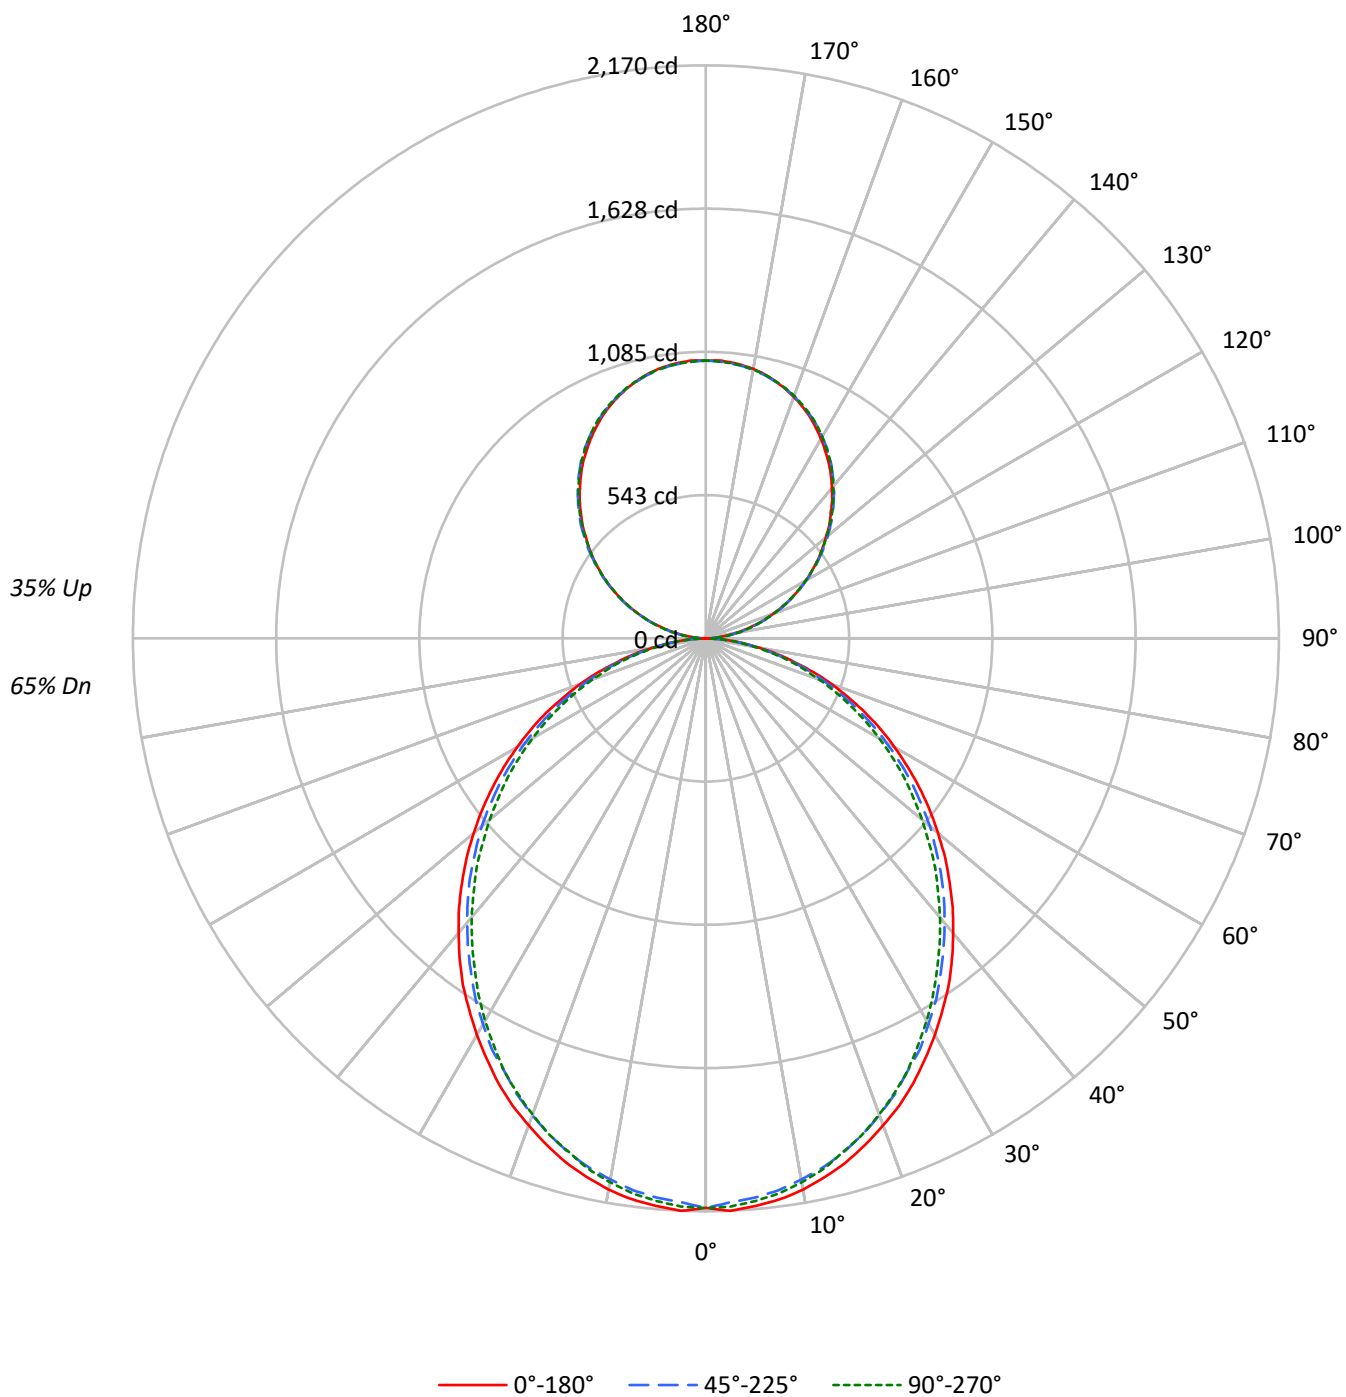

TEST NUMBER: P912596

CATALOG NUMBER: DFN2DIP-TR3F0-050D030US850-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	80	80	80	70	70	70
1	101	97	93	89	95	91	88	84	81	78	75	71	69	67	62	60	59
2	92	85	78	73	86	80	74	69	71	66	63	62	59	56	55	52	50
3	84	74	67	61	79	70	63	58	62	57	53	55	51	47	48	45	42
4	77	66	58	52	72	62	55	49	55	50	45	49	44	41	43	40	37
5	71	59	50	44	66	56	48	42	50	44	39	44	39	35	39	35	32
6	65	53	45	39	61	50	43	37	45	39	34	40	35	31	35	31	28
7	60	48	40	34	57	45	38	33	41	35	30	36	31	28	32	28	25
8	56	44	36	30	53	41	34	29	37	31	27	33	28	25	30	26	22
9	52	40	32	27	49	38	31	26	34	28	24	31	26	22	27	23	20
10	49	37	29	24	46	35	28	23	32	26	22	28	24	20	25	21	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2689	2689	2689
5°	2691	2649	2667
10°	2668	2611	2629
15°	2627	2566	2571
20°	2573	2504	2512
25°	2519	2430	2443
30°	2451	2361	2356
35°	2387	2281	2265
40°	2308	2199	2178
45°	2229	2117	2088
50°	2143	2031	1985
55°	2053	1931	1889
60°	1951	1814	1780
65°	1839	1691	1651
70°	1697	1542	1512
75°	1500	1362	1380
80°	1263	1134	1135
85°	891	746	732

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2229 cd/sqm

TEST NUMBER: P912596

CATALOG NUMBER: DFN2DIP-TR3F0-050D030US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	203.1	2.4
10°-20°	571.4	6.8
20°-30°	839.7	10.0
30°-40°	975.2	11.6
40°-50°	974.0	11.5
50°-60°	849.3	10.1
60°-70°	627.9	7.4
70°-80°	355.2	4.2
80°-90°	96.8	1.1
90°-100°	65.1	0.8
100°-110°	206.9	2.5
110°-120°	354.0	4.2
120°-130°	465.6	5.5
130°-140°	522.6	6.2
140°-150°	512.5	6.1
150°-160°	429.9	5.1
160°-170°	285.1	3.4
170°-180°	99.7	1.2
0°-30°	1614.1	19.1
0°-40°	2589.4	30.7
0°-60°	4412.7	52.3
0°-90°	5492.6	65.1
90°-120°	626.0	7.4
90°-150°	2126.7	25.2
90°-180°	2941.0	34.9
0°-180°	8433.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2158	2158	2158	2158	2158	
5°	2158	2150	2126	2143	2139	205
15°	2054	2042	2014	2023	2012	578
25°	1859	1842	1807	1811	1807	855
35°	1604	1583	1550	1537	1527	1001
45°	1305	1290	1259	1237	1228	1007
55°	988	975	950	925	915	883
65°	666	654	633	614	604	659
75°	348	344	334	322	326	372
85°	85	83	81	75	73	95
90°	1	11	31	29	30	8
95°	46	55	57	57	55	52
105°	191	194	195	197	197	202
115°	355	360	359	358	355	351
125°	517	525	522	519	518	462
135°	668	678	680	679	677	517
145°	812	818	823	824	820	507
155°	928	930	933	938	935	427
165°	1009	1008	1008	1015	1010	285
175°	1050	1048	1046	1052	1047	100
180°	1052	1052	1052	1052	1052	

TEST NUMBER: P912596

CATALOG NUMBER: DFN2DIP-TR3F0-050D030US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2157.6	2157.6	2157.6	2157.6	2157.6
2.5°	2170.1	2159.8	2136.9	2157.6	2153.7
5°	2157.6	2149.5	2126.5	2143.0	2139.2
7.5°	2143.0	2130.7	2107.9	2124.6	2120.4
10°	2120.4	2105.9	2081.0	2097.5	2091.4
12.5°	2089.1	2076.8	2052.0	2062.3	2058.1
15°	2053.9	2041.6	2014.5	2022.9	2012.5
17.5°	2010.3	1998.0	1970.9	1981.2	1970.9
20°	1962.6	1950.3	1921.2	1927.3	1919.2
22.5°	1915.0	1896.3	1869.2	1869.2	1865.0
25°	1858.9	1842.4	1807.1	1811.1	1807.1
27.5°	1796.6	1782.1	1755.2	1749.0	1738.7
30°	1734.5	1717.8	1686.8	1680.6	1672.3
32.5°	1668.0	1655.7	1622.5	1609.9	1601.6
35°	1603.7	1583.1	1549.8	1537.3	1527.0
37.5°	1531.1	1512.5	1479.2	1464.7	1454.3
40°	1456.6	1439.8	1406.5	1388.0	1379.7
42.5°	1383.9	1367.2	1334.1	1313.2	1300.9
45°	1305.1	1290.5	1259.3	1236.6	1228.2
47.5°	1228.2	1213.7	1180.5	1157.6	1145.3
50°	1147.3	1136.9	1107.9	1078.8	1068.4
52.5°	1068.4	1053.9	1027.0	1004.2	989.7
55°	987.7	975.1	950.2	925.3	915.0
57.5°	906.6	896.3	869.2	844.4	836.0
60°	825.7	817.6	788.5	765.5	759.4
62.5°	746.9	732.4	711.6	690.9	682.6
65°	666.1	653.5	632.8	614.2	603.7
67.5°	583.1	572.6	554.1	539.5	531.1
70°	506.3	497.9	479.2	464.7	456.6
72.5°	427.5	419.1	408.8	394.2	388.0
75°	348.4	344.5	333.9	321.6	325.8
77.5°	278.0	269.6	265.5	259.3	253.2
80°	207.6	205.4	201.2	195.1	190.9
82.5°	141.1	141.1	139.1	130.8	130.8
85°	84.9	83.0	81.0	74.6	72.6
87.5°	37.4	33.3	29.1	22.8	20.7
90°	1.0	11.4	31.1	29.2	30.2
92.5°	19.6	26.6	27.6	28.5	28.5
95°	46.4	55.2	56.8	56.8	55.2
97.5°	77.1	85.3	88.8	88.8	88.8
100°	112.6	119.9	122.4	122.4	121.5
102.5°	150.0	155.5	158.9	159.9	158.9
105°	191.0	193.5	195.4	197.0	197.0
107.5°	231.6	235.3	235.3	236.0	231.6
110°	270.9	276.0	276.0	276.0	273.5



TEST NUMBER: P912596

CATALOG NUMBER: DFN2DIP-TR3F0-050D030US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	313.4	318.8	317.8	315.3	313.4
115°	355.3	360.3	358.8	357.9	355.3
117.5°	396.8	403.8	399.4	396.8	394.2
120°	438.7	445.7	438.7	438.7	435.8
122.5°	476.8	485.6	481.2	478.6	476.8
125°	516.8	524.7	522.1	519.2	518.3
127.5°	555.7	565.6	562.2	558.3	555.7
130°	592.2	603.6	602.1	600.2	596.6
132.5°	633.1	642.0	642.7	638.2	635.7
135°	668.4	678.2	680.1	679.2	676.6
137.5°	707.7	715.6	717.2	716.6	712.8
140°	742.3	750.2	754.7	754.7	751.1
142.5°	777.9	785.7	788.3	789.3	785.7
145°	811.5	817.8	822.9	823.8	820.3
147.5°	841.6	849.5	853.3	854.9	851.4
150°	872.7	878.1	881.5	884.4	881.5
152.5°	900.3	905.6	910.0	913.6	910.0
155°	927.9	930.3	933.2	937.7	934.9
157.5°	951.6	953.5	955.2	961.5	957.1
160°	972.9	974.8	975.8	981.1	977.4
162.5°	992.6	992.6	993.6	999.5	995.1
165°	1009.4	1008.4	1008.4	1014.7	1010.3
167.5°	1024.6	1021.7	1021.7	1028.0	1023.6
170°	1036.0	1033.5	1032.6	1038.9	1033.5
172.5°	1043.9	1041.5	1040.5	1046.8	1041.5
175°	1050.3	1047.8	1045.9	1052.2	1046.8
177.5°	1053.8	1051.2	1049.3	1054.8	1049.3
180°	1052.2	1052.2	1052.2	1052.2	1052.2

TEST NUMBER: P912596

CATALOG NUMBER: DFN2DIP-TR3F0-050D030US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.95	12.96	12.76	13.80	14.84	11.52	12.53	12.33	13.37	14.41
	3H	13.61	14.52	14.44	15.37	16.43	13.14	14.05	13.97	14.90	15.97
	4H	14.20	15.06	15.04	15.91	16.99	13.73	14.59	14.57	15.45	16.52
	6H	14.60	15.39	15.45	16.25	17.34	14.13	14.92	14.99	15.79	16.88
	8H	14.70	15.46	15.57	16.34	17.43	14.23	14.99	15.10	15.87	16.96
	12H	14.75	15.47	15.62	16.35	17.46	14.28	15.00	15.15	15.88	16.99
4H	2H	12.42	13.28	13.27	14.14	15.21	12.08	12.94	12.93	13.80	14.87
	3H	14.29	15.01	15.15	15.90	16.99	13.90	14.62	14.76	15.51	16.60
	4H	15.00	15.66	15.88	16.54	17.66	14.60	15.26	15.48	16.14	17.26
	6H	15.52	16.09	16.41	17.00	18.12	15.12	15.68	16.00	16.59	17.71
	8H	15.67	16.20	16.56	17.10	18.24	15.26	15.79	16.15	16.70	17.83
	12H	15.74	16.22	16.66	17.14	18.28	15.33	15.81	16.24	16.73	17.87
8H	4H	15.21	15.74	16.10	16.64	17.78	14.85	15.38	15.74	16.29	17.42
	6H	15.84	16.27	16.76	17.22	18.35	15.48	15.92	16.40	16.86	18.00
	8H	16.05	16.44	16.98	17.38	18.53	15.69	16.08	16.62	17.01	18.17
	12H	16.18	16.53	17.12	17.46	18.66	15.81	16.15	16.74	17.08	18.28
12H	4H	15.20	15.68	16.11	16.60	17.74	14.85	15.33	15.76	16.25	17.39
	6H	15.87	16.25	16.79	17.19	18.34	15.52	15.91	16.45	16.84	18.00
	8H	16.11	16.45	17.04	17.38	18.58	15.76	16.10	16.69	17.03	18.23