

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912611

Luminaire Tested: DFN2DIP-TR3F0-050D060US850-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912611
REPORT IS A COMBINATION OF REPORTS P901838 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-050D060US850-RLLONL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11300.7 lumens
Efficiency: N/A
Efficacy: 124.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 90.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912611

CATALOG NUMBER: DFN2DIP-TR3F0-050D060US850-RLLONL

Luminous Intensity Polar Plot

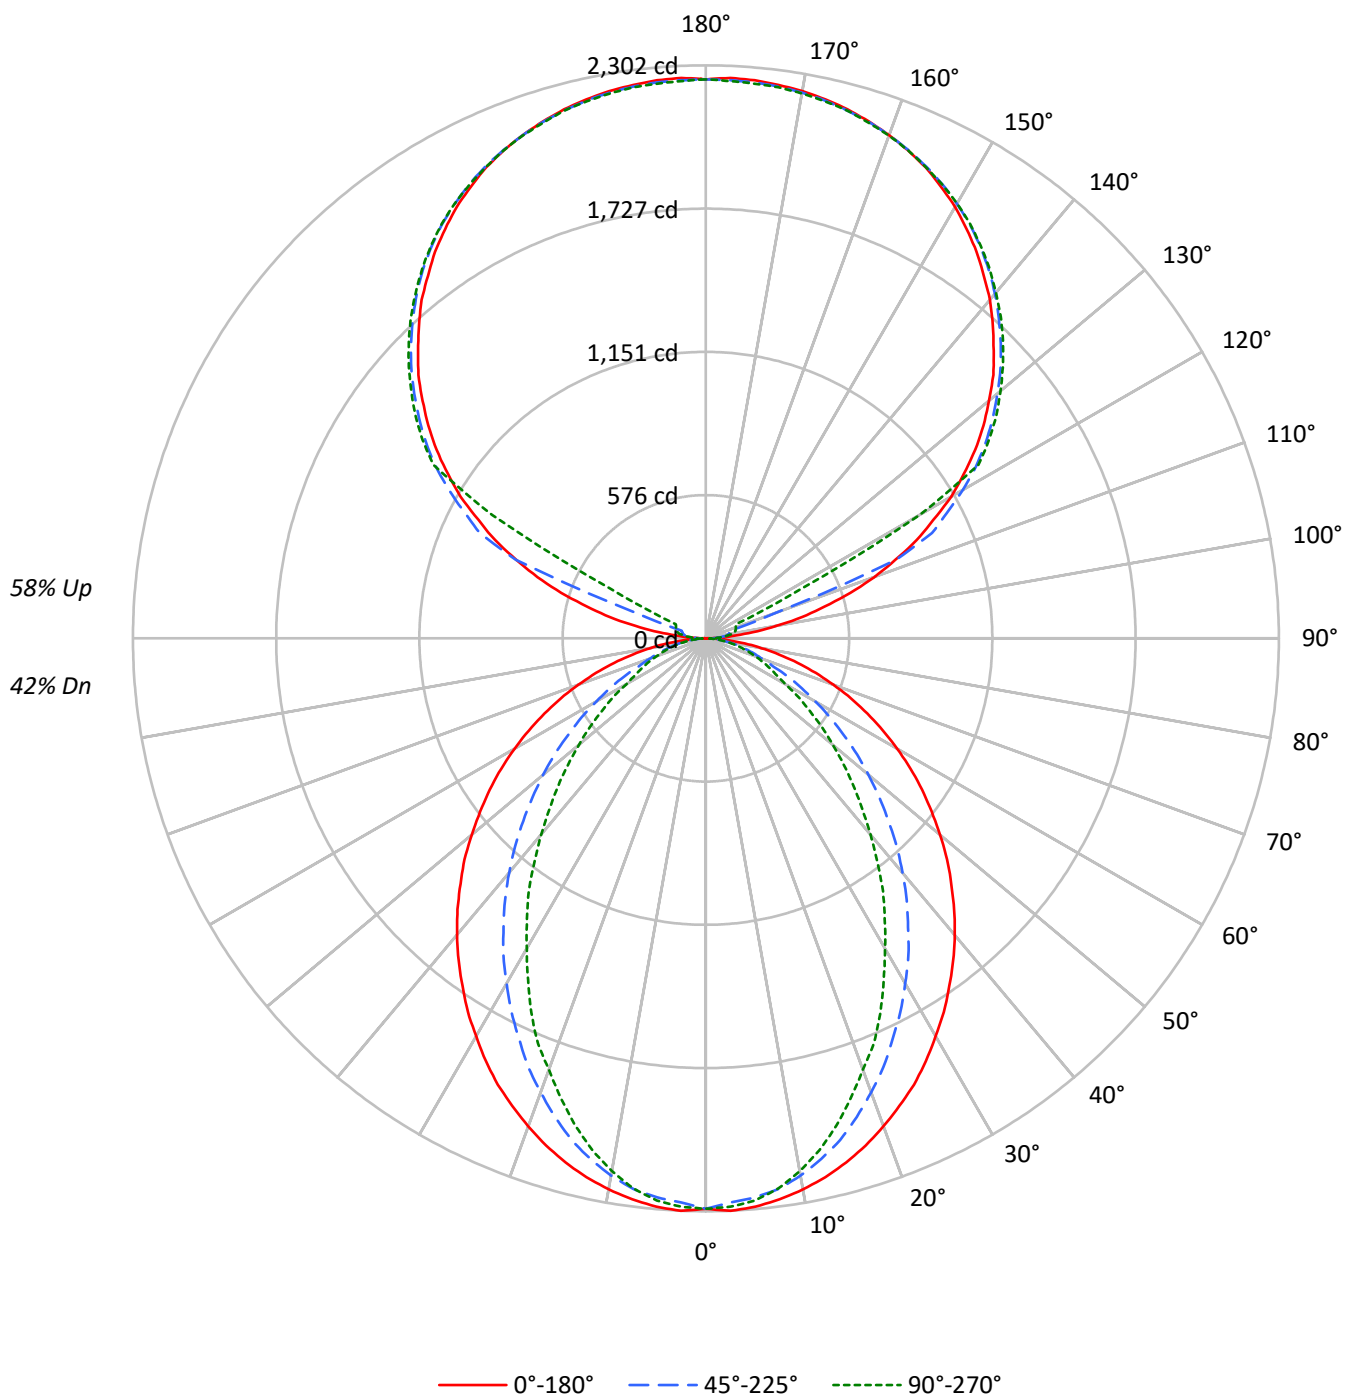

TEST NUMBER: P912611

CATALOG NUMBER: DFN2DIP-TR3F0-050D060US850-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	49	49	49
1	96	92	89	85	88	84	81	78	70	67	65	56	55	53	43	43	42
2	88	81	75	70	80	74	69	65	61	58	55	50	47	45	39	37	36
3	81	72	65	59	73	66	60	55	55	50	46	44	41	39	35	33	31
4	74	64	56	50	67	58	52	47	49	44	40	40	36	33	31	29	27
5	68	57	49	43	62	52	45	40	44	39	35	36	32	29	28	26	24
6	63	51	43	38	57	47	40	35	39	34	30	32	29	26	26	23	21
7	58	46	38	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	34	29	49	39	32	27	33	28	24	27	23	20	22	19	17
9	50	38	31	26	46	35	29	25	30	25	22	25	21	18	20	17	15
10	47	35	28	23	43	33	26	22	28	23	19	23	19	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2856	2856	2856
5°	2859	2808	2827
10°	2829	2751	2733
15°	2788	2657	2589
20°	2735	2530	2413
25°	2681	2387	2243
30°	2608	2241	2028
35°	2537	2085	1840
40°	2465	1923	1624
45°	2381	1743	1428
50°	2294	1563	1237
55°	2203	1370	1054
60°	2097	1168	865
65°	1976	964	777
70°	1828	774	700
75°	1643	677	633
80°	1375	561	543
85°	936	363	397

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2381 cd/sqm

TEST NUMBER: P912611

CATALOG NUMBER: DFN2DIP-TR3F0-050D060US850-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	214.8	1.9
10°-20°	589.6	5.2
20°-30°	827.8	7.3
30°-40°	902.4	8.0
40°-50°	829.4	7.3
50°-60°	651.3	5.8
60°-70°	424.0	3.8
70°-80°	218.2	1.9
80°-90°	59.7	0.5
90°-100°	74.1	0.7
100°-110°	276.0	2.4
110°-120°	732.1	6.5
120°-130°	1214.2	10.7
130°-140°	1289.8	11.4
140°-150°	1198.7	10.6
150°-160°	963.8	8.5
160°-170°	621.0	5.5
170°-180°	213.7	1.9
0°-30°	1632.2	14.4
0°-40°	2534.6	22.4
0°-60°	4015.3	35.5
0°-90°	4717.2	41.7
90°-120°	1082.2	9.6
90°-150°	4785.0	42.3
90°-180°	6583.0	58.3
0°-180°	11300.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2292	2292	2292	2292	2292	
5°	2292	2281	2254	2273	2267	217
15°	2180	2157	2086	2047	2026	614
25°	1979	1912	1775	1690	1659	910
35°	1705	1599	1417	1286	1240	1067
45°	1394	1255	1037	890	840	1076
55°	1060	898	674	550	510	947
65°	716	548	361	290	284	709
75°	382	236	166	151	149	404
85°	89	46	39	39	39	102
90°	2	20	32	41	44	11
95°	106	52	63	72	70	125
105°	494	543	99	117	124	528
115°	934	962	1003	250	133	920
125°	1321	1342	1373	1384	1389	1178
135°	1635	1661	1675	1692	1688	1263
145°	1896	1895	1922	1934	1926	1186
155°	2088	2074	2093	2103	2090	962
165°	2200	2190	2195	2207	2195	622
175°	2250	2239	2242	2254	2238	214
180°	2246	2246	2246	2246	2246	

TEST NUMBER: P912611

CATALOG NUMBER: DFN2DIP-TR3F0-050D060US850-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2291.7	2291.7	2291.7	2291.7	2291.7
2.5°	2302.1	2291.7	2268.9	2289.8	2285.5
5°	2291.7	2281.4	2254.4	2273.0	2266.9
7.5°	2273.0	2260.7	2231.6	2239.8	2229.4
10°	2248.2	2233.6	2192.3	2185.9	2173.5
12.5°	2217.1	2198.5	2142.4	2130.1	2107.1
15°	2179.7	2156.9	2086.5	2047.1	2026.4
17.5°	2136.2	2103.0	2015.8	1970.2	1937.0
20°	2086.5	2044.9	1941.2	1889.5	1843.7
22.5°	2032.6	1984.8	1864.5	1794.0	1763.0
25°	1978.6	1912.1	1775.3	1690.3	1659.1
27.5°	1914.4	1843.7	1692.3	1594.9	1547.2
30°	1845.9	1767.0	1601.1	1495.4	1439.3
32.5°	1779.5	1684.0	1514.1	1389.6	1337.7
35°	1704.9	1599.1	1416.6	1285.9	1240.2
37.5°	1632.2	1518.1	1325.4	1182.1	1130.4
40°	1555.5	1431.2	1229.8	1082.6	1028.7
42.5°	1476.7	1344.0	1134.5	980.9	929.2
45°	1393.8	1254.7	1037.0	889.6	839.8
47.5°	1314.9	1167.8	943.8	796.4	750.8
50°	1227.9	1080.6	852.5	709.2	665.8
52.5°	1142.7	987.1	765.3	628.5	589.1
55°	1059.8	898.0	673.9	549.6	510.3
57.5°	974.8	808.9	593.2	477.1	443.8
60°	887.6	721.7	508.0	402.5	369.2
62.5°	802.7	636.8	435.5	336.0	319.5
65°	715.5	547.5	360.9	290.4	284.1
67.5°	632.6	464.6	290.4	255.1	248.9
70°	545.5	383.7	240.5	219.8	211.5
72.5°	462.6	309.0	201.2	184.6	180.4
75°	381.6	236.3	165.9	151.4	149.4
77.5°	300.8	167.9	130.8	122.3	118.1
80°	226.0	120.3	99.5	91.3	91.3
82.5°	157.6	81.0	68.4	64.2	64.2
85°	89.2	45.6	39.4	39.4	39.4
87.5°	33.3	16.5	16.5	14.5	14.5
90°	1.6	19.5	32.4	40.7	43.8
92.5°	40.7	34.2	38.9	42.3	43.8
95°	105.6	51.9	63.3	71.6	69.9
97.5°	190.1	56.9	82.7	87.8	89.4
100°	287.7	65.0	92.6	105.6	108.8
102.5°	394.8	391.7	95.9	113.7	118.7
105°	493.9	542.7	99.1	116.9	123.5
107.5°	609.4	649.9	102.5	120.2	126.8
110°	720.0	753.9	284.5	122.0	128.3

TEST NUMBER: P912611

CATALOG NUMBER: DFN2DIP-TR3F0-050D060US850-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	823.9	853.0	825.4	125.0	130.1
115°	934.3	961.9	1002.6	250.3	133.3
117.5°	1030.2	1062.6	1090.4	857.9	432.2
120°	1137.5	1161.8	1191.2	1210.6	991.2
122.5°	1228.3	1254.4	1287.0	1296.6	1298.4
125°	1321.0	1342.2	1373.1	1384.5	1389.2
127.5°	1405.5	1428.3	1452.8	1469.0	1470.5
130°	1485.2	1511.2	1529.0	1546.9	1545.4
132.5°	1566.5	1587.6	1605.4	1620.0	1618.5
135°	1634.8	1660.8	1675.3	1691.7	1688.3
137.5°	1706.1	1725.6	1742.0	1758.2	1753.4
140°	1776.0	1789.1	1806.9	1821.5	1813.4
142.5°	1834.6	1846.0	1867.1	1880.0	1871.9
145°	1896.4	1894.6	1922.2	1933.7	1925.6
147.5°	1949.8	1945.0	1972.6	1980.7	1974.4
150°	2002.0	1990.5	2016.6	2026.3	2018.2
152.5°	2045.8	2032.8	2057.1	2067.0	2055.5
155°	2088.0	2073.5	2093.0	2102.7	2089.7
157.5°	2122.2	2109.2	2123.8	2135.3	2122.2
160°	2151.5	2141.6	2151.5	2161.1	2149.8
162.5°	2177.3	2167.7	2175.7	2187.2	2172.5
165°	2200.1	2190.5	2195.3	2206.7	2195.3
167.5°	2218.0	2208.2	2213.2	2224.7	2209.9
170°	2232.7	2222.9	2226.2	2237.5	2222.9
172.5°	2242.4	2232.7	2236.0	2247.4	2232.7
175°	2250.5	2239.1	2242.4	2253.7	2237.5
177.5°	2253.7	2242.4	2244.1	2255.5	2240.8
180°	2245.6	2245.6	2245.6	2245.6	2245.6

TEST NUMBER: P912611

CATALOG NUMBER: DFN2DIP-TR3F0-050D060US850-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.92	10.69	10.95	11.72	13.11	5.90	6.66	6.93	7.70	9.08
	3H	11.58	12.27	12.62	13.31	14.72	7.07	7.76	8.12	8.80	10.21
	4H	12.18	12.83	13.23	13.88	15.29	7.52	8.17	8.57	9.21	10.63
	6H	12.59	13.19	13.65	14.24	15.66	7.83	8.43	8.89	9.48	10.90
	8H	12.71	13.28	13.78	14.35	15.77	7.92	8.48	8.98	9.55	10.97
	12H	12.77	13.31	13.84	14.37	15.81	7.95	8.49	9.03	9.55	11.00
4H	2H	9.93	10.58	10.99	11.62	13.04	6.48	7.13	7.54	8.17	9.59
	3H	11.74	12.28	12.81	13.35	14.78	7.82	8.36	8.88	9.43	10.86
	4H	12.42	12.92	13.50	13.98	15.43	8.36	8.85	9.43	9.92	11.36
	6H	12.93	13.35	14.01	14.44	15.88	8.77	9.19	9.85	10.28	11.72
	8H	13.09	13.49	14.18	14.57	16.03	8.89	9.29	9.97	10.37	11.82
	12H	13.18	13.54	14.28	14.63	16.10	8.95	9.31	10.05	10.40	11.86
8H	4H	12.38	12.78	13.47	13.86	15.32	8.63	9.02	9.71	10.10	11.56
	6H	12.94	13.26	14.04	14.39	15.84	9.13	9.46	10.24	10.58	12.04
	8H	13.15	13.43	14.26	14.54	16.01	9.32	9.61	10.43	10.71	12.19
	12H	13.28	13.53	14.39	14.63	16.14	9.43	9.68	10.55	10.78	12.30
12H	4H	12.33	12.69	13.43	13.78	15.25	8.63	8.98	9.73	10.08	11.54
	6H	12.91	13.20	14.02	14.30	15.78	9.18	9.47	10.29	10.57	12.05
	8H	13.12	13.38	14.24	14.48	15.99	9.38	9.63	10.50	10.73	12.25

END OF REPORT