

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912674

Luminaire Tested: DFN2DIP-TR3F0-080D030US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912674
REPORT IS A COMBINATION OF REPORTS P900281 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-080D030US850-FLLFLL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11727.6 lumens
Efficiency: N/A
Efficacy: 113.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 103.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912674

CATALOG NUMBER: DFN2DIP-TR3F0-080D030US850-FLLFLL

Luminous Intensity Polar Plot

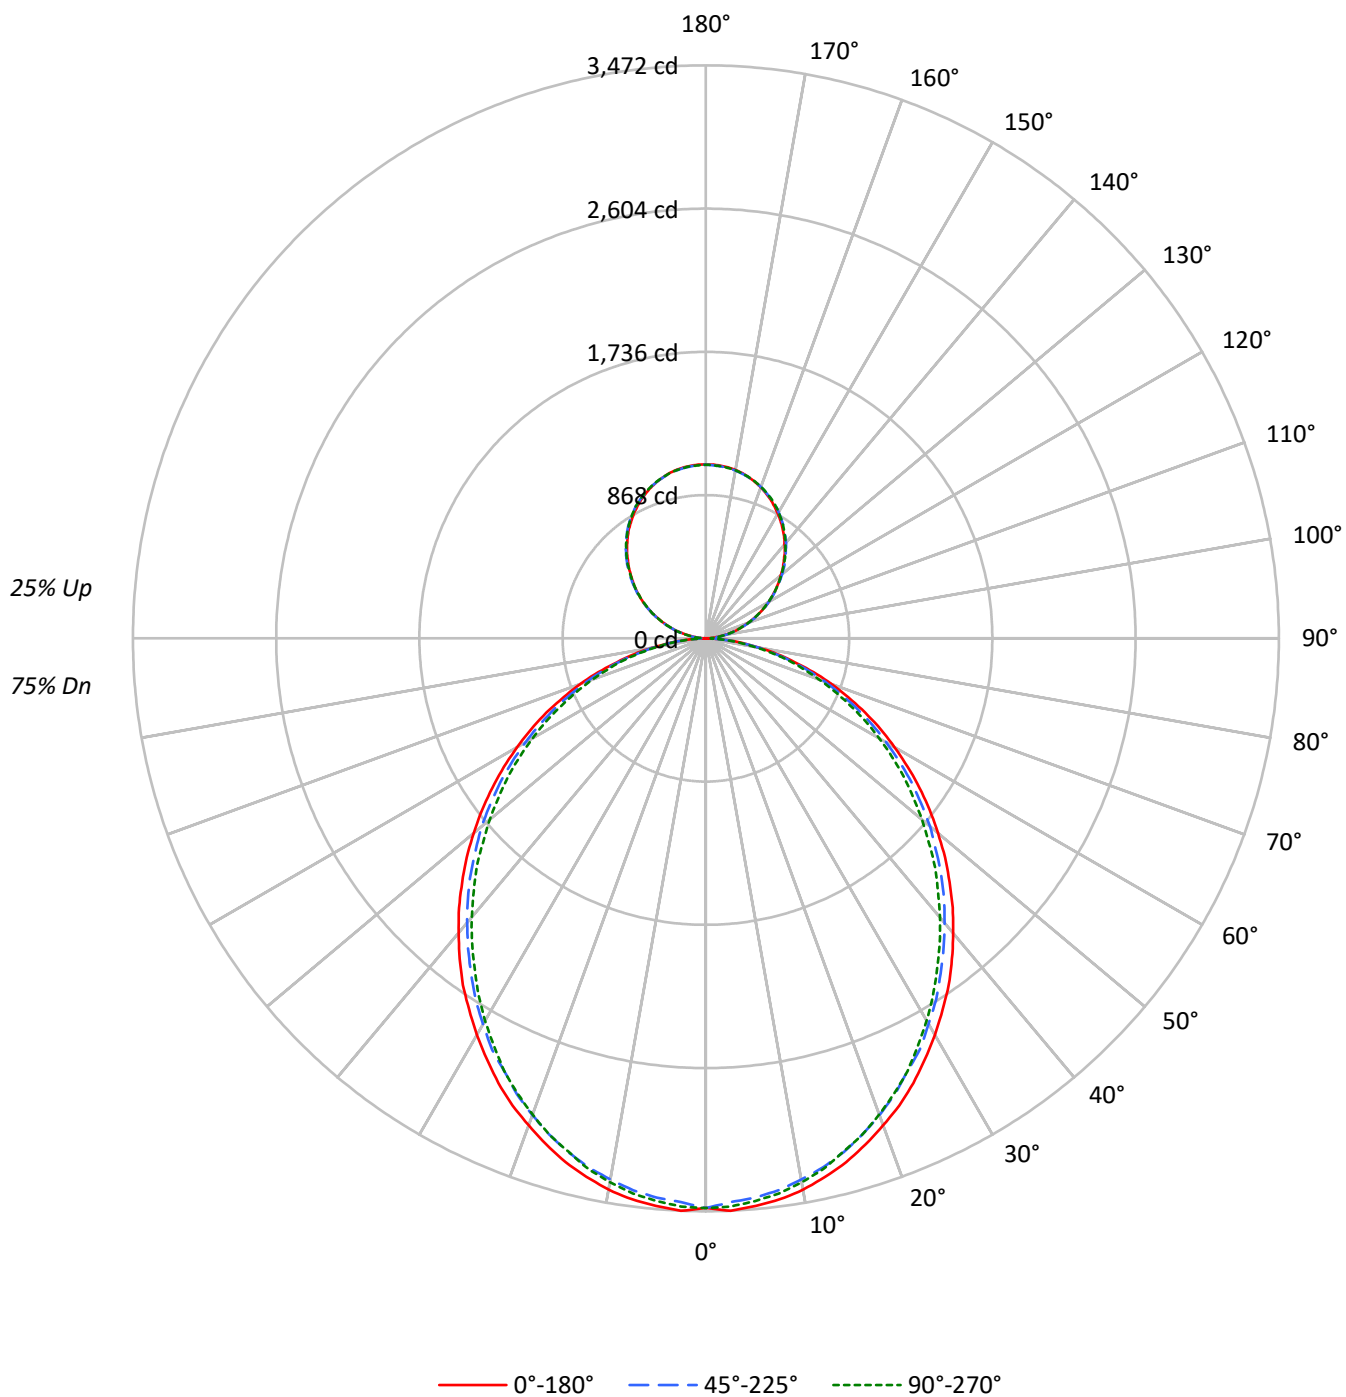

TEST NUMBER: P912674

CATALOG NUMBER: DFN2DIP-TR3F0-080D030US850-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	113	113	113	113	108	108	108	108	97	97	97	88	88	88	79	79	79
1	103	99	95	91	98	94	91	87	85	83	80	77	75	73	70	68	67
2	94	86	80	75	89	82	77	72	75	70	66	68	64	61	62	59	56
3	86	76	68	62	81	73	66	60	66	61	56	60	56	52	55	51	48
4	79	67	59	53	75	64	57	51	59	53	48	54	49	45	49	45	41
5	72	60	52	45	69	58	50	44	53	46	41	48	43	39	44	40	36
6	67	54	46	40	63	52	44	39	48	41	36	44	38	34	40	35	32
7	62	49	41	35	59	47	39	34	43	37	32	40	34	30	37	32	28
8	58	45	37	31	55	43	36	30	40	33	29	37	31	27	34	29	25
9	54	41	33	28	51	39	32	27	36	30	26	34	28	24	31	26	23
10	50	38	30	25	48	36	29	25	34	28	23	31	26	22	29	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4302	4302	4302
5°	4306	4238	4268
10°	4269	4178	4207
15°	4204	4105	4114
20°	4117	4006	4019
25°	4030	3888	3909
30°	3922	3778	3770
35°	3819	3649	3624
40°	3693	3518	3484
45°	3567	3387	3341
50°	3429	3249	3176
55°	3284	3090	3023
60°	3121	2901	2848
65°	2942	2705	2641
70°	2715	2467	2418
75°	2400	2180	2208
80°	2020	1814	1815
85°	1428	1194	1172

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3567 cd/sqm

TEST NUMBER: P912674

CATALOG NUMBER: DFN2DIP-TR3F0-080D030US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	324.9	2.8
10°-20°	914.2	7.8
20°-30°	1343.5	11.5
30°-40°	1560.4	13.3
40°-50°	1558.4	13.3
50°-60°	1358.9	11.6
60°-70°	1004.5	8.6
70°-80°	568.4	4.8
80°-90°	153.0	1.3
90°-100°	65.1	0.6
100°-110°	206.9	1.8
110°-120°	354.0	3.0
120°-130°	465.6	4.0
130°-140°	522.6	4.5
140°-150°	512.5	4.4
150°-160°	429.9	3.7
160°-170°	285.1	2.4
170°-180°	99.7	0.8
0°-30°	2582.6	22.0
0°-40°	4143.0	35.3
0°-60°	7060.4	60.2
0°-90°	8786.3	74.9
90°-120°	626.0	5.3
90°-150°	2126.7	18.1
90°-180°	2941.0	25.1
0°-180°	11727.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3452	3452	3452	3452	3452	
5°	3452	3439	3402	3429	3423	328
15°	3286	3267	3223	3237	3220	926
25°	2974	2948	2892	2898	2892	1369
35°	2566	2533	2480	2460	2443	1602
45°	2088	2065	2015	1979	1965	1612
55°	1580	1560	1520	1481	1464	1413
65°	1066	1046	1012	983	966	1054
75°	558	551	534	515	521	595
85°	136	133	130	119	116	152
90°	1	11	31	29	30	11
95°	46	55	57	57	55	52
105°	191	194	195	197	197	202
115°	355	360	359	358	355	351
125°	517	525	522	519	518	462
135°	668	678	680	679	677	517
145°	812	818	823	824	820	507
155°	928	930	933	938	935	427
165°	1009	1008	1008	1015	1010	285
175°	1050	1048	1046	1052	1047	100
180°	1052	1052	1052	1052	1052	

TEST NUMBER: P912674

CATALOG NUMBER: DFN2DIP-TR3F0-080D030US850-FLLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3452.1	3452.1	3452.1	3452.1	3452.1
2.5°	3472.2	3455.6	3419.0	3452.1	3445.8
5°	3452.1	3439.1	3402.5	3428.9	3422.6
7.5°	3428.9	3409.2	3372.6	3399.3	3392.7
10°	3392.7	3369.4	3329.6	3355.9	3346.2
12.5°	3342.6	3322.9	3283.1	3299.6	3293.0
15°	3286.3	3266.6	3223.2	3236.6	3220.1
17.5°	3216.5	3196.8	3153.4	3170.1	3153.4
20°	3140.1	3120.4	3073.9	3083.8	3070.7
22.5°	3064.1	3034.1	2990.8	2990.8	2984.1
25°	2974.2	2947.8	2891.5	2897.8	2891.5
27.5°	2874.5	2851.3	2808.3	2798.5	2781.9
30°	2775.3	2748.4	2698.9	2689.0	2675.6
32.5°	2668.9	2649.2	2595.9	2575.9	2562.6
35°	2566.0	2533.0	2479.7	2459.7	2443.1
37.5°	2449.8	2419.8	2366.7	2343.4	2326.9
40°	2330.5	2303.6	2250.5	2220.9	2207.5
42.5°	2214.2	2187.4	2134.6	2101.1	2081.5
45°	2088.1	2064.8	2014.8	1978.6	1965.3
47.5°	1965.3	1942.0	1888.7	1852.1	1832.4
50°	1835.6	1819.1	1772.5	1726.0	1709.5
52.5°	1709.5	1686.2	1643.3	1606.7	1583.4
55°	1580.2	1560.1	1520.4	1480.6	1464.0
57.5°	1450.7	1434.2	1390.8	1351.0	1337.6
60°	1321.0	1308.1	1261.5	1224.9	1215.0
62.5°	1194.9	1171.8	1138.6	1105.6	1092.1
65°	1065.7	1045.7	1012.5	982.6	966.0
67.5°	932.9	916.0	886.4	863.2	849.8
70°	810.0	796.6	766.8	743.5	730.4
72.5°	683.9	670.6	654.0	630.8	620.9
75°	557.5	551.2	534.3	514.6	521.2
77.5°	444.8	431.4	424.7	414.9	405.0
80°	332.1	328.6	321.9	312.1	305.3
82.5°	225.8	225.8	222.6	209.2	209.2
85°	136.0	132.7	129.6	119.4	116.2
87.5°	59.9	53.2	46.5	36.6	33.2
90°	1.0	11.4	31.1	29.2	30.2
92.5°	19.6	26.6	27.6	28.5	28.5
95°	46.4	55.2	56.8	56.8	55.2
97.5°	77.1	85.3	88.8	88.8	88.8
100°	112.6	119.9	122.4	122.4	121.5
102.5°	150.0	155.5	158.9	159.9	158.9
105°	191.0	193.5	195.4	197.0	197.0
107.5°	231.6	235.3	235.3	236.0	231.6
110°	270.9	276.0	276.0	276.0	273.5



TEST NUMBER: P912674

CATALOG NUMBER: DFN2DIP-TR3F0-080D030US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	313.4	318.8	317.8	315.3	313.4
115°	355.3	360.3	358.8	357.9	355.3
117.5°	396.8	403.8	399.4	396.8	394.2
120°	438.7	445.7	438.7	438.7	435.8
122.5°	476.8	485.6	481.2	478.6	476.8
125°	516.8	524.7	522.1	519.2	518.3
127.5°	555.7	565.6	562.2	558.3	555.7
130°	592.2	603.6	602.1	600.2	596.6
132.5°	633.1	642.0	642.7	638.2	635.7
135°	668.4	678.2	680.1	679.2	676.6
137.5°	707.7	715.6	717.2	716.6	712.8
140°	742.3	750.2	754.7	754.7	751.1
142.5°	777.9	785.7	788.3	789.3	785.7
145°	811.5	817.8	822.9	823.8	820.3
147.5°	841.6	849.5	853.3	854.9	851.4
150°	872.7	878.1	881.5	884.4	881.5
152.5°	900.3	905.6	910.0	913.6	910.0
155°	927.9	930.3	933.2	937.7	934.9
157.5°	951.6	953.5	955.2	961.5	957.1
160°	972.9	974.8	975.8	981.1	977.4
162.5°	992.6	992.6	993.6	999.5	995.1
165°	1009.4	1008.4	1008.4	1014.7	1010.3
167.5°	1024.6	1021.7	1021.7	1028.0	1023.6
170°	1036.0	1033.5	1032.6	1038.9	1033.5
172.5°	1043.9	1041.5	1040.5	1046.8	1041.5
175°	1050.3	1047.8	1045.9	1052.2	1046.8
177.5°	1053.8	1051.2	1049.3	1054.8	1049.3
180°	1052.2	1052.2	1052.2	1052.2	1052.2



TEST NUMBER: P912674

CATALOG NUMBER: DFN2DIP-TR3F0-080D030US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.33	15.47	15.04	16.20	17.06	13.90	15.04	14.61	15.77	16.63
	3H	16.00	17.03	16.72	17.76	18.66	15.53	16.56	16.25	17.30	18.19
	4H	16.59	17.56	17.34	18.31	19.22	16.13	17.09	16.87	17.84	18.75
	6H	17.00	17.89	17.75	18.65	19.58	16.53	17.43	17.29	18.18	19.11
	8H	17.11	17.96	17.87	18.74	19.66	16.64	17.49	17.41	18.27	19.20
	12H	17.16	17.98	17.93	18.75	19.70	16.69	17.50	17.46	18.27	19.23
4H	2H	14.82	15.79	15.56	16.54	17.45	14.48	15.45	15.22	16.19	17.10
	3H	16.70	17.51	17.46	18.29	19.22	16.31	17.12	17.07	17.90	18.83
	4H	17.42	18.15	18.19	18.94	19.89	17.02	17.75	17.79	18.54	19.49
	6H	17.94	18.58	18.73	19.39	20.35	17.54	18.17	18.33	18.98	19.94
	8H	18.09	18.69	18.89	19.49	20.47	17.69	18.28	18.48	19.09	20.06
	12H	18.17	18.71	18.99	19.54	20.52	17.76	18.29	18.57	19.12	20.10
8H	4H	17.63	18.23	18.43	19.03	20.01	17.28	17.87	18.07	18.68	19.65
	6H	18.26	18.76	19.09	19.61	20.58	17.91	18.40	18.73	19.25	20.22
	8H	18.48	18.92	19.32	19.77	20.76	18.12	18.56	18.95	19.40	20.39
	12H	18.62	19.01	19.46	19.84	20.89	18.24	18.63	19.08	19.47	20.51
12H	4H	17.63	18.17	18.45	19.00	19.97	17.28	17.82	18.10	18.65	19.63
	6H	18.29	18.74	19.13	19.58	20.57	17.95	18.39	18.78	19.23	20.22
	8H	18.54	18.93	19.38	19.77	20.82	18.19	18.58	19.03	19.41	20.46

END OF REPORT