

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912680

Luminaire Tested: DFN2DIP-TR3F0-080D040US850-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912680
REPORT IS A COMBINATION OF REPORTS P900296 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-080D040US850-RLLFLL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11467.0 lumens
Efficiency: N/A
Efficacy: 103.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 110.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912680

CATALOG NUMBER: DFN2DIP-TR3F0-080D040US850-RLLFLL

Luminous Intensity Polar Plot

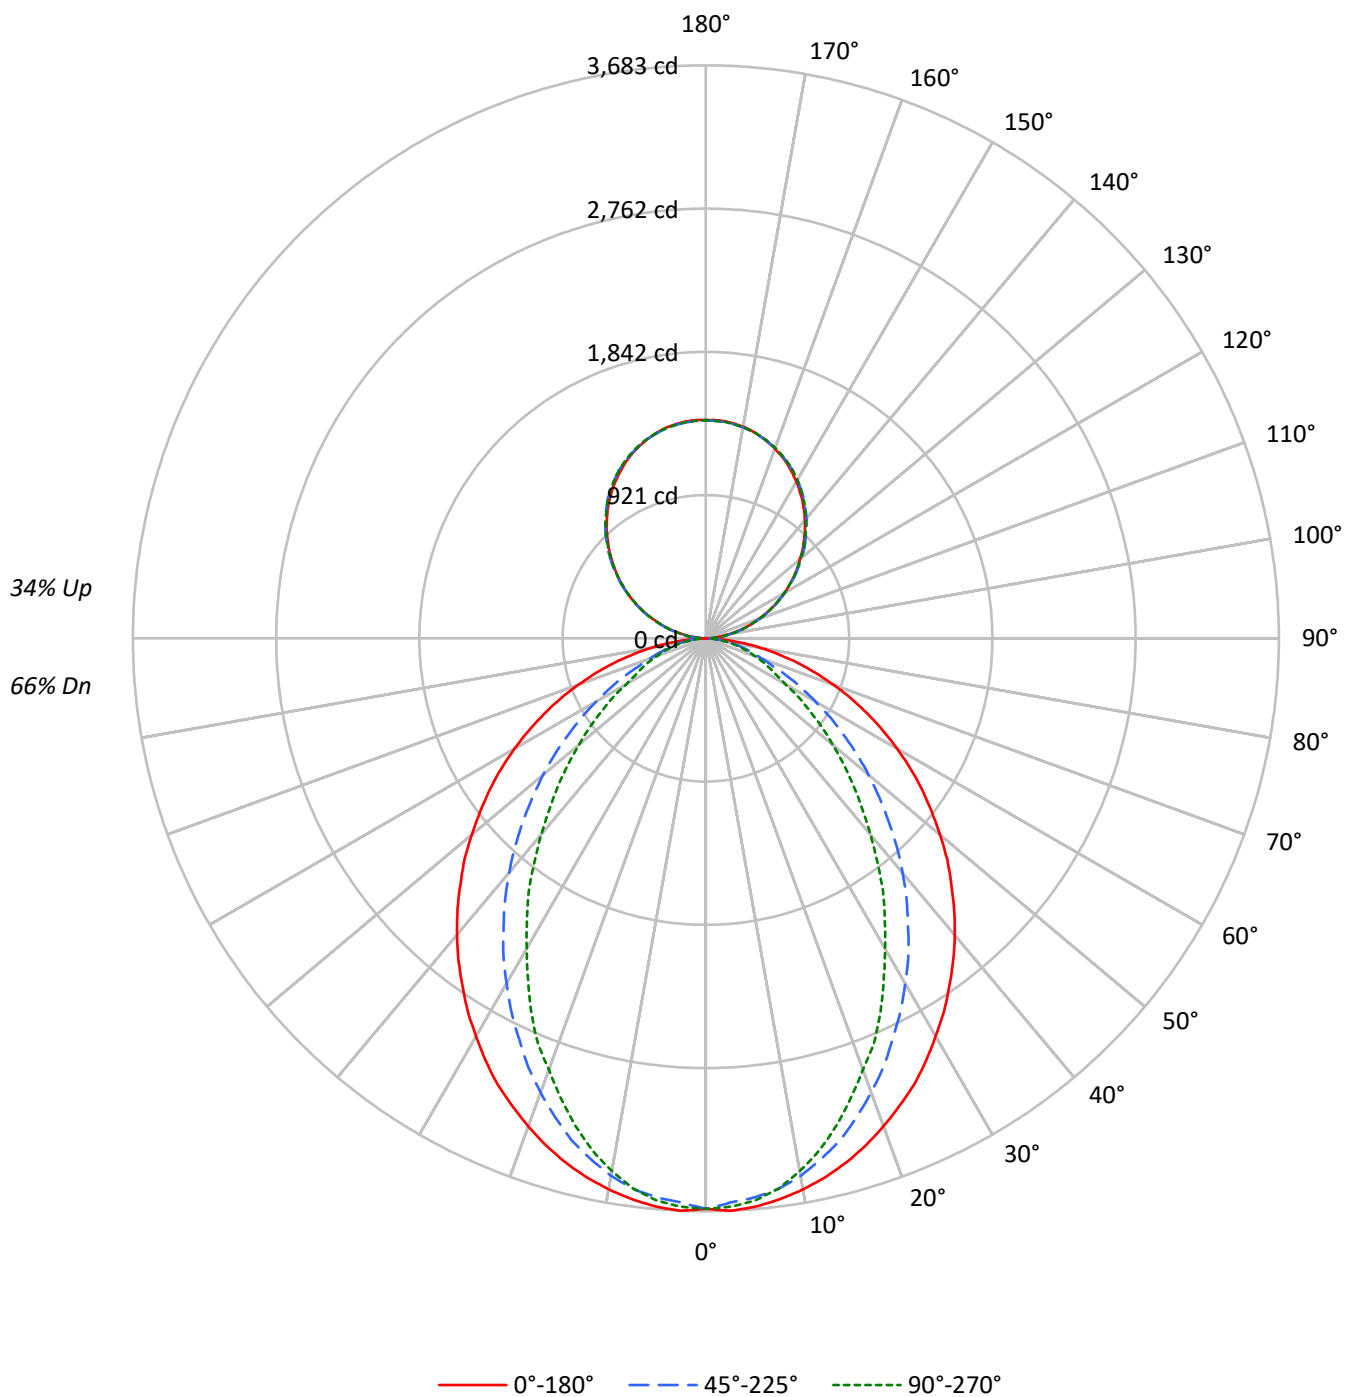

TEST NUMBER: P912680

CATALOG NUMBER: DFN2DIP-TR3F0-080D040US850-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	81	81	81	71	71	71
1	102	98	94	91	96	92	89	86	82	79	77	72	70	69	63	62	61
2	93	86	80	75	88	81	76	72	72	68	65	64	61	58	57	54	52
3	86	76	69	63	80	72	66	61	65	59	55	57	53	50	51	48	45
4	79	68	60	54	74	65	58	52	58	52	48	52	47	44	46	42	40
5	73	61	53	47	68	58	51	45	52	46	42	47	42	38	42	38	35
6	67	55	47	41	63	52	45	40	47	41	37	42	38	34	38	34	31
7	62	50	42	37	59	48	40	35	43	37	33	39	34	30	35	31	28
8	58	46	38	33	55	44	37	32	40	34	29	36	31	27	32	28	25
9	54	42	35	29	51	40	33	29	36	31	27	33	28	25	30	26	23
10	51	39	31	27	48	37	30	26	34	28	24	31	26	23	28	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4569	4569	4569
5°	4574	4493	4522
10°	4526	4401	4372
15°	4461	4252	4142
20°	4376	4048	3860
25°	4289	3820	3589
30°	4173	3586	3245
35°	4060	3335	2943
40°	3944	3076	2598
45°	3809	2790	2285
50°	3670	2500	1979
55°	3524	2192	1686
60°	3355	1870	1385
65°	3161	1543	1243
70°	2925	1238	1120
75°	2629	1083	1013
80°	2199	896	868
85°	1497	581	635

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3809 cd/sqm

TEST NUMBER: P912680

CATALOG NUMBER: DFN2DIP-TR3F0-080D040US850-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	343.7	3.0
10°-20°	943.4	8.2
20°-30°	1324.5	11.6
30°-40°	1443.8	12.6
40°-50°	1327.0	11.6
50°-60°	1042.1	9.1
60°-70°	678.3	5.9
70°-80°	349.2	3.0
80°-90°	93.1	0.8
90°-100°	86.8	0.8
100°-110°	275.8	2.4
110°-120°	472.0	4.1
120°-130°	620.8	5.4
130°-140°	696.8	6.1
140°-150°	683.3	6.0
150°-160°	573.2	5.0
160°-170°	380.1	3.3
170°-180°	132.9	1.2
0°-30°	2611.6	22.8
0°-40°	4055.4	35.4
0°-60°	6424.5	56.0
0°-90°	7545.2	65.8
90°-120°	834.7	7.3
90°-150°	2835.6	24.7
90°-180°	3922.0	34.2
0°-180°	11467.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3667	3667	3667	3667	3667	
5°	3667	3650	3607	3637	3627	348
15°	3488	3451	3338	3275	3242	983
25°	3166	3060	2840	2705	2655	1456
35°	2728	2558	2267	2058	1984	1707
45°	2230	2008	1659	1423	1344	1722
55°	1696	1437	1078	879	816	1515
65°	1145	876	577	465	454	1135
75°	610	378	266	242	239	646
85°	143	73	63	63	63	164
90°	1	15	42	39	40	11
95°	62	74	76	76	74	69
105°	255	258	260	263	263	269
115°	474	480	478	477	474	469
125°	689	700	696	692	691	616
135°	891	904	907	906	902	689
145°	1082	1090	1097	1098	1094	676
155°	1237	1240	1244	1250	1246	569
165°	1346	1345	1345	1353	1347	380
175°	1400	1397	1394	1403	1396	133
180°	1403	1403	1403	1403	1403	

TEST NUMBER: P912680

CATALOG NUMBER: DFN2DIP-TR3F0-080D040US850-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3666.8	3666.8	3666.8	3666.8	3666.8
2.5°	3683.3	3666.8	3630.2	3663.6	3656.9
5°	3666.8	3650.3	3606.9	3636.9	3627.0
7.5°	3636.9	3617.1	3570.6	3583.7	3567.1
10°	3597.0	3573.9	3507.7	3497.5	3477.7
12.5°	3547.5	3517.5	3427.7	3408.0	3371.4
15°	3487.6	3451.0	3338.3	3275.3	3242.2
17.5°	3417.8	3364.7	3225.3	3152.4	3099.2
20°	3338.3	3271.8	3106.0	3023.2	2949.9
22.5°	3252.0	3175.6	2983.1	2870.4	2820.7
25°	3165.8	3059.5	2840.5	2704.6	2654.6
27.5°	3062.9	2949.9	2707.7	2551.8	2475.4
30°	2953.5	2827.1	2561.7	2392.7	2302.8
32.5°	2847.1	2694.4	2422.6	2223.3	2140.3
35°	2727.8	2558.5	2266.6	2057.5	1984.2
37.5°	2611.6	2428.9	2120.5	1891.3	1808.6
40°	2488.8	2289.9	1967.7	1732.1	1645.9
42.5°	2362.7	2150.5	1815.2	1569.6	1486.7
45°	2230.0	2007.5	1659.3	1423.4	1343.9
47.5°	2104.0	1868.4	1510.0	1274.1	1201.3
50°	1964.5	1729.0	1364.0	1134.7	1065.3
52.5°	1828.3	1579.3	1224.4	1005.5	942.5
55°	1695.6	1436.8	1078.4	879.4	816.4
57.5°	1559.7	1294.2	949.2	763.3	710.1
60°	1420.2	1154.8	812.9	643.9	590.8
62.5°	1284.3	1018.8	696.8	537.6	511.2
65°	1144.9	875.9	577.3	464.8	454.5
67.5°	1012.2	743.3	464.8	408.0	398.2
70°	872.8	614.1	384.8	351.7	338.4
72.5°	740.0	494.3	321.8	295.4	288.7
75°	610.5	378.2	265.5	242.2	239.1
77.5°	481.3	268.6	209.2	195.7	189.1
80°	361.5	192.6	159.1	146.1	146.1
82.5°	252.1	129.5	109.5	102.8	102.8
85°	142.6	72.9	63.0	63.0	63.0
87.5°	53.1	26.4	26.4	23.3	23.3
90°	1.2	15.2	41.5	38.9	40.1
92.5°	26.2	35.5	36.8	38.0	38.0
95°	61.8	73.6	75.7	75.7	73.6
97.5°	102.8	113.8	118.4	118.4	118.4
100°	150.2	159.9	163.2	163.2	162.0
102.5°	200.1	207.3	211.9	213.1	211.9
105°	254.6	258.0	260.5	262.6	262.6
107.5°	308.7	313.8	313.8	314.6	308.7
110°	361.2	368.0	368.0	368.0	364.6

TEST NUMBER: P912680

CATALOG NUMBER: DFN2DIP-TR3F0-080D040US850-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	417.9	425.1	423.7	420.4	417.9
115°	473.7	480.5	478.3	477.1	473.7
117.5°	529.1	538.4	532.5	529.1	525.8
120°	585.0	594.2	585.0	585.0	581.1
122.5°	635.7	647.5	641.7	638.2	635.7
125°	689.0	699.6	696.2	692.3	691.1
127.5°	741.0	754.1	749.5	744.4	741.0
130°	789.6	804.9	802.8	800.3	795.6
132.5°	844.2	856.0	856.9	850.9	847.6
135°	891.2	904.3	906.8	905.5	902.2
137.5°	943.6	954.2	956.3	955.4	950.4
140°	989.7	1000.3	1006.2	1006.2	1001.5
142.5°	1037.1	1047.7	1051.0	1052.3	1047.7
145°	1081.9	1090.4	1097.1	1098.5	1093.8
147.5°	1122.1	1132.6	1137.7	1139.8	1135.2
150°	1163.6	1170.8	1175.4	1179.2	1175.4
152.5°	1200.4	1207.5	1213.5	1218.1	1213.5
155°	1237.1	1240.5	1244.3	1250.3	1246.4
157.5°	1268.9	1271.4	1273.5	1282.0	1276.0
160°	1297.2	1299.7	1301.0	1308.2	1303.1
162.5°	1323.4	1323.4	1324.7	1332.7	1326.8
165°	1345.9	1344.6	1344.6	1353.0	1347.1
167.5°	1366.2	1362.3	1362.3	1370.8	1364.8
170°	1381.4	1377.9	1376.7	1385.1	1377.9
172.5°	1391.9	1388.6	1387.2	1395.8	1388.6
175°	1400.4	1397.0	1394.5	1402.9	1395.8
177.5°	1405.1	1401.7	1399.1	1406.3	1399.1
180°	1402.9	1402.9	1402.9	1402.9	1402.9

TEST NUMBER: P912680

CATALOG NUMBER: DFN2DIP-TR3F0-080D040US850-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.73	14.71	14.55	15.55	16.57	9.71	10.69	10.53	11.52	12.55
	3H	15.41	16.29	16.24	17.13	18.19	10.91	11.78	11.73	12.62	13.68
	4H	16.02	16.85	16.87	17.70	18.77	11.36	12.18	12.20	13.03	14.10
	6H	16.44	17.20	17.30	18.06	19.14	11.68	12.44	12.54	13.30	14.38
	8H	16.57	17.29	17.44	18.17	19.25	11.77	12.50	12.64	13.37	14.45
	12H	16.63	17.32	17.50	18.19	19.30	11.82	12.51	12.69	13.38	14.48
4H	2H	13.77	14.59	14.62	15.44	16.51	10.32	11.14	11.17	11.99	13.06
	3H	15.60	16.29	16.46	17.17	18.25	11.68	12.36	12.54	13.24	14.33
	4H	16.29	16.92	17.17	17.80	18.91	12.22	12.85	13.10	13.73	14.84
	6H	16.81	17.34	17.70	18.25	19.36	12.65	13.18	13.54	14.09	15.20
	8H	16.98	17.48	17.87	18.38	19.51	12.77	13.28	13.67	14.17	15.30
	12H	17.08	17.53	17.99	18.44	19.58	12.84	13.29	13.75	14.21	15.34
8H	4H	16.27	16.77	17.16	17.67	18.80	12.51	13.01	13.40	13.91	15.04
	6H	16.83	17.24	17.75	18.19	19.31	13.03	13.44	13.94	14.38	15.51
	8H	17.04	17.41	17.97	18.34	19.49	13.21	13.58	14.14	14.51	15.66
	12H	17.18	17.50	18.11	18.43	19.62	13.33	13.66	14.26	14.58	15.78
12H	4H	16.23	16.68	17.14	17.60	18.73	12.52	12.97	13.43	13.89	15.02
	6H	16.81	17.17	17.73	18.11	19.25	13.07	13.44	14.00	14.37	15.52
	8H	17.03	17.35	17.96	18.27	19.47	13.29	13.61	14.22	14.53	15.73

END OF REPORT