

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912684

Luminaire Tested: DFN2DIP-TR3F0-080D050US850-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912684
REPORT IS A COMBINATION OF REPORTS P900310 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-080D050US850-RLLFLL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12448.6 lumens
Efficiency: N/A
Efficacy: 105.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 118
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912684

CATALOG NUMBER: DFN2DIP-TR3F0-080D050US850-RLLFLL

Luminous Intensity Polar Plot

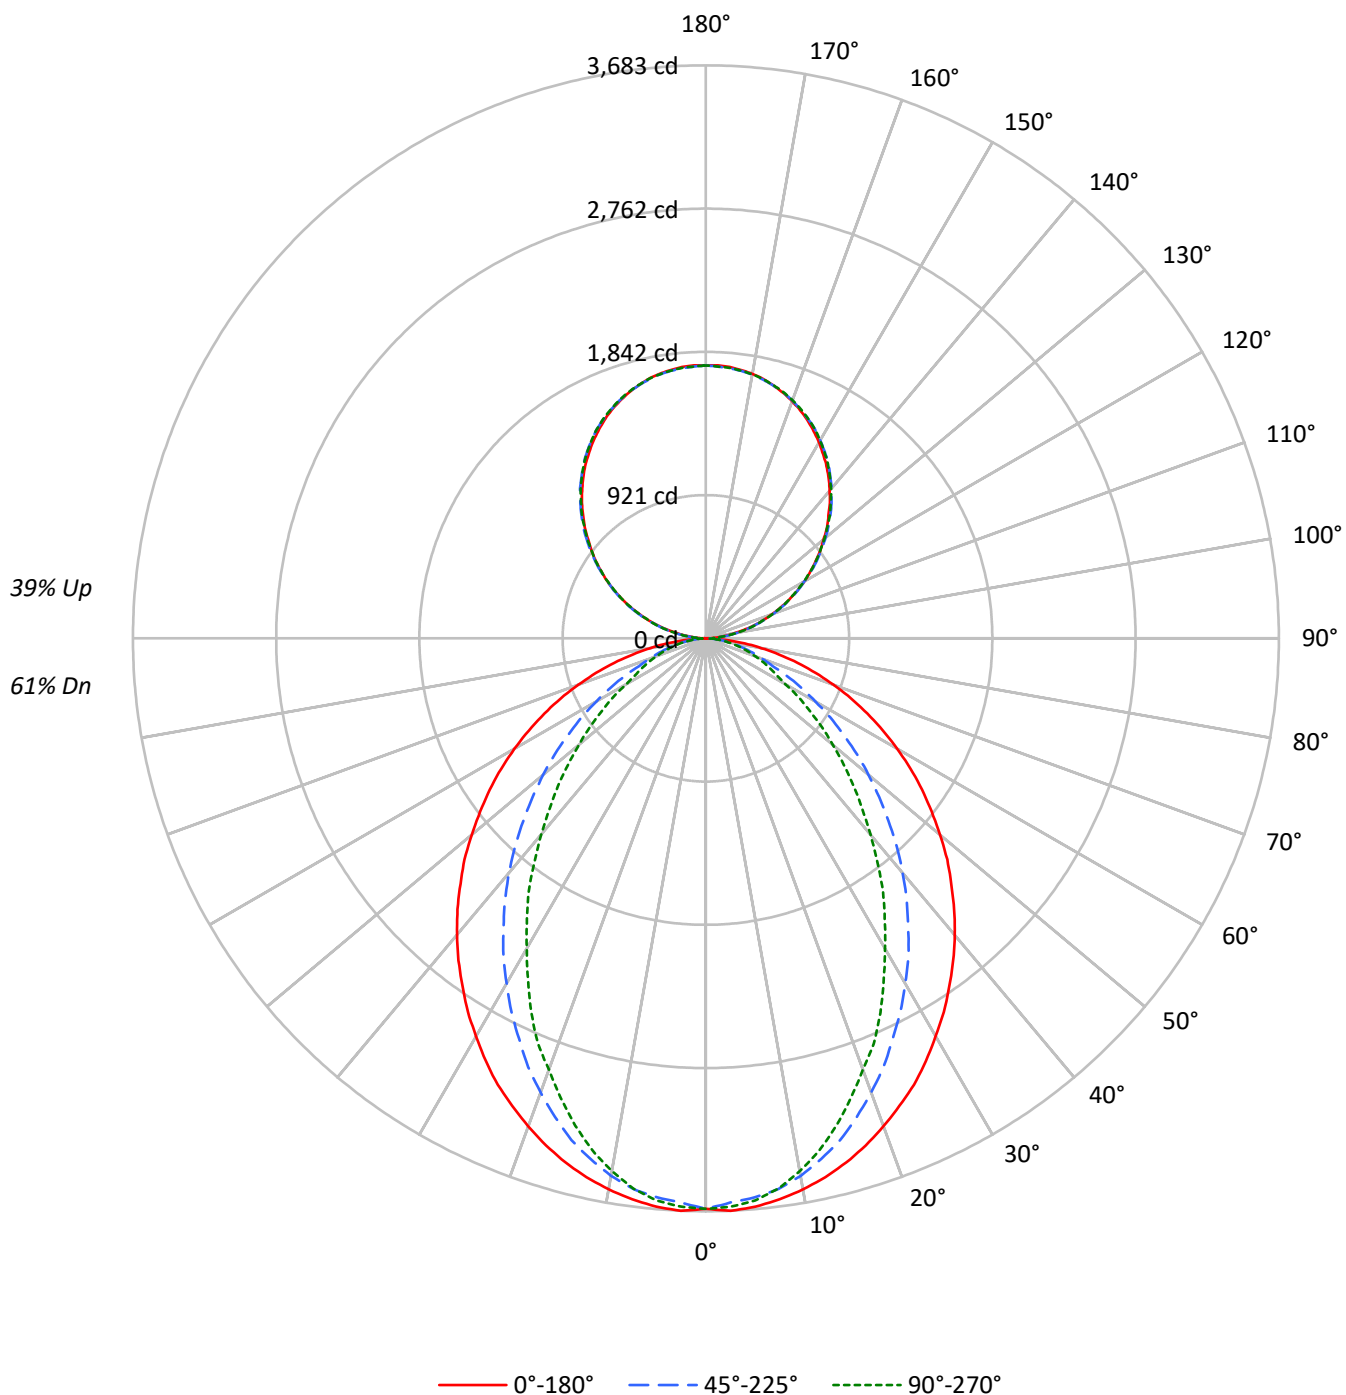

TEST NUMBER: P912684

CATALOG NUMBER: DFN2DIP-TR3F0-080D050US850-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	89	89	89	77	77	77	66	66	66
1	101	97	93	89	94	91	87	84	79	77	75	69	67	65	59	58	57
2	92	85	79	74	86	80	75	70	70	66	63	61	58	56	53	51	49
3	85	75	68	62	79	71	64	59	62	57	53	55	51	48	47	45	42
4	78	67	59	53	72	63	56	51	56	50	46	49	45	41	43	39	37
5	72	60	52	46	67	57	50	44	50	45	40	44	40	36	39	35	32
6	66	54	46	41	62	51	44	39	46	40	35	40	36	32	35	32	29
7	61	49	41	36	57	47	39	34	42	36	32	37	32	29	32	29	26
8	57	45	37	32	53	43	36	31	38	32	28	34	29	26	30	26	23
9	53	41	34	29	50	39	32	28	35	29	26	31	27	23	28	24	21
10	50	38	31	26	47	36	29	25	32	27	23	29	25	21	26	22	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4569	4569	4569
5°	4574	4493	4522
10°	4526	4401	4372
15°	4461	4252	4142
20°	4376	4048	3860
25°	4289	3820	3589
30°	4173	3586	3245
35°	4060	3335	2943
40°	3944	3076	2598
45°	3809	2790	2285
50°	3670	2500	1979
55°	3524	2192	1686
60°	3355	1870	1385
65°	3161	1543	1243
70°	2925	1238	1120
75°	2629	1083	1013
80°	2199	896	868
85°	1497	581	635

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3809 cd/sqm

TEST NUMBER: P912684

CATALOG NUMBER: DFN2DIP-TR3F0-080D050US850-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	343.7	2.8
10°-20°	943.4	7.6
20°-30°	1324.5	10.6
30°-40°	1443.8	11.6
40°-50°	1327.0	10.7
50°-60°	1042.1	8.4
60°-70°	678.3	5.4
70°-80°	349.2	2.8
80°-90°	94.1	0.8
90°-100°	108.5	0.9
100°-110°	344.8	2.8
110°-120°	590.1	4.7
120°-130°	776.0	6.2
130°-140°	871.0	7.0
140°-150°	854.2	6.9
150°-160°	716.5	5.8
160°-170°	475.2	3.8
170°-180°	166.1	1.3
0°-30°	2611.6	21.0
0°-40°	4055.4	32.6
0°-60°	6424.5	51.6
0°-90°	7546.2	60.6
90°-120°	1043.4	8.4
90°-150°	3544.6	28.5
90°-180°	4902.0	39.4
0°-180°	12448.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3667	3667	3667	3667	3667	
5°	3667	3650	3607	3637	3627	348
15°	3488	3451	3338	3275	3242	983
25°	3166	3060	2840	2705	2655	1456
35°	2728	2558	2267	2058	1984	1707
45°	2230	2008	1659	1423	1344	1722
55°	1696	1437	1078	879	816	1515
65°	1145	876	577	465	454	1135
75°	610	378	266	242	239	646
85°	143	73	63	63	63	164
90°	2	19	52	49	50	12
95°	77	92	95	95	92	86
105°	318	322	326	328	328	336
115°	592	601	598	596	592	586
125°	861	874	870	866	864	770
135°	1114	1130	1134	1132	1128	861
145°	1352	1363	1371	1373	1367	845
155°	1546	1551	1555	1563	1558	712
165°	1682	1681	1681	1691	1684	475
175°	1751	1746	1743	1754	1745	166
180°	1754	1754	1754	1754	1754	

TEST NUMBER: P912684

CATALOG NUMBER: DFN2DIP-TR3F0-080D050US850-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3666.8	3666.8	3666.8	3666.8	3666.8
2.5°	3683.3	3666.8	3630.2	3663.6	3656.9
5°	3666.8	3650.3	3606.9	3636.9	3627.0
7.5°	3636.9	3617.1	3570.6	3583.7	3567.1
10°	3597.0	3573.9	3507.7	3497.5	3477.7
12.5°	3547.5	3517.5	3427.7	3408.0	3371.4
15°	3487.6	3451.0	3338.3	3275.3	3242.2
17.5°	3417.8	3364.7	3225.3	3152.4	3099.2
20°	3338.3	3271.8	3106.0	3023.2	2949.9
22.5°	3252.0	3175.6	2983.1	2870.4	2820.7
25°	3165.8	3059.5	2840.5	2704.6	2654.6
27.5°	3062.9	2949.9	2707.7	2551.8	2475.4
30°	2953.5	2827.1	2561.7	2392.7	2302.8
32.5°	2847.1	2694.4	2422.6	2223.3	2140.3
35°	2727.8	2558.5	2266.6	2057.5	1984.2
37.5°	2611.6	2428.9	2120.5	1891.3	1808.6
40°	2488.8	2289.9	1967.7	1732.1	1645.9
42.5°	2362.7	2150.5	1815.2	1569.6	1486.7
45°	2230.0	2007.5	1659.3	1423.4	1343.9
47.5°	2104.0	1868.4	1510.0	1274.1	1201.3
50°	1964.5	1729.0	1364.0	1134.7	1065.3
52.5°	1828.3	1579.3	1224.4	1005.5	942.5
55°	1695.6	1436.8	1078.4	879.4	816.4
57.5°	1559.7	1294.2	949.2	763.3	710.1
60°	1420.2	1154.8	812.9	643.9	590.8
62.5°	1284.3	1018.8	696.8	537.6	511.2
65°	1144.9	875.9	577.3	464.8	454.5
67.5°	1012.2	743.3	464.8	408.0	398.2
70°	872.8	614.1	384.8	351.7	338.4
72.5°	740.0	494.3	321.8	295.4	288.7
75°	610.5	378.2	265.5	242.2	239.1
77.5°	481.3	268.6	209.2	195.7	189.1
80°	361.5	192.6	159.1	146.1	146.1
82.5°	252.1	129.5	109.5	102.8	102.8
85°	142.6	72.9	63.0	63.0	63.0
87.5°	53.1	26.4	26.4	23.3	23.3
90°	1.6	19.1	51.8	48.7	50.2
92.5°	32.8	44.4	46.0	47.6	47.6
95°	77.2	92.0	94.6	94.6	92.0
97.5°	128.4	142.2	148.1	148.1	148.1
100°	187.6	199.8	204.1	204.1	202.5
102.5°	250.1	259.1	264.8	266.5	264.8
105°	318.3	322.5	325.7	328.3	328.3
107.5°	385.9	392.3	392.3	393.4	385.9
110°	451.5	460.0	460.0	460.0	455.7

TEST NUMBER: P912684

CATALOG NUMBER: DFN2DIP-TR3F0-080D050US850-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	522.3	531.3	529.8	525.6	522.3
115°	592.1	600.6	598.0	596.4	592.1
117.5°	661.4	673.1	665.6	661.4	657.2
120°	731.2	742.8	731.2	731.2	726.4
122.5°	794.6	809.5	802.0	797.8	794.6
125°	861.2	874.4	870.2	865.5	863.9
127.5°	926.2	942.6	936.9	930.5	926.2
130°	987.1	1006.1	1003.4	1000.3	994.4
132.5°	1055.3	1070.1	1071.2	1063.8	1059.5
135°	1114.0	1130.3	1133.5	1132.0	1127.7
137.5°	1179.5	1192.7	1195.4	1194.3	1188.0
140°	1237.1	1250.4	1257.7	1257.7	1252.0
142.5°	1296.3	1309.6	1313.8	1315.4	1309.6
145°	1352.4	1363.0	1371.4	1373.1	1367.2
147.5°	1402.7	1415.9	1422.2	1424.8	1419.0
150°	1454.5	1463.4	1469.2	1474.0	1469.2
152.5°	1500.5	1509.5	1516.8	1522.7	1516.8
155°	1546.4	1550.6	1555.4	1562.8	1558.0
157.5°	1586.1	1589.2	1591.9	1602.5	1595.1
160°	1621.5	1624.7	1626.2	1635.2	1628.9
162.5°	1654.3	1654.3	1655.8	1665.9	1658.5
165°	1682.4	1680.7	1680.7	1691.3	1683.9
167.5°	1707.6	1702.9	1702.9	1713.5	1706.1
170°	1726.7	1722.5	1720.9	1731.5	1722.5
172.5°	1739.9	1735.7	1734.1	1744.7	1735.7
175°	1750.6	1746.2	1743.1	1753.7	1744.7
177.5°	1756.3	1752.1	1748.9	1757.9	1748.9
180°	1753.7	1753.7	1753.7	1753.7	1753.7

TEST NUMBER: P912684

CATALOG NUMBER: DFN2DIP-TR3F0-080D050US850-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.31	14.24	14.18	15.12	16.23	9.29	10.21	10.15	11.10	12.21
	3H	14.99	15.81	15.87	16.71	17.85	10.48	11.31	11.36	12.20	13.34
	4H	15.59	16.37	16.49	17.27	18.42	10.93	11.71	11.82	12.61	13.76
	6H	16.01	16.73	16.92	17.64	18.80	11.25	11.97	12.16	12.87	14.04
	8H	16.14	16.82	17.05	17.74	18.91	11.34	12.02	12.26	12.95	14.11
	12H	16.20	16.85	17.12	17.76	18.95	11.38	12.04	12.30	12.95	14.14
4H	2H	13.34	14.12	14.24	15.02	16.17	9.89	10.67	10.79	11.57	12.72
	3H	15.17	15.82	16.08	16.75	17.91	11.24	11.89	12.15	12.82	13.99
	4H	15.86	16.45	16.78	17.37	18.56	11.79	12.38	12.71	13.31	14.50
	6H	16.37	16.87	17.30	17.82	19.02	12.21	12.71	13.14	13.66	14.86
	8H	16.54	17.01	17.48	17.96	19.16	12.33	12.81	13.27	13.75	14.96
	12H	16.63	17.06	17.59	18.02	19.23	12.40	12.83	13.36	13.79	15.00
8H	4H	15.83	16.30	16.77	17.25	18.45	12.07	12.54	13.01	13.49	14.69
	6H	16.39	16.78	17.35	17.77	18.97	12.58	12.98	13.55	13.96	15.17
	8H	16.60	16.95	17.57	17.92	19.14	12.77	13.12	13.74	14.09	15.32
	12H	16.73	17.04	17.71	18.01	19.28	12.89	13.19	13.86	14.16	15.43
12H	4H	15.78	16.21	16.74	17.17	18.38	12.08	12.50	13.03	13.47	14.68
	6H	16.36	16.71	17.34	17.69	18.91	12.63	12.98	13.60	13.95	15.18
	8H	16.58	16.89	17.56	17.85	19.13	12.84	13.15	13.82	14.11	15.38