

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912701

Luminaire Tested: DFN2DIP-TR3F0-090D030US850-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912701
REPORT IS A COMBINATION OF REPORTS P901803 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-090D030US850-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13174.9 lumens
Efficiency: N/A
Efficacy: 112.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 117.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912701

CATALOG NUMBER: DFN2DIP-TR3F0-090D030US850-FLLONL

Luminous Intensity Polar Plot

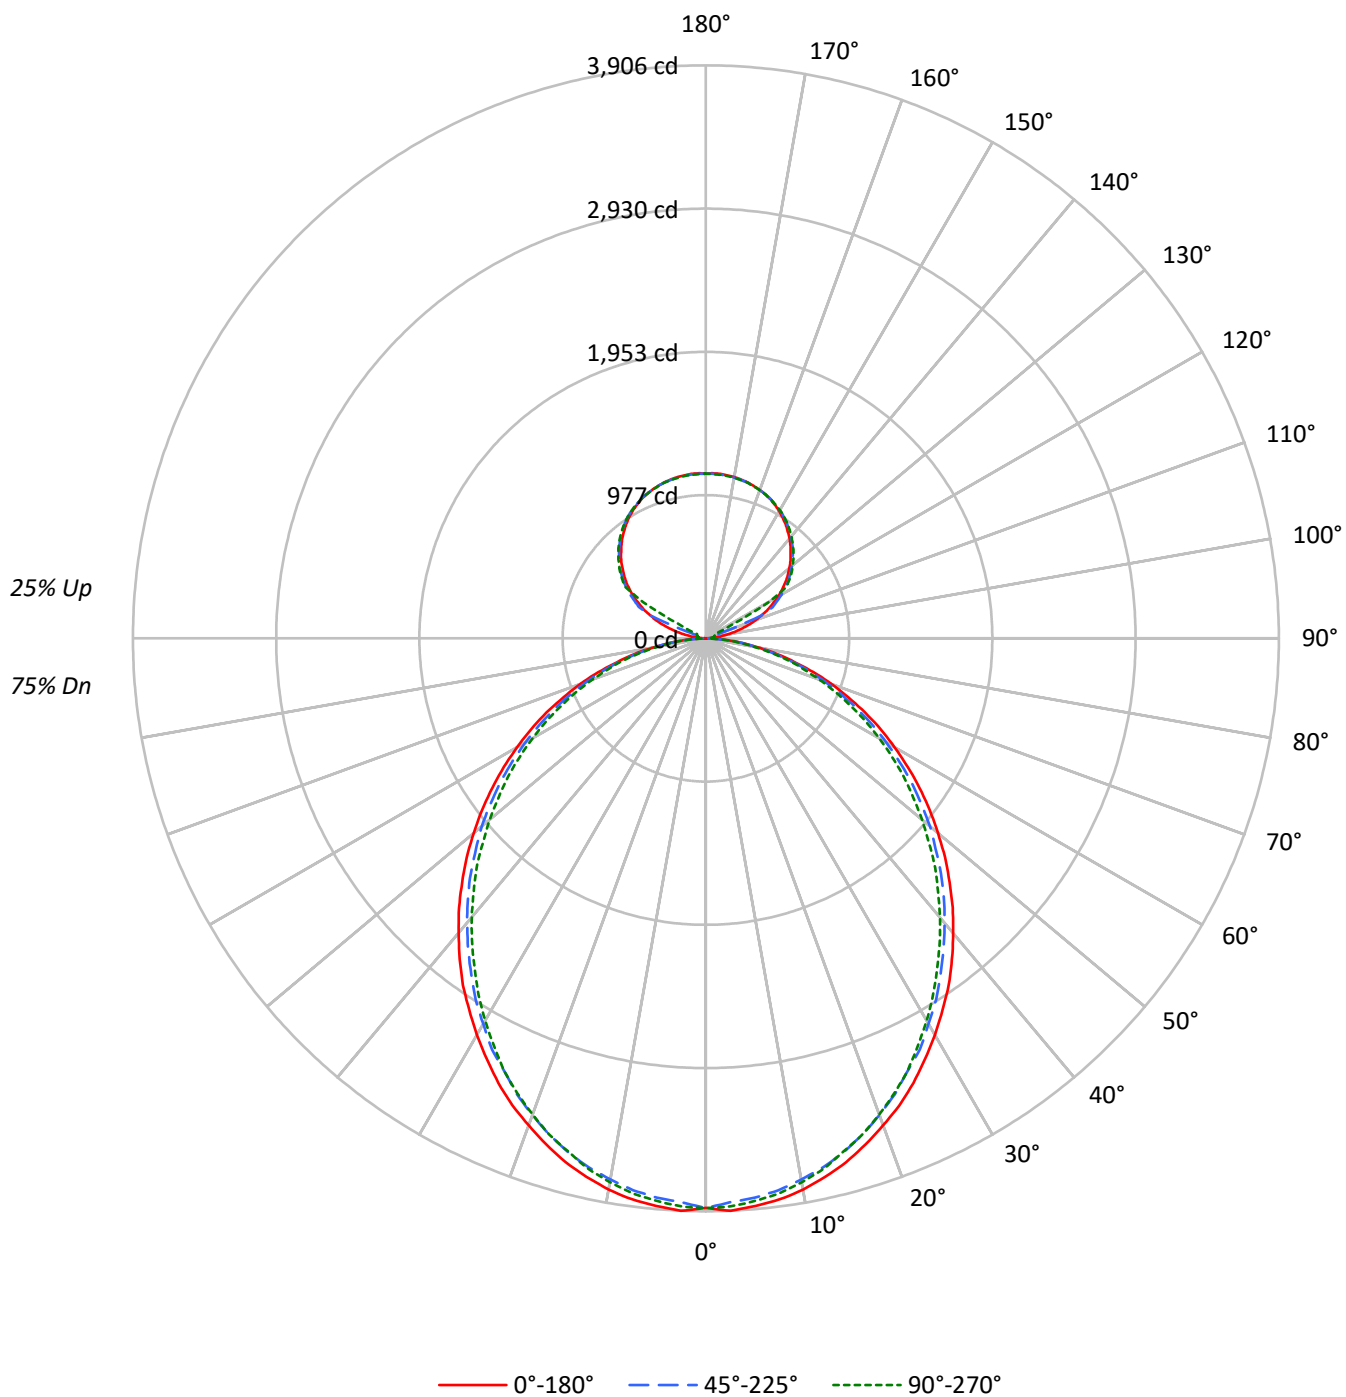

TEST NUMBER: P912701

CATALOG NUMBER: DFN2DIP-TR3F0-090D030US850-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	113	113	113	113	108	108	108	108	97	97	97	88	88	88	79	79	79
1	103	99	95	91	98	94	91	87	85	83	80	77	75	73	70	68	67
2	94	86	80	75	89	82	77	72	75	70	66	68	64	61	62	59	56
3	86	76	68	62	81	73	66	60	66	61	56	60	56	52	55	51	48
4	79	67	59	53	75	64	57	51	59	53	48	54	49	45	49	45	41
5	72	60	52	46	69	58	50	44	53	46	41	48	43	39	44	40	36
6	67	54	46	40	63	52	44	39	48	41	36	44	38	34	40	35	32
7	62	49	41	35	59	47	39	34	43	37	32	40	34	30	37	32	28
8	58	45	37	31	55	43	36	30	40	33	29	37	31	27	34	29	25
9	54	41	33	28	51	39	32	27	37	30	26	34	28	24	31	26	23
10	50	38	30	25	48	36	29	25	34	28	23	31	26	22	29	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4839	4839	4839
5°	4844	4768	4801
10°	4803	4700	4733
15°	4729	4618	4628
20°	4631	4507	4521
25°	4534	4374	4398
30°	4412	4250	4241
35°	4296	4105	4077
40°	4154	3958	3920
45°	4013	3811	3759
50°	3858	3656	3573
55°	3695	3476	3401
60°	3511	3264	3204
65°	3310	3044	2971
70°	3054	2775	2721
75°	2701	2452	2484
80°	2273	2040	2042
85°	1605	1344	1319

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4013 cd/sqm

TEST NUMBER: P912701

CATALOG NUMBER: DFN2DIP-TR3F0-090D030US850-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	365.5	2.8
10°-20°	1028.5	7.8
20°-30°	1511.4	11.5
30°-40°	1755.4	13.3
40°-50°	1753.3	13.3
50°-60°	1528.8	11.6
60°-70°	1130.1	8.6
70°-80°	639.4	4.9
80°-90°	170.7	1.3
90°-100°	37.0	0.3
100°-110°	138.0	1.0
110°-120°	366.1	2.8
120°-130°	607.1	4.6
130°-140°	644.9	4.9
140°-150°	599.4	4.5
150°-160°	481.9	3.7
160°-170°	310.5	2.4
170°-180°	106.9	0.8
0°-30°	2905.4	22.1
0°-40°	4660.9	35.4
0°-60°	7942.9	60.3
0°-90°	9883.2	75.0
90°-120°	541.1	4.1
90°-150°	2392.5	18.2
90°-180°	3292.0	25.0
0°-180°	13174.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3884	3884	3884	3884	3884	
5°	3884	3869	3828	3858	3850	369
15°	3697	3675	3626	3641	3622	1041
25°	3346	3316	3253	3260	3253	1540
35°	2887	2850	2790	2767	2748	1803
45°	2349	2323	2267	2226	2211	1813
55°	1778	1755	1710	1666	1647	1589
65°	1199	1176	1139	1106	1087	1185
75°	627	620	601	579	586	670
85°	153	149	146	134	131	171
90°	1	10	16	20	22	12
95°	53	26	32	36	35	63
105°	247	271	50	58	62	264
115°	467	481	501	125	67	460
125°	660	671	687	692	695	589
135°	817	830	838	846	844	631
145°	948	947	961	967	963	593
155°	1044	1037	1046	1051	1045	481
165°	1100	1095	1098	1103	1098	311
175°	1125	1120	1121	1127	1119	107
180°	1123	1123	1123	1123	1123	

TEST NUMBER: P912701

CATALOG NUMBER: DFN2DIP-TR3F0-090D030US850-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3883.6	3883.6	3883.6	3883.6	3883.6
2.5°	3906.2	3887.6	3846.5	3883.6	3876.5
5°	3883.6	3869.0	3827.8	3857.5	3850.3
7.5°	3857.5	3835.4	3794.1	3824.3	3816.7
10°	3816.7	3790.6	3745.8	3775.5	3764.4
12.5°	3760.4	3738.2	3693.5	3712.0	3704.6
15°	3697.1	3674.9	3626.1	3641.2	3622.5
17.5°	3618.6	3596.4	3547.7	3566.3	3547.7
20°	3532.6	3510.4	3458.1	3469.2	3454.5
22.5°	3447.0	3413.4	3364.6	3364.6	3357.1
25°	3346.0	3316.2	3252.9	3260.0	3252.9
27.5°	3233.8	3207.7	3159.4	3148.3	3129.7
30°	3122.2	3092.0	3036.1	3025.0	3010.0
32.5°	3002.5	2980.3	2920.4	2897.9	2882.8
35°	2886.8	2849.6	2789.7	2767.2	2748.5
37.5°	2756.1	2722.4	2662.5	2636.4	2617.8
40°	2621.7	2591.6	2531.7	2498.5	2483.5
42.5°	2490.9	2460.9	2401.4	2363.8	2341.7
45°	2349.1	2323.0	2266.7	2225.9	2210.9
47.5°	2210.9	2184.7	2124.8	2083.7	2061.5
50°	2065.1	2046.4	1994.1	1941.9	1923.2
52.5°	1923.2	1897.1	1848.7	1807.6	1781.4
55°	1777.8	1755.2	1710.4	1665.7	1647.1
57.5°	1632.0	1613.4	1564.7	1519.9	1504.8
60°	1486.2	1471.5	1419.2	1378.0	1367.0
62.5°	1344.3	1318.2	1280.9	1243.7	1228.7
65°	1198.9	1176.3	1139.1	1105.5	1086.8
67.5°	1049.6	1030.6	997.2	971.2	956.1
70°	911.3	896.2	862.6	836.4	821.8
72.5°	769.4	754.3	735.7	709.6	698.6
75°	627.3	620.0	601.1	578.9	586.4
77.5°	500.4	485.4	477.9	466.8	455.7
80°	373.6	369.6	362.1	351.0	343.6
82.5°	254.0	254.0	250.4	235.3	235.3
85°	152.9	149.4	145.8	134.3	130.8
87.5°	67.3	59.8	52.3	41.3	37.3
90°	0.8	9.8	16.2	20.4	21.8
92.5°	20.4	17.1	19.5	21.2	21.8
95°	52.8	26.0	31.6	35.8	34.9
97.5°	95.0	28.5	41.4	43.9	44.7
100°	143.8	32.5	46.4	52.8	54.5
102.5°	197.4	195.8	47.9	56.8	59.3
105°	247.0	271.4	49.6	58.4	61.8
107.5°	304.6	324.9	51.2	60.1	63.4
110°	360.0	376.9	142.2	61.0	64.2

TEST NUMBER: P912701

CATALOG NUMBER: DFN2DIP-TR3F0-090D030US850-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	412.0	426.5	412.8	62.5	65.0
115°	467.1	481.0	501.3	125.1	66.7
117.5°	515.1	531.3	545.2	429.0	216.1
120°	568.7	580.9	595.5	605.3	495.6
122.5°	614.2	627.3	643.6	648.3	649.2
125°	660.5	671.1	686.6	692.2	694.7
127.5°	702.8	714.1	726.4	734.5	735.3
130°	742.6	755.7	764.5	773.4	772.8
132.5°	783.2	793.8	802.7	810.0	809.2
135°	817.3	830.4	837.6	845.8	844.2
137.5°	853.0	862.8	871.0	879.1	876.7
140°	888.0	894.5	903.4	910.7	906.7
142.5°	917.4	923.0	933.6	940.0	936.0
145°	948.2	947.3	961.2	966.8	962.7
147.5°	974.9	972.5	986.3	990.3	987.1
150°	1001.0	995.3	1008.3	1013.1	1009.1
152.5°	1022.8	1016.4	1028.6	1033.5	1027.8
155°	1044.0	1036.8	1046.5	1051.3	1044.9
157.5°	1061.1	1054.7	1062.0	1067.6	1061.1
160°	1075.7	1070.9	1075.7	1080.6	1074.8
162.5°	1088.7	1083.8	1087.9	1093.6	1086.3
165°	1100.0	1095.2	1097.7	1103.3	1097.7
167.5°	1109.0	1104.1	1106.6	1112.3	1105.0
170°	1116.3	1111.4	1113.1	1118.8	1111.4
172.5°	1121.2	1116.3	1118.0	1123.6	1116.3
175°	1125.2	1119.5	1121.2	1126.9	1118.8
177.5°	1126.9	1121.2	1122.1	1127.7	1120.4
180°	1122.9	1122.9	1122.9	1122.9	1122.9

TEST NUMBER: P912701

CATALOG NUMBER: DFN2DIP-TR3F0-090D030US850-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.75	15.89	15.45	16.62	17.48	14.32	15.46	15.03	16.19	17.05
	3H	16.42	17.44	17.14	18.18	19.08	15.95	16.98	16.67	17.71	18.61
	4H	17.01	17.98	17.75	18.73	19.64	16.54	17.51	17.28	18.26	19.17
	6H	17.42	18.31	18.17	19.07	19.99	16.95	17.84	17.70	18.60	19.52
	8H	17.53	18.38	18.29	19.16	20.08	17.06	17.91	17.82	18.69	19.61
	12H	17.58	18.39	18.35	19.17	20.12	17.11	17.92	17.88	18.69	19.64
4H	2H	15.24	16.21	15.98	16.95	17.86	14.89	15.86	15.64	16.61	17.52
	3H	17.12	17.93	17.87	18.71	19.63	16.73	17.54	17.48	18.32	19.25
	4H	17.84	18.57	18.61	19.36	20.31	17.43	18.17	18.21	18.95	19.91
	6H	18.36	19.00	19.15	19.80	20.76	17.95	18.59	18.74	19.40	20.36
	8H	18.51	19.11	19.30	19.91	20.88	18.10	18.70	18.90	19.50	20.48
	12H	18.59	19.13	19.40	19.95	20.93	18.18	18.71	18.99	19.54	20.52
8H	4H	18.05	18.65	18.84	19.45	20.42	17.69	18.29	18.49	19.09	20.07
	6H	18.68	19.18	19.50	20.02	21.00	18.32	18.82	19.15	19.67	20.64
	8H	18.90	19.34	19.73	20.18	21.17	18.54	18.98	19.37	19.82	20.81
	12H	19.04	19.43	19.87	20.26	21.31	18.66	19.05	19.50	19.88	20.93
12H	4H	18.05	18.59	18.86	19.41	20.39	17.70	18.24	18.51	19.06	20.04
	6H	18.71	19.15	19.55	20.00	20.99	18.36	18.81	19.20	19.65	20.64
	8H	18.96	19.35	19.80	20.18	21.23	18.61	19.00	19.44	19.83	20.88

END OF REPORT