

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915281

Luminaire Tested: DFN2DIP-TR3F0-030D050US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915281
REPORT IS A COMBINATION OF REPORTS P901819 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-030D050US927-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6274.1 lumens
Efficiency: N/A
Efficacy: 102.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 61.1
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915281

CATALOG NUMBER: DFN2DIP-TR3F0-030D050US927-FLLONL

Luminous Intensity Polar Plot

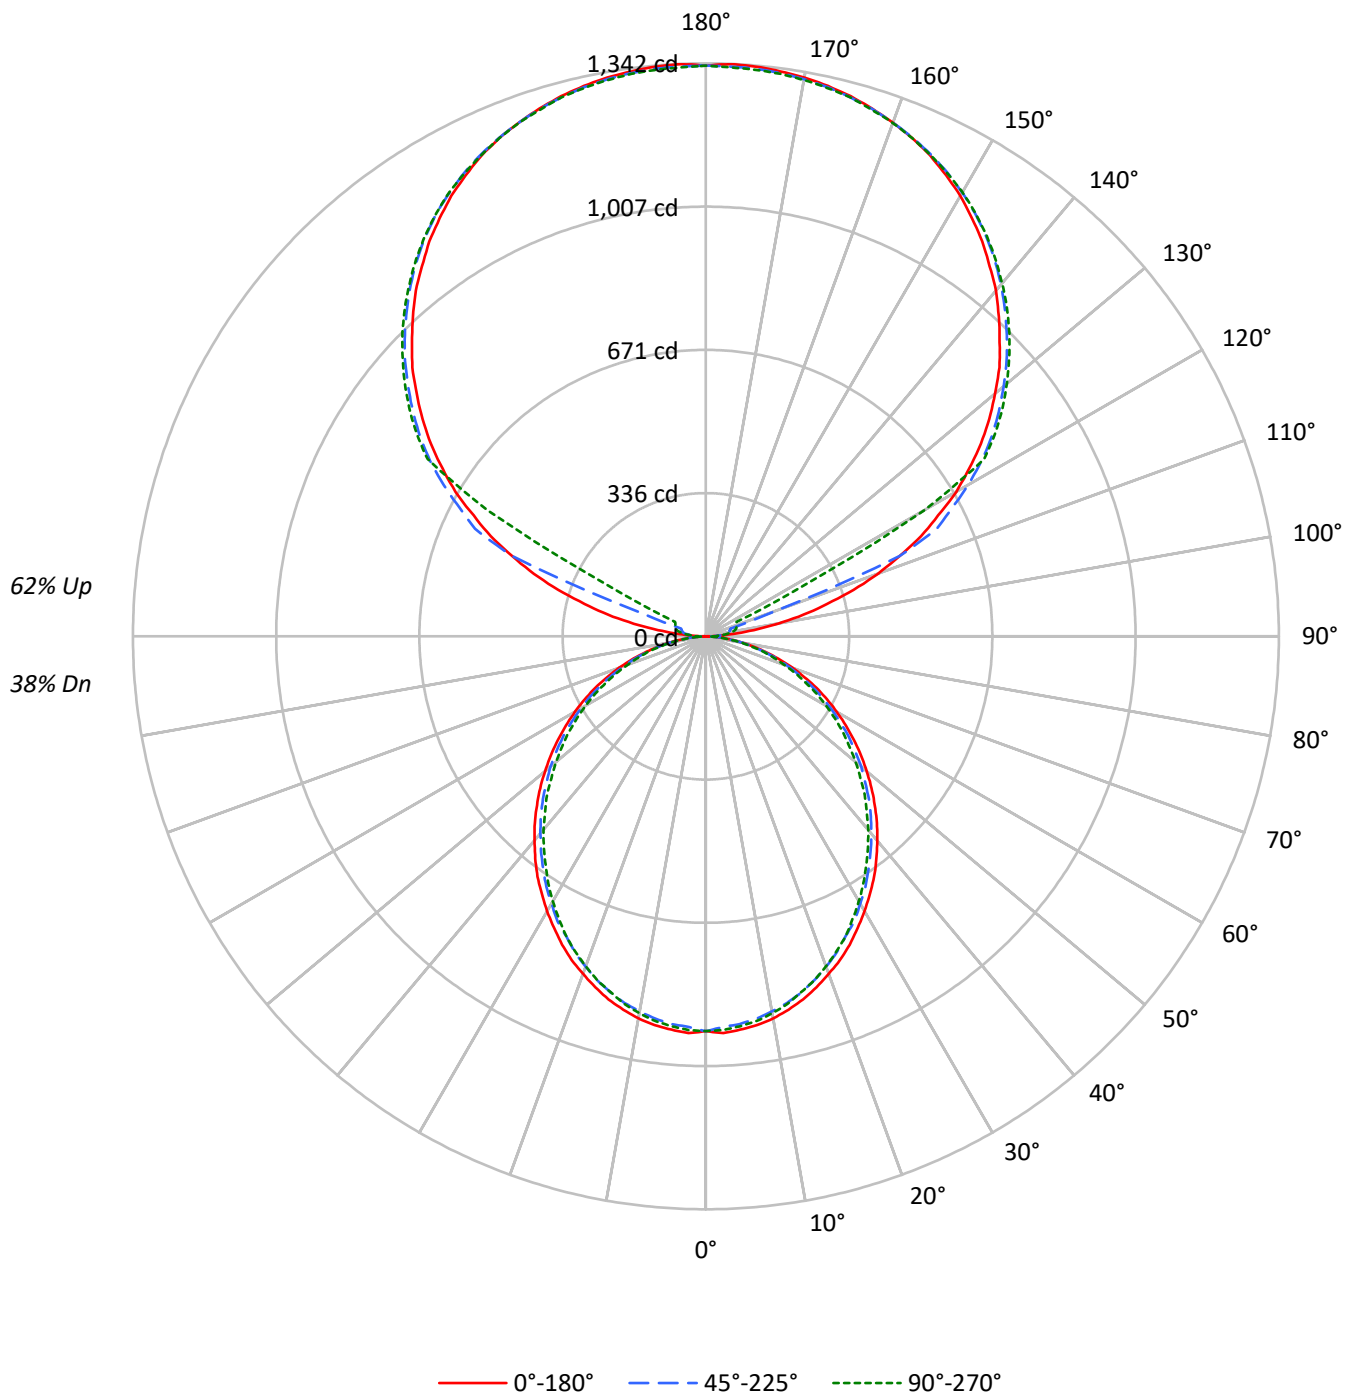

TEST NUMBER: P915281

CATALOG NUMBER: DFN2DIP-TR3F0-030D050US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	60	60	60	45	45	45
1	95	91	87	83	86	82	79	76	67	65	63	53	51	50	39	39	38
2	86	79	73	68	78	72	67	63	59	55	52	46	44	42	35	33	32
3	79	70	62	57	71	63	57	52	52	47	44	41	38	35	31	29	27
4	72	62	54	48	65	56	49	44	46	41	37	36	33	30	27	25	23
5	66	55	47	41	60	50	43	38	41	36	32	33	29	26	25	22	20
6	61	49	41	35	55	45	38	33	37	32	28	29	26	23	22	20	18
7	56	44	36	31	51	40	34	29	33	28	24	27	23	20	20	18	16
8	52	40	32	27	47	37	30	25	30	25	22	24	21	18	19	16	14
9	48	36	29	24	44	33	27	23	28	23	19	22	19	16	17	15	13
10	45	33	26	22	41	31	24	20	26	21	17	21	17	14	16	13	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1152	1152	1152
5°	1153	1135	1143
10°	1144	1119	1127
15°	1126	1100	1102
20°	1103	1073	1076
25°	1079	1041	1047
30°	1050	1012	1010
35°	1023	977	971
40°	989	942	933
45°	956	907	895
50°	919	870	851
55°	880	828	810
60°	836	777	763
65°	788	725	708
70°	727	661	648
75°	643	584	592
80°	541	486	486
85°	382	320	314

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 956 cd/sqm

TEST NUMBER: P915281

CATALOG NUMBER: DFN2DIP-TR3F0-030D050US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	87.0	1.4
10°-20°	244.9	3.9
20°-30°	359.9	5.7
30°-40°	418.0	6.7
40°-50°	417.5	6.7
50°-60°	364.0	5.8
60°-70°	269.1	4.3
70°-80°	152.3	2.4
80°-90°	42.5	0.7
90°-100°	44.1	0.7
100°-110°	164.3	2.6
110°-120°	435.8	6.9
120°-130°	722.8	11.5
130°-140°	767.8	12.2
140°-150°	713.6	11.4
150°-160°	573.7	9.1
160°-170°	369.7	5.9
170°-180°	127.2	2.0
0°-30°	691.8	11.0
0°-40°	1109.8	17.7
0°-60°	1891.3	30.1
0°-90°	2355.1	37.5
90°-120°	644.2	10.3
90°-150°	2848.4	45.4
90°-180°	3919.0	62.5
0°-180°	6274.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	925	925	925	925	925	
5°	925	921	911	918	917	88
15°	880	875	863	867	862	248
25°	797	790	774	776	774	367
35°	687	678	664	659	654	429
45°	559	553	540	530	526	432
55°	423	418	407	397	392	378
65°	286	280	271	263	259	282
75°	149	148	143	138	140	159
85°	36	36	35	32	31	41
90°	1	12	19	24	26	6
95°	63	31	38	43	42	74
105°	294	323	59	70	74	314
115°	556	573	597	149	79	548
125°	786	799	817	824	827	701
135°	973	989	997	1007	1005	752
145°	1129	1128	1144	1151	1146	706
155°	1243	1234	1246	1252	1244	573
165°	1310	1304	1307	1314	1307	370
175°	1340	1333	1335	1342	1332	127
180°	1337	1337	1337	1337	1337	

TEST NUMBER: P915281

CATALOG NUMBER: DFN2DIP-TR3F0-030D050US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	924.7	924.7	924.7	924.7	924.7
2.5°	930.1	925.7	915.8	924.7	923.0
5°	924.7	921.2	911.4	918.5	916.8
7.5°	918.5	913.2	903.4	910.6	908.8
10°	908.8	902.5	891.9	899.0	896.4
12.5°	895.4	890.1	879.5	883.8	882.1
15°	880.3	875.0	863.4	867.0	862.5
17.5°	861.6	856.3	844.7	849.1	844.7
20°	841.1	835.8	823.4	826.0	822.5
22.5°	820.8	812.8	801.1	801.1	799.3
25°	796.7	789.6	774.5	776.3	774.5
27.5°	770.0	763.7	752.3	749.6	745.2
30°	743.4	736.3	722.9	720.3	716.7
32.5°	714.9	709.6	695.4	690.0	686.4
35°	687.4	678.5	664.2	658.9	654.4
37.5°	656.2	648.2	634.0	627.7	623.3
40°	624.2	617.1	602.8	594.9	591.4
42.5°	593.1	586.0	571.8	562.8	557.5
45°	559.4	553.1	539.7	530.0	526.4
47.5°	526.4	520.2	506.0	496.1	490.8
50°	491.7	487.3	474.8	462.4	458.0
52.5°	458.0	451.7	440.2	430.4	424.1
55°	423.3	418.0	407.3	396.6	392.2
57.5°	388.6	384.1	372.6	361.9	358.3
60°	353.9	350.4	337.9	328.1	325.5
62.5°	320.1	313.9	305.0	296.1	292.6
65°	285.5	280.1	271.2	263.2	258.8
67.5°	249.9	245.4	237.4	231.2	227.7
70°	217.0	213.4	205.4	199.2	195.7
72.5°	183.2	179.6	175.2	169.0	166.4
75°	149.3	147.7	143.1	137.8	139.7
77.5°	119.1	115.6	113.8	111.1	108.5
80°	89.0	88.0	86.2	83.6	81.8
82.5°	60.4	60.4	59.7	56.0	56.0
85°	36.4	35.6	34.7	32.0	31.1
87.5°	16.0	14.3	12.4	9.8	8.9
90°	1.0	11.6	19.3	24.2	26.1
92.5°	24.2	20.4	23.2	25.2	26.1
95°	62.8	30.9	37.7	42.6	41.6
97.5°	113.1	33.9	49.3	52.3	53.2
100°	171.3	38.7	55.1	62.8	64.8
102.5°	235.0	233.1	57.1	67.7	70.7
105°	294.1	323.1	59.0	69.6	73.5
107.5°	362.7	386.8	61.0	71.5	75.5
110°	428.6	448.8	169.3	72.6	76.4

TEST NUMBER: P915281

CATALOG NUMBER: DFN2DIP-TR3F0-030D050US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	490.4	507.8	491.4	74.5	77.4
115°	556.2	572.6	596.8	149.0	79.4
117.5°	613.2	632.6	649.1	510.6	257.3
120°	677.1	691.6	709.0	720.6	590.0
122.5°	731.2	746.7	766.1	771.9	772.9
125°	786.3	799.0	817.4	824.1	827.0
127.5°	836.6	850.2	864.8	874.4	875.4
130°	884.1	899.6	910.1	920.8	920.0
132.5°	932.5	945.1	955.6	964.4	963.5
135°	973.1	988.6	997.2	1007.0	1005.0
137.5°	1015.6	1027.2	1037.0	1046.6	1043.8
140°	1057.2	1065.0	1075.5	1084.3	1079.5
142.5°	1092.1	1098.9	1111.4	1119.1	1114.3
145°	1128.9	1127.8	1144.2	1151.0	1146.2
147.5°	1160.7	1157.8	1174.3	1179.1	1175.3
150°	1191.7	1184.9	1200.4	1206.2	1201.3
152.5°	1217.7	1210.1	1224.6	1230.4	1223.6
155°	1242.9	1234.3	1245.9	1251.6	1244.0
157.5°	1263.2	1255.5	1264.2	1271.1	1263.2
160°	1280.7	1274.9	1280.7	1286.4	1279.7
162.5°	1296.1	1290.4	1295.1	1301.9	1293.2
165°	1309.6	1303.9	1306.8	1313.5	1306.8
167.5°	1320.3	1314.5	1317.5	1324.2	1315.5
170°	1329.0	1323.2	1325.2	1331.9	1323.2
172.5°	1334.8	1329.0	1331.0	1337.8	1329.0
175°	1339.7	1332.8	1334.8	1341.6	1331.9
177.5°	1341.6	1334.8	1335.9	1342.6	1333.9
180°	1336.7	1336.7	1336.7	1336.7	1336.7

TEST NUMBER: P915281

CATALOG NUMBER: DFN2DIP-TR3F0-030D050US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.44	7.20	7.49	8.26	9.70	6.01	6.77	7.07	7.83	9.27
	3H	8.08	8.76	9.15	9.83	11.29	7.61	8.29	8.68	9.36	10.82
	4H	8.66	9.30	9.73	10.37	11.84	8.19	8.84	9.27	9.91	11.37
	6H	9.04	9.64	10.13	10.71	12.19	8.58	9.17	9.66	10.24	11.72
	8H	9.14	9.71	10.23	10.80	12.27	8.67	9.24	9.77	10.33	11.80
	12H	9.18	9.72	10.28	10.80	12.30	8.71	9.25	9.81	10.33	11.83
4H	2H	6.88	7.53	7.97	8.60	10.06	6.54	7.19	7.63	8.26	9.72
	3H	8.73	9.27	9.82	10.37	11.84	8.34	8.88	9.43	9.98	11.45
	4H	9.43	9.93	10.53	11.01	12.51	9.03	9.53	10.13	10.61	12.11
	6H	9.93	10.36	11.04	11.47	12.96	9.53	9.95	10.63	11.06	12.55
	8H	10.07	10.47	11.18	11.57	13.08	9.67	10.06	10.77	11.17	12.68
	12H	10.14	10.50	11.26	11.61	13.12	9.72	10.08	10.85	11.20	12.71
8H	4H	9.62	10.01	10.72	11.12	12.62	9.26	9.66	10.36	10.76	12.27
	6H	10.23	10.56	11.36	11.70	13.21	9.87	10.20	11.00	11.35	12.85
	8H	10.44	10.73	11.58	11.86	13.38	10.08	10.37	11.21	11.49	13.02
	12H	10.57	10.82	11.70	11.94	13.50	10.19	10.44	11.32	11.56	13.12
12H	4H	9.60	9.95	10.72	11.07	12.58	9.25	9.61	10.37	10.72	12.23
	6H	10.26	10.55	11.39	11.67	13.20	9.91	10.20	11.04	11.33	12.85
	8H	10.49	10.74	11.63	11.86	13.42	10.14	10.39	11.27	11.51	13.07

END OF REPORT