

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915294

Luminaire Tested: DFN2DIP-TR3F0-030D080US927-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915294
REPORT IS A COMBINATION OF REPORTS P900342 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-030D080US927-RLLFLL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7628.7 lumens
Efficiency: N/A
Efficacy: 89.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 85.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915294

CATALOG NUMBER: DFN2DIP-TR3F0-030D080US927-RLLFLL

Luminous Intensity Polar Plot

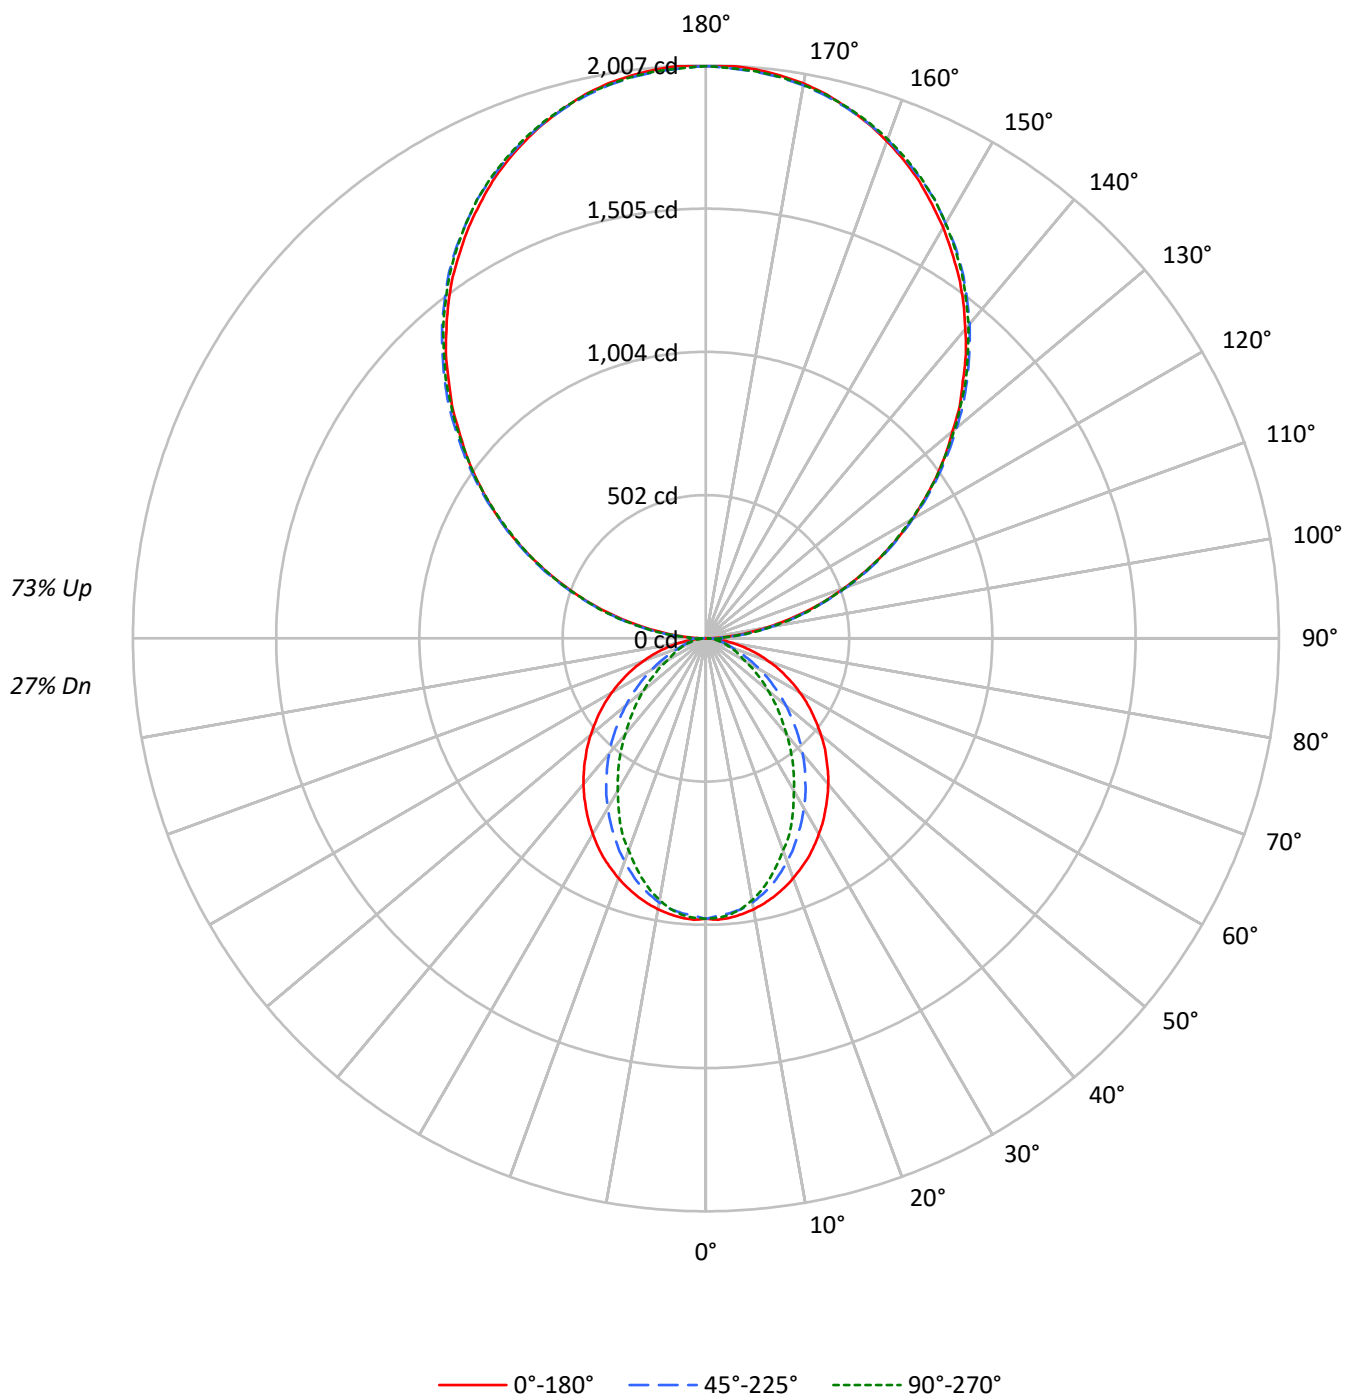

TEST NUMBER: P915294

CATALOG NUMBER: DFN2DIP-TR3F0-030D080US927-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	102	102	102	102	91	91	91	91	70	70	70	52	52	52	35	35	35
1	93	89	85	82	83	79	76	74	62	60	58	46	44	43	31	30	30
2	85	78	72	67	75	70	65	61	54	51	48	40	38	37	27	26	25
3	77	68	62	56	69	61	56	51	48	44	41	36	33	31	25	23	22
4	71	61	53	48	63	54	48	43	43	38	35	32	29	27	22	20	19
5	65	54	46	41	58	49	42	37	38	34	30	29	26	23	20	18	17
6	60	48	41	35	53	44	37	32	35	30	26	26	23	20	18	16	15
7	55	44	36	31	49	39	33	28	31	27	23	24	21	18	17	15	13
8	51	39	32	27	46	36	29	25	28	24	20	22	18	16	15	13	12
9	48	36	29	24	42	33	26	22	26	21	18	20	17	14	14	12	11
10	44	33	26	21	40	30	24	20	24	19	16	18	15	13	13	11	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1224	1224	1224
5°	1225	1204	1211
10°	1212	1179	1171
15°	1195	1139	1110
20°	1172	1084	1034
25°	1149	1023	961
30°	1118	961	869
35°	1087	893	788
40°	1056	824	696
45°	1020	747	612
50°	983	670	530
55°	944	587	452
60°	899	501	371
65°	847	413	333
70°	784	332	300
75°	704	290	271
80°	590	240	232
85°	401	156	170

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1956 cd/sqm

TEST NUMBER: P915294

CATALOG NUMBER: DFN2DIP-TR3F0-030D080US927-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	92.1	1.2
10°-20°	252.7	3.3
20°-30°	354.8	4.7
30°-40°	386.8	5.1
40°-50°	355.5	4.7
50°-60°	279.2	3.7
60°-70°	181.7	2.4
70°-80°	93.5	1.2
80°-90°	29.6	0.4
90°-100°	124.0	1.6
100°-110°	394.1	5.2
110°-120°	674.4	8.8
120°-130°	886.9	11.6
130°-140°	995.5	13.0
140°-150°	976.2	12.8
150°-160°	818.9	10.7
160°-170°	543.1	7.1
170°-180°	189.8	2.5
0°-30°	699.6	9.2
0°-40°	1086.3	14.2
0°-60°	1720.9	22.6
0°-90°	2025.8	26.6
90°-120°	1192.5	15.6
90°-150°	4051.1	53.1
90°-180°	5603.0	73.4
0°-180°	7628.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	982	982	982	982	982	
5°	982	978	966	974	972	93
15°	934	924	894	877	868	263
25°	848	820	761	724	711	390
35°	731	685	607	551	532	457
45°	597	538	444	381	360	461
55°	454	385	289	236	219	406
65°	307	235	155	124	122	304
75°	164	101	71	65	64	173
85°	38	20	17	17	17	44
90°	2	22	59	56	57	8
95°	88	105	108	108	105	98
105°	364	369	372	375	375	384
115°	677	686	683	682	677	669
125°	984	999	995	989	987	880
135°	1273	1292	1296	1294	1289	984
145°	1546	1558	1567	1569	1563	966
155°	1767	1772	1778	1786	1781	813
165°	1923	1921	1921	1933	1924	542
175°	2001	1996	1992	2004	1994	190
180°	2004	2004	2004	2004	2004	

TEST NUMBER: P915294

CATALOG NUMBER: DFN2DIP-TR3F0-030D080US927-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	982.2	982.2	982.2	982.2	982.2
2.5°	986.7	982.2	972.4	981.4	979.6
5°	982.2	977.8	966.2	974.2	971.5
7.5°	974.2	968.9	956.5	960.0	955.5
10°	963.5	957.4	939.6	936.8	931.6
12.5°	950.2	942.2	918.2	912.9	903.1
15°	934.2	924.4	894.2	877.3	868.5
17.5°	915.5	901.3	864.0	844.5	830.2
20°	894.2	876.4	831.9	809.8	790.2
22.5°	871.2	850.6	799.1	768.9	755.6
25°	848.0	819.5	760.9	724.4	711.1
27.5°	820.5	790.2	725.3	683.6	663.1
30°	791.2	757.3	686.2	641.0	616.9
32.5°	762.6	721.8	649.0	595.6	573.3
35°	730.7	685.3	607.1	551.1	531.6
37.5°	699.6	650.6	568.0	506.6	484.5
40°	666.7	613.4	527.1	464.0	440.9
42.5°	632.9	576.1	486.2	420.4	398.2
45°	597.4	537.7	444.5	381.3	360.0
47.5°	563.6	500.5	404.5	341.3	321.8
50°	526.2	463.1	365.4	304.0	285.3
52.5°	489.7	423.1	328.0	269.3	252.5
55°	454.2	384.8	288.8	235.6	218.7
57.5°	417.8	346.7	254.3	204.5	190.2
60°	380.4	309.3	217.8	172.5	158.3
62.5°	344.0	272.9	186.6	144.0	137.0
65°	306.7	234.6	154.6	124.5	121.8
67.5°	271.2	199.1	124.5	109.3	106.6
70°	233.8	164.5	103.1	94.2	90.6
72.5°	198.2	132.4	86.2	79.1	77.3
75°	163.5	101.3	71.1	64.9	64.0
77.5°	128.9	71.9	56.0	52.4	50.6
80°	96.9	51.6	42.6	39.1	39.1
82.5°	67.5	34.7	29.3	27.6	27.6
85°	38.2	19.5	16.9	16.9	16.9
87.5°	14.3	7.1	7.1	6.3	6.3
90°	1.8	21.8	59.3	55.6	57.4
92.5°	37.5	50.8	52.6	54.3	54.3
95°	88.2	105.1	108.1	108.1	105.1
97.5°	146.9	162.6	169.2	169.2	169.2
100°	214.5	228.4	233.2	233.2	231.4
102.5°	285.8	296.1	302.7	304.5	302.7
105°	363.8	368.6	372.2	375.3	375.3
107.5°	441.1	448.4	448.4	449.6	441.1
110°	516.0	525.7	525.7	525.7	520.9

TEST NUMBER: P915294

CATALOG NUMBER: DFN2DIP-TR3F0-030D080US927-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	597.0	607.3	605.5	600.6	597.0
115°	676.8	686.4	683.4	681.6	676.8
117.5°	755.9	769.2	760.7	755.9	751.1
120°	835.7	849.0	835.7	835.7	830.2
122.5°	908.2	925.1	916.6	911.8	908.2
125°	984.3	999.4	994.6	989.1	987.4
127.5°	1058.7	1077.4	1070.7	1063.5	1058.7
130°	1128.1	1149.9	1146.8	1143.3	1136.6
132.5°	1206.1	1223.0	1224.2	1215.8	1210.9
135°	1273.1	1291.9	1295.5	1293.7	1288.9
137.5°	1348.1	1363.2	1366.2	1365.0	1357.7
140°	1414.0	1429.0	1437.5	1437.5	1430.8
142.5°	1481.6	1496.7	1501.6	1503.4	1496.7
145°	1545.7	1557.7	1567.4	1569.2	1562.6
147.5°	1603.1	1618.2	1625.4	1628.5	1621.8
150°	1662.3	1672.5	1679.2	1684.7	1679.2
152.5°	1714.8	1725.1	1733.6	1740.3	1733.6
155°	1767.4	1772.3	1777.7	1786.1	1780.7
157.5°	1812.7	1816.4	1819.4	1831.4	1823.0
160°	1853.2	1856.9	1858.7	1868.9	1861.7
162.5°	1890.7	1890.7	1892.5	1904.0	1895.5
165°	1922.7	1920.9	1920.9	1933.0	1924.5
167.5°	1951.7	1946.3	1946.3	1958.4	1949.9
170°	1973.5	1968.6	1966.8	1978.9	1968.6
172.5°	1988.6	1983.8	1982.0	1994.0	1983.8
175°	2000.7	1995.8	1992.2	2004.3	1994.0
177.5°	2007.3	2002.5	1998.8	2009.1	1998.8
180°	2004.3	2004.3	2004.3	2004.3	2004.3

TEST NUMBER: P915294

CATALOG NUMBER: DFN2DIP-TR3F0-030D080US927-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	5.06	5.73	6.20	6.86	8.43	1.04	1.71	2.18	2.84	4.41
	3H	6.72	7.32	7.87	8.45	10.04	2.21	2.81	3.36	3.95	5.53
	4H	7.31	7.88	8.47	9.02	10.61	2.65	3.22	3.81	4.35	5.95
	6H	7.72	8.24	8.88	9.38	10.99	2.96	3.48	4.12	4.62	6.22
	8H	7.84	8.33	9.00	9.49	11.08	3.04	3.54	4.21	4.69	6.29
	12H	7.89	8.36	9.06	9.51	11.13	3.08	3.55	4.25	4.70	6.31
4H	2H	5.06	5.63	6.23	6.76	8.36	1.61	2.18	2.78	3.32	4.91
	3H	6.87	7.34	8.03	8.50	10.10	2.94	3.41	4.11	4.57	6.18
	4H	7.54	7.98	8.71	9.13	10.75	3.48	3.91	4.65	5.06	6.69
	6H	8.04	8.41	9.22	9.59	11.20	3.88	4.25	5.06	5.42	7.04
	8H	8.21	8.56	9.38	9.72	11.35	4.00	4.35	5.18	5.51	7.14
	12H	8.29	8.60	9.48	9.78	11.41	4.06	4.37	5.25	5.55	7.18
8H	4H	7.50	7.85	8.67	9.01	10.64	3.74	4.09	4.91	5.25	6.88
	6H	8.05	8.33	9.24	9.54	11.17	4.24	4.53	5.44	5.74	7.36
	8H	8.26	8.51	9.46	9.69	11.34	4.43	4.68	5.63	5.86	7.51
	12H	8.38	8.60	9.58	9.78	11.46	4.54	4.76	5.74	5.94	7.62
12H	4H	7.44	7.76	8.63	8.93	10.57	3.73	4.05	4.92	5.22	6.86
	6H	8.02	8.27	9.22	9.46	11.10	4.29	4.54	5.49	5.72	7.37
	8H	8.23	8.45	9.43	9.63	11.31	4.49	4.71	5.69	5.89	7.57

END OF REPORT