

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915370

Luminaire Tested: DFN2DIP-TR3F0-060D080US927-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915370
REPORT IS A COMBINATION OF REPORTS P900347 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-060D080US927-FLLFLL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10314.2 lumens
Efficiency: N/A
Efficacy: 87.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 118.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915370

CATALOG NUMBER: DFN2DIP-TR3F0-060D080US927-FLLFLL

Luminous Intensity Polar Plot

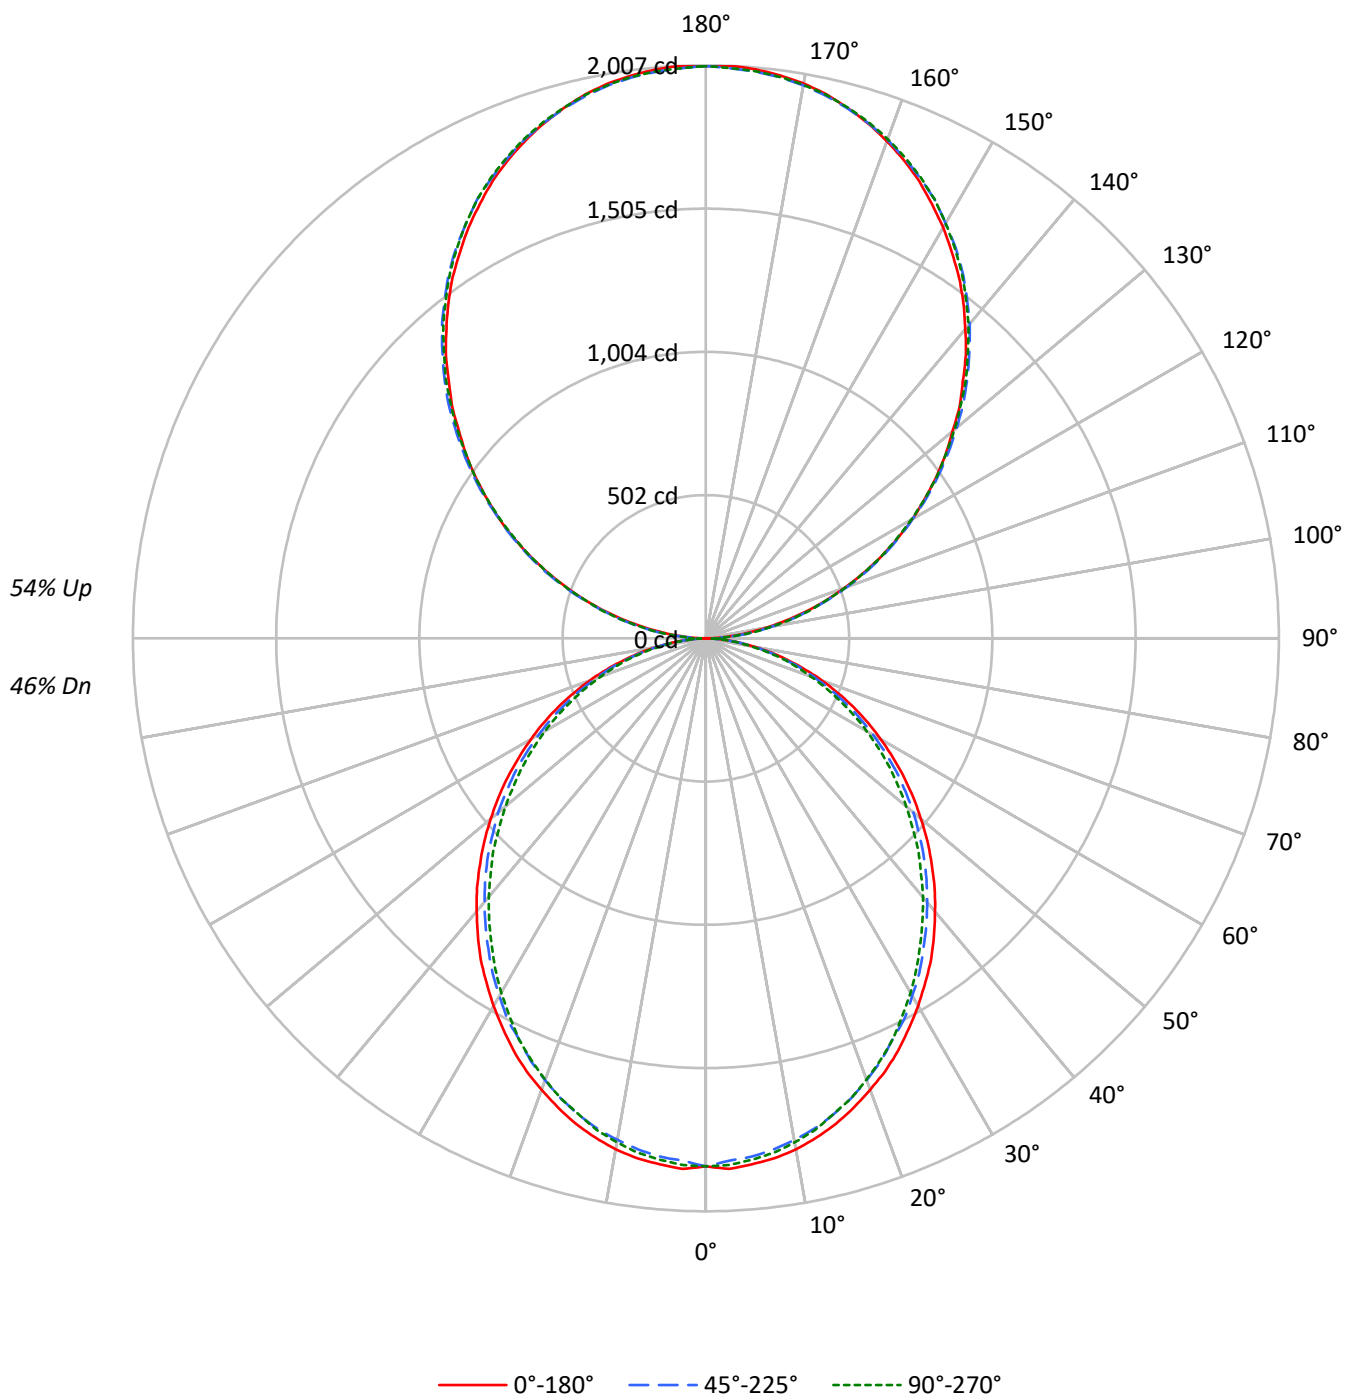

TEST NUMBER: P915370

CATALOG NUMBER: DFN2DIP-TR3F0-060D080US927-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52	46	46	46
1	97	93	89	85	89	85	82	79	71	69	66	58	56	55	46	45	44	38	38	38
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	41	39	37	32	32	32
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	34	32	27	27	27
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27	23	23	23
5	67	56	48	42	62	52	45	39	44	38	34	36	32	29	29	26	24	20	20	20
6	62	50	42	36	57	46	39	34	39	34	30	33	28	25	26	23	21	18	18	18
7	57	45	37	32	53	42	35	30	36	30	26	30	25	22	24	21	19	16	16	16
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17	14	14	14
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15	13	13	13
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14	12	12	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2305	2305	2305
5°	2307	2270	2286
10°	2287	2238	2254
15°	2252	2199	2204
20°	2205	2146	2153
25°	2159	2083	2094
30°	2101	2024	2020
35°	2046	1955	1941
40°	1978	1885	1866
45°	1911	1815	1790
50°	1837	1741	1701
55°	1760	1655	1619
60°	1672	1555	1526
65°	1576	1450	1415
70°	1455	1321	1296
75°	1286	1168	1183
80°	1082	972	972
85°	764	640	628

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1956 cd/sqm

TEST NUMBER: P915370

CATALOG NUMBER: DFN2DIP-TR3F0-060D080US927-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	174.1	1.7
10°-20°	489.8	4.7
20°-30°	719.8	7.0
30°-40°	836.0	8.1
40°-50°	834.9	8.1
50°-60°	728.0	7.1
60°-70°	538.2	5.2
70°-80°	304.5	3.0
80°-90°	86.1	0.8
90°-100°	124.0	1.2
100°-110°	394.1	3.8
110°-120°	674.4	6.5
120°-130°	886.9	8.6
130°-140°	995.5	9.7
140°-150°	976.2	9.5
150°-160°	818.9	7.9
160°-170°	543.1	5.3
170°-180°	189.8	1.8
0°-30°	1383.6	13.4
0°-40°	2219.6	21.5
0°-60°	3782.5	36.7
0°-90°	4711.2	45.7
90°-120°	1192.5	11.6
90°-150°	4051.1	39.3
90°-180°	5603.0	54.3
0°-180°	10314.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1849	1849	1849	1849	1849	
5°	1849	1842	1823	1837	1834	176
15°	1760	1750	1727	1734	1725	496
25°	1593	1579	1549	1552	1549	733
35°	1375	1357	1328	1318	1309	858
45°	1119	1106	1079	1060	1053	863
55°	847	836	814	793	784	757
65°	571	560	542	526	518	564
75°	299	295	286	276	279	319
85°	73	71	69	64	62	81
90°	2	22	59	56	57	10
95°	88	105	108	108	105	98
105°	364	369	372	375	375	384
115°	677	686	683	682	677	669
125°	984	999	995	989	987	880
135°	1273	1292	1296	1294	1289	984
145°	1546	1558	1567	1569	1563	966
155°	1767	1772	1778	1786	1781	813
165°	1923	1921	1921	1933	1924	542
175°	2001	1996	1992	2004	1994	190
180°	2004	2004	2004	2004	2004	

TEST NUMBER: P915370

CATALOG NUMBER: DFN2DIP-TR3F0-060D080US927-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1849.4	1849.4	1849.4	1849.4	1849.4
2.5°	1860.2	1851.3	1831.7	1849.4	1846.0
5°	1849.4	1842.5	1822.8	1837.0	1833.6
7.5°	1837.0	1826.5	1806.8	1821.1	1817.6
10°	1817.6	1805.1	1783.8	1797.9	1792.6
12.5°	1790.8	1780.2	1758.9	1767.8	1764.2
15°	1760.5	1750.0	1726.8	1734.0	1725.1
17.5°	1723.2	1712.7	1689.5	1698.3	1689.5
20°	1682.3	1671.7	1646.8	1652.1	1645.1
22.5°	1641.6	1625.5	1602.3	1602.3	1598.7
25°	1593.4	1579.3	1549.0	1552.4	1549.0
27.5°	1540.0	1527.6	1504.5	1499.3	1490.4
30°	1486.8	1472.4	1445.9	1440.6	1433.4
32.5°	1429.8	1419.3	1390.8	1380.0	1372.8
35°	1374.8	1357.0	1328.5	1317.7	1308.8
37.5°	1312.5	1296.4	1268.0	1255.4	1246.6
40°	1248.5	1234.1	1205.7	1189.9	1182.6
42.5°	1186.2	1171.9	1143.6	1125.7	1115.1
45°	1118.7	1106.2	1079.4	1060.0	1052.8
47.5°	1052.8	1040.4	1011.9	992.3	981.7
50°	983.4	974.5	949.7	924.7	915.8
52.5°	915.8	903.4	880.4	860.8	848.3
55°	846.6	835.8	814.5	793.2	784.3
57.5°	777.2	768.3	745.1	723.8	716.6
60°	707.7	700.8	675.9	656.2	650.9
62.5°	640.2	627.7	610.0	592.2	585.1
65°	570.9	560.2	542.5	526.4	517.5
67.5°	499.8	490.8	474.9	462.5	455.3
70°	434.0	426.8	410.7	398.3	391.3
72.5°	366.4	359.3	350.4	337.9	332.6
75°	298.7	295.3	286.2	275.7	279.2
77.5°	238.3	231.2	227.5	222.3	217.0
80°	177.9	176.0	172.5	167.2	163.6
82.5°	121.0	121.0	119.2	112.1	112.1
85°	72.8	71.1	69.4	63.9	62.3
87.5°	32.1	28.5	24.9	19.6	17.7
90°	1.8	21.8	59.3	55.6	57.4
92.5°	37.5	50.8	52.6	54.3	54.3
95°	88.2	105.1	108.1	108.1	105.1
97.5°	146.9	162.6	169.2	169.2	169.2
100°	214.5	228.4	233.2	233.2	231.4
102.5°	285.8	296.1	302.7	304.5	302.7
105°	363.8	368.6	372.2	375.3	375.3
107.5°	441.1	448.4	448.4	449.6	441.1
110°	516.0	525.7	525.7	525.7	520.9

TEST NUMBER: P915370

CATALOG NUMBER: DFN2DIP-TR3F0-060D080US927-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	597.0	607.3	605.5	600.6	597.0
115°	676.8	686.4	683.4	681.6	676.8
117.5°	755.9	769.2	760.7	755.9	751.1
120°	835.7	849.0	835.7	835.7	830.2
122.5°	908.2	925.1	916.6	911.8	908.2
125°	984.3	999.4	994.6	989.1	987.4
127.5°	1058.7	1077.4	1070.7	1063.5	1058.7
130°	1128.1	1149.9	1146.8	1143.3	1136.6
132.5°	1206.1	1223.0	1224.2	1215.8	1210.9
135°	1273.1	1291.9	1295.5	1293.7	1288.9
137.5°	1348.1	1363.2	1366.2	1365.0	1357.7
140°	1414.0	1429.0	1437.5	1437.5	1430.8
142.5°	1481.6	1496.7	1501.6	1503.4	1496.7
145°	1545.7	1557.7	1567.4	1569.2	1562.6
147.5°	1603.1	1618.2	1625.4	1628.5	1621.8
150°	1662.3	1672.5	1679.2	1684.7	1679.2
152.5°	1714.8	1725.1	1733.6	1740.3	1733.6
155°	1767.4	1772.3	1777.7	1786.1	1780.7
157.5°	1812.7	1816.4	1819.4	1831.4	1823.0
160°	1853.2	1856.9	1858.7	1868.9	1861.7
162.5°	1890.7	1890.7	1892.5	1904.0	1895.5
165°	1922.7	1920.9	1920.9	1933.0	1924.5
167.5°	1951.7	1946.3	1946.3	1958.4	1949.9
170°	1973.5	1968.6	1966.8	1978.9	1968.6
172.5°	1988.6	1983.8	1982.0	1994.0	1983.8
175°	2000.7	1995.8	1992.2	2004.3	1994.0
177.5°	2007.3	2002.5	1998.8	2009.1	1998.8
180°	2004.3	2004.3	2004.3	2004.3	2004.3

TEST NUMBER: P915370

CATALOG NUMBER: DFN2DIP-TR3F0-060D080US927-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.71	10.53	10.70	11.53	12.87	9.28	10.10	10.27	11.11	12.44
	3H	11.35	12.09	12.36	13.11	14.46	10.89	11.62	11.89	12.64	13.99
	4H	11.93	12.63	12.95	13.65	15.01	11.47	12.17	12.48	13.18	14.54
	6H	12.32	12.97	13.35	13.99	15.36	11.85	12.50	12.88	13.52	14.89
	8H	12.42	13.04	13.46	14.08	15.44	11.96	12.57	12.99	13.61	14.98
	12H	12.47	13.05	13.51	14.08	15.48	11.99	12.58	13.03	13.61	15.00
4H	2H	10.16	10.86	11.18	11.88	13.24	9.82	10.52	10.84	11.53	12.89
	3H	12.01	12.60	13.04	13.64	15.01	11.62	12.21	12.65	13.25	14.63
	4H	12.72	13.25	13.76	14.29	15.69	12.32	12.85	13.35	13.89	15.28
	6H	13.22	13.68	14.27	14.74	16.13	12.82	13.28	13.87	14.34	15.73
	8H	13.36	13.79	14.41	14.85	16.26	12.96	13.39	14.01	14.44	15.85
	12H	13.43	13.82	14.50	14.89	16.30	13.02	13.41	14.08	14.47	15.89
8H	4H	12.91	13.34	13.96	14.39	15.80	12.55	12.98	13.60	14.03	15.44
	6H	13.52	13.88	14.60	14.98	16.38	13.17	13.52	14.24	14.62	16.02
	8H	13.74	14.05	14.82	15.13	16.55	13.38	13.69	14.46	14.77	16.19
	12H	13.86	14.14	14.95	15.21	16.68	13.48	13.76	14.57	14.83	16.30
12H	4H	12.89	13.28	13.96	14.35	15.76	12.54	12.93	13.61	14.00	15.41
	6H	13.55	13.87	14.63	14.94	16.37	13.20	13.52	14.29	14.60	16.02
	8H	13.79	14.06	14.87	15.13	16.60	13.43	13.71	14.52	14.78	16.25