

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915427

Luminaire Tested: DFN2DIP-TR3F0-080D090US927-RLFL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915427
REPORT IS A COMBINATION OF REPORTS P900366 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-080D090US927-RLLFLL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11696.6 lumens
Efficiency: N/A
Efficacy: 77.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 151.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915427

CATALOG NUMBER: DFN2DIP-TR3F0-080D090US927-RLLFLL

Luminous Intensity Polar Plot

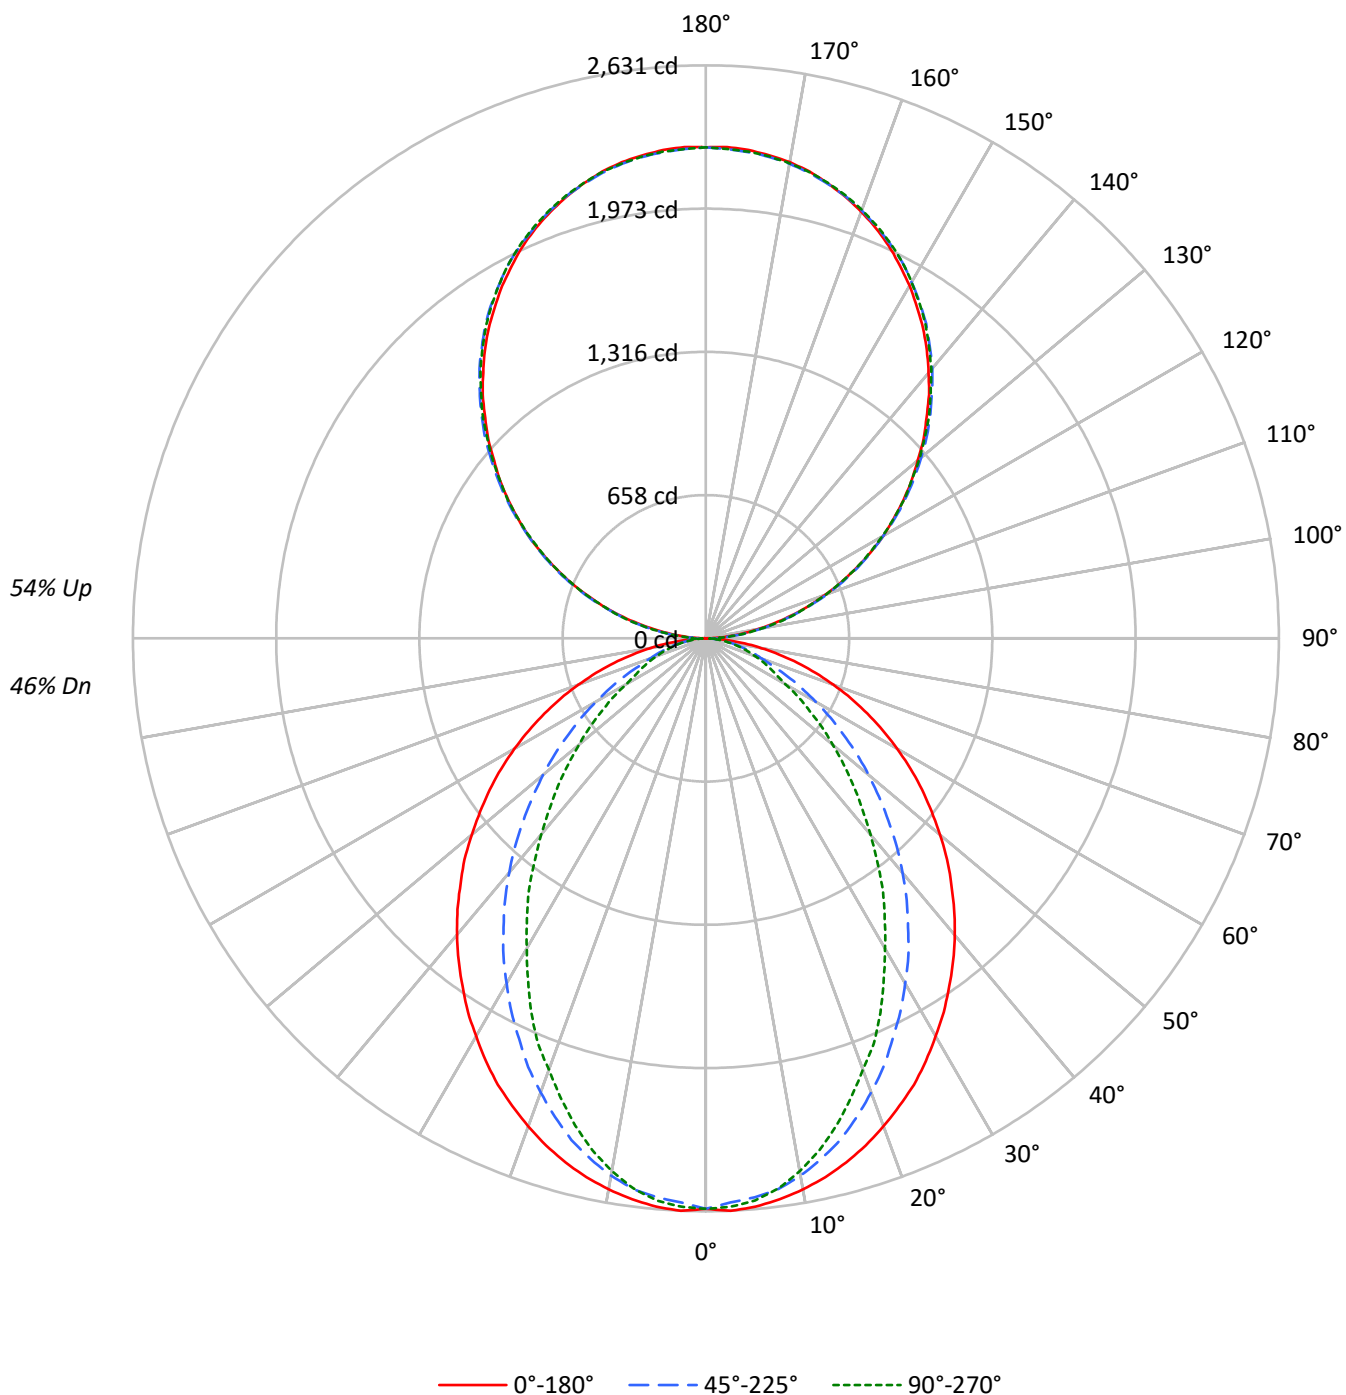

TEST NUMBER: P915427

CATALOG NUMBER: DFN2DIP-TR3F0-080D090US927-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	57	56	47	46	45
2	89	82	76	71	82	75	70	66	63	60	57	52	50	47	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	33
4	75	64	57	51	68	59	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	26	22	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3264	3264	3264
5°	3267	3209	3230
10°	3233	3144	3123
15°	3187	3037	2959
20°	3126	2891	2758
25°	3064	2728	2563
30°	2981	2562	2318
35°	2900	2383	2102
40°	2817	2197	1856
45°	2721	1993	1632
50°	2622	1786	1414
55°	2518	1566	1204
60°	2397	1336	989
65°	2258	1102	888
70°	2090	884	800
75°	1878	774	724
80°	1571	641	620
85°	1070	415	454

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2721 cd/sqm

TEST NUMBER: P915427

CATALOG NUMBER: DFN2DIP-TR3F0-080D090US927-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	245.5	2.1
10°-20°	673.9	5.8
20°-30°	946.1	8.1
30°-40°	1031.3	8.8
40°-50°	947.9	8.1
50°-60°	744.4	6.4
60°-70°	484.5	4.1
70°-80°	249.4	2.1
80°-90°	70.1	0.6
90°-100°	139.5	1.2
100°-110°	443.3	3.8
110°-120°	758.7	6.5
120°-130°	997.8	8.5
130°-140°	1120.0	9.6
140°-150°	1098.2	9.4
150°-160°	921.3	7.9
160°-170°	611.0	5.2
170°-180°	213.5	1.8
0°-30°	1865.5	15.9
0°-40°	2896.8	24.8
0°-60°	4589.2	39.2
0°-90°	5393.2	46.1
90°-120°	1341.5	11.5
90°-150°	4557.5	39.0
90°-180°	6303.0	53.9
0°-180°	11696.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2619	2619	2619	2619	2619	
5°	2619	2608	2576	2598	2591	248
15°	2491	2465	2385	2340	2316	702
25°	2261	2186	2029	1932	1896	1040
35°	1948	1828	1619	1470	1417	1220
45°	1593	1434	1185	1017	960	1230
55°	1211	1026	770	628	583	1082
65°	818	626	412	332	325	811
75°	436	270	190	173	171	461
85°	102	52	45	45	45	117
90°	2	24	67	62	65	12
95°	99	118	122	122	118	110
105°	409	415	419	422	422	432
115°	761	772	769	767	761	753
125°	1107	1124	1119	1113	1111	990
135°	1432	1453	1458	1455	1450	1107
145°	1739	1752	1763	1765	1758	1086
155°	1988	1994	2000	2009	2003	915
165°	2163	2161	2161	2175	2165	610
175°	2251	2245	2241	2255	2243	214
180°	2255	2255	2255	2255	2255	



TEST NUMBER: P915427

CATALOG NUMBER: DFN2DIP-TR3F0-080D090US927-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2619.3	2619.3	2619.3	2619.3	2619.3
2.5°	2631.1	2619.3	2593.1	2617.0	2612.2
5°	2619.3	2607.5	2576.5	2597.9	2590.8
7.5°	2597.9	2583.8	2550.6	2559.9	2548.1
10°	2569.4	2552.9	2505.6	2498.3	2484.2
12.5°	2534.0	2512.6	2448.5	2434.4	2408.2
15°	2491.3	2465.1	2384.6	2339.6	2315.9
17.5°	2441.4	2403.5	2303.9	2251.9	2213.8
20°	2384.6	2337.1	2218.7	2159.6	2107.2
22.5°	2323.0	2268.4	2130.9	2050.4	2014.9
25°	2261.4	2185.5	2029.0	1932.0	1896.2
27.5°	2187.9	2107.2	1934.2	1822.8	1768.2
30°	2109.7	2019.4	1829.9	1709.1	1645.0
32.5°	2033.8	1924.7	1730.5	1588.2	1528.8
35°	1948.5	1827.6	1619.1	1469.7	1417.4
37.5°	1865.5	1735.0	1514.7	1351.0	1291.9
40°	1777.8	1635.7	1405.6	1237.3	1175.7
42.5°	1687.7	1536.1	1296.6	1121.2	1062.0
45°	1592.9	1434.0	1185.3	1016.8	960.0
47.5°	1502.9	1334.7	1078.6	910.1	858.1
50°	1403.3	1235.1	974.3	810.6	761.0
52.5°	1306.0	1128.1	874.6	718.3	673.3
55°	1211.2	1026.3	770.3	628.2	583.2
57.5°	1114.1	924.5	678.0	545.3	507.2
60°	1014.5	824.9	580.7	459.9	422.0
62.5°	917.4	727.8	497.7	384.0	365.2
65°	817.8	625.7	412.4	332.0	324.6
67.5°	723.0	530.9	332.0	291.4	284.5
70°	623.4	438.6	274.9	251.2	241.7
72.5°	528.6	353.1	229.9	211.0	206.2
75°	436.1	270.1	189.6	173.0	170.8
77.5°	343.8	191.9	149.4	139.8	135.1
80°	258.3	137.6	113.7	104.3	104.3
82.5°	180.1	92.5	78.2	73.4	73.4
85°	101.9	52.0	45.0	45.0	45.0
87.5°	37.9	18.9	18.9	16.6	16.6
90°	2.1	24.5	66.6	62.5	64.6
92.5°	42.1	57.1	59.2	61.2	61.2
95°	99.3	118.3	121.7	121.7	118.3
97.5°	165.2	182.8	190.4	190.4	190.4
100°	241.3	257.0	262.4	262.4	260.4
102.5°	321.5	333.1	340.6	342.6	340.6
105°	409.2	414.6	418.7	422.2	422.2
107.5°	496.2	504.4	504.4	505.7	496.2
110°	580.5	591.4	591.4	591.4	586.0

TEST NUMBER: P915427

CATALOG NUMBER: DFN2DIP-TR3F0-080D090US927-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	671.6	683.2	681.1	675.7	671.6
115°	761.4	772.2	768.8	766.8	761.4
117.5°	850.4	865.4	855.9	850.4	844.9
120°	940.2	955.1	940.2	940.2	934.0
122.5°	1021.7	1040.8	1031.3	1025.8	1021.7
125°	1107.4	1124.3	1119.0	1112.8	1110.8
127.5°	1191.0	1212.0	1204.6	1196.4	1191.0
130°	1269.2	1293.6	1290.2	1286.1	1278.7
132.5°	1356.8	1375.9	1377.2	1367.7	1362.3
135°	1432.3	1453.3	1457.5	1455.4	1450.0
137.5°	1516.6	1533.6	1537.0	1535.6	1527.5
140°	1590.7	1607.7	1617.2	1617.2	1609.7
142.5°	1666.8	1683.8	1689.2	1691.3	1683.8
145°	1738.9	1752.5	1763.3	1765.4	1757.9
147.5°	1803.5	1820.4	1828.6	1832.0	1824.6
150°	1870.1	1881.7	1889.1	1895.2	1889.1
152.5°	1929.2	1940.8	1950.3	1957.8	1950.3
155°	1988.4	1993.8	1999.9	2009.4	2003.3
157.5°	2039.3	2043.4	2046.8	2060.4	2050.9
160°	2084.9	2089.0	2091.0	2102.5	2094.4
162.5°	2127.0	2127.0	2129.1	2142.0	2132.5
165°	2163.1	2161.0	2161.0	2174.6	2165.1
167.5°	2195.7	2189.6	2189.6	2203.1	2193.6
170°	2220.2	2214.7	2212.7	2226.3	2214.7
172.5°	2237.1	2231.7	2229.7	2243.3	2231.7
175°	2250.7	2245.3	2241.2	2254.9	2243.3
177.5°	2258.2	2252.8	2248.7	2260.3	2248.7
180°	2254.9	2254.9	2254.9	2254.9	2254.9

TEST NUMBER: P915427

CATALOG NUMBER: DFN2DIP-TR3F0-080D090US927-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.83	11.63	11.83	12.63	13.96	6.81	7.61	7.80	8.61	9.94
	3H	12.49	13.21	13.50	14.22	15.57	7.99	8.70	8.99	9.71	11.06
	4H	13.10	13.77	14.11	14.79	16.14	8.43	9.11	9.45	10.12	11.48
	6H	13.51	14.13	14.54	15.15	16.52	8.75	9.37	9.78	10.39	11.76
	8H	13.63	14.22	14.66	15.26	16.62	8.83	9.42	9.87	10.46	11.83
	12H	13.69	14.25	14.73	15.28	16.67	8.87	9.44	9.91	10.46	11.85
4H	2H	10.84	11.52	11.87	12.53	13.89	7.39	8.07	8.42	9.08	10.44
	3H	12.66	13.22	13.69	14.26	15.63	8.73	9.29	9.77	10.34	11.71
	4H	13.34	13.86	14.38	14.89	16.28	9.27	9.79	10.32	10.82	12.22
	6H	13.85	14.29	14.90	15.35	16.74	9.69	10.13	10.74	11.19	12.58
	8H	14.02	14.43	15.07	15.48	16.88	9.81	10.22	10.86	11.27	12.68
	12H	14.10	14.48	15.17	15.54	16.95	9.87	10.24	10.94	11.31	12.72
8H	4H	13.31	13.72	14.36	14.77	16.17	9.55	9.96	10.60	11.01	12.41
	6H	13.86	14.20	14.93	15.29	16.70	10.06	10.40	11.13	11.49	12.89
	8H	14.07	14.37	15.15	15.45	16.87	10.24	10.54	11.32	11.62	13.04
	12H	14.20	14.46	15.29	15.54	17.00	10.35	10.62	11.44	11.69	13.15
12H	4H	13.26	13.63	14.32	14.69	16.10	9.55	9.92	10.62	10.99	12.40
	6H	13.83	14.13	14.92	15.21	16.63	10.10	10.40	11.18	11.48	12.90
	8H	14.05	14.31	15.13	15.38	16.84	10.31	10.57	11.39	11.64	13.10

END OF REPORT