

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915433

Luminaire Tested: DFN2DIP-TR3F0-090D040US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915433
REPORT IS A COMBINATION OF REPORTS P901817 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-090D040US927-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10195.3 lumens
Efficiency: N/A
Efficacy: 82.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 124.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915433

CATALOG NUMBER: DFN2DIP-TR3F0-090D040US927-FLLONL

Luminous Intensity Polar Plot

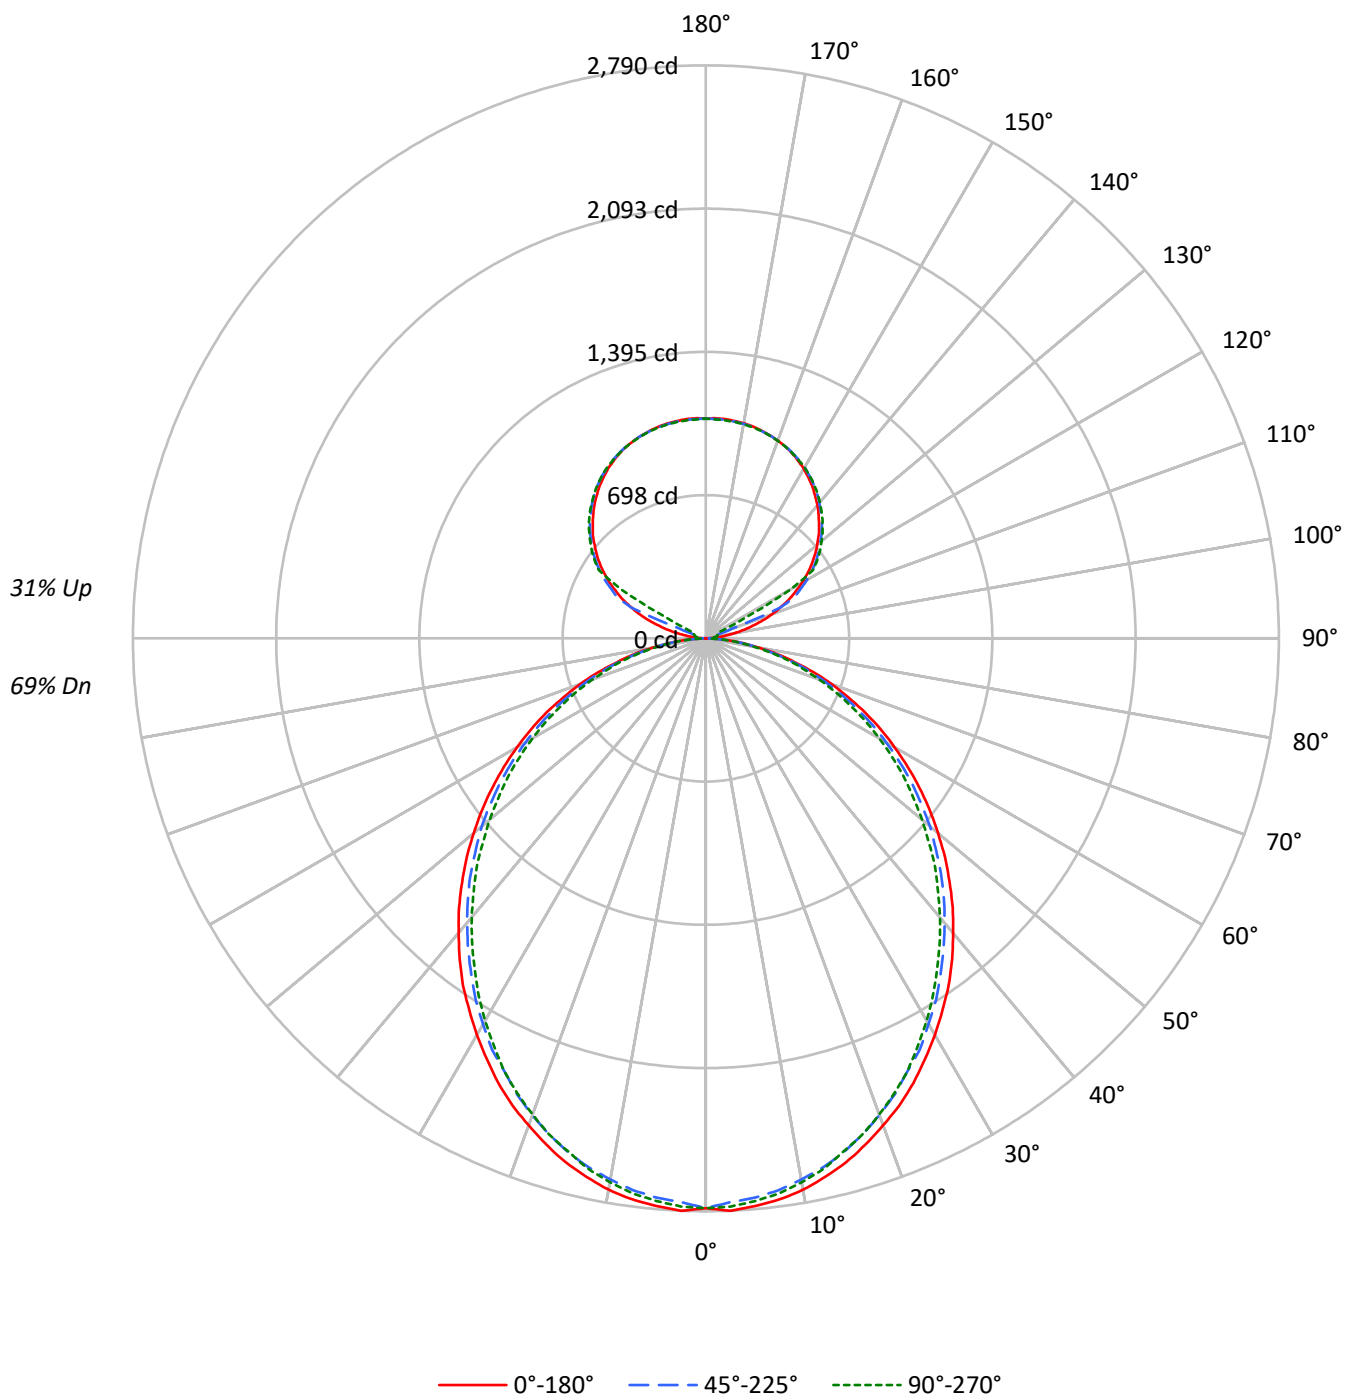

TEST NUMBER: P915433

CATALOG NUMBER: DFN2DIP-TR3F0-090D040US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	83	83	83	74	74	74
1	102	98	94	90	96	92	89	86	83	80	77	74	72	70	65	64	62
2	93	85	79	74	88	81	75	70	72	68	64	65	61	58	57	55	53
3	85	75	67	61	80	71	64	59	64	59	54	57	53	49	51	48	45
4	78	67	58	52	73	63	56	50	57	51	46	51	46	42	46	42	39
5	71	59	51	45	67	57	49	43	51	45	40	46	41	37	41	37	34
6	66	53	45	39	62	51	43	38	46	40	35	42	36	32	37	33	30
7	61	48	40	34	58	46	39	33	42	36	31	38	33	29	34	30	26
8	57	44	36	31	54	42	35	30	38	32	28	35	29	26	31	27	24
9	53	40	33	27	50	39	31	27	35	29	25	32	27	23	29	25	21
10	50	37	30	25	47	36	29	24	32	27	22	30	25	21	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3457	3457	3457
5°	3460	3406	3429
10°	3431	3357	3381
15°	3378	3299	3306
20°	3308	3219	3229
25°	3238	3124	3141
30°	3151	3036	3030
35°	3069	2932	2912
40°	2967	2827	2800
45°	2866	2722	2685
50°	2756	2611	2552
55°	2640	2483	2429
60°	2508	2332	2288
65°	2365	2174	2123
70°	2182	1982	1943
75°	1929	1752	1775
80°	1624	1457	1459
85°	1146	960	942

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2866 cd/sqm

TEST NUMBER: P915433

CATALOG NUMBER: DFN2DIP-TR3F0-090D040US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	261.1	2.6
10°-20°	734.7	7.2
20°-30°	1079.6	10.6
30°-40°	1253.9	12.3
40°-50°	1252.4	12.3
50°-60°	1092.1	10.7
60°-70°	807.3	7.9
70°-80°	456.7	4.5
80°-90°	122.4	1.2
90°-100°	35.2	0.3
100°-110°	131.5	1.3
110°-120°	348.6	3.4
120°-130°	578.2	5.7
130°-140°	614.2	6.0
140°-150°	570.9	5.6
150°-160°	458.9	4.5
160°-170°	295.7	2.9
170°-180°	101.8	1.0
0°-30°	2075.4	20.4
0°-40°	3329.4	32.7
0°-60°	5673.8	55.7
0°-90°	7060.2	69.2
90°-120°	515.3	5.1
90°-150°	2278.7	22.4
90°-180°	3135.0	30.7
0°-180°	10195.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2774	2774	2774	2774	2774	
5°	2774	2764	2734	2756	2750	263
15°	2641	2625	2590	2601	2588	744
25°	2390	2369	2324	2329	2324	1100
35°	2062	2036	1993	1977	1963	1288
45°	1678	1659	1619	1590	1579	1295
55°	1270	1254	1222	1190	1176	1135
65°	856	840	814	790	776	847
75°	448	443	429	414	419	478
85°	109	107	104	96	93	122
90°	1	9	15	19	21	9
95°	50	25	30	34	33	60
105°	235	258	47	56	59	251
115°	445	458	477	119	64	438
125°	629	639	654	659	662	561
135°	778	791	798	806	804	601
145°	903	902	915	921	917	565
155°	994	988	997	1001	995	458
165°	1048	1043	1045	1051	1045	296
175°	1072	1066	1068	1073	1066	102
180°	1069	1069	1069	1069	1069	

TEST NUMBER: P915433

CATALOG NUMBER: DFN2DIP-TR3F0-090D040US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2774.1	2774.1	2774.1	2774.1	2774.1
2.5°	2790.3	2777.0	2747.6	2774.1	2769.1
5°	2774.1	2763.7	2734.3	2755.5	2750.4
7.5°	2755.5	2739.7	2710.2	2731.8	2726.4
10°	2726.4	2707.7	2675.7	2696.9	2689.0
12.5°	2686.1	2670.3	2638.4	2651.6	2646.3
15°	2640.9	2625.1	2590.2	2601.0	2587.7
17.5°	2584.8	2569.0	2534.2	2547.5	2534.2
20°	2523.4	2507.6	2470.2	2478.1	2467.6
22.5°	2462.3	2438.3	2403.4	2403.4	2398.0
25°	2390.1	2368.9	2323.6	2328.7	2323.6
27.5°	2310.0	2291.3	2256.8	2248.9	2235.6
30°	2230.2	2208.7	2168.8	2160.8	2150.1
32.5°	2144.8	2128.9	2086.1	2070.0	2059.3
35°	2062.1	2035.5	1992.7	1976.7	1963.3
37.5°	1968.7	1944.6	1901.9	1883.3	1869.9
40°	1872.7	1851.2	1808.5	1784.7	1774.0
42.5°	1779.3	1757.8	1715.4	1688.5	1672.7
45°	1678.0	1659.4	1619.1	1590.0	1579.3
47.5°	1579.3	1560.6	1517.8	1488.4	1472.6
50°	1475.1	1461.8	1424.4	1387.1	1373.8
52.5°	1373.8	1355.1	1320.6	1291.2	1272.5
55°	1269.9	1253.8	1221.8	1189.9	1176.5
57.5°	1165.8	1152.5	1117.7	1085.7	1074.9
60°	1061.6	1051.1	1013.8	984.4	976.4
62.5°	960.3	941.6	915.0	888.4	877.7
65°	856.4	840.3	813.6	789.6	776.3
67.5°	749.7	736.2	712.3	693.7	682.9
70°	650.9	640.2	616.2	597.5	587.0
72.5°	549.6	538.8	525.5	506.9	499.0
75°	448.1	442.9	429.4	413.5	418.9
77.5°	357.4	346.7	341.4	333.4	325.5
80°	266.9	264.0	258.6	250.7	245.4
82.5°	181.4	181.4	178.9	168.1	168.1
85°	109.2	106.7	104.2	95.9	93.4
87.5°	48.1	42.7	37.4	29.5	26.6
90°	0.7	9.3	15.4	19.4	20.8
92.5°	19.4	16.2	18.5	20.1	20.8
95°	50.2	24.7	30.1	34.1	33.3
97.5°	90.5	27.1	39.5	41.8	42.5
100°	137.0	31.0	44.1	50.2	51.8
102.5°	188.0	186.6	45.6	54.1	56.5
105°	235.2	258.5	47.2	55.7	58.8
107.5°	290.2	309.5	48.8	57.3	60.4
110°	342.9	359.0	135.5	58.1	61.1

TEST NUMBER: P915433

CATALOG NUMBER: DFN2DIP-TR3F0-090D040US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	392.4	406.2	393.1	59.6	61.9
115°	444.9	458.0	477.4	119.1	63.5
117.5°	490.6	506.0	519.3	408.5	205.8
120°	541.7	553.3	567.2	576.5	472.1
122.5°	584.9	597.4	612.9	617.5	618.3
125°	629.1	639.2	653.9	659.3	661.6
127.5°	669.3	680.2	691.8	699.6	700.3
130°	707.3	719.7	728.1	736.6	735.9
132.5°	745.9	756.1	764.5	771.5	770.8
135°	778.5	790.9	797.8	805.6	804.1
137.5°	812.5	821.7	829.6	837.3	835.0
140°	845.7	852.0	860.5	867.4	863.6
142.5°	873.7	879.1	889.1	895.2	891.4
145°	903.1	902.3	915.4	920.8	916.9
147.5°	928.5	926.2	939.4	943.3	940.2
150°	953.3	947.9	960.4	965.0	961.1
152.5°	974.2	968.0	979.6	984.3	978.9
155°	994.3	987.5	996.7	1001.3	995.1
157.5°	1010.6	1004.4	1011.5	1016.8	1010.6
160°	1024.5	1019.9	1024.5	1029.1	1023.7
162.5°	1036.9	1032.3	1036.2	1041.6	1034.6
165°	1047.7	1043.1	1045.4	1050.8	1045.4
167.5°	1056.3	1051.5	1054.0	1059.4	1052.4
170°	1063.3	1058.6	1060.1	1065.6	1058.6
172.5°	1067.9	1063.3	1064.8	1070.2	1063.3
175°	1071.7	1066.3	1067.9	1073.2	1065.6
177.5°	1073.2	1067.9	1068.7	1074.1	1067.1
180°	1069.4	1069.4	1069.4	1069.4	1069.4

TEST NUMBER: P915433

CATALOG NUMBER: DFN2DIP-TR3F0-090D040US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.14	14.21	13.91	15.00	15.97	12.71	13.78	13.49	14.57	15.54
	3H	14.81	15.77	15.59	16.57	17.57	14.34	15.30	15.12	16.10	17.10
	4H	15.40	16.30	16.20	17.11	18.12	14.93	15.83	15.73	16.65	17.66
	6H	15.80	16.64	16.62	17.46	18.48	15.33	16.17	16.15	16.99	18.01
	8H	15.91	16.70	16.73	17.54	18.57	15.44	16.23	16.26	17.07	18.10
	12H	15.96	16.72	16.79	17.55	18.60	15.49	16.24	16.32	17.08	18.13
4H	2H	13.62	14.53	14.43	15.34	16.35	13.28	14.19	14.09	15.00	16.01
	3H	15.50	16.25	16.32	17.10	18.12	15.11	15.86	15.93	16.71	17.73
	4H	16.21	16.90	17.05	17.74	18.80	15.81	16.50	16.64	17.34	18.40
	6H	16.73	17.33	17.58	18.19	19.25	16.33	16.92	17.18	17.79	18.85
	8H	16.88	17.44	17.73	18.30	19.37	16.47	17.03	17.33	17.89	18.96
	12H	16.96	17.46	17.83	18.34	19.42	16.54	17.04	17.42	17.93	19.00
8H	4H	16.42	16.98	17.27	17.84	18.91	16.06	16.62	16.92	17.49	18.55
	6H	17.05	17.51	17.93	18.42	19.49	16.69	17.15	17.57	18.06	19.13
	8H	17.27	17.68	18.16	18.58	19.66	16.90	17.31	17.79	18.21	19.30
	12H	17.40	17.76	18.30	18.65	19.79	17.02	17.38	17.92	18.28	19.42
12H	4H	16.42	16.92	17.29	17.80	18.88	16.07	16.57	16.94	17.45	18.53
	6H	17.08	17.49	17.97	18.39	19.48	16.73	17.14	17.62	18.04	19.13
	8H	17.32	17.68	18.22	18.58	19.72	16.97	17.33	17.87	18.22	19.36