

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918007

Luminaire Tested: DFN2DIP-TR3F0-030D040US930-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918007
REPORT IS A COMBINATION OF REPORTS P901806 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-030D040US930-RLLONL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5307.6 lumens
Efficiency: N/A
Efficacy: 99.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 53.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918007

CATALOG NUMBER: DFN2DIP-TR3F0-030D040US930-RLLONL

Luminous Intensity Polar Plot

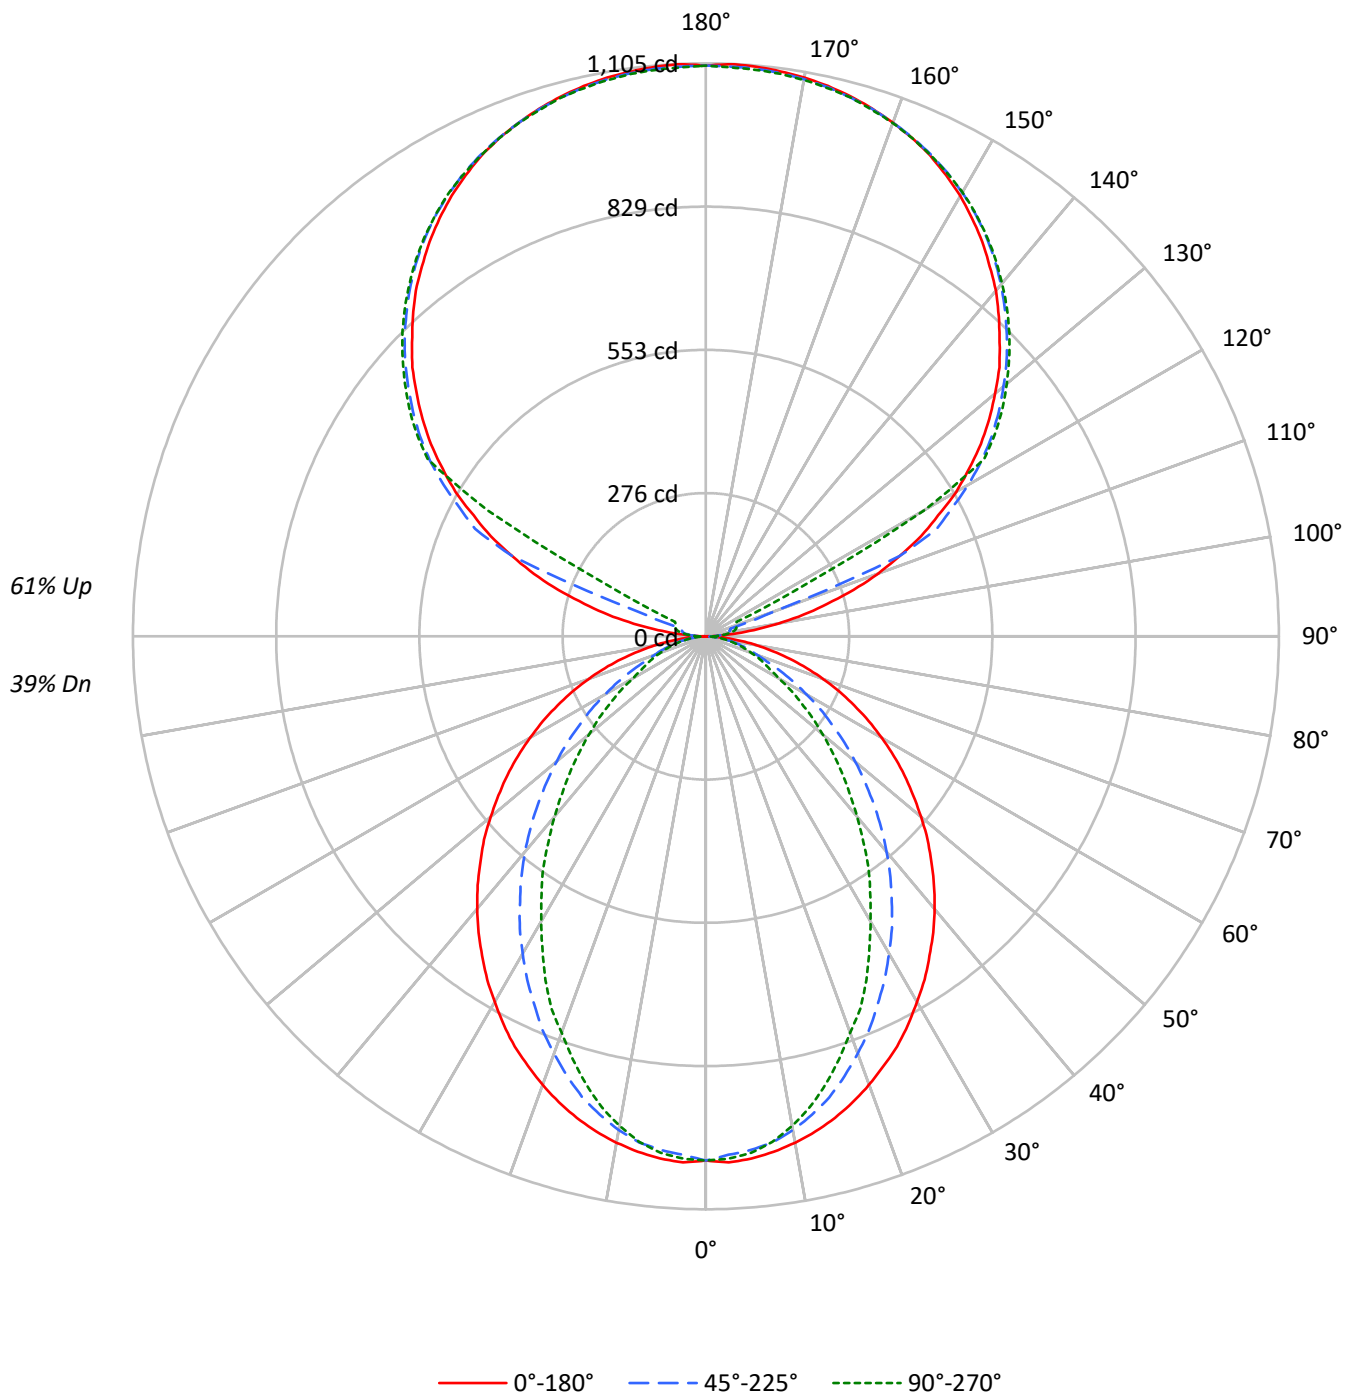

TEST NUMBER: P918007

CATALOG NUMBER: DFN2DIP-TR3F0-030D040US930-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	77	77	77	61	61	61	46	46	46
1	96	92	88	85	87	83	80	78	68	66	64	54	53	52	41	41	40
2	87	80	75	70	79	73	68	64	60	57	54	48	46	44	37	35	34
3	80	71	64	58	73	65	59	54	53	49	46	43	40	37	33	31	29
4	73	63	55	50	67	58	51	46	48	43	39	38	35	32	30	27	26
5	67	56	48	43	61	52	45	40	43	38	34	35	31	28	27	25	23
6	62	51	43	37	56	46	40	35	39	34	30	31	28	25	25	22	20
7	57	46	38	33	52	42	35	31	35	30	26	29	25	22	23	20	18
8	53	42	34	29	49	38	32	27	32	27	23	26	22	20	21	18	16
9	50	38	31	26	45	35	29	24	29	24	21	24	20	18	19	17	15
10	46	35	28	23	42	32	26	22	27	22	19	22	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1260	1260	1260
5°	1261	1239	1247
10°	1248	1213	1205
15°	1230	1172	1142
20°	1206	1116	1064
25°	1183	1053	989
30°	1151	989	895
35°	1119	919	811
40°	1087	848	716
45°	1050	769	630
50°	1012	689	546
55°	972	604	465
60°	925	515	382
65°	871	425	343
70°	806	341	309
75°	725	299	279
80°	607	247	240
85°	413	160	175

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1050 cd/sqm

TEST NUMBER: P918007

CATALOG NUMBER: DFN2DIP-TR3F0-030D040US930-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	94.7	1.8
10°-20°	260.1	4.9
20°-30°	365.1	6.9
30°-40°	398.0	7.5
40°-50°	365.8	6.9
50°-60°	287.3	5.4
60°-70°	187.0	3.5
70°-80°	96.3	1.8
80°-90°	26.5	0.5
90°-100°	36.3	0.7
100°-110°	135.3	2.5
110°-120°	358.8	6.8
120°-130°	595.1	11.2
130°-140°	632.1	11.9
140°-150°	587.5	11.1
150°-160°	472.3	8.9
160°-170°	304.4	5.7
170°-180°	104.8	2.0
0°-30°	720.0	13.6
0°-40°	1118.0	21.1
0°-60°	1771.2	33.4
0°-90°	2080.9	39.2
90°-120°	530.4	10.0
90°-150°	2345.2	44.2
90°-180°	3227.0	60.8
0°-180°	5307.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1011	1011	1011	1011	1011	
5°	1011	1006	994	1003	1000	96
15°	962	951	920	903	894	271
25°	873	843	783	746	732	401
35°	752	705	625	567	547	471
45°	615	553	458	392	370	475
55°	467	396	297	242	225	418
65°	316	242	159	128	125	313
75°	168	104	73	67	66	178
85°	39	20	17	17	17	45
90°	1	10	16	20	21	5
95°	52	25	31	35	34	61
105°	242	266	49	57	60	259
115°	458	471	491	123	65	451
125°	647	658	673	679	681	577
135°	801	814	821	829	828	619
145°	929	929	942	948	944	581
155°	1023	1016	1026	1030	1024	472
165°	1078	1074	1076	1082	1076	305
175°	1103	1097	1099	1105	1097	105
180°	1101	1101	1101	1101	1101	

TEST NUMBER: P918007

CATALOG NUMBER: DFN2DIP-TR3F0-030D040US930-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1010.9	1010.9	1010.9	1010.9	1010.9
2.5°	1015.5	1010.9	1000.8	1010.0	1008.2
5°	1010.9	1006.3	994.4	1002.7	999.9
7.5°	1002.7	997.2	984.4	988.0	983.4
10°	991.6	985.3	967.0	964.2	958.8
12.5°	978.0	969.7	945.0	939.5	929.4
15°	961.5	951.4	920.3	902.9	893.8
17.5°	942.2	927.6	889.2	869.1	854.4
20°	920.3	902.0	856.2	833.5	813.3
22.5°	896.6	875.5	822.4	791.3	777.6
25°	872.8	843.4	783.1	745.6	731.8
27.5°	844.4	813.3	746.5	703.5	682.4
30°	814.2	779.4	706.2	659.7	634.9
32.5°	784.9	742.8	667.9	612.9	590.0
35°	752.0	705.3	624.8	567.2	547.1
37.5°	720.0	669.6	584.6	521.4	498.6
40°	686.2	631.3	542.5	477.5	453.8
42.5°	651.3	592.9	500.4	432.7	409.9
45°	614.8	553.4	457.5	392.4	370.5
47.5°	580.0	515.1	416.3	351.2	331.2
50°	541.6	476.6	376.0	312.8	293.7
52.5°	504.0	435.5	337.6	277.2	259.8
55°	467.4	396.1	297.3	242.5	225.1
57.5°	430.0	356.8	261.7	210.4	195.8
60°	391.5	318.4	224.1	177.5	162.9
62.5°	354.1	280.9	192.1	148.2	141.0
65°	315.6	241.5	159.1	128.1	125.3
67.5°	279.1	204.9	128.1	112.5	109.7
70°	240.6	169.3	106.1	96.9	93.3
72.5°	204.0	136.2	88.7	81.4	79.6
75°	168.3	104.3	73.2	66.8	65.9
77.5°	132.6	74.0	57.6	54.0	52.1
80°	99.7	53.1	43.9	40.3	40.3
82.5°	69.5	35.7	30.2	28.4	28.4
85°	39.3	20.1	17.4	17.4	17.4
87.5°	14.7	7.3	7.3	6.4	6.4
90°	0.7	9.5	15.9	20.0	21.4
92.5°	20.0	16.7	19.1	20.7	21.4
95°	51.7	25.4	31.0	35.1	34.2
97.5°	93.2	27.9	40.6	43.0	43.8
100°	141.0	31.9	45.4	51.7	53.3
102.5°	193.5	192.0	47.0	55.7	58.1
105°	242.1	266.0	48.6	57.3	60.5
107.5°	298.6	318.5	50.2	58.9	62.1
110°	352.9	369.5	139.4	59.8	62.9

TEST NUMBER: P918007

CATALOG NUMBER: DFN2DIP-TR3F0-030D040US930-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	403.8	418.1	404.6	61.3	63.8
115°	457.9	471.4	491.4	122.6	65.4
117.5°	504.9	520.8	534.4	420.4	211.8
120°	557.5	569.4	583.8	593.4	485.8
122.5°	602.0	614.8	630.8	635.5	636.3
125°	647.4	657.9	672.9	678.6	680.9
127.5°	688.8	700.0	712.0	720.0	720.7
130°	727.9	740.7	749.3	758.1	757.4
132.5°	767.7	778.1	786.8	794.0	793.3
135°	801.2	814.0	821.1	829.1	827.5
137.5°	836.2	845.7	853.8	861.7	859.3
140°	870.4	876.9	885.6	892.8	888.8
142.5°	899.2	904.7	915.1	921.4	917.5
145°	929.4	928.6	942.1	947.7	943.7
147.5°	955.6	953.2	966.8	970.8	967.7
150°	981.1	975.6	988.4	993.1	989.1
152.5°	1002.7	996.3	1008.2	1013.0	1007.5
155°	1023.4	1016.3	1025.8	1030.5	1024.2
157.5°	1040.1	1033.7	1041.0	1046.5	1040.1
160°	1054.4	1049.6	1054.4	1059.2	1053.6
162.5°	1067.1	1062.4	1066.4	1072.0	1064.8
165°	1078.3	1073.6	1075.9	1081.5	1075.9
167.5°	1087.1	1082.2	1084.8	1090.3	1083.1
170°	1094.3	1089.5	1091.0	1096.7	1089.5
172.5°	1099.0	1094.3	1095.9	1101.5	1094.3
175°	1102.9	1097.4	1099.0	1104.6	1096.7
177.5°	1104.6	1099.0	1099.8	1105.5	1098.3
180°	1100.7	1100.7	1100.7	1100.7	1100.7

TEST NUMBER: P918007

CATALOG NUMBER: DFN2DIP-TR3F0-030D040US930-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.80	7.55	7.85	8.60	10.02	2.77	3.52	3.83	4.58	6.00
	3H	8.46	9.13	9.52	10.19	11.63	3.95	4.62	5.01	5.68	7.12
	4H	9.06	9.69	10.13	10.76	12.20	4.39	5.03	5.47	6.09	7.54
	6H	9.47	10.05	10.55	11.12	12.58	4.71	5.29	5.79	6.36	7.81
	8H	9.59	10.14	10.67	11.23	12.68	4.79	5.35	5.88	6.43	7.88
	12H	9.64	10.17	10.73	11.25	12.72	4.83	5.36	5.92	6.43	7.91
4H	2H	6.81	7.44	7.88	8.50	9.95	3.35	3.99	4.43	5.05	6.50
	3H	8.62	9.14	9.70	10.23	11.69	4.69	5.22	5.78	6.31	7.77
	4H	9.30	9.78	10.39	10.86	12.34	5.23	5.71	6.32	6.79	8.27
	6H	9.80	10.21	10.90	11.32	12.79	5.64	6.05	6.74	7.16	8.63
	8H	9.97	10.36	11.07	11.45	12.94	5.76	6.15	6.86	7.25	8.74
	12H	10.05	10.40	11.17	11.51	13.01	5.82	6.17	6.94	7.28	8.77
8H	4H	9.26	9.65	10.36	10.74	12.23	5.50	5.89	6.60	6.98	8.47
	6H	9.81	10.13	10.93	11.27	12.75	6.01	6.33	7.13	7.46	8.95
	8H	10.02	10.30	11.15	11.42	12.93	6.19	6.47	7.32	7.59	9.10
	12H	10.15	10.40	11.28	11.51	13.05	6.31	6.55	7.44	7.67	9.21
12H	4H	9.21	9.56	10.32	10.67	12.16	5.50	5.85	6.61	6.96	8.45
	6H	9.79	10.07	10.91	11.18	12.69	6.05	6.33	7.18	7.45	8.96
	8H	10.00	10.24	11.13	11.36	12.90	6.26	6.50	7.39	7.62	9.16

END OF REPORT