

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918009

Luminaire Tested: DFN2DIP-TR3F0-030D050US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918009
REPORT IS A COMBINATION OF REPORTS P901819 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-030D050US930-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6457.2 lumens
Efficiency: N/A
Efficacy: 105.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 61.1
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918009

CATALOG NUMBER: DFN2DIP-TR3F0-030D050US930-FLLONL

Luminous Intensity Polar Plot

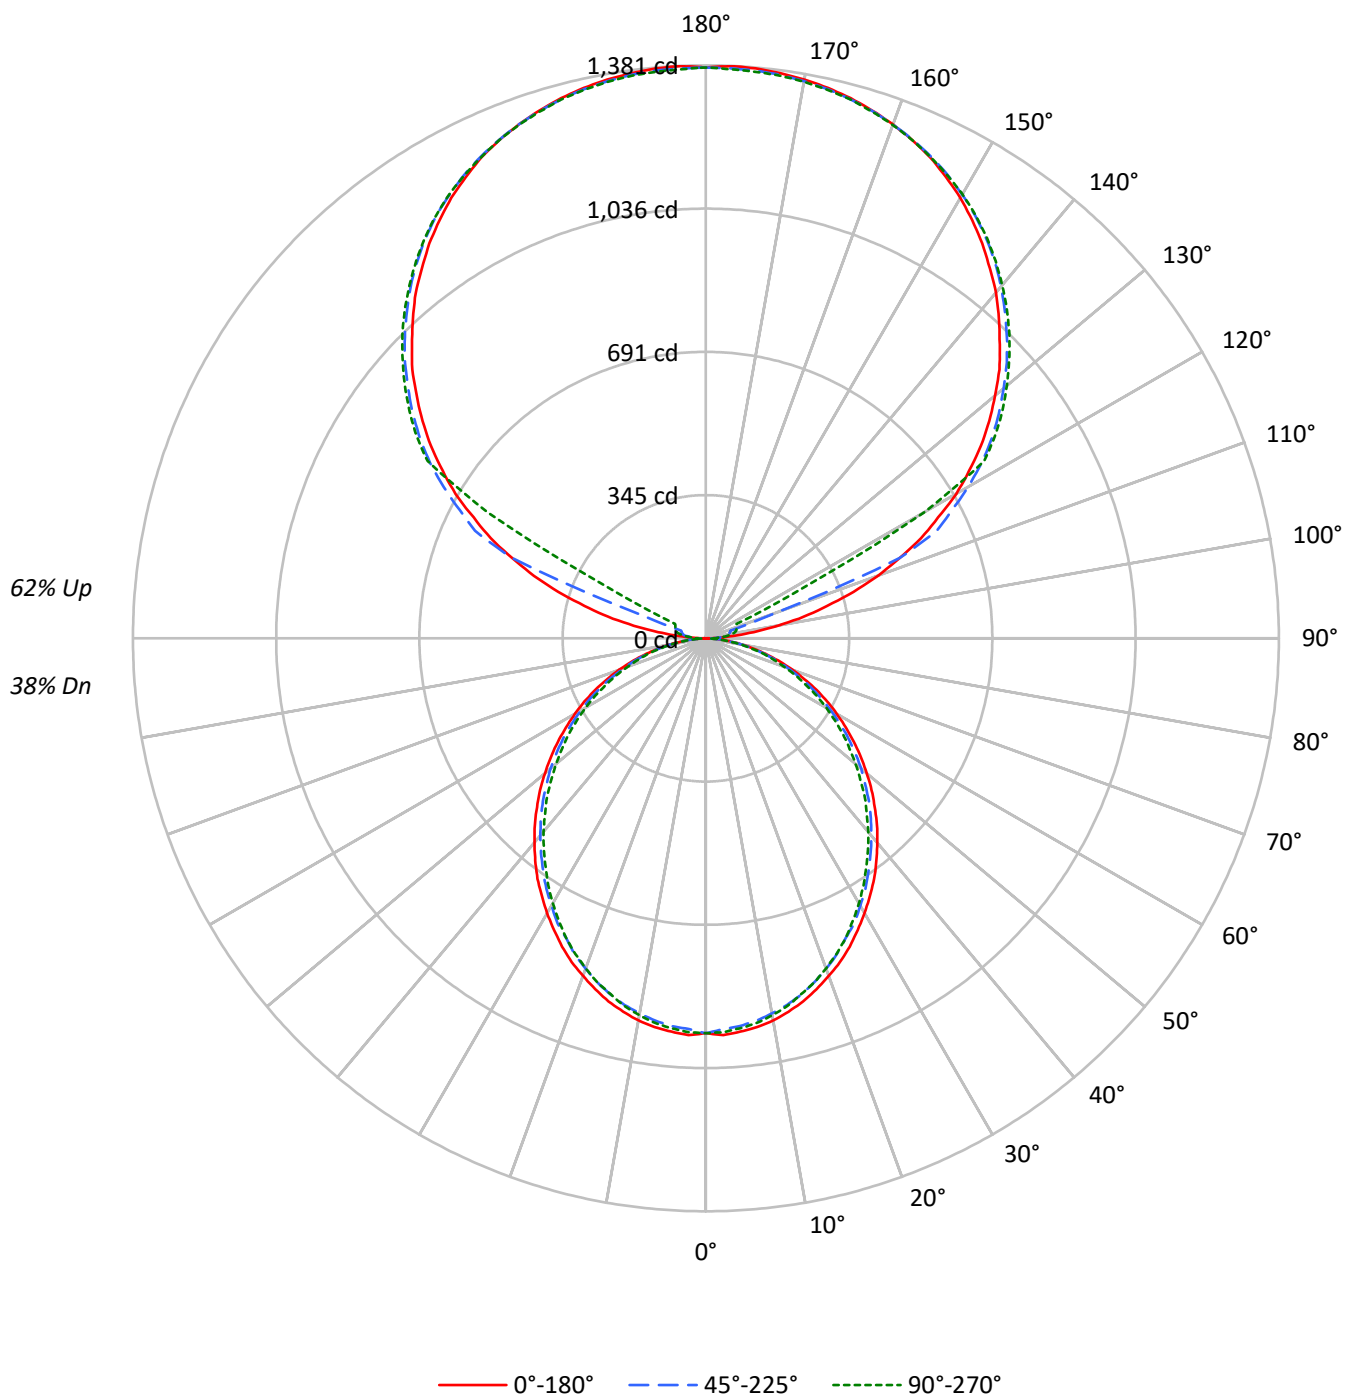

TEST NUMBER: P918009

CATALOG NUMBER: DFN2DIP-TR3F0-030D050US930-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	60	60	60	45	45	45
1	95	91	87	83	86	82	79	76	67	65	63	53	51	50	39	39	38
2	86	79	73	68	78	72	67	63	59	55	52	46	44	42	35	33	32
3	79	70	62	57	71	63	57	52	52	47	44	41	38	35	31	29	27
4	72	62	54	48	65	56	49	44	46	41	37	36	33	30	27	25	23
5	66	55	47	41	60	50	43	38	41	36	32	33	29	26	25	22	20
6	61	49	41	35	55	45	38	33	37	32	28	29	26	23	22	20	18
7	56	44	36	31	51	40	34	29	33	28	24	27	23	20	20	18	16
8	52	40	32	27	47	37	30	25	30	25	22	24	21	18	19	16	14
9	48	36	29	24	44	33	27	23	28	23	19	22	19	16	17	15	13
10	45	33	26	22	41	31	24	20	26	21	17	21	17	14	16	13	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1186	1186	1186
5°	1187	1168	1176
10°	1177	1152	1160
15°	1159	1132	1134
20°	1135	1104	1108
25°	1111	1072	1078
30°	1081	1042	1039
35°	1053	1006	999
40°	1018	970	961
45°	983	934	921
50°	945	896	876
55°	906	852	834
60°	860	800	785
65°	811	746	728
70°	748	680	667
75°	662	601	609
80°	557	500	500
85°	394	329	323

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 983 cd/sqm

TEST NUMBER: P918009

CATALOG NUMBER: DFN2DIP-TR3F0-030D050US930-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	89.6	1.4
10°-20°	252.0	3.9
20°-30°	370.4	5.7
30°-40°	430.2	6.7
40°-50°	429.7	6.7
50°-60°	374.6	5.8
60°-70°	277.0	4.3
70°-80°	156.7	2.4
80°-90°	43.8	0.7
90°-100°	45.4	0.7
100°-110°	169.1	2.6
110°-120°	448.5	6.9
120°-130°	743.9	11.5
130°-140°	790.2	12.2
140°-150°	734.4	11.4
150°-160°	590.4	9.1
160°-170°	380.5	5.9
170°-180°	130.9	2.0
0°-30°	712.0	11.0
0°-40°	1142.2	17.7
0°-60°	1946.5	30.1
0°-90°	2423.9	37.5
90°-120°	663.0	10.3
90°-150°	2931.5	45.4
90°-180°	4033.0	62.5
0°-180°	6457.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	952	952	952	952	952	
5°	952	948	938	945	944	90
15°	906	901	889	892	888	255
25°	820	813	797	799	797	377
35°	707	698	684	678	674	442
45°	576	569	556	545	542	444
55°	436	430	419	408	404	390
65°	294	288	279	271	266	290
75°	154	152	147	142	144	164
85°	38	37	36	33	32	42
90°	1	12	20	25	27	6
95°	65	32	39	44	43	77
105°	303	333	61	72	76	323
115°	572	589	614	153	82	564
125°	809	822	841	848	851	722
135°	1002	1018	1026	1036	1034	774
145°	1162	1161	1178	1185	1180	727
155°	1279	1270	1282	1288	1280	589
165°	1348	1342	1345	1352	1345	381
175°	1379	1372	1374	1381	1371	131
180°	1376	1376	1376	1376	1376	

TEST NUMBER: P918009

CATALOG NUMBER: DFN2DIP-TR3F0-030D050US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	951.7	951.7	951.7	951.7	951.7
2.5°	957.2	952.7	942.6	951.7	950.0
5°	951.7	948.1	938.0	945.3	943.5
7.5°	945.3	939.9	929.8	937.2	935.3
10°	935.3	928.9	917.9	925.2	922.5
12.5°	921.5	916.1	905.1	909.6	907.8
15°	906.0	900.6	888.6	892.3	887.7
17.5°	886.7	881.3	869.4	873.9	869.4
20°	865.7	860.2	847.4	850.1	846.5
22.5°	844.7	836.5	824.5	824.5	822.6
25°	819.9	812.7	797.1	798.9	797.1
27.5°	792.5	786.0	774.2	771.5	767.0
30°	765.1	757.7	744.0	741.3	737.6
32.5°	735.8	730.3	715.7	710.1	706.5
35°	707.4	698.3	683.6	678.1	673.5
37.5°	675.4	667.2	652.5	646.0	641.5
40°	642.5	635.1	620.4	612.3	608.6
42.5°	610.4	603.1	588.5	579.3	573.8
45°	575.7	569.2	555.5	545.4	541.8
47.5°	541.8	535.4	520.7	510.6	505.2
50°	506.1	501.5	488.7	475.9	471.3
52.5°	471.3	464.9	453.1	443.0	436.5
55°	435.7	430.2	419.1	408.2	403.7
57.5°	399.9	395.3	383.4	372.4	368.8
60°	364.2	360.6	347.8	337.7	335.0
62.5°	329.5	323.0	313.9	304.8	301.1
65°	293.8	288.3	279.2	270.9	266.4
67.5°	257.2	252.6	244.3	238.0	234.3
70°	223.3	219.6	211.4	205.0	201.4
72.5°	188.6	184.8	180.3	173.9	171.2
75°	153.7	152.0	147.3	141.9	143.7
77.5°	122.6	119.0	117.1	114.4	111.7
80°	91.6	90.6	88.7	86.0	84.2
82.5°	62.2	62.2	61.4	57.6	57.6
85°	37.5	36.6	35.7	32.9	32.0
87.5°	16.5	14.7	12.8	10.1	9.1
90°	1.0	11.9	19.9	24.9	26.8
92.5°	24.9	21.0	23.9	25.9	26.8
95°	64.7	31.8	38.8	43.9	42.8
97.5°	116.4	34.9	50.7	53.8	54.7
100°	176.3	39.9	56.7	64.7	66.7
102.5°	241.9	239.9	58.8	69.6	72.7
105°	302.6	332.6	60.7	71.7	75.7
107.5°	373.3	398.1	62.8	73.6	77.7
110°	441.1	461.9	174.2	74.7	78.6

TEST NUMBER: P918009

CATALOG NUMBER: DFN2DIP-TR3F0-030D050US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	504.8	522.6	505.7	76.6	79.7
115°	572.4	589.3	614.2	153.4	81.7
117.5°	631.1	651.0	668.1	525.5	264.8
120°	696.8	711.8	729.7	741.7	607.2
122.5°	752.5	768.5	788.5	794.4	795.5
125°	809.3	822.3	841.2	848.2	851.2
127.5°	861.0	875.0	890.1	899.9	900.9
130°	909.9	925.9	936.7	947.7	946.8
132.5°	959.7	972.7	983.5	992.5	991.6
135°	1001.5	1017.5	1026.3	1036.4	1034.4
137.5°	1045.2	1057.2	1067.2	1077.2	1074.2
140°	1088.0	1096.1	1106.9	1115.9	1111.0
142.5°	1124.0	1131.0	1143.9	1151.8	1146.8
145°	1161.8	1160.7	1177.6	1184.6	1179.7
147.5°	1194.6	1191.6	1208.5	1213.5	1209.6
150°	1226.5	1219.5	1235.4	1241.4	1236.4
152.5°	1253.3	1245.4	1260.3	1266.3	1259.3
155°	1279.2	1270.3	1282.2	1288.2	1280.3
157.5°	1300.1	1292.2	1301.1	1308.1	1300.1
160°	1318.1	1312.1	1318.1	1324.0	1317.0
162.5°	1333.9	1328.0	1332.9	1339.9	1331.0
165°	1347.9	1342.0	1344.9	1351.8	1344.9
167.5°	1358.9	1352.8	1355.9	1362.9	1353.9
170°	1367.8	1361.8	1363.8	1370.8	1361.8
172.5°	1373.8	1367.8	1369.9	1376.8	1367.8
175°	1378.8	1371.7	1373.8	1380.7	1370.8
177.5°	1380.7	1373.8	1374.8	1381.8	1372.8
180°	1375.7	1375.7	1375.7	1375.7	1375.7

TEST NUMBER: P918009

CATALOG NUMBER: DFN2DIP-TR3F0-030D050US930-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.54	7.30	7.59	8.36	9.80	6.11	6.87	7.17	7.93	9.37
	3H	8.18	8.86	9.25	9.93	11.39	7.71	8.39	8.78	9.46	10.92
	4H	8.76	9.40	9.83	10.47	11.94	8.29	8.93	9.37	10.01	11.47
	6H	9.14	9.74	10.23	10.81	12.29	8.68	9.27	9.76	10.34	11.82
	8H	9.24	9.81	10.33	10.90	12.37	8.77	9.34	9.87	10.43	11.90
	12H	9.28	9.82	10.38	10.91	12.40	8.81	9.35	9.91	10.43	11.93
4H	2H	6.98	7.63	8.07	8.70	10.16	6.64	7.29	7.73	8.36	9.82
	3H	8.83	9.37	9.92	10.47	11.94	8.44	8.98	9.53	10.08	11.55
	4H	9.53	10.03	10.63	11.11	12.61	9.13	9.63	10.23	10.71	12.21
	6H	10.03	10.46	11.14	11.57	13.06	9.63	10.05	10.73	11.16	12.65
	8H	10.17	10.57	11.28	11.67	13.18	9.77	10.16	10.87	11.27	12.78
	12H	10.24	10.60	11.36	11.71	13.23	9.82	10.18	10.95	11.30	12.81
8H	4H	9.72	10.11	10.82	11.22	12.72	9.36	9.76	10.46	10.86	12.37
	6H	10.33	10.66	11.46	11.81	13.31	9.97	10.30	11.10	11.45	12.95
	8H	10.55	10.83	11.68	11.96	13.48	10.18	10.47	11.31	11.59	13.12
	12H	10.67	10.92	11.80	12.04	13.60	10.29	10.54	11.42	11.66	13.22
12H	4H	9.70	10.05	10.82	11.17	12.68	9.35	9.71	10.47	10.82	12.33
	6H	10.36	10.65	11.49	11.77	13.30	10.01	10.30	11.14	11.43	12.95
	8H	10.59	10.84	11.73	11.96	13.52	10.24	10.49	11.37	11.61	13.17

END OF REPORT