

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918065

Luminaire Tested: DFN2DIP-TR3F0-050D060US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918065
REPORT IS A COMBINATION OF REPORTS P901837 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-050D060US930-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8878.6 lumens
Efficiency: N/A
Efficacy: 98.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 90.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918065

CATALOG NUMBER: DFN2DIP-TR3F0-050D060US930-FLLONL

Luminous Intensity Polar Plot

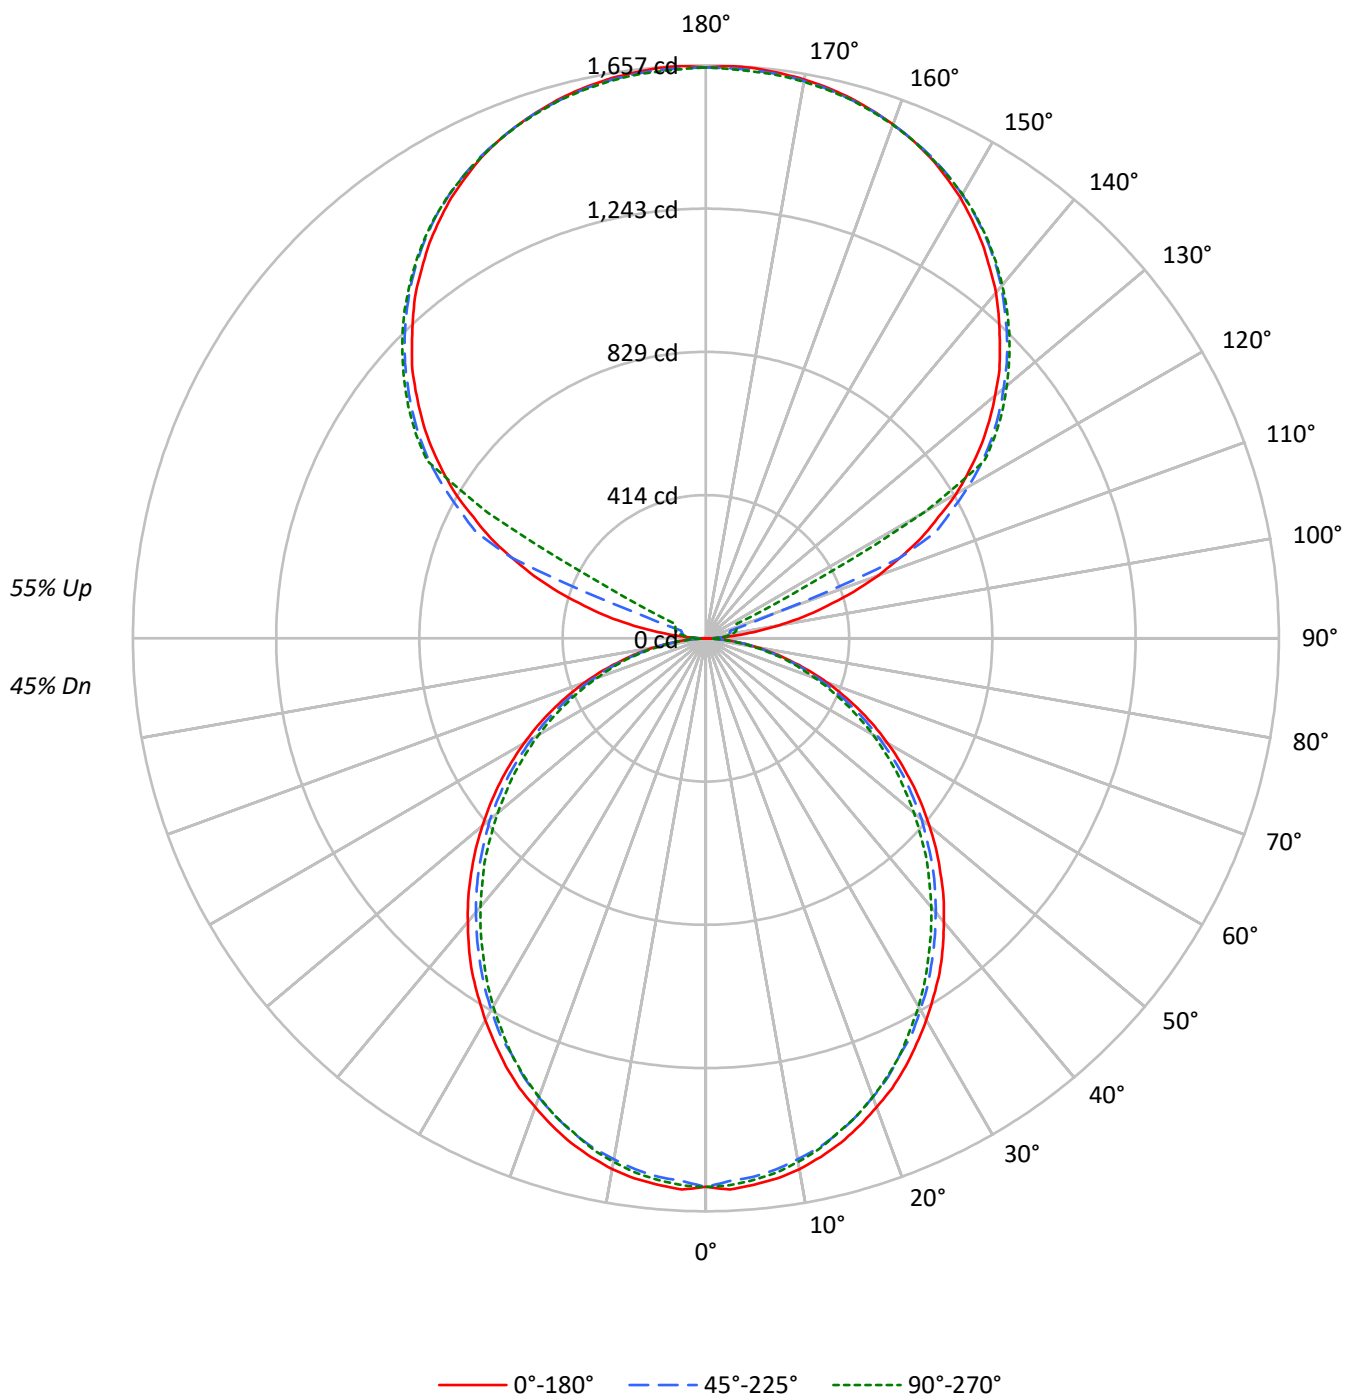

TEST NUMBER: P918065

CATALOG NUMBER: DFN2DIP-TR3F0-050D060US930-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52
1	97	92	89	85	89	85	82	79	71	68	66	58	56	55	46	45	44
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	40	39	37
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	33	31
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27
5	67	56	48	42	62	52	45	39	43	38	34	36	32	29	29	26	24
6	62	50	42	36	57	46	39	34	39	34	30	32	28	25	26	23	21
7	57	45	37	32	53	42	35	30	35	30	26	30	25	22	24	21	18
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1977	1977	1977
5°	1979	1947	1961
10°	1962	1919	1933
15°	1931	1886	1890
20°	1891	1841	1847
25°	1852	1786	1796
30°	1802	1736	1732
35°	1755	1677	1665
40°	1697	1617	1601
45°	1639	1556	1535
50°	1576	1493	1459
55°	1509	1420	1389
60°	1434	1333	1309
65°	1352	1243	1213
70°	1248	1133	1111
75°	1103	1002	1015
80°	928	833	834
85°	656	548	538

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1639 cd/sqm

TEST NUMBER: P918065

CATALOG NUMBER: DFN2DIP-TR3F0-050D060US930-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	149.3	1.7
10°-20°	420.0	4.7
20°-30°	617.3	7.0
30°-40°	717.0	8.1
40°-50°	716.1	8.1
50°-60°	624.4	7.0
60°-70°	461.6	5.2
70°-80°	261.1	2.9
80°-90°	71.8	0.8
90°-100°	54.4	0.6
100°-110°	202.9	2.3
110°-120°	538.2	6.1
120°-130°	892.7	10.1
130°-140°	948.2	10.7
140°-150°	881.3	9.9
150°-160°	708.5	8.0
160°-170°	456.5	5.1
170°-180°	157.1	1.8
0°-30°	1186.6	13.4
0°-40°	1903.6	21.4
0°-60°	3244.1	36.5
0°-90°	4038.6	45.5
90°-120°	795.6	9.0
90°-150°	3517.8	39.6
90°-180°	4840.0	54.5
0°-180°	8878.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1586	1586	1586	1586	1586	
5°	1586	1580	1563	1576	1573	151
15°	1510	1501	1481	1487	1480	425
25°	1367	1354	1328	1332	1328	629
35°	1179	1164	1139	1130	1123	736
45°	959	949	926	909	903	740
55°	726	717	698	680	673	649
65°	490	480	465	452	444	484
75°	256	253	246	236	240	273
85°	62	61	60	55	53	70
90°	1	14	24	30	32	8
95°	78	38	47	53	51	92
105°	363	399	73	86	91	388
115°	687	707	737	184	98	676
125°	971	987	1009	1018	1021	866
135°	1202	1221	1232	1244	1241	928
145°	1394	1393	1413	1422	1416	872
155°	1535	1524	1539	1546	1536	707
165°	1618	1610	1614	1622	1614	457
175°	1654	1646	1648	1657	1645	157
180°	1651	1651	1651	1651	1651	

TEST NUMBER: P918065

CATALOG NUMBER: DFN2DIP-TR3F0-050D060US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1586.2	1586.2	1586.2	1586.2	1586.2
2.5°	1595.4	1587.8	1571.0	1586.2	1583.3
5°	1586.2	1580.2	1563.3	1575.5	1572.6
7.5°	1575.5	1566.4	1549.6	1561.9	1558.9
10°	1558.9	1548.2	1529.9	1542.0	1537.5
12.5°	1535.9	1526.8	1508.5	1516.1	1513.0
15°	1509.9	1500.9	1481.0	1487.2	1479.5
17.5°	1477.9	1468.8	1448.9	1456.5	1448.9
20°	1442.8	1433.8	1412.4	1416.9	1411.0
22.5°	1407.9	1394.1	1374.2	1374.2	1371.1
25°	1366.6	1354.5	1328.5	1331.5	1328.5
27.5°	1320.8	1310.1	1290.4	1285.8	1278.2
30°	1275.1	1262.9	1240.1	1235.5	1229.4
32.5°	1226.3	1217.2	1192.8	1183.6	1177.5
35°	1179.0	1163.8	1139.4	1130.2	1122.6
37.5°	1125.6	1111.9	1087.4	1076.8	1069.2
40°	1070.8	1058.5	1034.0	1020.4	1014.3
42.5°	1017.4	1005.1	980.8	965.4	956.3
45°	959.4	948.8	925.8	909.1	902.9
47.5°	902.9	892.3	867.9	851.0	842.0
50°	843.4	835.8	814.5	793.1	785.5
52.5°	785.5	774.8	755.0	738.3	727.6
55°	726.1	716.9	698.5	680.3	672.7
57.5°	666.5	658.9	639.0	620.8	614.6
60°	607.0	601.0	579.7	562.8	558.3
62.5°	549.1	538.4	523.2	507.9	501.8
65°	489.7	480.5	465.2	451.5	443.8
67.5°	428.7	420.9	407.3	396.6	390.4
70°	372.2	366.1	352.3	341.6	335.7
72.5°	314.3	308.1	300.5	289.8	285.3
75°	256.2	253.2	245.5	236.4	239.5
77.5°	204.4	198.2	195.2	190.6	186.1
80°	152.6	151.0	147.9	143.4	140.3
82.5°	103.7	103.7	102.2	96.1	96.1
85°	62.5	61.0	59.5	54.9	53.4
87.5°	27.5	24.5	21.4	16.8	15.2
90°	1.1	14.3	23.8	29.9	32.2
92.5°	29.9	25.1	28.6	31.1	32.2
95°	77.6	38.2	46.6	52.7	51.4
97.5°	139.7	41.8	60.8	64.6	65.7
100°	211.5	47.8	68.1	77.6	80.0
102.5°	290.2	288.0	70.5	83.6	87.2
105°	363.1	399.0	72.9	85.9	90.8
107.5°	448.0	477.8	75.3	88.4	93.2
110°	529.3	554.2	209.1	89.7	94.3

TEST NUMBER: P918065

CATALOG NUMBER: DFN2DIP-TR3F0-050D060US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	605.7	627.1	606.8	91.9	95.6
115°	686.9	707.2	737.1	184.0	98.0
117.5°	757.3	781.2	801.6	630.7	317.7
120°	836.3	854.1	875.7	890.0	728.7
122.5°	903.0	922.2	946.2	953.2	954.6
125°	971.2	986.8	1009.4	1017.8	1021.3
127.5°	1033.3	1050.0	1068.0	1079.9	1081.1
130°	1091.8	1111.0	1124.1	1137.3	1136.1
132.5°	1151.6	1167.2	1180.2	1191.0	1189.8
135°	1201.8	1221.0	1231.6	1243.7	1241.2
137.5°	1254.3	1268.6	1280.7	1292.6	1289.1
140°	1305.6	1315.3	1328.4	1339.1	1333.2
142.5°	1348.7	1357.1	1372.6	1382.1	1376.1
145°	1394.2	1392.9	1413.2	1421.6	1415.6
147.5°	1433.5	1429.9	1450.2	1456.1	1451.5
150°	1471.8	1463.4	1482.5	1489.6	1483.7
152.5°	1504.0	1494.4	1512.3	1519.6	1511.2
155°	1535.0	1524.4	1538.7	1545.8	1536.3
157.5°	1560.2	1550.6	1561.4	1569.8	1560.2
160°	1581.7	1574.4	1581.7	1588.8	1580.5
162.5°	1600.7	1593.6	1599.5	1607.9	1597.2
165°	1617.5	1610.4	1613.9	1622.3	1613.9
167.5°	1630.6	1623.4	1627.1	1635.5	1624.6
170°	1641.4	1634.2	1636.6	1644.9	1634.2
172.5°	1648.5	1641.4	1643.8	1652.2	1641.4
175°	1654.5	1646.1	1648.5	1656.8	1644.9
177.5°	1656.8	1648.5	1649.8	1658.2	1647.4
180°	1650.9	1650.9	1650.9	1650.9	1650.9

TEST NUMBER: P918065

CATALOG NUMBER: DFN2DIP-TR3F0-050D060US930-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.15	9.98	10.15	10.98	12.32	8.73	9.55	9.72	10.56	11.89
	3H	10.80	11.54	11.81	12.56	13.91	10.34	11.07	11.34	12.09	13.44
	4H	11.38	12.08	12.40	13.10	14.46	10.92	11.61	11.93	12.63	13.99
	6H	11.77	12.42	12.80	13.44	14.81	11.30	11.95	12.33	12.97	14.35
	8H	11.87	12.49	12.91	13.53	14.90	11.41	12.02	12.44	13.06	14.43
	12H	11.92	12.50	12.96	13.53	14.93	11.44	12.03	12.48	13.06	14.45
4H	2H	9.61	10.31	10.63	11.32	12.69	9.27	9.96	10.29	10.98	12.35
	3H	11.46	12.04	12.49	13.09	14.47	11.07	11.65	12.10	12.70	14.08
	4H	12.17	12.70	13.21	13.74	15.14	11.76	12.30	12.80	13.34	14.74
	6H	12.67	13.13	13.72	14.19	15.58	12.27	12.72	13.32	13.79	15.18
	8H	12.81	13.24	13.86	14.30	15.71	12.41	12.84	13.46	13.89	15.30
	12H	12.88	13.27	13.95	14.34	15.75	12.47	12.85	13.53	13.92	15.34
8H	4H	12.36	12.78	13.41	13.84	15.25	12.00	12.43	13.05	13.48	14.89
	6H	12.97	13.33	14.05	14.42	15.83	12.62	12.97	13.69	14.07	15.47
	8H	13.19	13.50	14.27	14.58	16.01	12.82	13.14	13.91	14.22	15.64
	12H	13.31	13.59	14.40	14.66	16.13	12.93	13.21	14.02	14.28	15.75
12H	4H	12.34	12.73	13.41	13.79	15.21	11.99	12.38	13.06	13.45	14.86
	6H	13.00	13.31	14.08	14.39	15.82	12.65	12.97	13.74	14.05	15.47
	8H	13.23	13.51	14.32	14.58	16.05	12.88	13.16	13.97	14.23	15.70