

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918088

Luminaire Tested: DFN2DIP-TR3F0-060D050US930-RLFL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918088
REPORT IS A COMBINATION OF REPORTS P900306 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-060D050US930-RLLFLL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7765.7 lumens
Efficiency: N/A
Efficacy: 82.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 94.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918088

CATALOG NUMBER: DFN2DIP-TR3F0-060D050US930-RLLFLL

Luminous Intensity Polar Plot

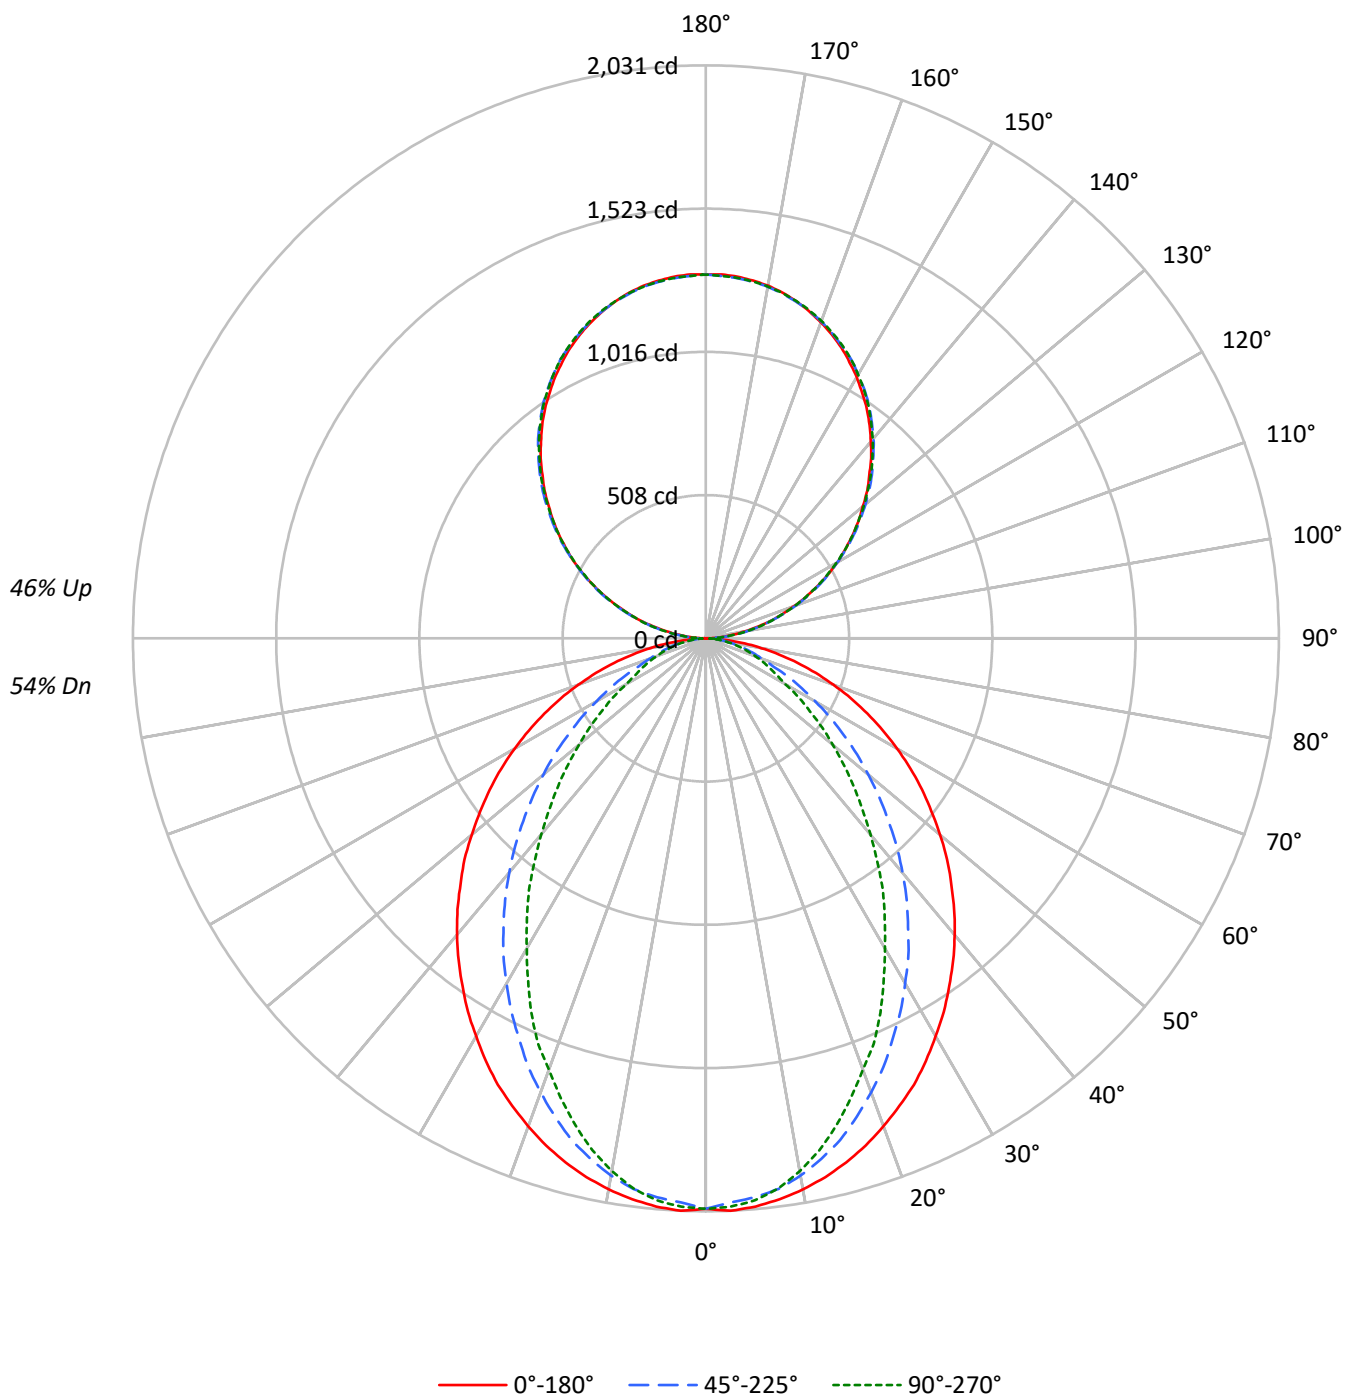

TEST NUMBER: P918088

CATALOG NUMBER: DFN2DIP-TR3F0-060D050US930-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	59	59	59
1	99	95	91	88	92	88	85	82	76	73	71	64	62	61	53	52	51
2	91	84	78	73	84	78	73	68	67	63	60	57	54	52	48	46	44
3	83	74	67	61	77	69	63	58	59	55	51	51	47	44	43	40	38
4	76	66	58	52	71	61	55	49	53	48	44	46	42	38	38	36	33
5	70	59	51	45	65	55	48	43	48	42	38	41	37	34	35	32	29
6	65	53	45	39	60	50	43	37	43	38	34	37	33	30	32	29	26
7	60	48	40	35	56	45	38	33	39	34	30	34	30	27	29	26	23
8	56	44	36	31	52	41	34	30	36	31	27	31	27	24	27	24	21
9	52	40	33	28	48	38	31	27	33	28	24	29	25	22	25	22	19
10	49	37	30	25	45	35	28	24	31	25	22	27	23	20	23	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2519	2519	2519
5°	2522	2477	2494
10°	2496	2427	2411
15°	2460	2344	2284
20°	2413	2232	2129
25°	2365	2106	1979
30°	2301	1977	1789
35°	2238	1839	1623
40°	2174	1696	1432
45°	2100	1538	1260
50°	2024	1379	1091
55°	1943	1209	929
60°	1850	1031	763
65°	1743	851	685
70°	1613	682	617
75°	1449	597	558
80°	1212	494	479
85°	825	320	350

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2100 cd/sqm

TEST NUMBER: P918088

CATALOG NUMBER: DFN2DIP-TR3F0-060D050US930-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.5	2.4
10°-20°	520.2	6.7
20°-30°	730.3	9.4
30°-40°	796.1	10.3
40°-50°	731.7	9.4
50°-60°	574.6	7.4
60°-70°	374.0	4.8
70°-80°	192.5	2.5
80°-90°	52.8	0.7
90°-100°	79.8	1.0
100°-110°	253.5	3.3
110°-120°	433.8	5.6
120°-130°	570.5	7.3
130°-140°	640.4	8.2
140°-150°	627.9	8.1
150°-160°	526.8	6.8
160°-170°	349.3	4.5
170°-180°	122.1	1.6
0°-30°	1439.9	18.5
0°-40°	2236.0	28.8
0°-60°	3542.3	45.6
0°-90°	4161.7	53.6
90°-120°	767.0	9.9
90°-150°	2605.8	33.6
90°-180°	3604.0	46.4
0°-180°	7765.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2022	2022	2022	2022	2022	
5°	2022	2013	1989	2005	2000	192
15°	1923	1903	1841	1806	1788	542
25°	1746	1687	1566	1491	1464	803
35°	1504	1411	1250	1134	1094	941
45°	1230	1107	915	785	741	950
55°	935	792	595	485	450	835
65°	631	483	318	256	251	626
75°	337	208	146	134	132	356
85°	79	40	35	35	35	90
90°	1	14	38	36	37	8
95°	57	68	70	70	68	63
105°	234	237	240	241	241	247
115°	435	442	440	438	435	431
125°	633	643	640	636	635	566
135°	819	831	833	832	829	633
145°	994	1002	1008	1009	1005	621
155°	1137	1140	1144	1149	1145	523
165°	1237	1236	1236	1243	1238	349
175°	1287	1284	1282	1289	1283	122
180°	1289	1289	1289	1289	1289	

TEST NUMBER: P918088

CATALOG NUMBER: DFN2DIP-TR3F0-060D050US930-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2021.8	2021.8	2021.8	2021.8	2021.8
2.5°	2030.9	2021.8	2001.6	2020.0	2016.3
5°	2021.8	2012.6	1988.8	2005.3	1999.8
7.5°	2005.3	1994.4	1968.8	1976.0	1966.8
10°	1983.3	1970.5	1934.1	1928.4	1917.5
12.5°	1956.0	1939.4	1889.9	1879.1	1858.9
15°	1923.0	1902.7	1840.6	1805.9	1787.6
17.5°	1884.6	1855.2	1778.3	1738.1	1708.9
20°	1840.6	1803.9	1712.5	1666.9	1626.5
22.5°	1793.1	1750.9	1644.8	1582.7	1555.3
25°	1745.6	1686.9	1566.2	1491.3	1463.7
27.5°	1688.9	1626.5	1493.0	1407.0	1364.9
30°	1628.5	1558.8	1412.4	1319.2	1269.7
32.5°	1569.9	1485.6	1335.8	1225.9	1180.1
35°	1504.1	1410.7	1249.8	1134.4	1094.0
37.5°	1440.0	1339.2	1169.2	1042.8	997.2
40°	1372.2	1262.6	1084.9	955.0	907.5
42.5°	1302.8	1185.7	1000.9	865.4	819.8
45°	1229.6	1106.8	914.9	784.8	740.9
47.5°	1160.1	1030.2	832.6	702.5	662.3
50°	1083.2	953.3	752.0	625.7	587.4
52.5°	1008.0	870.8	675.1	554.4	519.7
55°	934.9	792.2	594.6	484.9	450.1
57.5°	860.0	713.5	523.3	420.9	391.5
60°	783.1	636.7	448.3	355.1	325.7
62.5°	708.2	561.8	384.2	296.4	281.8
65°	631.3	483.0	318.4	256.2	250.6
67.5°	558.1	409.8	256.2	225.0	219.6
70°	481.2	338.5	212.1	194.0	186.5
72.5°	408.1	272.6	177.4	162.9	159.1
75°	336.6	208.5	146.3	133.5	131.8
77.5°	265.4	148.1	115.3	107.9	104.3
80°	199.3	106.2	87.7	80.6	80.6
82.5°	139.0	71.4	60.3	56.7	56.7
85°	78.6	40.2	34.7	34.7	34.7
87.5°	29.4	14.6	14.6	12.8	12.8
90°	1.1	14.0	38.1	35.8	36.9
92.5°	24.1	32.6	33.8	35.0	35.0
95°	56.7	67.7	69.5	69.5	67.7
97.5°	94.4	104.5	108.8	108.8	108.8
100°	137.9	146.9	150.0	150.0	148.9
102.5°	183.8	190.5	194.7	195.9	194.7
105°	234.0	237.1	239.5	241.3	241.3
107.5°	283.7	288.4	288.4	289.2	283.7
110°	331.9	338.2	338.2	338.2	335.0

TEST NUMBER: P918088

CATALOG NUMBER: DFN2DIP-TR3F0-060D050US930-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	384.0	390.6	389.5	386.4	384.0
115°	435.3	441.6	439.6	438.5	435.3
117.5°	486.2	494.8	489.3	486.2	483.1
120°	537.5	546.1	537.5	537.5	534.0
122.5°	584.2	595.1	589.6	586.5	584.2
125°	633.2	642.9	639.8	636.3	635.1
127.5°	680.9	693.0	688.8	684.0	680.9
130°	725.7	739.6	737.7	735.4	731.1
132.5°	775.8	786.7	787.5	782.0	778.9
135°	819.0	831.0	833.3	832.2	829.1
137.5°	867.2	876.9	878.8	878.0	873.3
140°	909.5	919.2	924.6	924.6	920.4
142.5°	953.0	962.8	965.9	967.0	962.8
145°	994.3	1002.0	1008.2	1009.4	1005.1
147.5°	1031.2	1040.9	1045.5	1047.5	1043.2
150°	1069.3	1075.9	1080.1	1083.6	1080.1
152.5°	1103.1	1109.7	1115.1	1119.4	1115.1
155°	1136.9	1140.0	1143.5	1148.9	1145.4
157.5°	1166.0	1168.3	1170.3	1178.1	1172.6
160°	1192.0	1194.4	1195.6	1202.2	1197.5
162.5°	1216.2	1216.2	1217.3	1224.7	1219.3
165°	1236.8	1235.6	1235.6	1243.4	1237.9
167.5°	1255.4	1251.9	1251.9	1259.7	1254.3
170°	1269.4	1266.3	1265.2	1272.9	1266.3
172.5°	1279.1	1276.0	1274.9	1282.6	1276.0
175°	1286.9	1283.8	1281.5	1289.2	1282.6
177.5°	1291.2	1288.1	1285.7	1292.3	1285.7
180°	1289.2	1289.2	1289.2	1289.2	1289.2



TEST NUMBER: P918088

CATALOG NUMBER: DFN2DIP-TR3F0-060D050US930-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.63	11.49	11.57	12.44	13.66	6.61	7.47	7.54	8.42	9.64
	3H	12.30	13.07	13.25	14.03	15.27	7.80	8.57	8.74	9.52	10.77
	4H	12.91	13.63	13.87	14.59	15.85	8.24	8.97	9.20	9.93	11.18
	6H	13.32	13.99	14.29	14.96	16.22	8.56	9.23	9.53	10.20	11.46
	8H	13.45	14.08	14.42	15.06	16.33	8.65	9.29	9.63	10.27	11.53
	12H	13.50	14.11	14.49	15.09	16.37	8.69	9.30	9.67	10.27	11.56
4H	2H	10.65	11.38	11.62	12.34	13.59	7.20	7.93	8.17	8.89	10.15
	3H	12.48	13.08	13.45	14.07	15.34	8.55	9.16	9.53	10.14	11.41
	4H	13.16	13.71	14.14	14.70	15.99	9.10	9.65	10.08	10.63	11.92
	6H	13.67	14.14	14.66	15.15	16.44	9.51	9.98	10.51	10.99	12.28
	8H	13.84	14.28	14.84	15.28	16.59	9.64	10.08	10.63	11.08	12.38
	12H	13.93	14.33	14.95	15.35	16.66	9.70	10.10	10.71	11.11	12.42
8H	4H	13.13	13.57	14.13	14.57	15.88	9.37	9.81	10.37	10.81	12.12
	6H	13.69	14.05	14.71	15.09	16.40	9.88	10.25	10.90	11.29	12.59
	8H	13.90	14.22	14.93	15.25	16.57	10.07	10.39	11.10	11.42	12.74
	12H	14.03	14.31	15.06	15.34	16.70	10.19	10.47	11.22	11.49	12.86
12H	4H	13.08	13.48	14.10	14.50	15.81	9.38	9.78	10.39	10.79	12.10
	6H	13.66	13.98	14.69	15.01	16.33	9.93	10.25	10.96	11.28	12.60
	8H	13.88	14.16	14.91	15.18	16.55	10.14	10.42	11.17	11.44	12.81

END OF REPORT