

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918094

Luminaire Tested: DFN2DIP-TR3F0-060D070US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918094
REPORT IS A COMBINATION OF REPORTS P900333 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-060D070US930-FLLFLL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9893.7 lumens
Efficiency: N/A
Efficacy: 89.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 110.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918094

CATALOG NUMBER: DFN2DIP-TR3F0-060D070US930-FLLFLL

Luminous Intensity Polar Plot

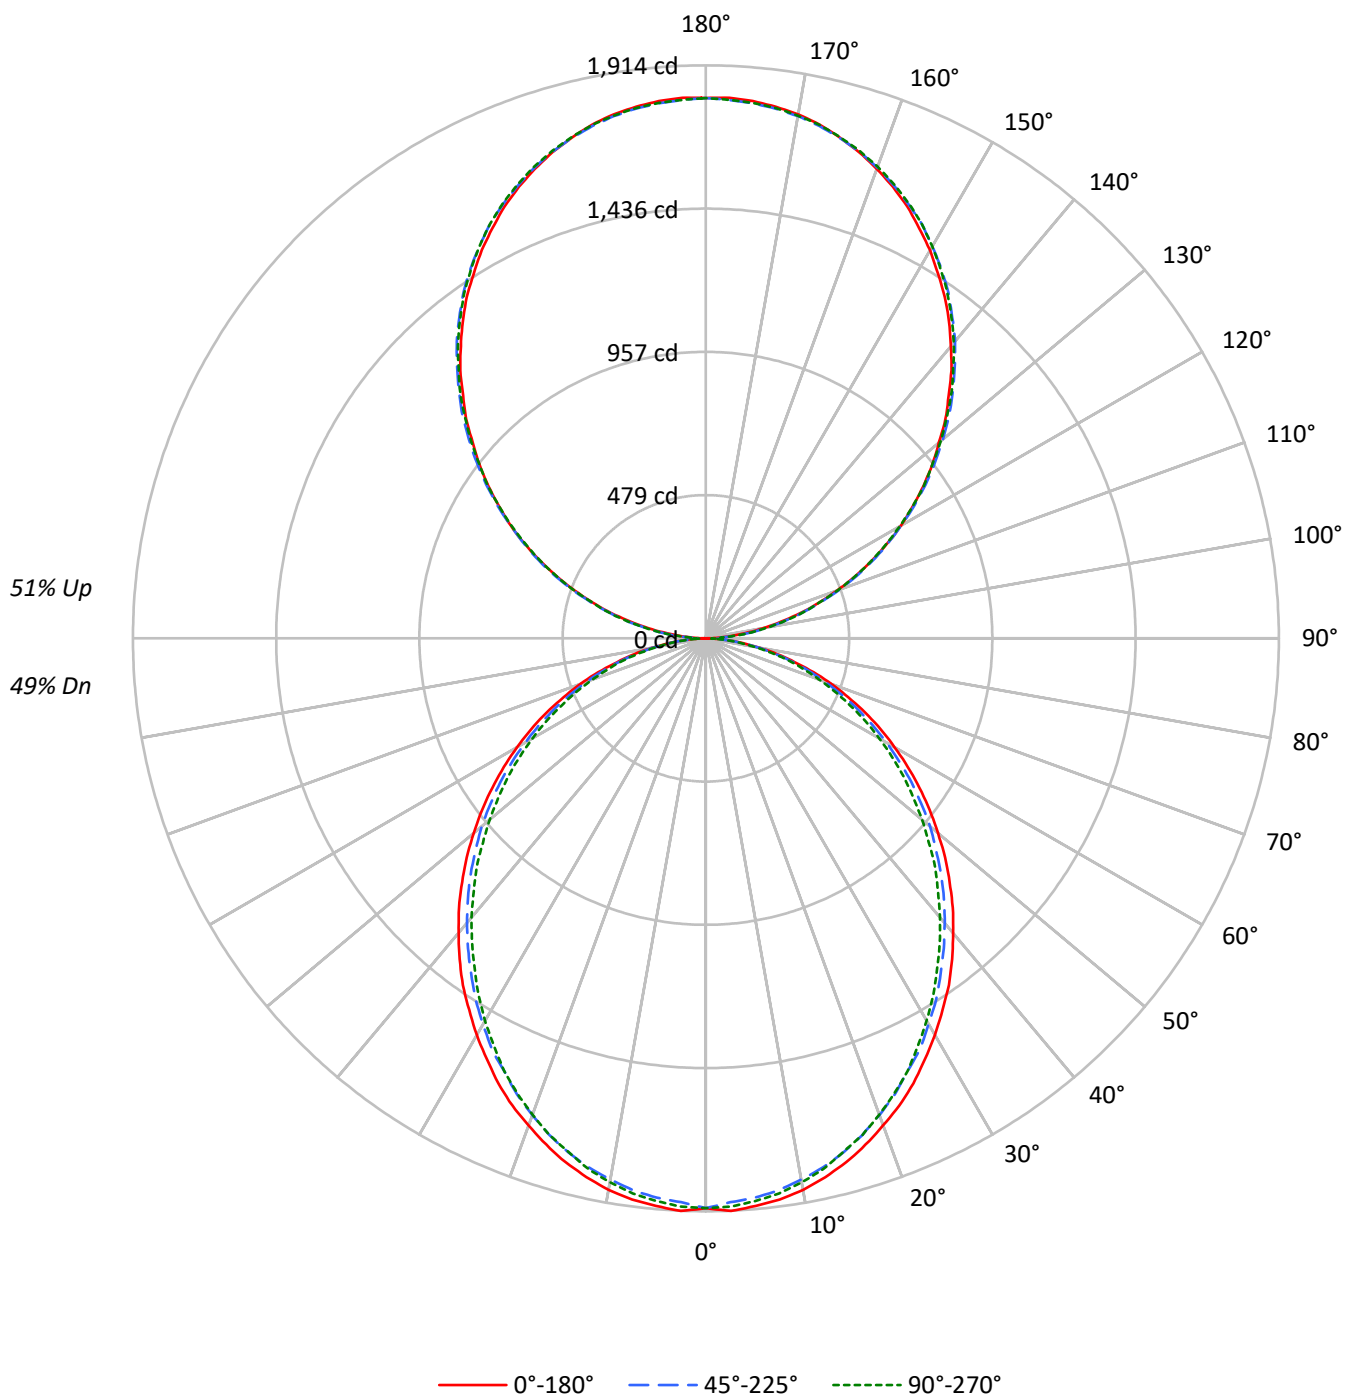

TEST NUMBER: P918094

CATALOG NUMBER: DFN2DIP-TR3F0-060D070US930-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	83	83	83	68	68	68	55	55	55
1	98	93	89	86	90	86	83	80	73	70	68	60	59	57	49	48	47
2	89	81	75	70	82	75	70	65	64	60	56	53	50	48	43	41	39
3	81	72	64	58	74	66	60	55	56	51	47	47	43	40	38	36	33
4	74	63	55	49	68	59	52	46	50	45	40	42	38	34	34	31	29
5	68	56	48	42	62	52	45	40	45	39	35	37	33	30	31	28	25
6	63	51	43	37	58	47	40	35	40	35	30	34	29	26	28	25	22
7	58	46	38	32	53	42	35	30	36	31	27	31	26	23	25	22	20
8	54	41	34	28	49	39	32	27	33	28	24	28	24	21	23	20	18
9	50	38	30	25	46	35	29	24	30	25	21	26	22	19	22	18	16
10	47	35	28	23	43	32	26	22	28	23	19	24	20	17	20	17	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2372	2372	2372
5°	2374	2337	2353
10°	2354	2303	2319
15°	2318	2263	2268
20°	2270	2209	2216
25°	2222	2144	2155
30°	2162	2083	2079
35°	2106	2012	1998
40°	2036	1940	1921
45°	1967	1868	1842
50°	1891	1792	1751
55°	1811	1704	1667
60°	1721	1600	1570
65°	1622	1492	1456
70°	1497	1360	1334
75°	1324	1202	1218
80°	1114	1000	1001
85°	786	658	646

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1967 cd/sqm

TEST NUMBER: P918094

CATALOG NUMBER: DFN2DIP-TR3F0-060D070US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	179.1	1.8
10°-20°	504.1	5.1
20°-30°	740.8	7.5
30°-40°	860.4	8.7
40°-50°	859.3	8.7
50°-60°	749.3	7.6
60°-70°	553.9	5.6
70°-80°	313.4	3.2
80°-90°	87.8	0.9
90°-100°	111.7	1.1
100°-110°	354.9	3.6
110°-120°	607.3	6.1
120°-130°	798.7	8.1
130°-140°	896.5	9.1
140°-150°	879.1	8.9
150°-160°	737.5	7.5
160°-170°	489.1	4.9
170°-180°	170.9	1.7
0°-30°	1424.0	14.4
0°-40°	2284.3	23.1
0°-60°	3892.9	39.3
0°-90°	4848.0	49.0
90°-120°	1073.9	10.9
90°-150°	3648.2	36.9
90°-180°	5046.0	51.0
0°-180°	9893.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1903	1903	1903	1903	1903	
5°	1903	1896	1876	1891	1887	181
15°	1812	1801	1777	1785	1776	510
25°	1640	1625	1594	1598	1594	755
35°	1415	1397	1367	1356	1347	884
45°	1151	1138	1111	1091	1084	889
55°	871	860	838	816	807	779
65°	588	577	558	542	533	581
75°	307	304	295	284	287	328
85°	75	73	71	66	64	84
90°	2	20	53	50	52	10
95°	79	95	97	97	95	88
105°	328	332	335	338	338	346
115°	609	618	616	614	609	603
125°	886	900	896	891	889	792
135°	1147	1163	1167	1165	1161	886
145°	1392	1403	1412	1413	1407	870
155°	1592	1596	1601	1608	1604	733
165°	1731	1730	1730	1741	1733	488
175°	1802	1797	1794	1805	1796	171
180°	1805	1805	1805	1805	1805	

TEST NUMBER: P918094

CATALOG NUMBER: DFN2DIP-TR3F0-060D070US930-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1903.4	1903.4	1903.4	1903.4	1903.4
2.5°	1914.5	1905.4	1885.1	1903.4	1899.9
5°	1903.4	1896.2	1876.0	1890.6	1887.1
7.5°	1890.6	1879.8	1859.5	1874.3	1870.6
10°	1870.6	1857.8	1835.8	1850.4	1844.9
12.5°	1843.1	1832.1	1810.2	1819.3	1815.7
15°	1811.9	1801.1	1777.2	1784.6	1775.5
17.5°	1773.5	1762.7	1738.8	1747.8	1738.8
20°	1731.4	1720.5	1694.8	1700.3	1693.1
22.5°	1689.5	1672.9	1649.0	1649.0	1645.4
25°	1639.9	1625.4	1594.2	1597.7	1594.2
27.5°	1584.9	1572.1	1548.4	1543.0	1533.9
30°	1530.2	1515.4	1488.1	1482.6	1475.2
32.5°	1471.5	1460.7	1431.3	1420.2	1412.9
35°	1414.9	1396.6	1367.3	1356.2	1347.0
37.5°	1350.8	1334.2	1305.0	1292.1	1283.0
40°	1284.9	1270.2	1240.9	1224.6	1217.2
42.5°	1220.8	1206.1	1177.0	1158.5	1147.6
45°	1151.4	1138.5	1110.9	1091.0	1083.5
47.5°	1083.5	1070.7	1041.5	1021.2	1010.3
50°	1012.1	1003.0	977.4	951.7	942.6
52.5°	942.6	929.8	906.0	885.9	873.1
55°	871.3	860.2	838.3	816.4	807.2
57.5°	799.9	790.8	766.9	744.9	737.5
60°	728.4	721.2	695.6	675.4	669.9
62.5°	658.8	646.0	627.8	609.5	602.2
65°	587.6	576.6	558.3	541.8	532.6
67.5°	514.4	505.1	488.8	476.0	468.6
70°	446.6	439.3	422.7	409.9	402.8
72.5°	377.1	369.7	360.6	347.8	342.3
75°	307.4	303.9	294.6	283.7	287.4
77.5°	245.2	237.9	234.2	228.8	223.3
80°	183.1	181.2	177.5	172.0	168.4
82.5°	124.5	124.5	122.7	115.4	115.4
85°	74.9	73.2	71.4	65.8	64.1
87.5°	33.0	29.4	25.6	20.2	18.3
90°	1.6	19.6	53.3	50.1	51.7
92.5°	33.8	45.7	47.4	49.0	49.0
95°	79.4	94.7	97.4	97.4	94.7
97.5°	132.2	146.3	152.4	152.4	152.4
100°	193.1	205.7	210.0	210.0	208.4
102.5°	257.4	266.6	272.6	274.3	272.6
105°	327.6	331.9	335.2	337.9	337.9
107.5°	397.2	403.7	403.7	404.9	397.2
110°	464.7	473.4	473.4	473.4	469.0



TEST NUMBER: P918094

CATALOG NUMBER: DFN2DIP-TR3F0-060D070US930-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	537.6	546.9	545.3	540.9	537.6
115°	609.4	618.2	615.5	613.8	609.4
117.5°	680.7	692.7	685.1	680.7	676.4
120°	752.5	764.5	752.5	752.5	747.6
122.5°	817.8	833.1	825.5	821.1	817.8
125°	886.4	900.0	895.7	890.8	889.2
127.5°	953.3	970.2	964.3	957.7	953.3
130°	1015.9	1035.5	1032.8	1029.6	1023.5
132.5°	1086.1	1101.4	1102.4	1094.9	1090.5
135°	1146.6	1163.3	1166.7	1165.0	1160.7
137.5°	1214.0	1227.6	1230.3	1229.2	1222.7
140°	1273.3	1286.9	1294.5	1294.5	1288.6
142.5°	1334.2	1347.9	1352.2	1353.8	1347.9
145°	1392.0	1402.8	1411.5	1413.2	1407.2
147.5°	1443.6	1457.3	1463.8	1466.5	1460.5
150°	1497.0	1506.2	1512.2	1517.1	1512.2
152.5°	1544.3	1553.6	1561.1	1567.2	1561.1
155°	1591.6	1595.9	1600.9	1608.5	1603.6
157.5°	1632.5	1635.7	1638.4	1649.3	1641.7
160°	1668.9	1672.2	1673.8	1683.0	1676.5
162.5°	1702.7	1702.7	1704.3	1714.6	1707.0
165°	1731.4	1729.8	1729.8	1740.7	1733.1
167.5°	1757.6	1752.7	1752.7	1763.6	1756.0
170°	1777.2	1772.9	1771.2	1782.1	1772.9
172.5°	1790.8	1786.4	1784.8	1795.7	1786.4
175°	1801.6	1797.3	1794.1	1804.9	1795.7
177.5°	1807.7	1803.3	1800.0	1809.3	1800.0
180°	1804.9	1804.9	1804.9	1804.9	1804.9

TEST NUMBER: P918094

CATALOG NUMBER: DFN2DIP-TR3F0-060D070US930-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.13	10.98	11.09	11.96	13.24	9.70	10.55	10.66	11.53	12.82
	3H	11.78	12.54	12.75	13.53	14.84	11.31	12.07	12.29	13.06	14.37
	4H	12.36	13.08	13.35	14.07	15.39	11.89	12.61	12.88	13.61	14.92
	6H	12.75	13.42	13.75	14.41	15.74	12.28	12.95	13.28	13.95	15.27
	8H	12.85	13.49	13.86	14.50	15.83	12.38	13.02	13.39	14.03	15.36
	12H	12.89	13.50	13.91	14.51	15.86	12.42	13.03	13.43	14.03	15.38
4H	2H	10.58	11.31	11.58	12.30	13.62	10.24	10.96	11.24	11.96	13.27
	3H	12.44	13.04	13.44	14.06	15.39	12.05	12.65	13.05	13.67	15.00
	4H	13.14	13.70	14.16	14.71	16.06	12.74	13.30	13.76	14.31	15.66
	6H	13.65	14.13	14.67	15.16	16.51	13.25	13.72	14.27	14.76	16.11
	8H	13.79	14.24	14.82	15.27	16.63	13.39	13.83	14.41	14.86	16.23
	12H	13.86	14.26	14.91	15.31	16.68	13.45	13.85	14.49	14.90	16.27
8H	4H	13.34	13.78	14.36	14.81	16.18	12.98	13.42	14.00	14.45	15.82
	6H	13.96	14.32	15.01	15.40	16.76	13.60	13.97	14.65	15.04	16.40
	8H	14.17	14.49	15.23	15.55	16.93	13.81	14.13	14.86	15.19	16.57
	12H	14.30	14.58	15.36	15.63	17.06	13.92	14.20	14.98	15.25	16.68
12H	4H	13.32	13.72	14.36	14.77	16.14	12.97	13.37	14.02	14.42	15.79
	6H	13.98	14.31	15.04	15.37	16.75	13.64	13.96	14.69	15.02	16.40
	8H	14.22	14.50	15.28	15.56	16.98	13.87	14.15	14.93	15.20	16.63

END OF REPORT